


NOTES

- 1. Symbols and identification per ANSI/ISA-5.1. Legend: DC-I-002.
- 2. All instruments are field mounted and wired to CP-1 (PLC). Dashed stub = electrical signal to the PLC; card, channel and terminal per data/io_list.xlsx.
- 3. FO / FC = fail open / fail closed on loss of signal or power.
- 4. Instrument details: data/instrument_index.xlsx. Control: docs/01-system-basis.md.
- 5. Condenser water side (cooling towers) not in scope.

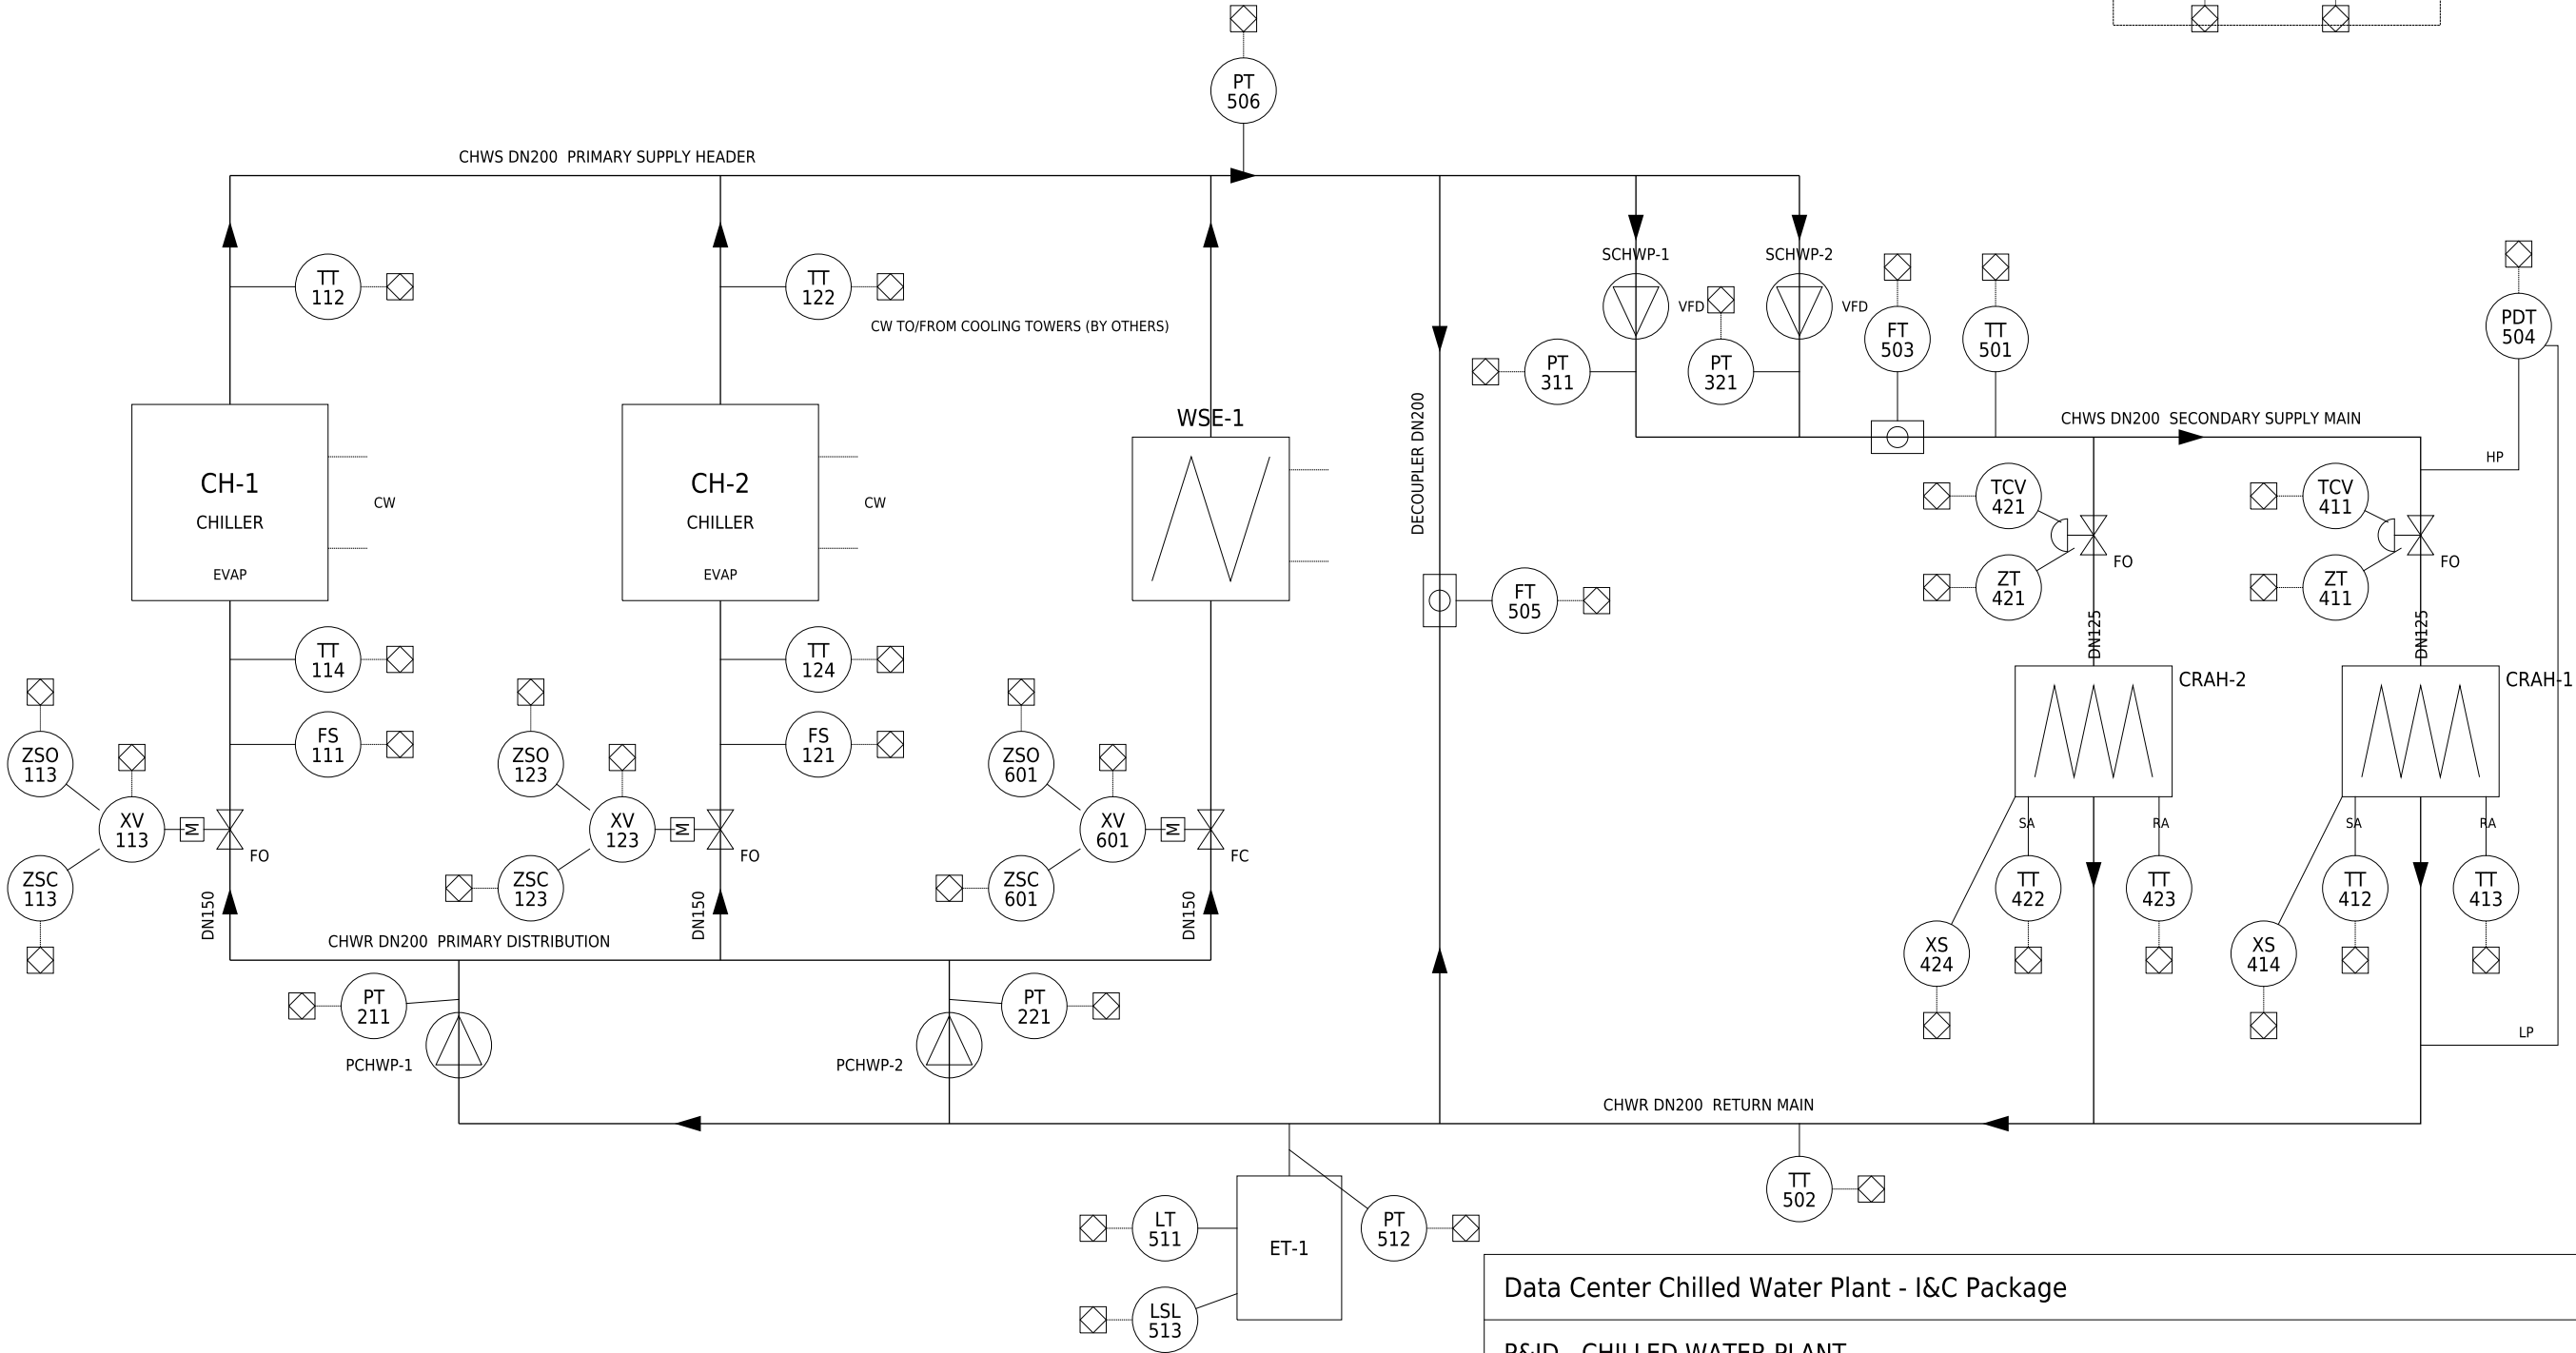

NOT FOR CONSTRUCTION - PORTFOLIO PROJECT

REV	DATE	DESCRIPTION
A	2026-10-08	ISSUED FOR REVIEW

Data Center Chilled Water Plant - I&C Package	
P&ID - CHILLED WATER PLANT	
DWG DC-I-001	REV A
DATE 2026-10-08 SCALE NTS DRAWN S. Anandkumar	SHEET ANSI B