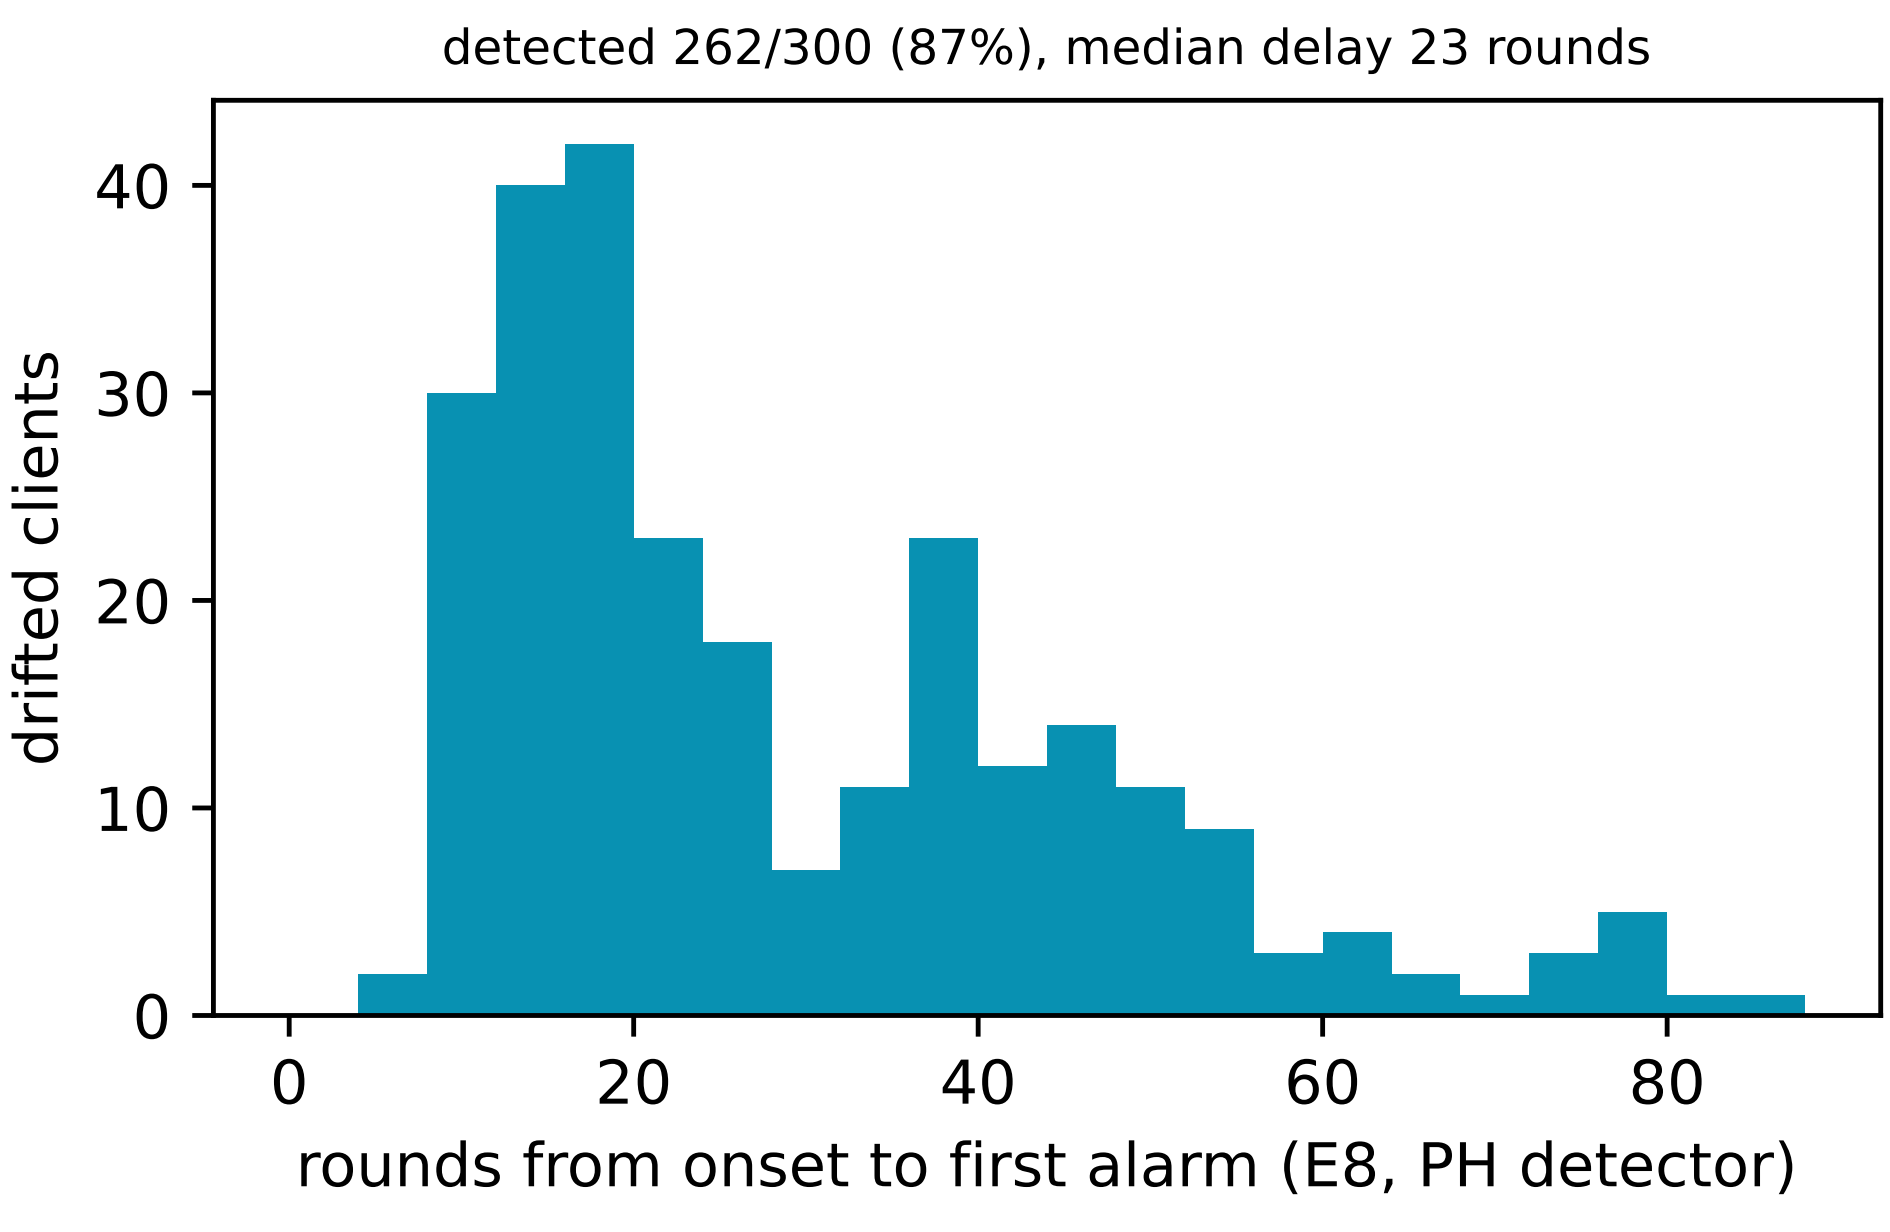
detected 262/300 (87%), median delay 23 rounds
drifted clients
0
10
20
30
40
0
20
40
60
80
rounds from onset to first alarm (E8, PH detector)