

Maintenance Summary 2025

Northfield assembly plant - Maintenance Department annual review

1. Scope

This summary records equipment downtime at Northfield for 2025, grouped by cause and quarter. It complements the Factory Operations Report 2025, which discusses the effect of downtime on production efficiency.

Downtime hours are counted across all three production lines. Planned maintenance is a fixed 40 hours per quarter and is included in the totals.

2. Downtime by Cause

Cause	Q1	Q2	Q3	Q4
Mechanical failure	42	28	55	71
Electrical fault	18	14	20	22
Material shortage	12	9	31	38
Changeover	30	28	31	33
Planned maintenance	40	40	40	40
Total	142	119	177	204

Table 2: Downtime hours by cause and quarter, 2025.

Total downtime was lowest in Q2 at 119 hours and highest in Q4 at 204 hours, an increase of 85 hours.

3. Findings

Mechanical failure is the largest single cause of unplanned downtime, increasing from 28 hours in Q2 to 71 hours in Q4. Root-cause analysis traced most events to worn spindle bearings on Line 3.

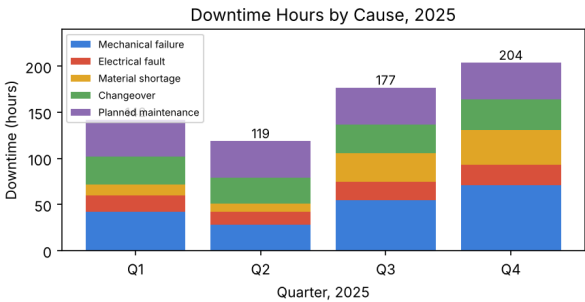


Figure 2: Downtime hours by cause per quarter, stacked bars.

4. Actions Taken

Bearing inspections were moved from quarterly to monthly in Q3. A spare spindle assembly was purchased in Q4 to shorten repair time. Electrical faults stayed roughly flat at 14 to 22 hours per quarter.

5. Recommendations

Replace all Line 3 spindle bearings during the planned Q1 2026 shutdown, hold a minimum safety stock of cast aluminium blanks, and review the planned maintenance allowance of 40 hours per quarter once bearing replacement is complete.