



KEY PLAN

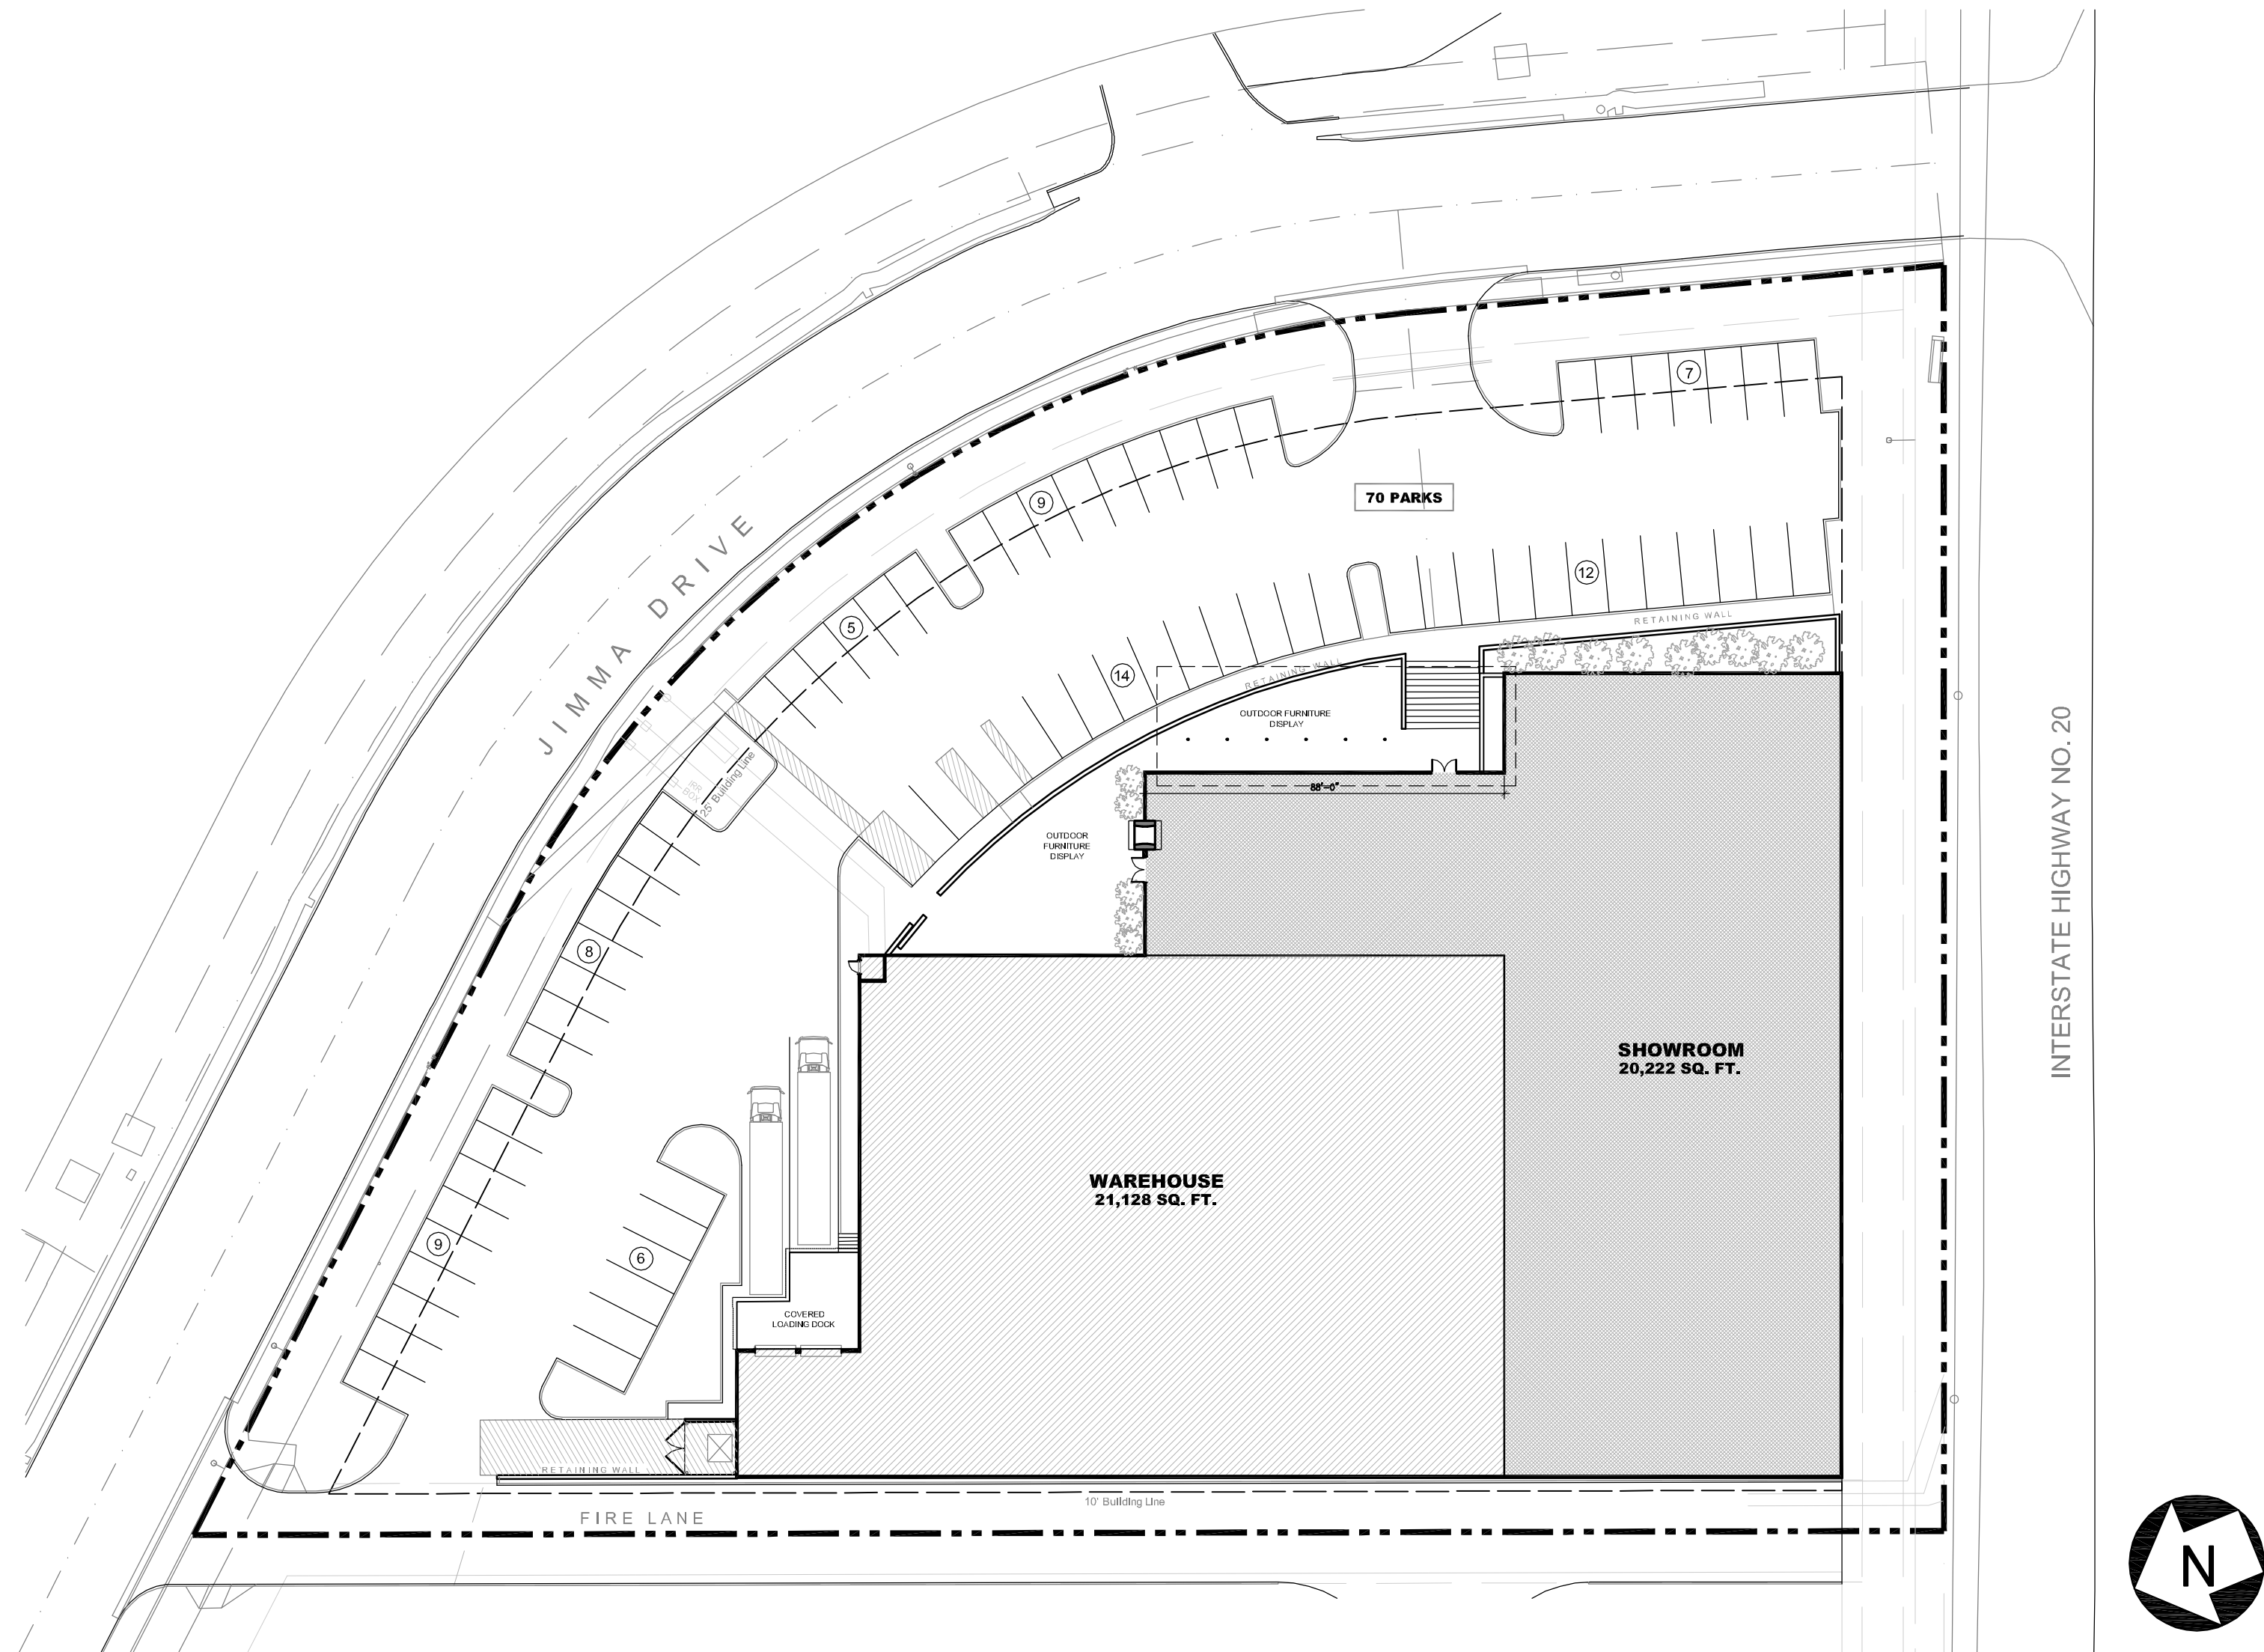

VICINITY MAP

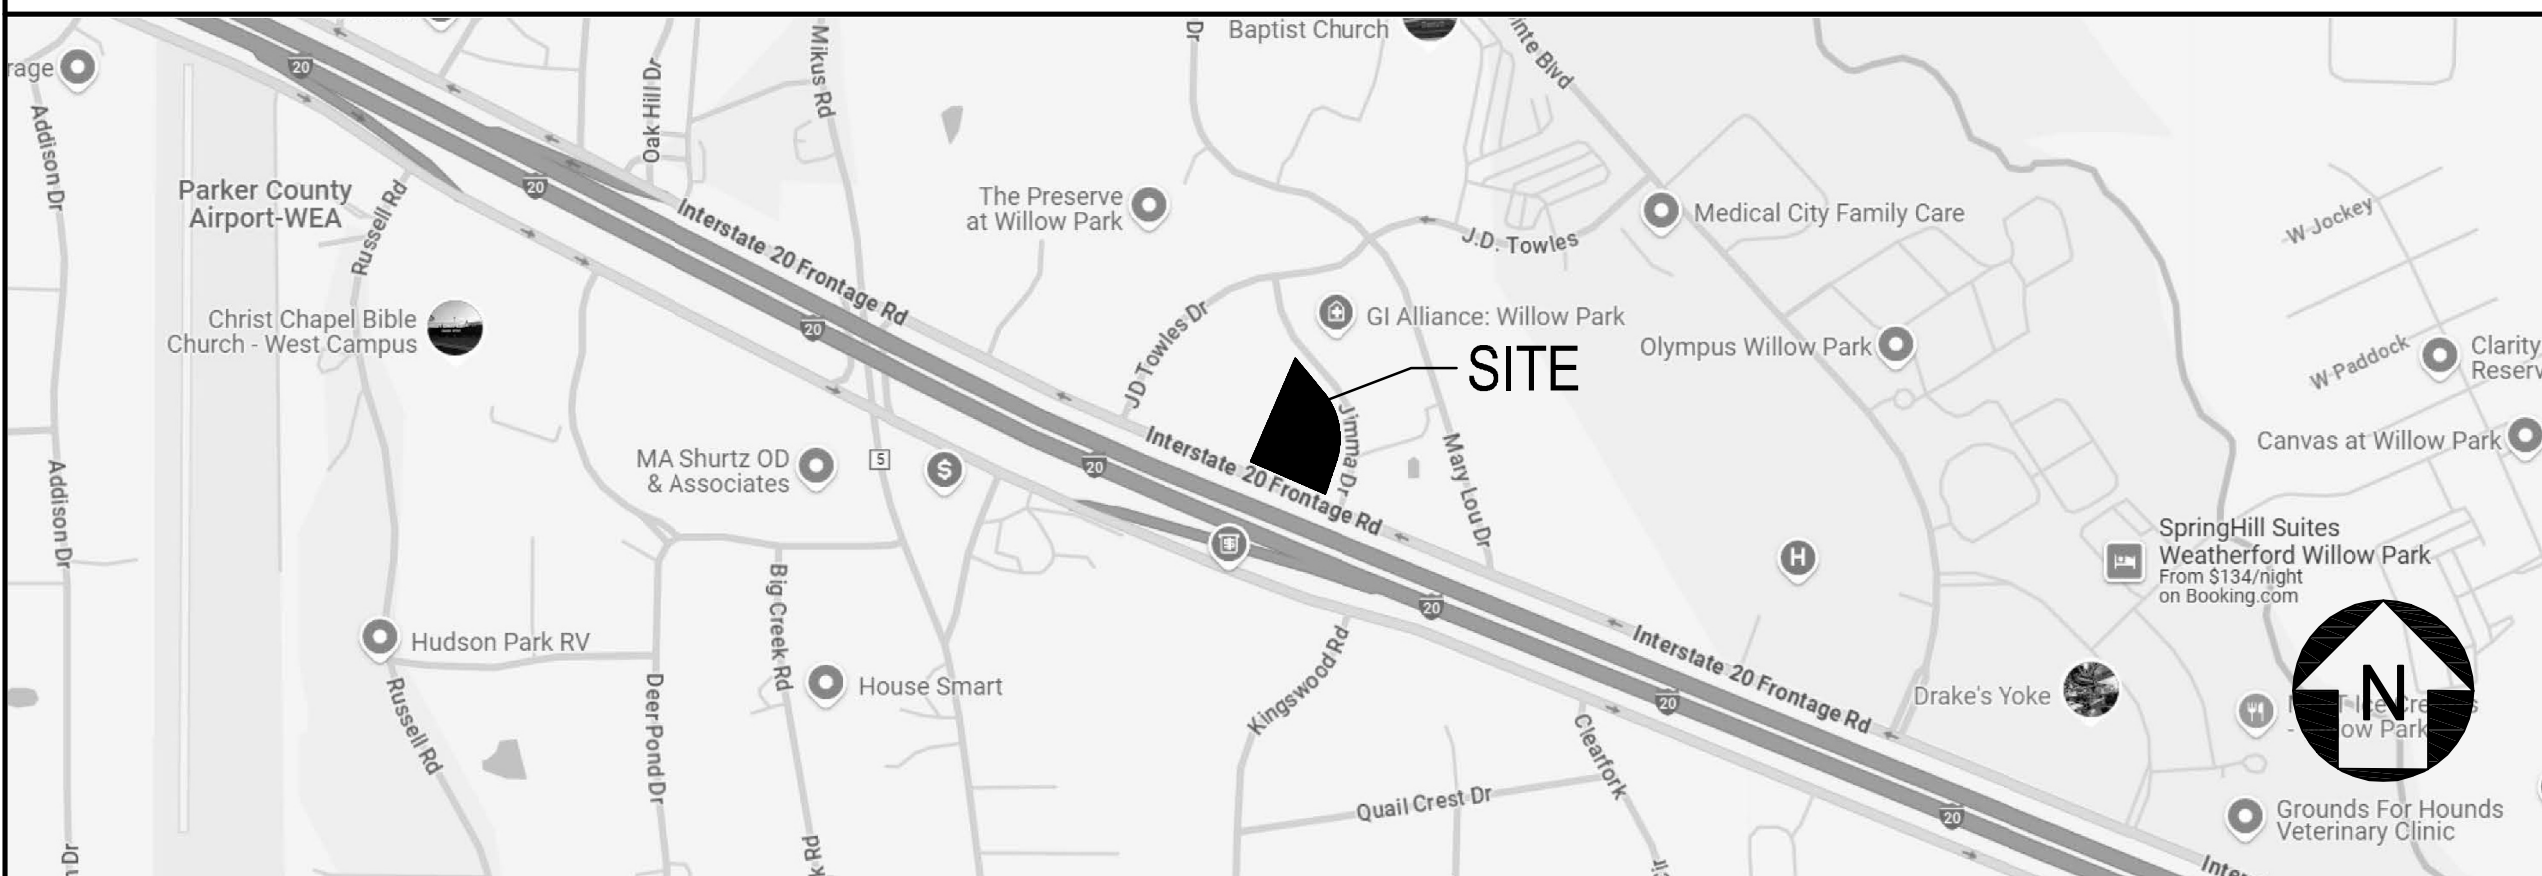

PROJECT DIRECTORY

TENANT:
ADOBE INTERIORS
4651 BRYANT IRVING ROAD
FORT WORTH, TX 76132
CONTACT: JERRY DIPPLE

GENERAL CONTRACTOR:
COOPER JENSEN CONTRACTORS
117 N. SYLVANIA AVE.
FORT WORTH, TX 76111
CONTACT: PETE JENSEN
817.715.7008

ARCHITECT OF RECORD:
MARK HOPPER A.I.A.
800 EXPOSITION AVENUE
DALLAS, TX 75226

STRUCTURAL ENGINEER:
H&H ENGINEERING, INC.
105 SPROLES DRIVE
FORT WORTH, TX 76126
817.713.4977
CONTACT: WILL HEBERT, P.E.

STRUCTURAL ENGINEER:
FALKOFSKE ENGINEERING, INC.
722 NORTH FIELDER ROAD
ARLINGTON, TX 76012
817.261.8300
CONTACT: JORGE JIMENEZ, P.E.

PROJECT COORDINATOR:
HUB CITY PRODUCTIONS
4100 COMMERCE STREET #14
DALLAS, TX 75226
214.821.8242
CONTACT: ROBERT ROMANO
hubcityr2002@gmail.com

METAL BUILDING FABRICATOR:
PRACTICE METALS
900 NORTH CRESSON HIGHWAY #136
CRESSON, TX 76035
CONTACT: CHANCE ROBERTS
682.404.1010

MEP ENGINEER:
ALEXANDER SOLORZANO, P.E.
926 PRIMROSE DR.
SANGER, TX 76266
817.707.5546
CONTACT: ALEXANDER SOLORZANO, P.E.

RESPONSIBILITY SCHEDULE

	EXISTING	OWNER	GENERAL CONTRACTOR	MECHANICAL CONTRACTOR	ELECTRICAL CONTRACTOR	PLUMBING CONTRACTOR	FURNISH BY	INSTALL BY	REMARKS
SHELL									PRE-ENGINEERED METAL BUILDING
									STANDING SEAM METAL ROOF
									ROOF ACCESS HATCH
									UTILITY SERVICES TO BLDG.
									FIRE PROOFING
									INSULATION
									METAL & WOOD FRAMING/DECKING
									STOREFRONT SIGNAGE
GENERAL									REAR EXIT DOOR
									EXTERIOR PERGOLA ON METAL FRAME
									STOREFRONT DOORS, GLASS & FRAMING
									INTERIOR METAL/WOOD DOORS AND FRAMES
									ALL HARDWARE
									INTERIOR PARTITIONS & CEILING TAPE/BED
									INTERIOR GRAPHICS & SIGNAGE
									ELECTRIC SERVICE TO BUILDING
EQUIPMENT									ADDITIONAL GENERAL ELECTRICAL WIRING
									TELEPHONE & DATA CABLING
									TELEPHONE CONDUIT (PULL WIRE)
									LIGHT FIXTURES & LAMPS
									EMERGENCY LIGHTS & EXIT SIGNS
									MECHANICAL EQUIPMENT
									MECHANICAL AIR TO SPACE
									MECHANICAL SUPPLY & RETURN DUCTING
MISCELLANEOUS									MECHANICAL CONTROLS
									FIRE EXTINGUISHERS
									FIRE ALARM SYSTEM
									FIRE SPRINKLER SYSTEM
									PLUMBING (WASTE, VENT & WATER) TO BUILDING
									NEW PLUMBING PIPING
									NEW PLUMBING FIXTURES & ACCESSORIES
FINISHES									PAINT
									NEW LAY-IN CEILING ASSEMBLY @ BOH
									POLISHED CONCRETE FLOORS
									LUXURY VINYL TILE "WOOD PLANK" FLOORING @ OFFICES
									PORCELAIN TILE FLOORING @ TOILET ROOMS
									CERAMIC TILE @ TOILET ROOMS
									SOLID SURFACE COUNTER TOP @ EMPLOYEE LOUNGE
									BIRCH PLYWOOD CABINETS @ EMPLOYEE LOUNGE
EQUIPMENT									METAL DOORS & WINDOWS
									CULTURED STONE BUILDING FACADE
									CEDAR WOOD PLANK FINISH @ BLDG. FACADE SETBACK
									RECLAIMED WOOD PLANK FINISH @ SERVICE BAR CLG.
									SALES DISPLAY FIXTURES
									MOBILE DIVIDER WALL UNITS
									APPLIANCES @ EMPLOYEE LOUNGE
EQUIPMENT									BAR SERVICE EQUIPMENT
									INDUSTRIAL METAL RACKING ASSEMBLY
									TELEPHONE SYSTEM
									SECURITY ALARM SYSTEM
									COMPUTER SYSTEMS/DATA LINE
									SOUND SYSTEM
									CUSTOM MILLWORK @ SERVICE BAR
MISCELLANEOUS									DOUBLE-SIDED FIRE PLACE @ SERVICE BAR
									LOOSE FURNITURE/SEATING
									TOILET ROOM ACCESSORIES
									GREASE INTERCEPTOR
									PATIO DINING FURNITURE
									G.C. TO COORDINATE INSTALL.
									G.C. TO COORDINATE INSTALL.
EQUIPMENT									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
EQUIPMENT									BACKER + D-MARK
									PER OWNER SPECIFICATION
									GC (CAT 6 WIRE ONLY)
									PER OWNER A/V CONSULTANT
									G.C. TO COORDINATE INSTALL.
									G.C. TO COORDINATE INSTALL.
									PER OWNER SPECIFICATIONS
EQUIPMENT									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS
									PER OWNER SPECIFICATIONS

DRAWING INDEX

T000	PROJECT INFO & KEY PLAN	3, 4, 5, 6, 7, 8	MEP
CIVIL	COVER SHEET		MEP1.0 MEP SPECIFICATIONS
C1.0	FINAL PLAT		MEP2.0 MEP ROOF PLAN
C2.0	SITE PLAN		M1.0 MECHANICAL PLAN
C3.0	PAVING AND GRADING PLAN		M1.1 MEZZANINE MECHANICAL PLAN
C4.0	DRAINAGE MAP & COMPUTATIONS		M2.0 MECHANICAL LOADS & DETAILS
C5.0	DIMENSION CONTROL PLAN		E1.0 POWER PLAN
C6.0	STORM WATER POLLUTION PREVENT.		E1.1 MEZZANINE POWER PLAN
C7.0-C7.1	WATER AND SEWER PLAN		E2.0 LIGHTING PLAN
C8.0	SITE DETAILS		E2.1 MEZZANINE LIGHTING PLAN
C9.0	GENERAL NOTES		E2.2 SITE LIGHTING PLAN
C10.0-10.3	SANITARY SEWER PLAN AND PROFILE		E3.0 ELECTRICAL PANELS & RISERS
	EXISTING PLANS		P1.0 PLUMBING SUPPLY PLAN
			P1.1 MEZZANINE PLUMBING SUPPLY PLAN
			P2.0 PLUMBING WASTE PLAN
			P2.1 MEZZANINE PLUMBING WASTE PLAN
			P3.0 PLUMBING SUPPLY RISER
			P3.1 PLUMBING WASTE RISER
ARCH	ARCHITECTURAL SITE PLAN	1, 2, 8	STRUCT
A001	ACCESSIBILITY STANDARDS		S101 SPECIAL INSP. & GENERAL NOTES
A015	ACCESSIBILITY STANDARDS		S201 FOUNDATION PLAN
A016	PROJECT SPECIFICATIONS		S202 FOUNDATION DETAILS
A100	CONSTRUCTION PLAN	1, 3, 4, 7, 8	SP1 GENERAL NOTES
A101	SCHEDULES/MEZZANINE PLAN & RCP	4, 8	CRW1 CONCRETE RETAINING WALLS
A102	LIFE SAFETY PLAN	2, 3	CRW2 CONCRETE RETAINING WALLS
A200	REFLECTED CEILING PLAN	3, 7, 8	CRW3 CONCRETE RETAINING WALLS
A201	ROOF PLAN	7, 8	CRW4 CONCRETE RETAINING WALLS
A300	EXTERIOR ELEVATIONS	1, 3, 8	CRW5 CONCRETE RETAINING WALLS
A301	INTERIOR ELEVATIONS	1, 7	CRW6 CONCRETE RETAINING WALLS
A302	INTERIOR ELEVATIONS	1, 7	CRW7 CONCRETE RETAINING WALLS
A303	INTERIOR ELEVATIONS	1, 7, 8	RW1 GENERAL NOTES AND DETAILS
A304	INTERIOR ELEVATIONS	1, 7, 8	RW2 MASONRY STONE RETAINING WALLS
A305	TOILET ROOM PLAN DETAIL		S0 CANOPY - GENERAL NOTES
A400	BUILDING SECTIONS	1, 4	S1 CANOPY - RECTANGULAR
A401	WALL SECTION & DETAILS	8	S2 CANOPY - TRIANGULAR
A402	CONSTRUCTION DETAILS	2	S3 CANOPY STRUCTURE DETAILS
A500	METAL BUILDING DETAILS	8	
A501	METAL BUILDING DETAILS	8	RACKING SYSTEMS
A502	METAL CANOPY DETAILS	1	Z1 COVER SHEET
A503	METAL CANOPY DETAILS	1, 3, 5	L1 PROPOSED LAYOUT
A504	CONSTRUCTION DETAILS	5	E1 PROPOSED ELEVATIONS
A505	CONSTRUCTION DETAILS	5, 8	

GENERAL NOTES

- THE FOLLOWING NOTES SHALL APPLY TO, AND GOVERN, ALL DRAWINGS AND SPECIFICATIONS UNLESS OTHERWISE NOTED.
- THE WORK DELINEATED IN THESE DRAWINGS SHALL CONFORM TO ALL APPLICABLE FEDERAL, STATE AND LOCAL CODES, STANDARDS AND REGULATIONS.
- CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING EXISTING CONDITIONS AT THE JOB SITE PRIOR TO SUBMISSION OF BIDS. PRIOR TO CONSTRUCTION, CONTRACTOR TO VERIFY ALL DIMENSIONS WITHIN THIS DOCUMENT.
- DRAWINGS ARE NOT TO BE SCALED.
- DETAILS SHALL BE CONSIDERED TYPICAL AT SIMILAR CONDITIONS UNLESS OTHERWISE NOTED.
- SAFETY MEASURES: THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING MEANS, METHODS, SCHEDULING AND SAFETY OF THE CONSTRUCTION PROCESS. THIS SHALL INCLUDE ALL NECESSARY INDEPENDENT ENGINEERING REVIEW AND TESTING AS REQUIRED.
- CONTRACTOR SHALL BE RESPONSIBLE FOR THE CONTAINMENT OF ALL DUST AND CONSTRUCTION DEBRIS SO AS NOT TO INCONVENIENCE OTHER PROPERTIES.
- DIMENSIONS ARE TYPICALLY FROM FACE OF FINISH UNLESS OTHERWISE NOTED.
- BUILDING SHALL BE EVALUATED FOR EMERGENCY RESPONDER RADIO COVERAGE AT COMPLETION OR NEAR COMPLETION.
- MATERIALS WITH A FLAME SPREAD OF GREATER THAN 200 SHALL NOT BE USED.

CODE INFORMATION

TOTAL SQUARE FOOTAGE 41,350 S.F.
FULLY-SPRINKLERED

APPLICABLE CODES

BUILDING: 2021 INTERNATIONAL BUILDING CODE
MECHANICAL: 2021 INTERNATIONAL MECHANICAL CODE
PLUMBING: 2021 INTERNATIONAL PLUMBING CODE
ELECTRICAL: 2020 NATIONAL ELECTRIC CODE
FIRE: 2021 INTERNATIONAL FIRE CODE
FUEL & GAS: 2012 TAS
ACCESSIBILITY: 2021 INTERNATIONAL ENERGY CONSERVATION CODE
ENERGY: 2021 INTERNATIONAL ENERGY CONSERVATION CODE

CONSTRUCTION TYPE: III-B

OCCUPANCY: M

OCCUPANT LOAD:
SHOWROOM & SALES AREA: 20,128/60 = 337
STORAGE, STOCK & SHIPPING AREA: 21,128 = 70
TOTAL OCCUPANT LOAD: 407

EXIT REQUIREMENTS:
MINIMUM ACCESS DOORWAYS: 4
ACTUAL ACCESS DOORWAYS: 6

*PROJECT DESCRIPTION: GROUND-UP CONSTRUCTION OF SINGLE STORY FURNITURE SALES OFFICES, SHOWROOM & WAREHOUSE. NEW MECHANICAL, ELECTRICAL & PLUMBING EQUIPMENT.




4100 COMMERCE STREET
DALLAS TEXAS 75226
TEL: 214.821.8242

hubcityr2002@gmail.com

ADOBE INTERIORS
121 JIMMA DRIVE • WILLOW PARK, TEXAS 76087

PROJECT INFORMATION &
KEY PLAN

REV. NO.	DATE	DESCRIPTION
1	03.23.26	OWNER REVISION + NEW STRUCTURAL
2	04.26.26	OWNER REVISION + NEW STRUCTURAL
3	05.20.26	OWNER REVISION
4	06.31.26	OWNER REVISION

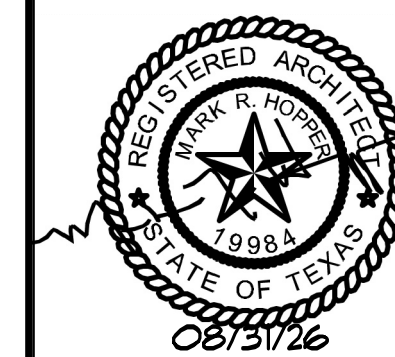


DATE ISSUED:
06-27-25

PROJECT NO.:
24834

DRAWING NO.:
T000

ADOBE INTERIORS SITE IMPROVEMENTS

LOT 1R-1 BLOCK F
CROWN POINTE ADDITION PHASE 4
CITY OF WILLOW PARK
PARKER COUNTY, TEXAS

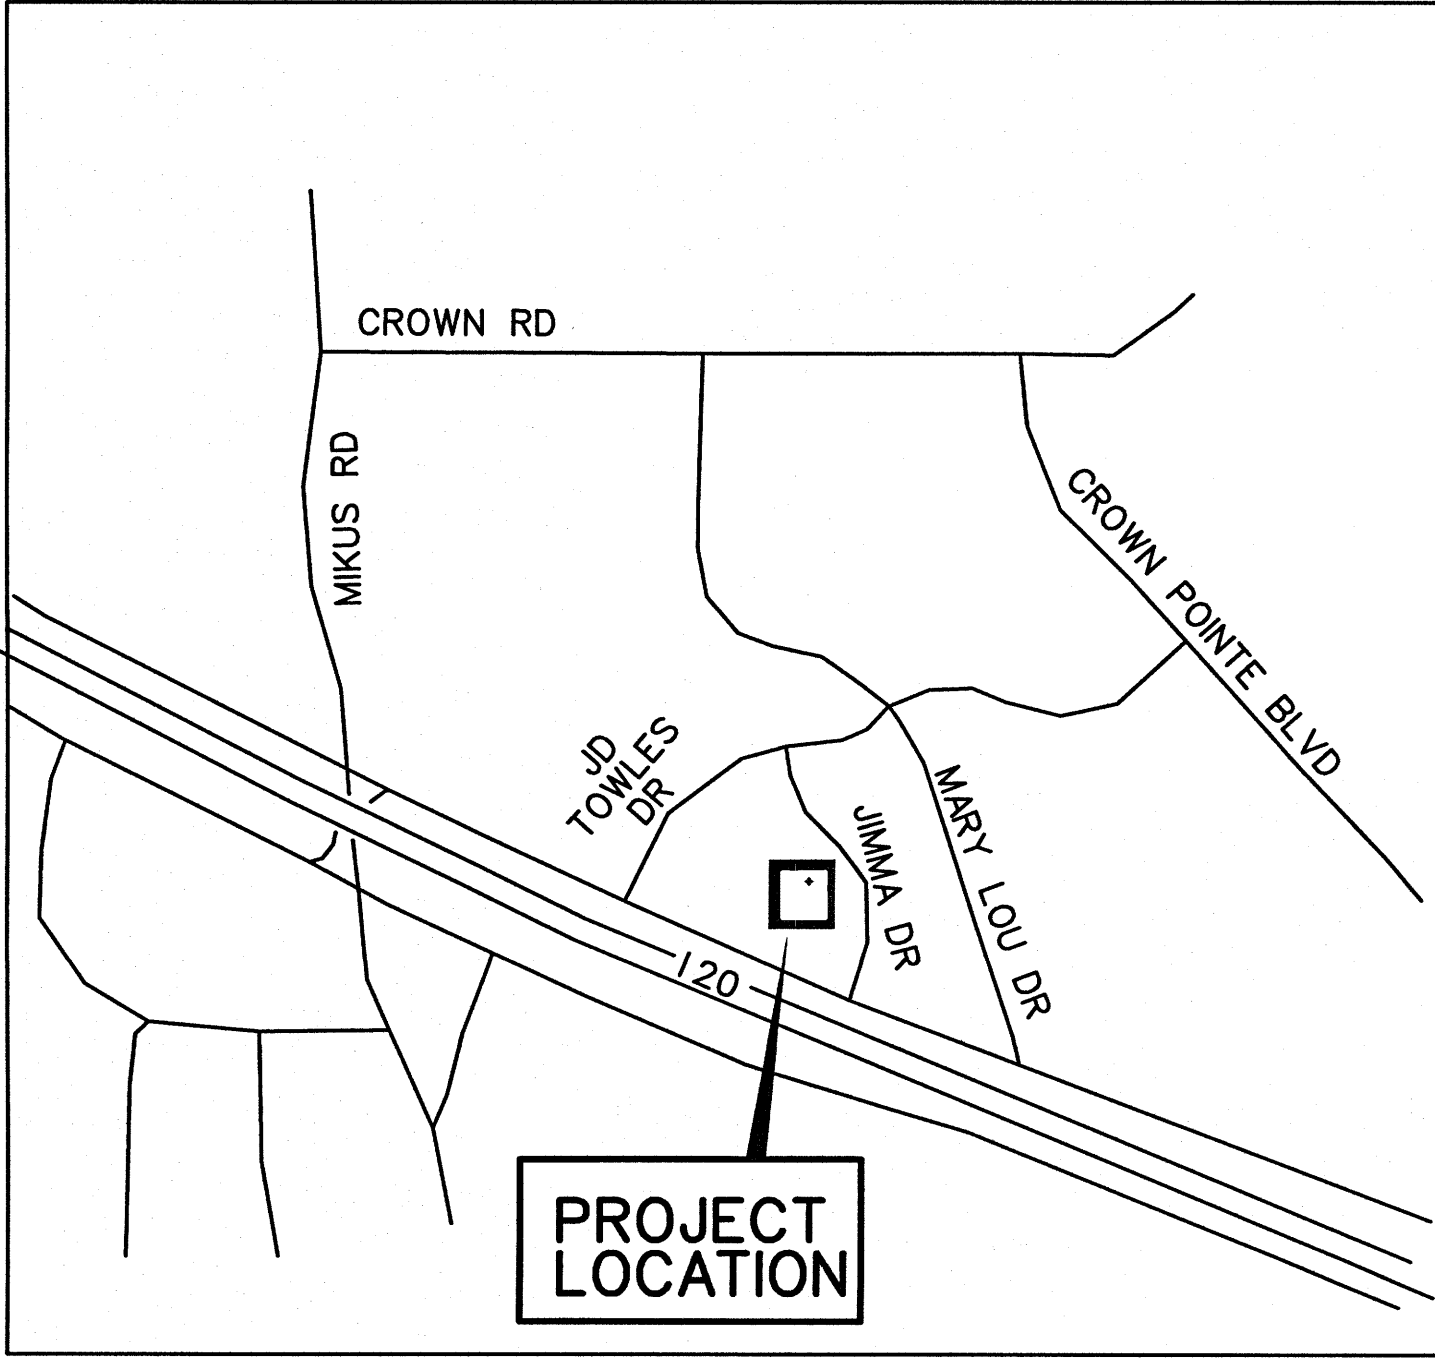

VICINITY MAP
N.T.S.

PROJECT LOCATION

121 JIMMA DRIVE
WILLOW PARK, TX 76087

SES PROJECT NO. 24144

NOTES AND SUBMITTALS PREPARED:
PRELIM PLANS 1-16-2025
PRELIM PLANS 3-13-2025
PRELIM PLANS 3-25-2025
PRELIM PLANS 4-2-25
PRELIM PLANS 5-9-25
PRELIM PLANS 7-9-25
FINAL PLANS 8-4-25



PREPARED BY

SWAIM

ENGINEERING & SURVEYING

Jason Swaim, PE, RPLS
506 N. MASON
Bowie, Texas 76230

Phone: (940) 872-5075
Cell: (940) 531-0047
Fax: (940) 872-4079
Email: jswaim@swaimengineering.com

PREPARED FOR

ADOBE INTERIORS

JERRY DIPPLE
4651 BRYANT IRVING RD.
FORT WORTH, TEXAS 76132

INDEX OF SHEETS

SHEET NO.	DESCRIPTION
	COVER SHEET
	FINAL PLAT
	SITE PLAN
C1.0	PAVING AND GRADING PLAN
C2.0	DIMENSION CONTROL PLAN
C3.0	DRAINAGE AREA MAP AND COMPUTATIONS
C4.0	STORM WATER POLLUTION PREVENTION PLAN(SWPPP)
C5.0	WATER AND SEWER PLAN
C6.0	SITE DETAILS
C7.0-C7.1	GENERAL NOTES
C8.0	SANITARY SEWER PLAN AND PROFILE
C9.0	EXISTING PLANS
C10.0-10.3	

APPROVED FOR CONSTRUCTION



CITY DEPARTMENT	DATE	SIGNATURE
PLANNING & ZONING		
CITY COUNCIL		
BUILDING INSPECTION		
FIRE DEPARTMENT		

RUNOFF COMPUTATIONS
 SES 24144 - ADOBE FURNITURE

AREA NO.	AREA (SF)	LENTH (L)	EX. V. (FPS)	PR. V. (FPS)	EX T. CALC (T C)	EX T. USED (T C)	PR. T. CALC (T C)	PR. T. USED (T C)	AREA (AC.) A	RO COEF. PREDEV.	RO COEF. PROP.	EX I 10 YR I (10)	EX I 100 YR I (100)	PR I 10 YR I (10)	PR I 100 YR I (100)	EX RO 10 YR Q (10)	EX RO 100 YR Q (100)	PR RO 10 YR Q (10)	PR RO 100 YR Q (100)	DESCRIPTION OF OUTFALL
A1	34892	488	1.00	1.10	8.13	10.00	7.39	10.00	0.80	0.80	0.63	6.44	9.22	6.44	9.22	4.13	5.91	3.24	4.63	TO TXDOT CULVERT
A2	31465	333	1.00	1.10	5.55	10.00	5.05	10.00	0.72	0.80	0.66	6.44	9.22	6.44	9.22	3.72	5.33	3.09	4.42	TO TXDOT CULVERT
B1	30394	228	1.00	1.10	3.80	10.00	3.45	10.00	0.70	0.80	0.76	6.44	9.22	6.44	9.22	3.59	5.15	3.40	4.87	TO JIMMA DR ROW INLET 5
B2	10305	240	1.00	1.10	4.00	10.00	3.64	10.00	0.24	0.80	0.67	6.44	9.22	6.44	9.22	1.22	1.74	1.02	1.46	TO JIMMA DR ROW INLET 5
C	88233	196	1.00	1.10	3.27	10.00	2.97	10.00	2.03	0.80	0.71	6.44	9.22	6.44	9.22	10.44	14.94	9.21	13.18	TO GRATE INLET 10 (SEE ORIG. PLAN Q100-11.21)
D	14610	382	1.00	1.10	5.03	10.00	4.58	10.00	0.34	0.80	0.73	6.44	9.22	6.44	9.22	1.73	2.47	1.58	2.26	TO CURB INLET 7 (SEE ORIG. PLAN Q100-2.8)
E	203898	523	1.00	1.10	8.72	10.00	7.92	10.00	4.68	0.50	0.00	6.44	9.22	6.44	9.22	15.07	21.58	0.00	0.00	TO WYE INLET 9 (SEE ORIG. PLAN DA 9)

COMPOSIT C COMPUTATION			COMPOSITE		
A1	0.3 SF	0.9 SF	17743.00	18406.00	0.63
A2			12373.00	19091.00	0.66
B1			7211.00	23183.00	0.76
B2			3901.00	6369.00	0.67
C			28529.00	59704.00	0.71
D			4102.00	10508.00	0.73

LEGEND

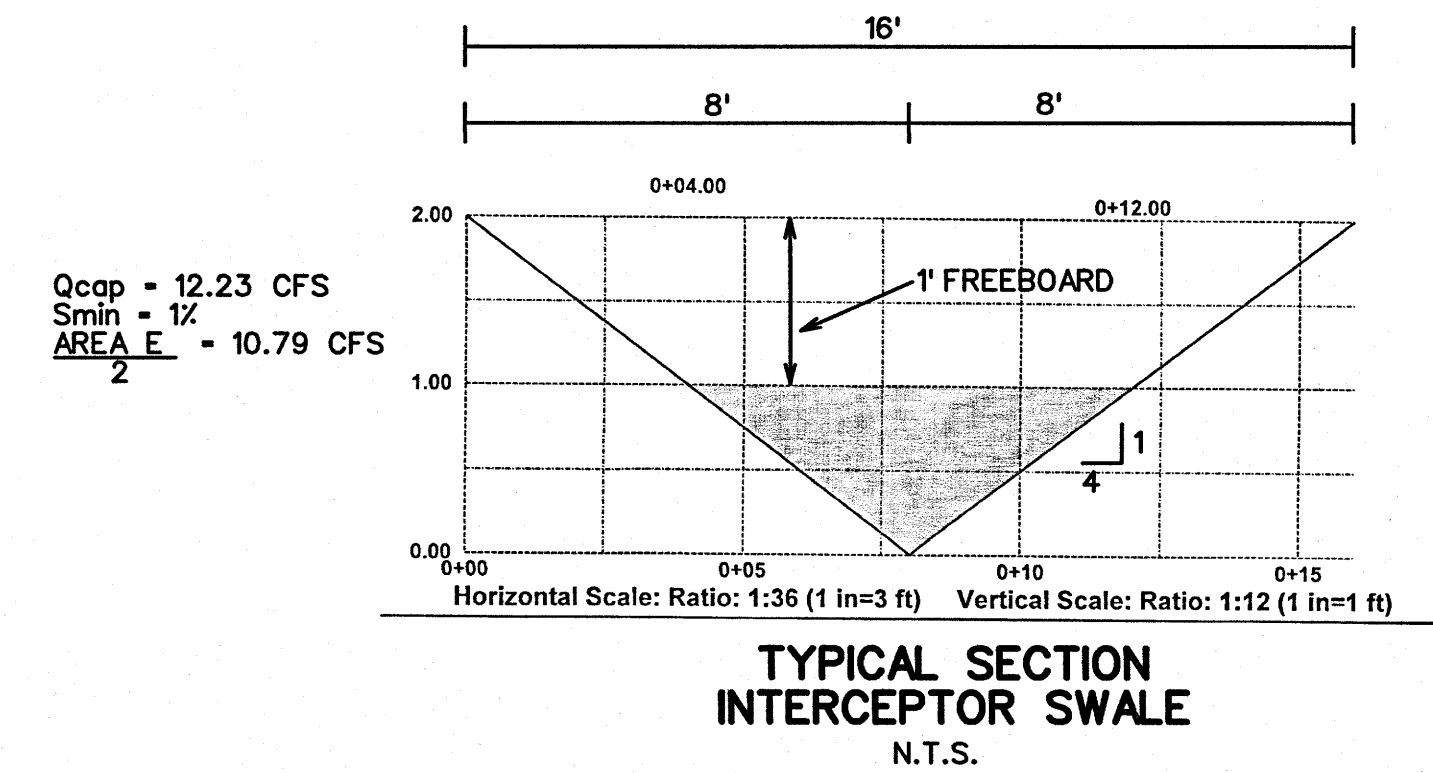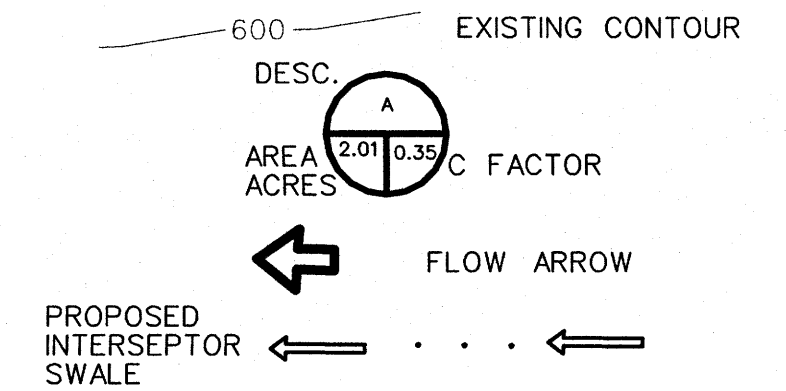

SINGLE GRATE = .072 SF
 PER GRATE DETAIL SD13

GRATE INLET COMPUTATIONS

$$Q = CA\sqrt{2GH}$$

$$A = 2.34 \approx \frac{2.34}{1.58 \text{ SF/GRATE}} = 1.48 \approx 2 \text{ GRATES NEEDED}$$

$$QCAP = .7(3.16) \sqrt{2G(1.1)} = 18.6 \text{ CFS}$$


INLET 5 10' CURB INLET

$$Q \text{ CAP} = CA\sqrt{2GH}$$


$$= .7(5) \sqrt{2G(1)}$$

$$= 28.08 \text{ CFS}$$

$$Q100 = DA5 + AREA B = 4.87 + 1.46 = 6.33$$

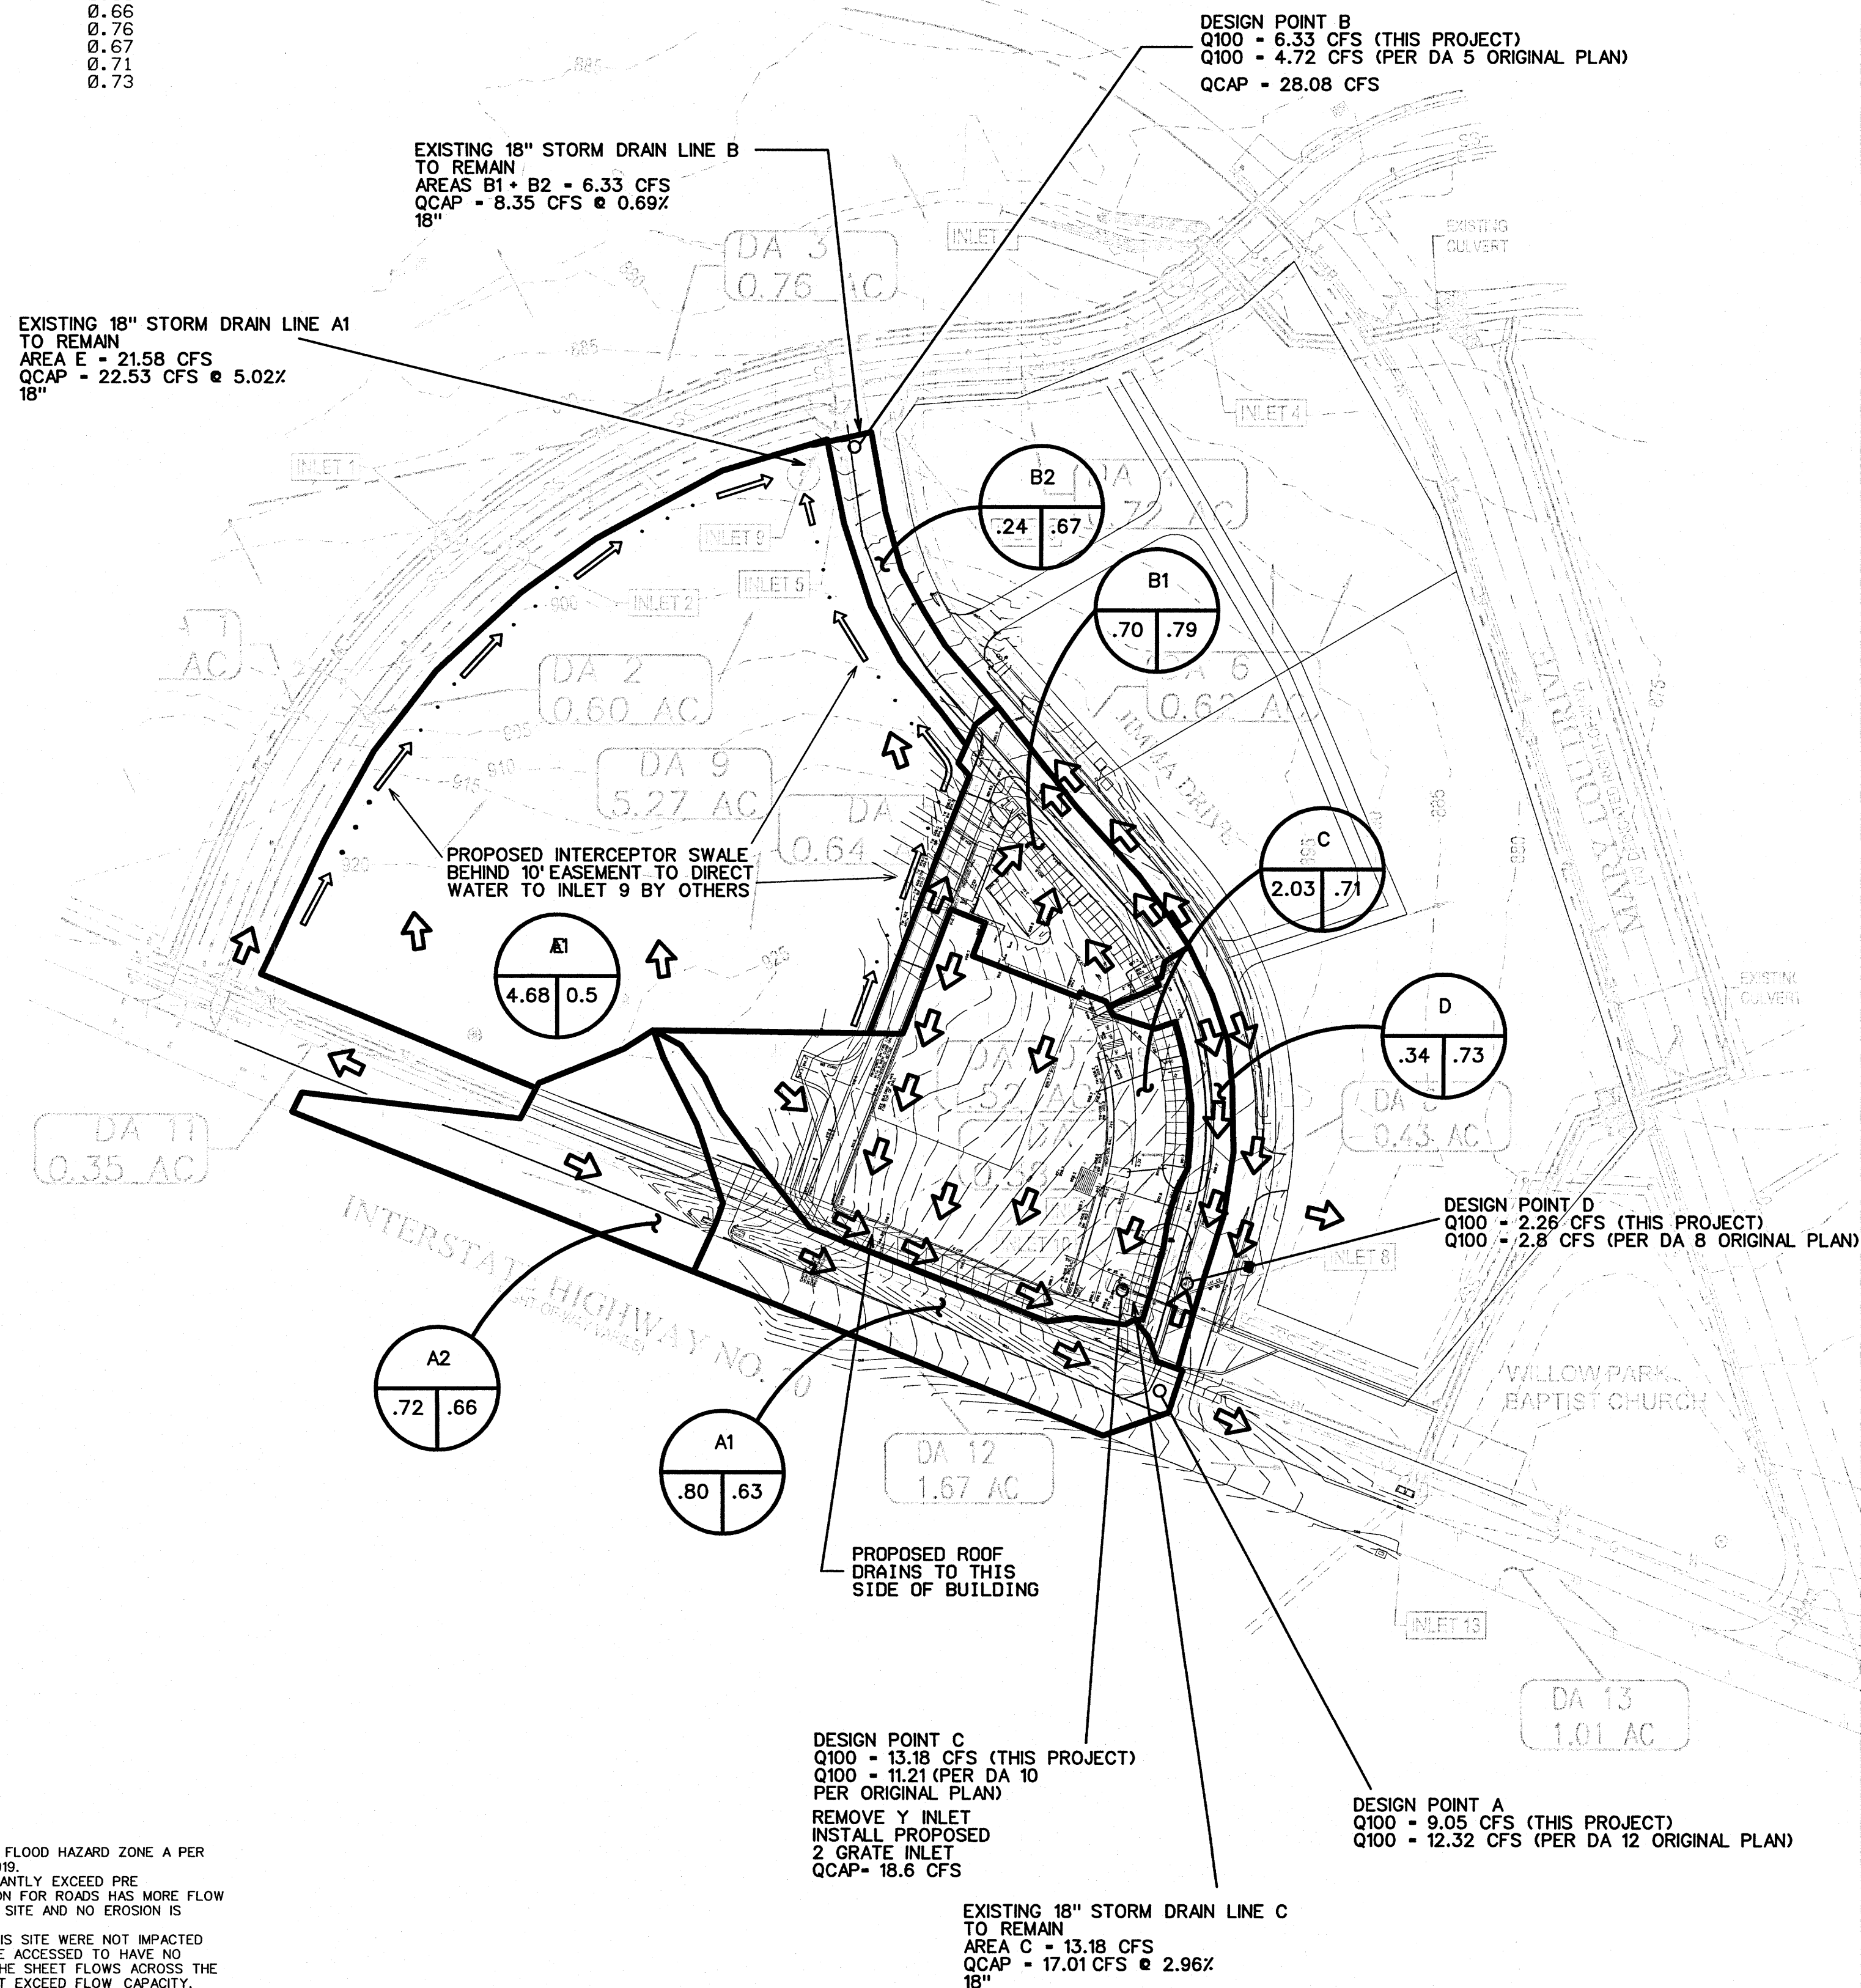

- NOTES:
1. NO PART OF THE SUBJECT PROPERTY IS WITHIN FLOOD HAZARD ZONE A PER FEMA FIRM PANEL 48367C0425F DATED APRIL 5, 2010.
 2. POST DEVELOPMENT RUNOFF DOES NOT SIGNIFICANTLY EXCEED PRE DEVELOPMENT RUNOFF AND THE STANDARD SECTION FOR ROADS HAS MORE FLOW CAPACITY IN THE DITCH THAN GENERATED BY THIS SITE AND NO EROSION IS ANTICIPATED.
 3. THE EFFECTS OF DRAINAGE DOWNSTREAM OF THIS SITE WERE NOT IMPACTED AND FLOW PATTERNS WERE NOT CHANGED AND ARE ANTICIPATED TO HAVE NO ADVERSE EFFECTS OR IMPACTS DOWNSTREAM AND THE SHEET FLOWS ACROSS THE PROPERTY LINES OR TO ROADSIDE DITCHES DO NOT EXCEED FLOW CAPACITY.
 4. SES PROJECT NO. 24144 - ADOBE INTERIOR SITE
 5. LOCATION AND WIDTH OF PROPOSED DRAINAGE EASEMENTS ARE SHOWN ON THE PLAT IF ANY.
 6. ASSUMED FULLY DEVELOPED ON ADJACENT LOT.

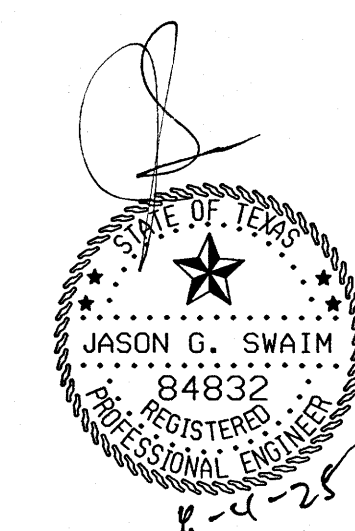

OWNER / DEVELOPER:

ADOBE INTERIORS

Adobe Interiors
 4651 Bryant Irving Rd.
 Fort Worth, Texas 76123
 Cell Phone: 254-485-9005

PREPARED BY:

SWAIM
 ENGINEERING & SURVEYING
 506 N MASON - BOWIE, TX 76230
 (940) 872 - 5075

PROPOSED DRAINAGE AREA MAP AND COMPUTATIONS

LOT 1R-1, BLOCK F
 CROWN POINTE ADDITION PHASE 4

CITY OF WILLOW PARK, TX

FILE: SHEETDAMAP

8-2-2025

C4.0

CHAPTER 5: GENERAL SITE AND BUILDING ELEMENTS (CONT.)

503.5 Vertical Clearance. Vehicle pull-up spaces, access aisles serving them, and a vehicular route from an entrance to the passenger loading zone, and from the passenger loading zone to a vehicular exit shall provide a vertical clearance of 114 inches (2895 mm) minimum.

504 Stairways

504.1 General. Stairs shall comply with 504.

504.2 Treads and Risers. All steps on a flight of stairs shall have uniform riser heights and uniform tread depths. Risers shall be 4 inches (100 mm) high minimum and 7 inches (180 mm) high maximum. Treads shall be 11 inches (280 mm) deep minimum.


504.3 Open Risers. Open risers are not permitted.

504.4 Tread Surface. Stair treads shall comply with 302.

Changes in level are not permitted.

EXCEPTION: Treads shall be permitted to have a slope not steeper than 1:48.

504.5 Nosings. The radius of curvature at the leading edge of the tread shall be 1/2 inch (13 mm) maximum. Nosings that project beyond risers shall have the underside of the leading edge curved or beveled. Risers shall be permitted to slope under the tread at an angle of 30 degrees maximum from vertical. The permitted projection of the nosing shall extend 1 1/2 inches (38 mm) maximum over the tread below.

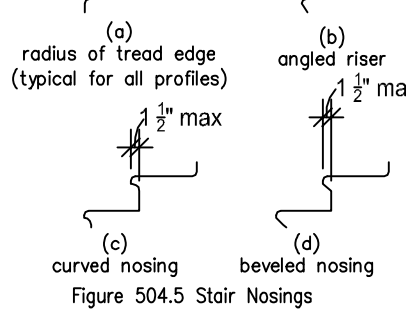

504.6 Handrails. Stairs shall have handrails complying with 505.

504.7 Wet Conditions. Stair treads and landings subject to wet conditions shall be designed to prevent the accumulation of water.

505 Handrails

505.1 General. Handrails provided along walking surfaces complying with 403, required for stairs complying with 405, and required at stairs complying with 504 shall comply with 505.


505.2 Where Required. Handrails shall be provided on both sides of stairs and ramps.

EXCEPTION: In assembly areas, handrails shall not be required on both sides of aisle ramps where a handrail is provided at either side of the aisle.


505.3 Continuity. Handrails shall be continuous within the full length of each stair flight or ramp run. Inside handrails on switchback or dogleg stairs and ramps shall be continuous between flights or runs.

EXCEPTION: In assembly areas, handrails on ramps shall not be required to be continuous in aisles serving seating.

505.4 Height. Top of gripping surfaces of handrails shall be 34 inches (865 mm) minimum and 38 inches (965 mm) maximum vertically above walking surfaces, stair nosings, and ramp surfaces. Handrails shall be at a consistent height above walking surfaces, stair nosings, and ramp surfaces.

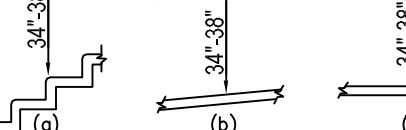

505.5 Clearance. Clearance between handrail gripping surfaces and adjacent surfaces shall be 1 1/2 inches (38 mm) minimum.




505.6 Gripping Surface. Handrail gripping surface shall be continuous along their length and shall not be obstructed along their tops or sides. The bottoms of handrail gripping surfaces shall not be obstructed for more than 20 percent of their length. Where provided, horizontal projections shall occur 1 1/2 inches (38 mm) minimum below the bottom of the handrail gripping surface.



EXCEPTIONS:


1. Where handrails are provided along walking surfaces with slopes not steeper than 1:20, the bottoms of handrail gripping surfaces shall be permitted to be obstructed along their entire length where they are integral to crash rolls or bumper guards.

2. The distance between horizontal projections and the bottom of the handrail gripping surface shall be permitted to be reduced by 1/8 inch (3.2 mm) for each 1/2 inch (13 mm) of additional horizontal perimeter dimension that exceeds 4 inches (100 mm).




505.7 Cross Section. Handrail gripping surfaces shall have a cross section complying with 505.7.1 or 505.7.2.

505.7.1 Circular Cross Section. Handrail gripping surfaces with a circular cross section shall have an outside diameter of 1 1/4 inches (32 mm) minimum and 2 inches (51 mm) maximum.

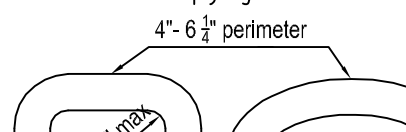

505.7.2 Non-Circular Cross Sections. Handrail gripping surfaces with a non-circular cross section shall have a perimeter dimension of 4 inches (100 mm) minimum and 6 1/4 inches (160 mm) maximum, and a cross-section dimension of 2 1/4 inches (57 mm) maximum.

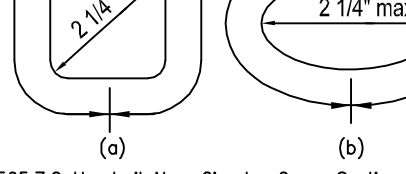

505.8 Surfaces. Handrail gripping surfaces and any surfaces adjacent to them shall be free of sharp or abrasive elements and shall have rounded edges.

505.9 Fittings. Handrails shall not rotate within their fittings.

505.10 Handrail Extensions. Handrail gripping surfaces shall extend beyond and in the same direction of stair flights and ramp runs in accordance with 505.10.

EXCEPTIONS:

1. Extensions shall not be required for continuous handrails at the inside turn of switchback or dogleg stairs and ramps.

2. In assembly areas, extensions shall be required for handrails in aisles serving seating where the handrails are discontinuous to provide access to seating and to permit crutches while seated.

3. In corridors, full extensions of handrails shall not be required where such extensions would be hazardous due to plan configuration.

505.10.1 Top and Bottom Extension at Ramps. Ramp handrails shall extend horizontally above the landing for 12 inches (305 mm) minimum beyond the top and bottom of ramp runs. Extensions shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an adjacent stair flight.



505.10.2 Top Extension at Stairs. At the top of a stair flight, handrails shall extend horizontally above the landing for 12 inches (305 mm) minimum beyond the top of the stair flight. Extensions shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an adjacent stair flight.



505.10.3 Bottom Extension at Stairs. At the bottom of a stair flight, handrails shall extend at the slope of the stair flight for a horizontal distance of at least equal to one tread depth beyond the last riser. Extensions shall return to a wall, guard, or the landing surface, or shall be continuous to the handrail of an adjacent stair flight.




Note: w = tread depth

505.10.4 Bottom Extension of Ramps



505.10.5 Bottom Extension of Stairs



CHAPTER 6: PLUMBING ELEMENTS & FACILITIES

601 General

601.1 Scope. The provisions of Chapter 6 shall apply where required by Chapter 2 or where referenced by a requirement in this document.

602 Drinking Fountains

602.1 General. Drinking fountains shall comply with 307 and 602.

602.2 Clear Floor Space. Units shall have a clear floor or ground space complying with 305 positioned for a forward approach and centered on the unit. Knee and toe clearance complying with 306 shall be provided.


EXCEPTION: A parallel approach complying with 305 shall be permitted at units for children's use where the spout is 30 inches (760 mm) maximum above the finish floor or ground and is 3 1/2 inches (80 mm) maximum from the front edge of the unit, including bumpers.

602.3 Operable Parts. Operable parts shall comply with 309.

602.4 Spout Height. Spout outlets shall be 36 inches (915 mm) maximum above the finish floor or ground.

602.5 Spout Location. The spout shall be located 15 inches (380 mm) minimum from the vertical support and 5 inches (125 mm) maximum from the front edge of the unit, including bumpers.

602.6 Water Flow. The spout shall provide a flow of water 4 inches (100 mm) high minimum and shall be located 5 inches (125 mm) maximum from the front of the unit. The angle of the water stream shall be measured horizontally relative to the front face of the unit. Where spouts are located less than 3 inches (75 mm) of the front of the unit, the angle of the water stream shall be 30 degrees maximum. Where spouts are located between 3 inches (75 mm) and 5 inches (125 mm) maximum from the front of the unit, the angle of the water stream shall be 15 degrees maximum.



602.7 Drinking Fountains for Standing Persons. Spout outlets of drinking fountains for standing persons shall be 38 inches (965 mm) minimum and 43 inches (1090 mm) maximum above the finish floor or ground.

603 Toilet and Bathing Rooms

603.1 General. Toilet and bathing rooms shall comply with 603.

603.2 Clearances. Clearances shall comply with 603.2.

603.2.1 Turning Space. Turning space complying with 304 shall be provided within the room.

CHAPTER 6: PLUMBING ELEMENTS & FACILITIES (CONT.)

603.2.2 Overlap. Required clear floor spaces, clearance at fixtures, and turning space shall be permitted to overlap.

603.2.3 Door Swing. Doors shall not swing into the clear floor space or clearance required for any fixture. Doors shall be permitted to swing into the required turning space.

EXCEPTIONS:

1. Doors to a toilet room or bathing room for a single occupant accessed only through a private office and not for common use or public use shall be permitted to swing into the clear floor space or clearance provided the swing of the door can be reversed to comply with 603.2.3.

2. Where the toilet room or bathing room is for individual use and a clear floor space complying with 305.3 is provided within the room beyond the arc of the door swing, doors shall be permitted to swing into the clear floor space or clearance required for any fixture.

603.3 Mirrors. Mirrors located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 40 inches (1015 mm) maximum above the finish floor or ground. Mirrors not located above lavatories or countertops shall be installed with the bottom edge of the reflecting surface 35 inches (890 mm) maximum above the finish floor or ground.


603.4 Coat Hooks and Shelves. Coat hooks shall be located within one of the reach ranges specified in 308. Shelves shall be located 40 inches (1015 mm) minimum and 48 inches (1220 mm) maximum above the finish floor.

604 Water Closets and Toilet Compartments

604.1 General. Water closets and toilet compartments shall comply with 604.2 through 604.8.


EXCEPTION: Water closets and toilet compartments for children's use shall be permitted to comply with 604.9.

604.2 Location. The water closet shall be positioned with a wall or partition to the rear and to one side. The centerline of the water closet shall be 15 inches (405 mm) minimum to 18 inches (455 mm) maximum from the side wall or partition, except that the water closet shall be 17 inches (430 mm) minimum and 19 inches (485 mm) maximum from the side wall or partition in the ambulatory accessible toilet compartment specified in 604.8.2. Water closets shall be arranged for a left-hand or right-hand approach.

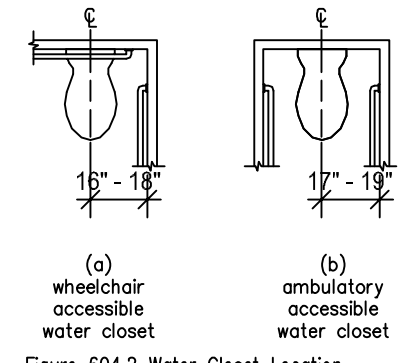

604.3 Clearance. Clearances around water closets and in toilet compartments shall comply with 604.3.

604.3.1 Size. Clearance around a water closet shall be 60 inches (1525 mm) minimum measured perpendicular from the side wall and 56 inches (1420 mm) minimum measured perpendicular from the rear wall.

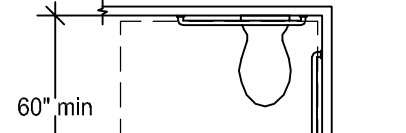


604.3.2 Overlap. The required clearance around the water closet shall be permitted to overlap the water closet, associated grab bars, dispensers, sanitary napkin disposal units, coat hooks, shelves, accessible routes, clear floor space and clearances required at other fixtures, and the turning space or other clearances or obstructions shall be located within the required water closet clearance.

604.4 Seats. The seat height of a water closet above the finish floor shall be 17 inches (430 mm) minimum and 19 inches (485 mm) maximum measured to the top of the seat. Seats shall not be sprung to return to a lifted position.

EXCEPTIONS:

1. A water closet in a toilet room for a single occupant accessed only through a private office and not for common use or public use shall not be required to comply with 604.4.


604.5 Grab Bars. Grab bars for water closets shall comply with 609. Grab bars shall be provided on the side wall closest to the water closet and on the rear wall.



1. Grab bars shall not be required to be installed in a toilet room for a single occupant accessed only through a private office and not for common use or public use provided that reinforcement has been installed in walls and located so as to permit the installation of grab bars complying with 604.5.

3. In detention or correction facilities, grab bars shall not be required to be installed in housing or holding cells that are specially designed without protrusions for purposes of suicide prevention.

604.5.1 Side Wall. The side wall grab bar shall be 42 inches (1065 mm) long minimum, located 12 inches (305 mm) maximum from the rear wall and extending 54 inches (1370 mm) minimum from the rear wall.



604.5.2 Rear Wall. The rear wall grab bar shall be 36 inches (915 mm) long minimum and extend from the centerline of the water closet 12 inches (305 mm) minimum on one side and 24 inches (610 mm) minimum on the other side.




EXCEPTIONS:


1. The rear grab bar shall be permitted to be 24 inches (610 mm) long, centered on the water closet.

where wall space does not permit a length of 36 inches (915 mm) minimum due to the location of a recessed fixture adjacent to the water closet.


2. Where an administrative authority requires flush controls for flush valves to be located in a position that conflicts with the location of the rear grab bar, then the rear grab bar shall be permitted to be split or shifted to the open side of the toilet area.



604.6 Flush Controls. Flush controls shall be hand operated or automatic. Hand operated flush controls shall comply with 309. Flush controls shall be located on the open side of the water closet except in ambulatory accessible compartments complying with 604.8.2.



604.7 Dispensers. Toilet paper dispensers shall comply with 309.4 and shall be 7 inches (180 mm) minimum and 9 inches (230 mm) maximum from the side wall or partition measured to the centerline of the dispenser. The outlet of the dispenser shall be 15 inches (380 mm) minimum and 48 inches (1220 mm) maximum above the finish floor. The dispenser shall not be located behind grab bars. Dispensers shall not be of a type that controls delivery or that does not allow continuous paper flow.



604.8 Toilet Compartments. Wheelchair accessible toilet compartments shall meet the requirements of 604.8.1 and 604.8.3. Compartments containing more than one plumbing fixture shall comply with 603. Ambulatory accessible compartments shall comply with 604.8.2 and 604.8.3.


604.8.1 Wheelchair Accessible Compartments. Wheelchair accessible compartments shall comply with 604.8.1.

604.8.1.1 Size. Wheelchair accessible compartments shall be 60 inches (1525 mm) wide minimum measured perpendicular to the side wall, and 56 inches (1420 mm) deep minimum for wall hung water closets and 59 inches (1500 mm) deep minimum for floor mounted water closets measured perpendicular to the rear wall.

Wheelchair accessible compartments for children's use shall be 60 inches (1525 mm) wide minimum measured perpendicular to the side wall, and 59 inches (1500 mm) deep minimum for wall hung and floor mounted water closets measured perpendicular to the rear wall.




604.8.1.2 Doors. Toilet compartment doors, including door hardware, shall comply with 404 except that if the approach is to the latch side of the compartment door, clearance between the door side of the compartment and any obstruction shall be 42 inches (1065 mm) minimum. Doors shall be located in the front partition or in the side wall or partition farthest from the water closet. Where located in the front partition, the door opening shall be 4 inches (100 mm) maximum from the side wall or partition farthest from the water closet. Where located in the side wall or partition, the door opening shall be 4 inches (100 mm) maximum from the front partition. The door shall be self-closing. A door pull complying with 404.2.7 shall be placed on both sides of the door near the latch. Toilet compartment doors shall not swing into the minimum required compartment area.



604.8.1.3 Approach. Compartments shall be arranged for left-hand or right-hand approach to the water closet.

604.8.1.4 Toe Clearance. The front partition and at least one side partition shall provide a toe clearance of 9 inches (230 mm) minimum above the finish floor and 6 inches (150 mm) deep minimum beyond the compartment-side face of the partition, exclusive of partition support members. Compartments for children's use shall provide a toe clearance of 12 inches (305 mm) minimum above the finish floor.

EXCEPTION: Toe clearance at the front partition is not required in a compartment greater than 62 inches (1575 mm) deep with a wall-hung water closet or 65 inches (1650 mm) deep with a floor-mounted water closet. Toe clearance at the side partition is not required in a compartment greater than 66 inches (1675 mm) wide. Toe clearance at the front partition is not required in a compartment for children's use that is greater than 65 inches (1650 mm) deep.




604.8.1.5 Grab Bars. Grab bars shall comply with 609. A side-wall grab bar complying with 604.5.1 shall be provided and shall be located on the wall closest to the water closet. In addition, a rear-wall grab bar complying with 604.5.2 shall be provided.



604.8.2 Ambulatory Accessible Compartments. Ambulatory accessible compartments shall comply with 604.8.2.

604.8.2.1 Size. Ambulatory accessible compartments shall have a depth of 60 inches (1525 mm) minimum and a width of 35 inches (890 mm) minimum and 37 inches (940 mm) maximum.


604.8.2.2 Doors. Toilet compartment doors, including door hardware, shall comply with 404, except that if the approach is to the latch side of the compartment door, clearance between the door side of the compartment and any obstruction shall be 42 inches (1065 mm) minimum. The door shall be self-closing. A door pull complying with 404.2.7 shall be placed on both sides of the door near the latch. Toilet compartment doors shall not swing into the minimum required compartment area.



604.8.2.3 Approach. Compartments shall be arranged for left-hand or right-hand approach to the water closet.

604.8.2.4 Toe Clearance. The front partition and at least one side partition shall provide a toe clearance of 9 inches (230 mm) minimum above the finish floor and 6 inches (150 mm) deep minimum beyond the compartment-side face of the partition, exclusive of partition support members. Compartments for children's use shall provide a toe clearance of 12 inches (305 mm) minimum above the finish floor.


EXCEPTION: Toe clearance at the front partition is not required in a compartment greater than 62 inches (1575 mm) deep with a wall-hung water closet or 65 inches (1650 mm) deep with a floor-mounted water closet. Toe clearance at the side partition is not required in a compartment greater than 66 inches (1675 mm) wide. Toe clearance at the front partition is not required in a compartment for children's use that is greater than 65 inches (1650 mm) deep.



604.8.2.5 Grab Bars. Grab bars shall comply with 609. A side-wall grab bar complying with 604.5.1 shall be provided and shall be located on the wall closest to the water closet. In addition, a rear-wall grab bar complying with 604.5.2 shall be provided.



604.8.2.6 Flush Controls. Flush controls shall be hand operated or automatic. Hand operated flush controls shall comply with 309. Flush controls shall be located on the open side of the water closet except in ambulatory accessible compartments complying with 604.8.2.



604.8.2.7 Dispensers. Toilet paper dispensers shall comply with 309.4 and shall be 7 inches (180 mm) minimum and 9 inches (230 mm) maximum from the side wall or partition measured to the centerline of the dispenser. The outlet of the dispenser shall be 15 inches (380 mm) minimum and 48 inches (1220 mm) maximum above the finish floor. The dispenser shall not be located behind grab bars. Dispensers shall not be of a type that controls delivery or that does not allow continuous paper flow.



604.8.2.8 Toilet Compartments. Wheelchair accessible toilet compartments shall meet the requirements of 604.8.1 and 604.8.3. Compartments containing more than one plumbing fixture shall comply with 603. Ambulatory accessible compartments shall comply with 604.8.2 and 604.8.3.

604.8.2.8.1 Wheelchair Accessible Compartments. Wheelchair accessible compartments shall comply with 604.8.1.

604.8.2.8.1.1 Size. Wheelchair accessible compartments shall be 60 inches (1525 mm) wide minimum measured perpendicular to the side wall, and 56 inches (1420 mm) deep minimum for wall hung water closets and 59 inches (1500 mm) deep minimum for floor mounted water closets measured perpendicular to the rear wall.

Wheelchair accessible compartments for children's use shall be 60 inches (1525 mm) wide minimum measured perpendicular to the side wall, and 59 inches (1500 mm) deep minimum for wall hung and floor mounted water closets measured perpendicular to the rear wall.

604.8.2.8.1.2 Doors. Toilet compartment doors, including door hardware, shall comply with 404 except that if the approach is to the latch side of the compartment door, clearance between the door side of the compartment and any obstruction shall be 42 inches (1065 mm) minimum. Doors shall be located in the front partition or in the side wall or partition farthest from the water closet. Where located in the front partition, the door opening shall be 4 inches (100 mm) maximum from the side wall or partition farthest from the water closet. Where located in the side wall or partition, the door opening shall be 4 inches (100 mm) maximum from the front partition. The door shall be self-closing. A door pull complying with 404.2.7 shall be placed on both sides of the door near the latch. Toilet compartment doors shall not swing into the minimum required compartment area.