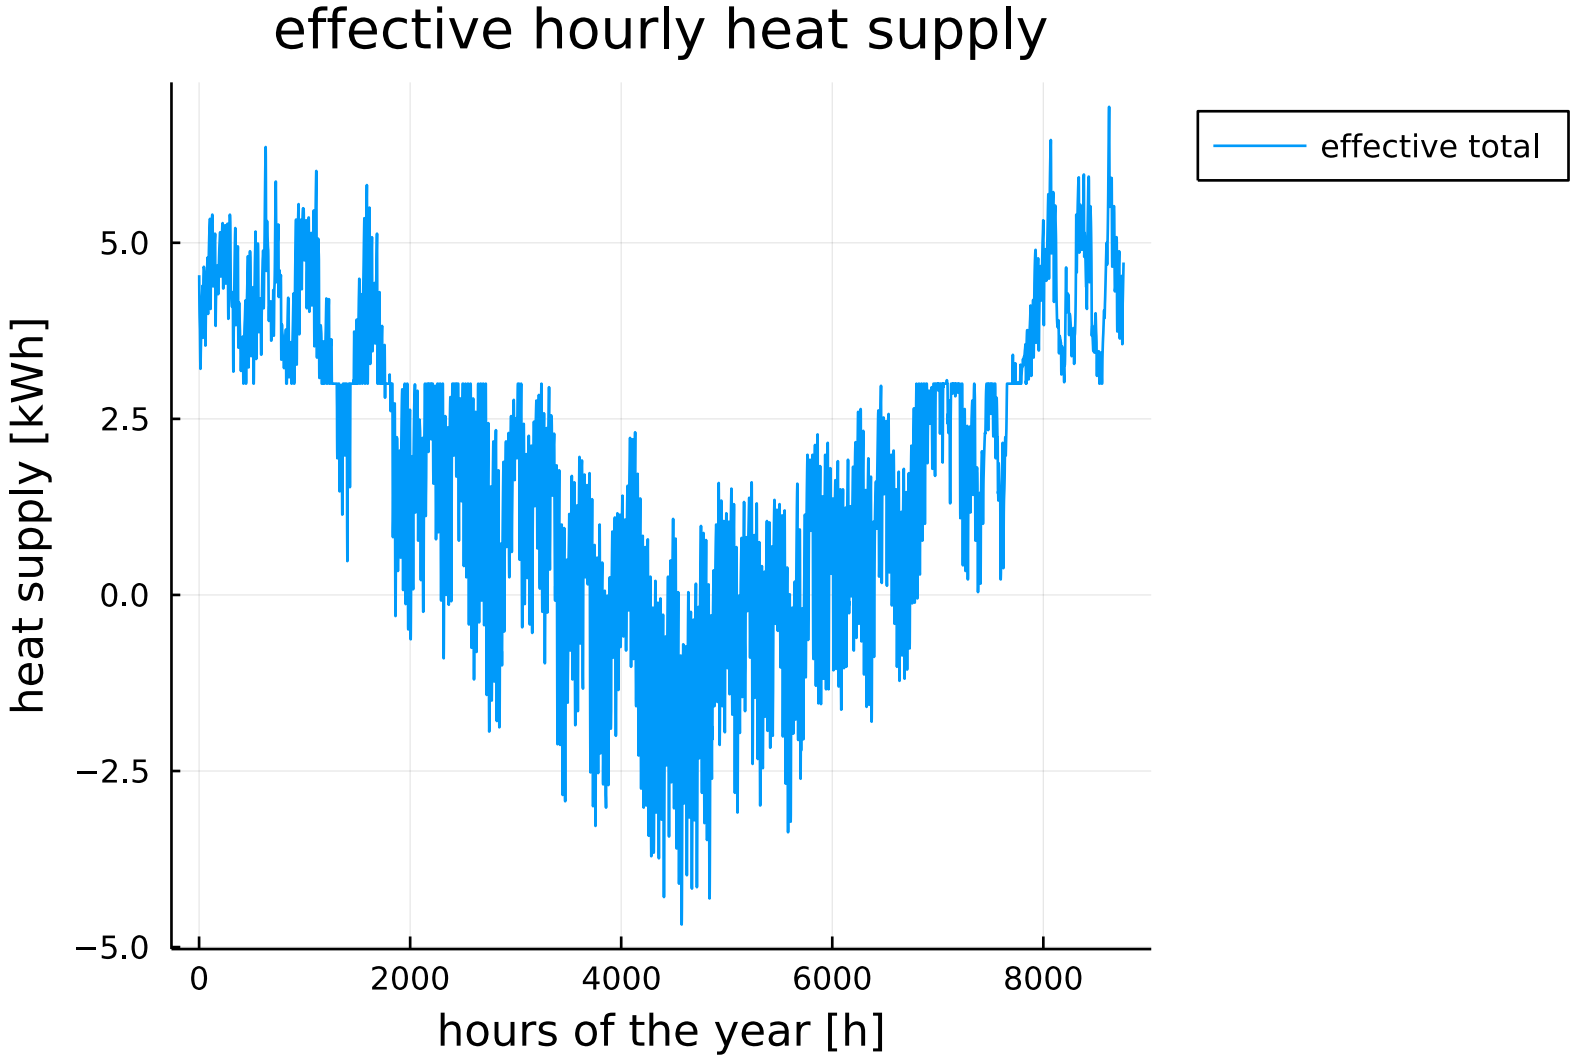
effective hourly heat supply
effective total
heat supply [kWh]
5.0
2.5
0.0
−2.5
−5.0
0
2000
4000
6000
8000
hours of the year [h]