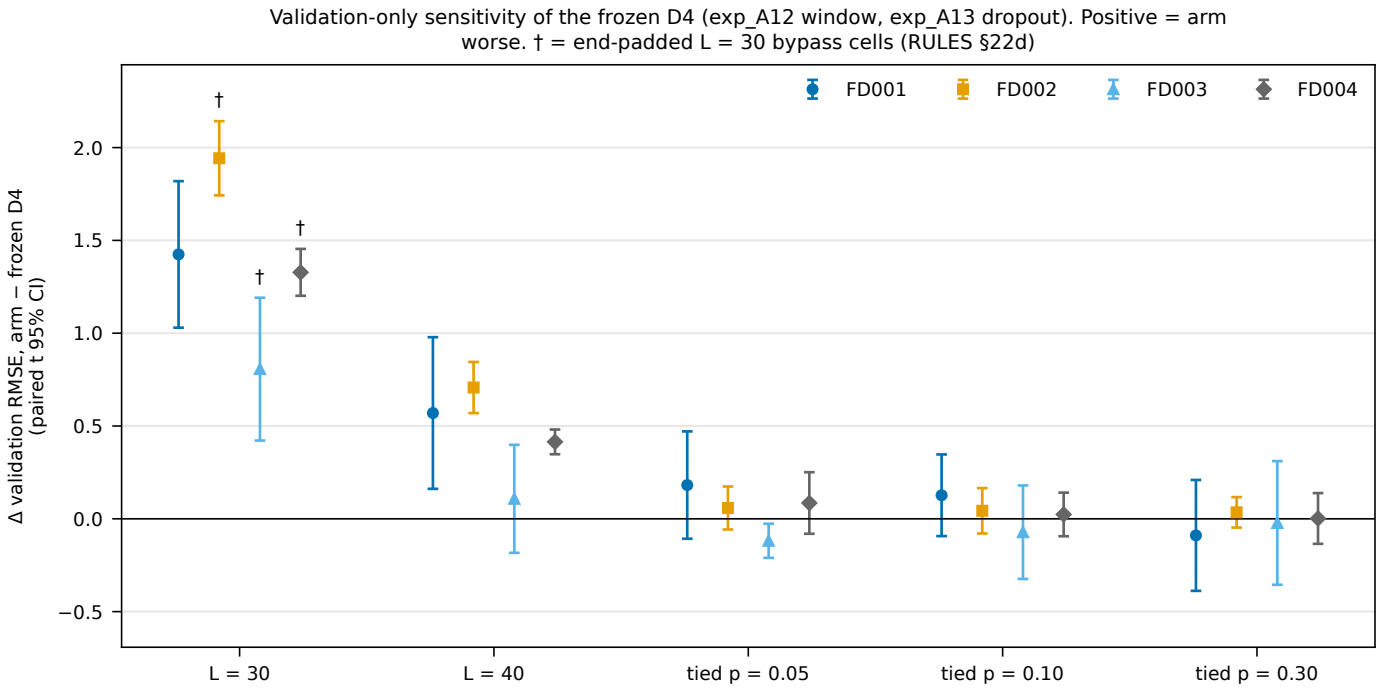
Validation-only sensitivity of the frozen D4 (exp_A12 window, exp_A13 dropout). Positive = arm worse. † = end-padded L = 30 bypass cells (RULES §22d)
FD001
FD002
FD003
FD004
Δ validation RMSE, arm − frozen D4 (paired t 95% CI)
2.0
1.5
1.0
0.5
0.0
−0.5
†
†
†
L = 30
L = 40
tied p = 0.05
tied p = 0.10
tied p = 0.30