


Profitability indices vs. capacity additions (rolling horizon, no policy)

Δ capacity additions, $\omega : 0 \rightarrow 0.95$ [GW resp. GWh]

(a) Do additions follow Π ? $\rho_{\text{Spearman}} = 0.83$ (non-ceiling)

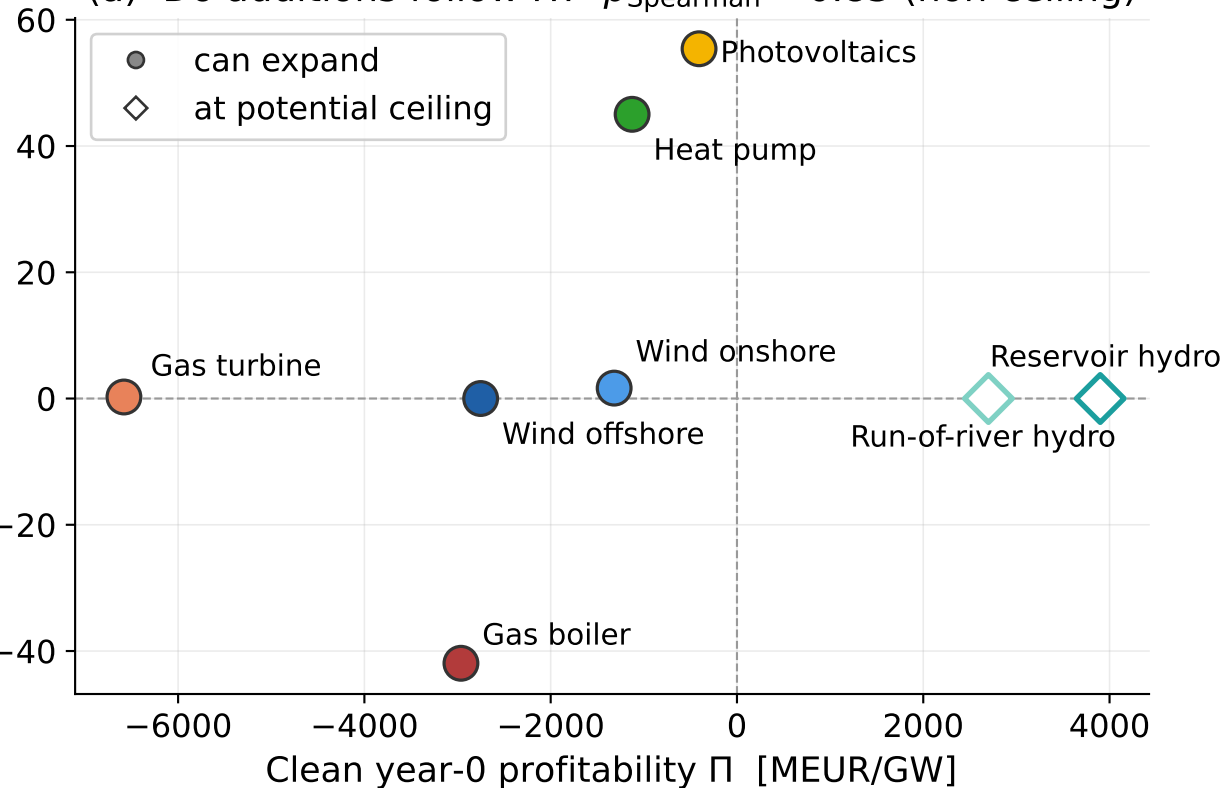

(b) Heat sector: heat pump vs. gas boiler additions

