


Profitability indices vs. capacity additions (rolling horizon, no policy)

(a) Do additions follow π ? $\rho_{\text{Spearman}} = 0.66$ (non-ceiling)



(b) Heat sector: bias substitutes boiler $\rightarrow$ heat pump

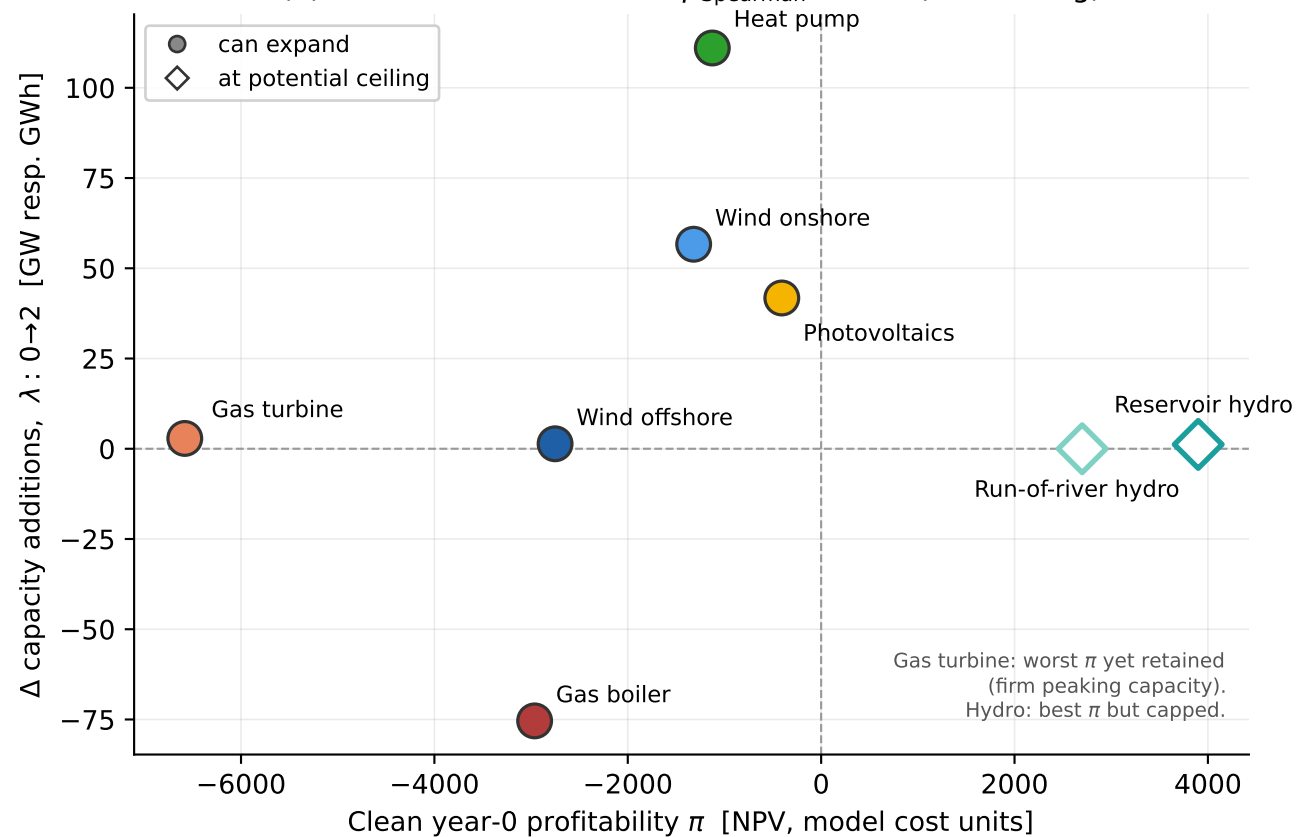