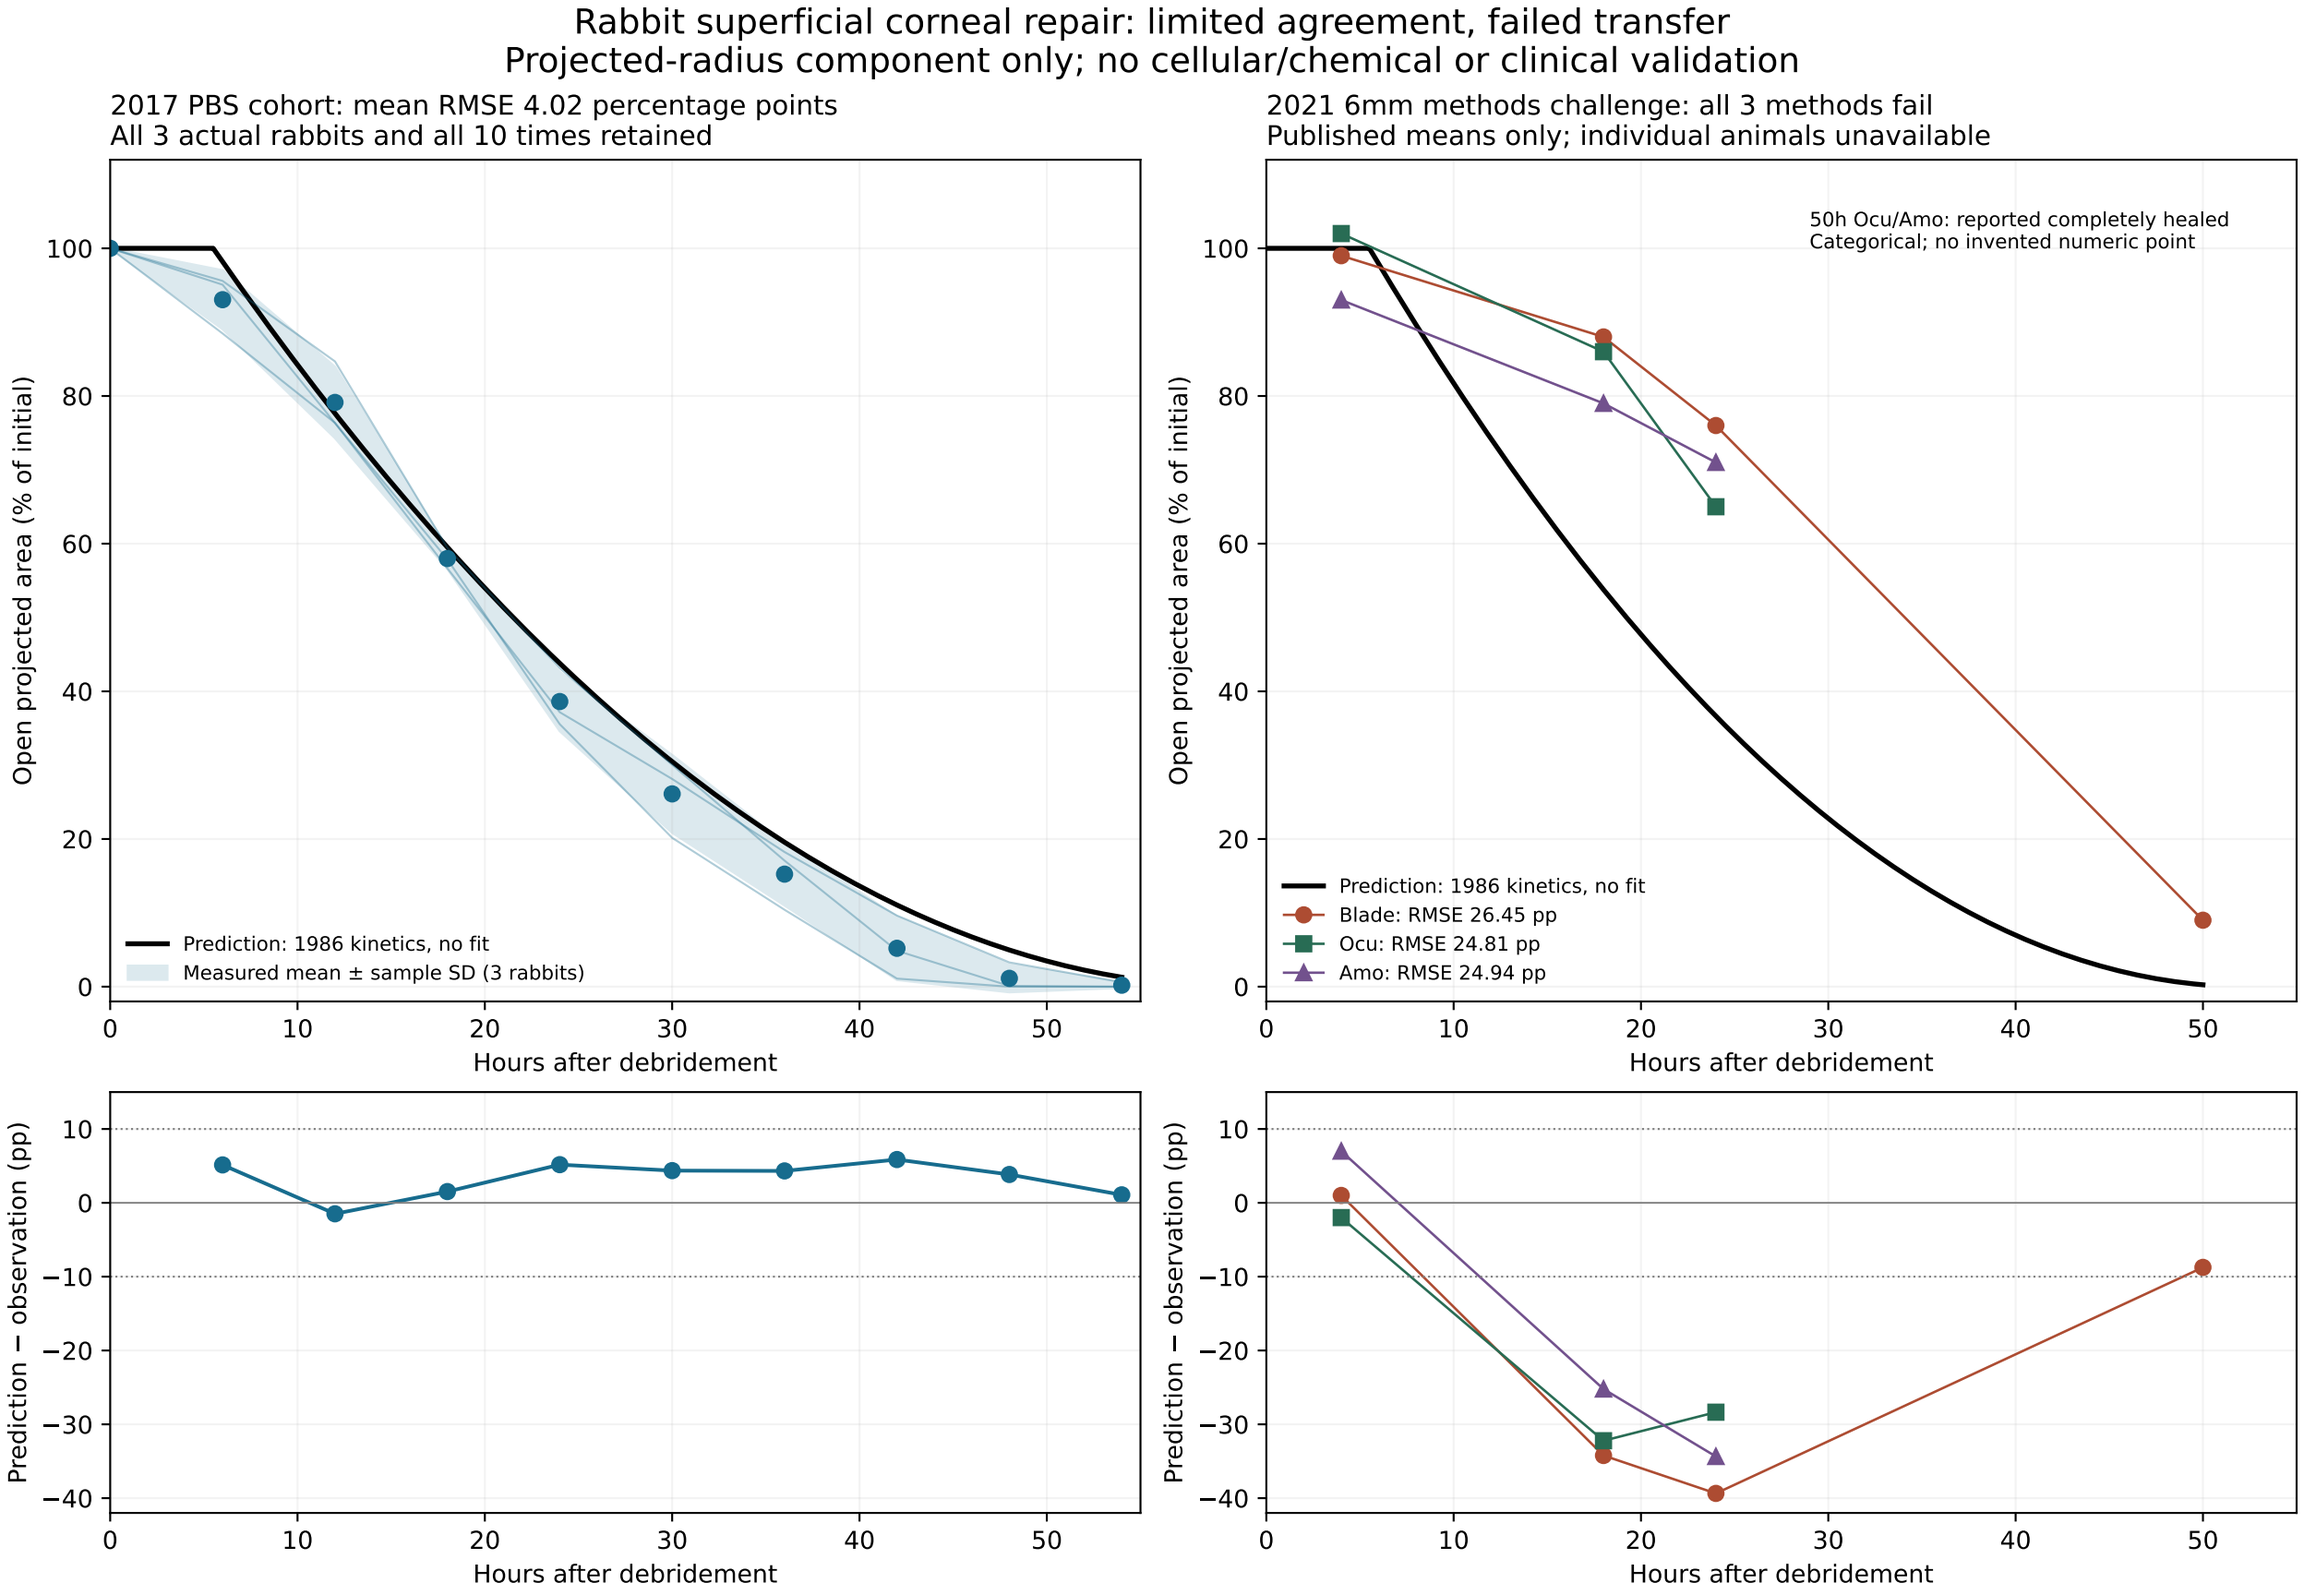
Rabbit superficial corneal repair: limited agreement, failed transfer
Projected-radius component only; no cellular/chemical or clinical validation
2017 PBS cohort: mean RMSE 4.02 percentage points
All 3 actual rabbits and all 10 times retained
2021 6mm methods challenge: all 3 methods fail
Published means only; individual animals unavailable
50h Ocu/Amo: reported completely healed
Categorical; no invented numeric point
Open projected area (% of initial)
Prediction: 1986 kinetics, no fit
Measured mean ± sample SD (3 rabbits)
Blade: RMSE 26.45 pp
Ocu: RMSE 24.81 pp
Amo: RMSE 24.94 pp
Hours after debridement
Prediction − observation (pp)