

# Cost-Effective and Privacy-Preserving Energy Management for Smart Meters

Lei Yang, *Member, IEEE*, Xu Chen, *Member, IEEE*, Junshan Zhang, *Fellow, IEEE*, and H. Vincent Poor, *Fellow, IEEE*

**Abstract**—Smart meters, designed for information collection and system monitoring in smart grid, report fine-grained power consumption to utility providers. With these highly accurate profiles of energy usage, however, it is possible to identify consumers' specific activities or behavior patterns, thereby giving rise to serious privacy concerns. This paper addresses these concerns by designing a cost-effective and privacy-preserving energy management technique that uses a rechargeable battery. From a holistic perspective, a dynamic programming framework is designed for consumers to strike a tradeoff between smart meter data privacy and the cost of electricity. In general, a major challenge in solving dynamic programming problems lies in the need for the knowledge of future electricity consumption events. By exploring the underlying structure of the original problem, an equivalent problem is derived, which can be solved by using only the current observations. An online control algorithm is then developed to solve the equivalent problem based on the Lyapunov optimization technique. It is shown that without the knowledge of the statistics of the time-varying load requirements and the electricity price processes, the proposed online control algorithm, parametrized by a positive value  $V$ , is within  $O(1/V)$  of the optimal solution to the original problem, where the maximum value of  $V$  is limited by the battery capacity. The efficacy of the proposed algorithm is demonstrated through extensive numerical analysis using real data.

**Index Terms**—Battery, cost saving, data privacy, load monitor, smart grid, smart meter.

## I. INTRODUCTION

TRADITIONAL power grids are being transformed into smart grids using advanced information control and communication technologies to offer higher reliability, security, and efficiency in power systems [1]–[3]. To support both dynamic pricing and a two-way flow of electricity between

homes (or micro grids) and power grids, smart meters are being widely deployed. Compared to conventional analog meters, smart meters measure power consumption at a much finer granularity. Such fine-grained information, however, may give rise to serious concerns of security regarding attacks [4] and data privacy [5], especially for residential consumers.

The privacy of smart meter data has recently garnered much attention. Recent work [5] provides an overview of the privacy implications of fine-grained power consumption monitoring. From the information collected by smart meters, complex usage patterns, such as residential occupancy and social activities, can be extracted without *a priori* knowledge of household activities [6]. Multiple methods [7]–[13] have been proposed to protect smart meter data privacy. One common approach is to introduce uncertainty in individual power consumption by perturbing the load measurements [7], [8]. However, this approach requires modification of the metering infrastructure, which may not be logistically and economically viable, with millions of smart meters already installed. Besides, the modification of usage data could result in inaccurate billing and grid controls, thereby undermining grid management.

In this paper, we address the threats to electricity consumer privacy by using energy storage devices (such as a rechargeable battery) [15]. In particular, a battery can be used to protect the usage patterns of electricity consumers. Ideally, all usage patterns can be perfectly masked by charging and discharging the battery to maintain a constant metered load, such that all load measurements equal to the average consumer's load. Moreover, the rechargeable battery can also be used to reduce the cost of electricity, as the electricity price is time-varying. It is likely that consumers may tolerate some degree of information leakage to reduce their electricity costs by adapting their needs to the time-varying electricity price. However, it is challenging to control the battery charging/discharging to achieve this, without the knowledge of future electricity consumption events, not to mention the time-varying load requirements and electricity prices with possibly unknown statistics. To tackle this challenge, an online control algorithm with low computational complexity is developed to jointly protect smart meter data privacy and reduce the cost of electricity, while taking into account the cost of repeated charging and discharging on the battery's lifetime.

## A. Summary of Main Contributions

Our main contributions are summarized as follows.

- 1) We develop a dynamic programming framework that can protect smart meter data privacy in a cost-effective

Manuscript received February 24, 2014; revised June 11, 2014; accepted July 18, 2014. Date of publication August 12, 2014; date of current version December 17, 2014. This work was supported in part by the U.S. Air Force Office of Scientific Research under Multi-University Research Initiative Grant FA9550-09-1-0643, in part by the U.S. National Science Foundation under Grant CPS-1035906 and Grant CNS-1218484, and in part by the Defense Threat Reduction Agency under Grant HDTRA1-13-1-0029. Paper no. TSG-00144-2014.

L. Yang is with the School of Engineering and Applied Science, Princeton University, Princeton, NJ 08544 USA; and also with the School of Electrical, Computer, and Energy Engineering, Arizona State University, Tempe, AZ 85287 USA (e-mail: leiy@princeton.edu).

X. Chen and J. Zhang are with the School of Electrical, Computer, and Energy Engineering, Arizona State University, Tempe, AZ 85287 USA (e-mail: xchen179@asu.edu; junshan.zhang@asu.edu).

H. V. Poor is with the School of Engineering and Applied Science, Princeton University, Princeton, NJ 08544 USA (e-mail: poor@princeton.edu).

Color versions of one or more of the figures in this paper are available online at <http://ieeexplore.ieee.org>.

Digital Object Identifier 10.1109/TSG.2014.2343611

manner, while taking into account the impact of repeated charging and discharging on the battery's lifetime. One major challenge in solving this problem is the need for the knowledge of future electricity consumption events. Moreover, due to the finite battery capacity, the control actions at all slots are coupled. It turns out that had the charging/discharging constraints been relaxed, the average battery charging and discharging power would be evened out. By exploiting this structure, we recast the original problem as a decoupled optimization problem with a larger feasible set, such that the optimal control action at each slot can be solved by using only the current observations, and it is also optimal for the original problem, if it is feasible for the original problem.

- 2) By carefully constructing the Lyapunov function, we develop an online control algorithm to solve the decoupled optimization problem based on the Lyapunov optimization technique [16], [17], such that the control action always lies in the feasible region of the original problem. The proposed online control algorithm requires solution of a mixed-integer nonlinear program, in order to consider the cost of repeated charging and discharging on the battery's lifetime. By decomposing the problem into multiple cases, a closed-form solution to each case of the mixed-integer nonlinear program is derived.
- 3) We show that the proposed online control algorithm, parametrized by a positive value  $V$ , is within  $O(1/V)$  of the optimal solution to the original problem, where the maximum value of  $V$  is limited by the battery capacity. In this way, we quantify the impact of the battery capacity on the performance of the proposed online control algorithm. Using real data, we demonstrate the efficacy of our online control algorithm through extensive numerical exploration. The results corroborate that our algorithm can protect smart meter data privacy in a cost-effective manner.

## B. Related Work

Smart meter data privacy protection has been studied in a number of papers. Heuristic algorithms are developed to tackle this challenge (see [9], [10], [14], [13]). Kalogridis *et al.* [9] propose a “best-effort” algorithm against power load changes by charging/discharging the battery to maintain the current load equal to the previous load. McLaughlin *et al.* [10] propose a nonintrusive load leveling (NIL) algorithm to mask appliance features that are used by nonintrusive load monitoring (NILM) algorithms (see [18]–[20]) to detect appliance switch-on/off events. None of these works have considered optimal control algorithms to protect smart meter data privacy. Moreover, as pointed out in [14], the methods proposed in [9] and [10] suffer from precise load change recovery attacks, due to the leakage of load-change information. The information leakage is mainly due to the fact that the “best-effort” algorithm in [9] attempts to maintain the current load at all times, and that the NIL algorithm in [10] often encounters a period of peak loads. In contrast, the online control algorithm proposed here determines the observed load profile

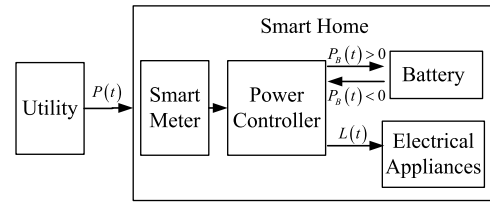


Fig. 1. System model.

by solving a well-designed optimization problem with unobservable parameters, without which the original load profile cannot be recovered. Therefore, the proposed approach does not suffer from precise load change recovery attacks [14].

Recent work [13] proposes a Monte Carlo simulation-based approach to jointly optimize the cost of electricity and privacy. Furthermore, [11] proposes wallet-friendly privacy protection for smart meters by using stochastic dynamic programming. Along a different line, recent work [12] protects smart meter data privacy by using energy harvesting and storage devices from an information theoretic perspective. All these works require the knowledge of the statistics of the load requirements or the electricity prices, which may not be readily available. Moreover, the solution to dynamic programming requires solution of a value function that can be computationally difficult when the state space of the system is large and hence suffers from the curse of dimensionality.

Unlike the prior works, this paper proposes a low complexity online control algorithm that is within  $O(1/V)$  of the optimal solution, without the knowledge of the statistics of the time-varying load requirements and the electricity price processes.

The rest of the paper is organized as follows. In Section II, we describe the system model. In Section III, we propose a cost-effective and privacy-preserving energy management framework. In Section IV, we propose an optimal online control algorithm. In Section V, we evaluate the performance of the proposed online control algorithm using real data. The paper is concluded in Section VI.

## II. SYSTEM MODEL

We consider a discrete-time system, in which the length of each time slot matches the typical sampling and operation time scale of the smart meter. An overview of the system model is given in Fig. 1. We assume that a smart home contains an energy storage device (battery) and a power controller that can control the combination of power drawn from the utility and the battery to satisfy the load requirements. In the following, the model of each component in Fig. 1 is described in detail, aiming to optimize the load profile to mask individual consumption events in a cost-effective manner.

### A. Battery Model

We denote by  $B^{\max}$  the battery capacity, by  $B(t)$  the energy level of the battery at slot  $t$ , and by  $P_B(t)$  the power charged to (when  $P_B(t) > 0$ ) or discharged from (when  $P_B(t) < 0$ ) the battery during slot  $t$ . Assume that the battery energy leakage is negligible, which is a reasonable assumption, since the time

scale over which the loss takes place (e.g., about 3–20% a month for lead-acid batteries) is much larger than the minute-level time scale. Then, the dynamics of the battery energy level can be expressed as

$$B(t+1) = B(t) + P_B(t). \quad (1)$$

Since the charging and discharging rates of the battery are physically constrained, we denote by  $P_B^{\max}$  the maximum charging rate and by  $P_B^{\min}$  the maximum discharging rate.  $P_B^{\max}$  and  $P_B^{\min}$  are positive constants depending on the physical properties of the battery. Therefore, we have the following constraint on  $P_B(t)$ :

$$-P_B^{\min} \leq P_B(t) \leq P_B^{\max}. \quad (2)$$

Since the battery energy level should always be nonnegative and cannot exceed the battery capacity, we need to ensure that in each slot  $t$

$$0 \leq B(t) \leq B^{\max}. \quad (3)$$

Based on constraints (1)–(3), we have the following equivalent constraints in each slot  $t$  for  $P_B(t)$ :

$$P_B(t) \geq -\min\{P_B^{\min}, B(t)\} \quad (4)$$

$$P_B(t) \leq \min\{P_B^{\max}, B^{\max} - B(t)\}. \quad (5)$$

For simplicity, a basic battery model (see [21]) is used to model the cost of repeated charging and discharging. It is assumed that the number of charging/discharging cycles for each battery is limited. Given the battery's cost and the number of charging/discharging cycles, the cost of repeated charging and discharging on the battery's lifetime can be calculated using the battery's cost divided by the number of charging/discharging cycles, i.e., an amortized cost  $C_B$  (in unit of dollars) incurred with each charging or discharging. Therefore, at each slot, an operating cost of  $C_B$  is incurred whenever the battery is charging ( $P_B(t) > 0$ ) or discharging ( $P_B(t) < 0$ ). Nevertheless, the results in the paper can be easily generalized to more complicated battery models.

### B. Load Model

We denote by  $L(t)$  the residential load generated at slot  $t$ .  $L(t)$  is assumed to be independent and identical distributed (*i.i.d.*) over time slots with some unknown probability distribution. Assume that  $L(t)$  is deterministically bounded by a finite constant  $L^{\max}$ , so that

$$L(t) \leq L^{\max}, \quad \forall t. \quad (6)$$

$L^{\max}$  can be determined by the total power consumption of all electrical appliances in the home.

With the battery, the total power used to serve the load is given by

$$L(t) = P(t) - P_B(t), \quad (7)$$

where  $P(t)$  denotes the power drawn from the grid at slot  $t$ . Assume that the maximum amount of power that can be drawn from the grid in any slot is upper bounded by  $P^{\max}$ , that is

$$0 \leq P(t) \leq P^{\max}, \quad \forall t. \quad (8)$$

Note that for the original scenario where the battery is not used,  $P^{\max}$  must be larger than  $L^{\max}$  in order to satisfy all residential loads. Therefore, we have  $P^{\max} \geq L^{\max}$ .

### C. Electricity Pricing Model

Since the electricity price is time-varying, e.g., time-of-use electricity pricing, the rechargeable battery offers an opportunity to reduce the cost of electricity, in addition to privacy protection. Let  $c(t)$  denote the cost per unit of power drawn from the grid at slot  $t$ . We assume that  $c(t)$  evolves according to an *i.i.d.* process with some unknown distribution and is deterministically bounded by a finite constant  $c^{\max}$ , so that  $c(t) \leq c^{\max}$ .

Given the system model, our goal is to design a control algorithm that jointly optimizes the cost of power and smart meter data privacy, while meeting all the constraints. For ease of exposition, the load process and the electricity price process are assumed to be *i.i.d.* over slots. The algorithm developed for this case can be applied to non *i.i.d.* scenarios, as shown in Section V, where numerical studies are carried out in non *i.i.d.* environments. Our results can be generalized for the non *i.i.d.* case by using the delayed Lyapunov drift and  $T$  slot drift techniques developed in [16] and [17].

## III. COST-EFFECTIVE AND PRIVACY-PRESERVING ENERGY MANAGEMENT

Based on the system model above, we now study cost-effective and privacy-preserving energy management.

### A. Control Objective

With the use of a battery, the original load profile  $L(t)$  becomes  $P(t) = L(t) + P_B(t)$ . Intuitively, in order to mask energy usage profiles, the modified load profile  $P(t)$  needs to be as “flat” as possible, as the privacy information is contained in appliance switch-on/off events, i.e., the differences between successive power measurements. If  $P(t)$  is equal to a constant value representing the average residential load, then all individual consumption events would be perfectly masked. Let  $\bar{L} = \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t L(\tau)$  denote the average residential load. In real time, by charging/discharging the battery,  $P(t)$  needs to be controlled with as little deviation from  $\bar{L}$  as possible. Equivalently, the control objective is to minimize the “variance” of  $P(t)$ , that is

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E} \left\{ (P(\tau) - \bar{L})^2 \right\}. \quad (9)$$

It can be seen that minimizing (9) generally requires the knowledge of all future consumption events due to  $\bar{L}$ . Heuristic algorithms (see [9], [10]) have been devised to mitigate this issue by charging/discharging the battery to make  $P(t)$  achieve a target load determined heuristically, which inevitably sacrifices performance. As discussed later in Proposition 1, by exploring the problem structure, this issue can be solved by transforming (9) into an equivalent problem.

Beyond privacy protection, the rechargeable battery can also be used to reduce the cost electricity, by utilizing the time-varying electricity price. In this paper, we jointly optimize

the cost of electricity and smart meter data privacy. The corresponding objective function can be expressed as

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E} \left\{ \underbrace{c(\tau)P(\tau)}_{\text{Electricity cost}} + \underbrace{\mathbf{1}_B(\tau)C_B}_{\text{Battery operation cost}} + \underbrace{\beta(P(\tau) - \bar{L})^2}_{\text{Smart meter data privacy}} \right\}, \quad (10)$$

where the indicator function  $\mathbf{1}_B(t)$  corresponds to the battery operation, i.e.,  $\mathbf{1}_B(t) = 1$  if  $P_B(t) \neq 0$  (the battery is charging/discharging), otherwise  $\mathbf{1}_B(t) = 0$ .  $\beta \geq 0$  is a parameter chosen by the customer to trade off between reducing the cost of electricity and protecting smart meter data privacy. For example, when  $\beta = 0$ , the customer optimizes only the cost of electricity; when  $\beta$  is large, the customer focuses more on protecting smart meter data privacy. Assuming that the limit exists in (10), our goal is to design a control algorithm that can minimize this time averaged cost subject to the constraints described in the system model.

### B. Problem Formulation

The cost-effective and privacy-preserving energy management problem can be formulated as the following stochastic dynamic programming problem:

$$\mathbf{P1}: \min \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E} \left\{ c(\tau)P(\tau) + \mathbf{1}_B(\tau)C_B + \beta(P(\tau) - \bar{L})^2 \right\} \quad (11)$$

s.t. constraints (4), (5), (7), (8).

One major challenge of solving **P1** is the lack of knowledge of future time-varying load requirements and electricity prices. Moreover, due to the finite battery capacity constraints (4) and (5), the current control action would impact the future control actions, making it more challenging to solve **P1**. Note that the traditional approach based on dynamic programming (e.g., the approach in [11]) is difficult to apply, because it requires the statistics of load requirements and electricity prices, and the computational complexity may suffer from the curse of dimensionality. As the statistics of load requirements and electricity prices may not be known, in this paper, we develop an online control algorithm to solve this problem by using only the current observations, while taking into account the *finite* battery capacity constraints.

### C. Problem Relaxation

To solve **P1**, we first consider a relaxed version of **P1**, by using (2) to relax the constraints (4) and (5). Define the average expected charging or discharging rate of the battery as

$$\bar{P}_B = \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E}\{P_B(\tau)\}. \quad (12)$$

Since the battery energy evolves based on (1), summing over all  $t$  and taking expectation of both sides, we have

$$\mathbb{E}\{B(t+1)\} - B(1) = \sum_{\tau=1}^t \mathbb{E}\{P_B(\tau)\}, \quad (13)$$

where  $B(1)$  is the initial battery energy level. Since the battery capacity is finite, dividing both sides by  $t$ , and taking  $t \rightarrow \infty$  in (13) yields

$$\bar{P}_B = 0. \quad (14)$$

Thus, we have the following relaxed problem:

$$\mathbf{P2}: \min \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E} \left\{ c(\tau)P(\tau) + \mathbf{1}_B(\tau)C_B + \beta(P(\tau) - \bar{L})^2 \right\} \quad (15)$$

s.t. constraints (2), (7), (8)

$$\bar{P}_B = 0.$$

One main challenge of solving **P2** is that it requires the knowledge of all future consumption events to compute  $\bar{L}$ . Now that  $\bar{P}_B = 0$ , the average charging power is equal to the average discharging power, indicating that the battery does not consume energy on average. By exploiting this structure, we show in the following proposition that the decision variable  $P(t)$  is independent of  $\bar{L}$ . Therefore, **P2** can be solved without using the knowledge of  $\bar{L}$ .

*Proposition 1:* Consider the following stochastic optimization problem:

$$\mathbf{P3}: \min \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E} \left\{ c(\tau)P(\tau) + \mathbf{1}_B(\tau)C_B + \beta P(\tau)^2 \right\} \quad (16)$$

s.t. constraints (2), (7), (8)

$$\bar{P}_B = 0.$$

Any optimal solution to **P3** is also optimal for **P2** and vice versa.

*Proof:* Since any feasible solution to **P3** is also feasible for **P2** and vice versa, it is sufficient to show that the objective functions of **P3** and **P2** differ by at most a constant independent of  $P(t)$ . Equivalently, it is sufficient to show that

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E}\{\bar{L}^2 - 2\bar{L}P(\tau)\} \quad (17)$$

is a constant independent of the choice of  $P(t)$ . Since  $\bar{L}$  is a constant depending only on  $L(t)$ , it is sufficient to show that

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E}\{P(\tau)\} \quad (18)$$

is a constant independent of the choice of  $P(t)$ .

Since  $P(t) = L(t) + P_B(t)$ , summing over all  $t$ , taking the expectation of both sides, dividing both sides by  $t$  and taking  $t \rightarrow \infty$ , we have

$$\begin{aligned} \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E}\{P(\tau)\} &= \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t L(\tau) \\ &\quad + \lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E}\{P_B(\tau)\} \\ &= \bar{L} + \bar{P}_B. \end{aligned} \quad (19)$$

Since  $\bar{P}_B = 0$ , we have

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E}\{P(\tau)\} = \bar{L}, \quad (20)$$

thereby concluding the proof. ■



From Proposition 1, any feasible solution to **P1** is also a feasible solution to **P3**, since **P2** is equivalent to **P3** and the feasible set of **P2** is larger than that of **P1**. Let  $\phi_{\text{rel}}$  and  $\phi_{\text{opt}}$  denote the optimal objective value of the relaxed problem **P3** and that of **P1**, respectively. Since **P3** is less constrained than **P1**, the optimal value of **P3** will not exceed that of **P1** by more than a constant  $\beta\bar{L}^2$  that can be computed based on Proposition 1, i.e.,  $\phi_{\text{rel}} \leq \phi_{\text{opt}} - \beta\bar{L}^2$ .

Note that **P3** is a decoupled control problem, in the sense that the optimal control actions  $P(t)$  and  $P_B(t)$  at each slot can be determined purely by the current state  $L(t)$  and  $c(t)$ . Specifically, it can be shown that there exists a stationary, randomized policy that can achieve the optimal solution to **P3** as presented in the following lemma.

*Lemma 1:* If  $L(t)$  and  $c(t)$  are *i.i.d.* over time slots, then there exists a stationary, randomized policy that makes control decisions  $P^{\text{stat}}(t)$  and  $P_B^{\text{stat}}(t)$  at every slot purely as a function (possibly randomized) of the current state  $L(t)$  and  $c(t)$ , while satisfying the constraints of **P3** and providing the following guarantees:

$$\begin{aligned} \mathbb{E}\{P_B^{\text{stat}}(t)\} &= 0, \\ \mathbb{E}\{c(t)P^{\text{stat}}(t) + \mathbf{1}_{\{P^{\text{stat}}(t) \neq 0\}}C_B + \beta P^{\text{stat}}(t)^2\} &= \phi_{\text{rel}}, \end{aligned}$$

where the expectations above are with respect to the stationary distributions of  $L(t)$  and  $c(t)$ , and the randomized control decisions.

The proof of Lemma 1 follows from the framework in [17] and is omitted for brevity. Note that the above stationary, randomized policy may not be feasible for the original problem **P1**, as the constraints (4) and (5) may be violated. However, the existence of such a policy can be used to design our online control policy that meets all constraints of **P1** and derive a performance guarantee for our algorithm as shown later in Theorem 1.

#### IV. OPTIMAL ONLINE CONTROL ALGORITHM

In this section, we design an online control algorithm that can achieve the optimal solution to **P1** asymptotically. The proposed online control algorithm is designed based on **P3**, and uses a control parameter  $V > 0$  to quantify the impact of the battery capacity on the performance of the algorithm as discussed later. The key idea of our algorithm is to construct a Lyapunov function with a perturbed weight for determining the control actions. By carefully designing the weight, we can show that whenever the battery is charged or discharged, the battery energy level always lies in the feasible region of **P1**. From Proposition 1, if the optimal solution to **P3** can be found and lies in the feasible region of **P1**, it is also optimal for **P1**. To this end, we define a perturbed variable  $U(t)$  to track the battery energy level as

$$U(t) = B(t) - V(c^{\max} + 2\beta L^{\max}) - P_B^{\min}. \quad (21)$$

Note that  $B(t)$  is the actual battery energy level at slot  $t$  and  $U(t)$  is simply a shifted version of  $B(t)$  with the same dynamics

$$U(t+1) = U(t) + P_B(t). \quad (22)$$

#### A. Lyapunov Optimization

We define the following Lyapunov function:  $Z(U(t)) = \frac{1}{2}U(t)^2$ . The corresponding conditional Lyapunov drift can be defined as follows:

$$\Delta(U(t)) = \mathbb{E}\{Z(U(t+1)) - Z(U(t))|U(t)\}. \quad (23)$$

Following the drift-plus-penalty framework [17], our online control algorithm is designed to minimize an upper bound on the following function, in order to achieve the optimal solution to **P1**:

$$\Delta(U(t)) + V\mathbb{E}\{c(t)P(t) + \mathbf{1}_B(t)C_B + \beta P(t)^2|U(t)\}. \quad (24)$$

The following lemma provides an upper bound for (24).

*Lemma 2 (Drift Bound):* For any control policy that satisfies the constraints of **P3**, we have

$$\begin{aligned} \Delta(U(t)) + V\mathbb{E}\{c(t)P(t) + \mathbf{1}_B(t)C_B + \beta P(t)^2|U(t)\} \\ \leq K + U(t)\mathbb{E}\{P_B(t)|U(t)\} \\ + V\mathbb{E}\{c(t)P(t) + \mathbf{1}_B(t)C_B + \beta P(t)^2|U(t)\}, \end{aligned} \quad (25)$$

where the constant  $K$  is defined as

$$K = \frac{1}{2} \max \left\{ \left( P_B^{\min} \right)^2, \left( P_B^{\max} \right)^2 \right\}. \quad (26)$$

*Proof:* Squaring both sides of (22), dividing by 2, and rearranging, we have

$$\frac{U(t+1)^2 - U(t)^2}{2} = \frac{1}{2}P_B(t)^2 + U(t)P_B(t).$$

Since  $-P_B^{\min} \leq P_B(t) \leq P_B^{\max}$ , we have

$$\begin{aligned} \frac{U(t+1)^2 - U(t)^2}{2} \leq \frac{1}{2} \max \left\{ \left( P_B^{\min} \right)^2, \left( P_B^{\max} \right)^2 \right\} \\ + U(t)P_B(t). \end{aligned}$$

Taking conditional expectations of the above and adding  $V\mathbb{E}\{c(t)P(t) + \mathbf{1}_B(t)C_B + \beta P(t)^2|U(t)\}$  to both sides, the proof is concluded. ■

#### B. Online Control Algorithm

The design principle of our online control algorithm is to minimize the right-hand-side of the drift-plus-penalty bound (25) subject to the constraints of **P3** at each slot  $t$ , by observing the current state  $U(t)$ ,  $L(t)$ , and  $c(t)$ . The online control algorithm chooses the control actions  $P_B(t)$  and  $P(t)$  as the solution to the following optimization problem:

$$\begin{aligned} \mathbf{P4:} \quad & \min \quad U(t)P_B(t) + V(c(t)P(t) + \mathbf{1}_B(t)C_B + \beta P(t)^2) \\ & \text{s.t.} \quad -P_B^{\min} \leq P_B(t) \leq P_B^{\max} \\ & \quad \quad 0 \leq P(t) \leq P^{\max} \\ & \quad \quad L(t) = P(t) - P_B(t). \end{aligned} \quad (27)$$

It can be observed that for each slot  $t$ , **P4** is a mixed-integer nonlinear program. To solve it, we consider the optimal values of the objective in **P4** for two modes with and without charging/discharging respectively, and then choose the mode that yields the lowest value of the objective. The corresponding control actions of the mode can then be implemented in real time.

**Algorithm 1** Online Control Algorithm

**Initialization:** Given the initial battery charge level  $0 \leq B_{\text{init}} \leq B^{\text{max}}$ , set  $t = 1$  and compute  $U(1)$  based on (21).  
**For each time slot  $t$**   
 1) Compute  $\theta_1(t)$  and  $\theta_2(t)$  based on (28) and (29).  
 2) Choose the control decisions  $P_B^*(t)$  and  $P^*(t)$  associated with the lower value of  $\theta_1(t)$  and  $\theta_2(t)$ .  
 3) Update  $U(t)$  according to (22).

Let  $P_B^*(t)$  and  $P^*(t)$  denote the optimal solution to **P4**. For each case,  $P_B^*(t)$  and  $P^*(t)$  can be characterized by using the Karush–Kuhn–Tucker (KKT) conditions [22]. The optimal solution to **P4** is given as follows.

1) *The Case Without Charging/Discharging* ( $\mathbf{1}_B(t) = 0$ ): Let  $\theta_1(t)$  denote the optimal value of the objective in **P4** without charging/discharging. In this case, we have  $P_B^*(t) = 0$  and  $P^*(t) = L(t)$ .  $\theta_1(t)$  can be calculated as

$$\theta_1(t) = V(c(t)P^*(t) + \beta P^*(t)^2). \quad (28)$$

2) *The Case With Charging/Discharging* ( $\mathbf{1}_B(t) = 1$ ): Let  $\theta_2(t)$  denote the optimal value of the objective in **P4** with charging/discharging. Letting  $UB = \min\{P_B^{\text{max}}, P^{\text{max}} - L(t)\}$  and  $LB = \max\{-P_B^{\text{min}}, -L(t)\}$ ,  $P_B^*(t)$  and  $P^*(t)$  can be calculated as follows.

- If  $-\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta} > UB$ , then  $P_B^*(t) = UB$  and  $P^*(t) = P_B^*(t) + L(t)$ .
- If  $LB \leq -\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta} \leq UB$ , then  $P_B^*(t) = -\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta}$  and  $P^*(t) = P_B^*(t) + L(t)$ .
- If  $-\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta} < LB$ , then  $P_B^*(t) = LB$  and  $P^*(t) = P_B^*(t) + L(t)$ .

Given  $P_B^*(t)$  and  $P^*(t)$ ,  $\theta_2(t)$  can be calculated as follows:

$$\theta_2(t) = U(t)P_B^*(t) + V(C_B + c(t)P^*(t) + \beta P^*(t)^2). \quad (29)$$

After computing  $\theta_1(t)$  and  $\theta_2(t)$ , we choose the lower value of  $\theta_1(t)$  and  $\theta_2(t)$  and the corresponding control actions. A detailed description of the online control algorithm is given in Algorithm 1.

**C. Performance Analysis**

In this section, we analyze the feasibility and performance of our online control algorithm. We define an upper bound  $V^{\text{max}}$  on parameter  $V$  as follows:

$$V^{\text{max}} = \frac{B^{\text{max}} - P_B^{\text{max}} - P_B^{\text{min}}}{c^{\text{max}} + 2\beta L^{\text{max}}}. \quad (30)$$

Next, the optimal solution to **P4** has the following properties that are useful for the performance analysis.

**Lemma 3:** The optimal solution to **P4** has the following properties.

- 1) If  $U(t) \geq 0$ , then  $P_B^*(t) \leq 0$ .
- 2) If  $U(t) \leq -V(c^{\text{max}} + 2\beta L^{\text{max}})$ , then  $P_B^*(t) \geq 0$ .

*Proof:* If  $U(t) \geq 0$ , then  $P_B^*(t)$  can be either  $LB$  or  $-\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta}$ . Since  $LB \leq 0$  and  $-\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta} \leq 0$ , we have  $P_B^*(t) \leq 0$ .

If  $U(t) \leq -V(c^{\text{max}} + 2\beta L^{\text{max}})$ , then  $P_B^*(t)$  can be either  $UB$  or  $-\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta}$ . Since  $UB \geq 0$  and  $-\frac{U(t)+V(c(t)+2\beta L(t))}{2V\beta} \geq 0$ , we have  $P_B^*(t) \geq 0$ . ■

Then, we have the following results.

**Theorem 1:** Suppose the initial battery charge level  $B_{\text{init}}$  satisfies  $0 \leq B_{\text{init}} \leq B^{\text{max}}$ . Implementing the above online control algorithm with any fixed parameter  $0 < V \leq V^{\text{max}}$  for all  $t$ , we have the following performance guarantees.

- 1) The battery energy level  $B(t)$  is always in the range  $0 \leq B(t) \leq B^{\text{max}}$  for all  $t$ .
- 2) All control decisions are feasible for **P1**.
- 3) If  $L(t)$  and  $c(t)$  are *i.i.d.* over slots, then the time-average expected cost under the proposed online control algorithm is within  $K/V$  of the optimal value

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E} \left\{ c(\tau)P(\tau) + \mathbf{1}_B(\tau)C_B + \beta P(\tau)^2 \right\} \leq \phi_{\text{rel}} + \frac{K}{V} \quad (31)$$

where  $K$  is a constant given in (26).

*Proof:* 1) *Proof of Part 1:* To show  $0 \leq B(t) \leq B^{\text{max}}$  for all  $t$ , it suffices to show that  $-V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}} \leq U(t) \leq B^{\text{max}} - V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$  for all  $t$ , according to (22). As  $0 \leq B_{\text{init}} \leq B^{\text{max}}$ , it is easy to verify  $-V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}} \leq U(1) \leq B^{\text{max}} - V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$ .

Then, we show  $-V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}} \leq U(t) \leq B^{\text{max}} - V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$  by induction. Suppose that  $-V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}} \leq U(t) \leq B^{\text{max}} - V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$  holds for slot  $t$ . We need to show that it also holds for slot  $t+1$ .

First, if  $0 \leq U(t) \leq B^{\text{max}} - V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$ , then  $P_B^*(t) \leq 0$  based on Lemma 3. Therefore, using (22), we have  $U(t+1) \leq U(t) \leq B^{\text{max}} - V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$ . If  $U(t) \leq 0$ , then  $U(t+1) \leq P_B^{\text{max}}$  based on (22), since the maximum charging rate is  $P_B^{\text{max}}$ . Using (30), for any  $0 < V \leq V^{\text{max}}$  we have  $B^{\text{max}} - P_B^{\text{min}} - V(c^{\text{max}} + 2\beta L^{\text{max}}) \geq B^{\text{max}} - P_B^{\text{min}} - V^{\text{max}}(c^{\text{max}} + 2\beta L^{\text{max}}) = P_B^{\text{max}}$ . Therefore, we have  $U(t+1) \leq B^{\text{max}} - P_B^{\text{min}} - V(c^{\text{max}} + 2\beta L^{\text{max}})$ .

Second, if  $-V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}} \leq U(t) \leq -V(c^{\text{max}} + 2\beta L^{\text{max}})$ , then  $P_B^*(t) \geq 0$  based on Lemma 3. Then, using (22), we have  $U(t+1) \geq U(t) \geq -V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$ . If  $U(t) \geq -V(c^{\text{max}} + 2\beta L^{\text{max}})$ , then  $U(t+1) \geq -V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}}$  based on (22), since the maximum discharging rate is  $P_B^{\text{min}}$ . Therefore, we have  $-V(c^{\text{max}} + 2\beta L^{\text{max}}) - P_B^{\text{min}} \leq U(t+1)$ , which concludes the proof.

2) *Proof of Part 2:* From the proof above, the constraint on  $B(t)$  is satisfied for all  $t$ . Since the control decisions we make satisfy all the constraints in **P3**, with  $0 \leq B(t) \leq B^{\text{max}}$  for all  $t$ , all the constraints in **P1** are also satisfied. Therefore, our control decisions are feasible for **P1**.

3) *Proof of Part 3:* The proposed online control algorithm is designed to minimize the right-hand-side of (25) over all possible feasible control policies, including the optimal, stationary policy given in Lemma 1. Therefore, we have the following:

$$\Delta(U(t)) + V\mathbb{E}\{c(t)P(t) + \mathbf{1}_B(t)C_B + \beta P(t)^2 | U(t)\} \leq K + V\mathbb{E}\{c(t)P^{\text{stat}}(t) + \mathbf{1}_{P_B^{\text{stat}}(t) \neq 0}(t)C_B + \beta P^{\text{stat}}(t)^2 | U(t)\}.$$

Taking the expectation of both sides, using the law of iterative expectation, and summing over all  $t$ , we have

$$V \sum_{\tau=1}^t \mathbb{E} \{ c(\tau)P(\tau) + \mathbf{1}_B(\tau)C_B + \beta P(\tau)^2 \} \leq Kt + Vt\phi_{rel} - \mathbb{E}\{Z(U(t))\} + \mathbb{E}\{Z(U(1))\}.$$

Dividing both sides by  $Vt$ , taking the limit as  $t \rightarrow \infty$  and using the facts that  $\mathbb{E}\{Z(U(t))\}$  is finite and  $\mathbb{E}\{Z(U(1))\}$  is nonnegative, we have

$$\lim_{t \rightarrow \infty} \frac{1}{t} \sum_{\tau=1}^t \mathbb{E} \{ c(\tau)P(\tau) + \mathbf{1}_B(\tau)C_B + \beta P(\tau)^2 \} \leq \phi_{rel} + \frac{K}{V}.$$

Theorem 1 shows that by choosing a larger  $V$ , the time-average expected cost under the proposed online control algorithm can be pushed closer to the optimal solution to **P1**. Since  $V^{\max}$  is determined by the battery capacity, (31) quantifies the impact of the battery capacity on the performance of the proposed online control algorithm. The larger the battery capacity is, the better the proposed online control algorithm can optimize smart meter data privacy and the cost of electricity.

*Remarks:* Note that Theorem 1 holds for all sample paths, including sample paths generated by  $L(t)$  and  $c(t)$  that are non *i.i.d.* over slots. The proposed online control algorithm can be applied to non *i.i.d.* scenarios, as demonstrated in Section V, where numerical studies are carried out in non *i.i.d.* environments. Our results can be generalized for the non *i.i.d.* case by using the delayed Lyapunov drift and  $T$  slot drift techniques developed in [16] and [17].

## V. CASE STUDIES

### A. Data and Simulation Setting

We evaluate the performance of the proposed algorithm by using the real-time measurements at a Georgian apartment [9] and the load profile constructed based on a domestic electricity demand model [23]. The time resolution of the load profile is one-minute. The actual load profile given by the real-time measurements represents the case in which the power usage is high, while the constructed load profile based on the domestic electricity demand model [23] represents the case in which the power usage is low. The electricity prices are set according to SRPs residential time-of-use price plan [24]. The on-peak price is 21.09 cent per kWh during 1:00 PM to 8:00 PM, while the off-peak price is 7.04 cent per kWh for the remaining time of a day. In the simulation, we fix the parameters  $P_B^{\min} = P_B^{\max} = 6$  kW,  $P^{\max} = 10$  kW and  $C_B = 0.1$  cent.

### B. Privacy Protection and Power Cost Saving

Based on the two data sets, Fig. 2 compares load profiles given by our algorithm under different values of  $\beta$ . As discussed in Section III,  $\beta$  strikes a tradeoff between the cost of electricity and smart meter data privacy. As illustrated in Fig. 2, when  $\beta = 1$ , the proposed algorithm smooths out the original load profile and the appliance switch-on/off events are masked accordingly. Fig. 3 takes a closer look at the

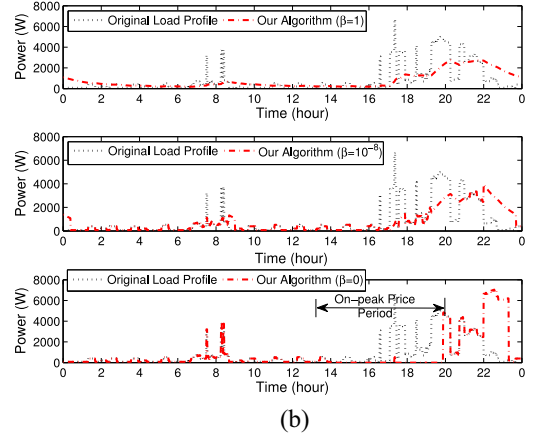
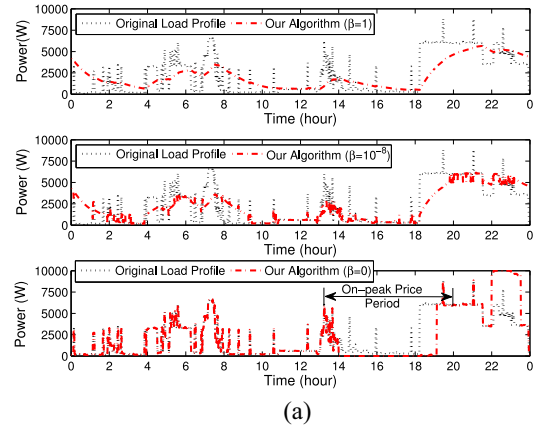


Fig. 2. Comparison of load profiles given by our algorithm under different values of  $\beta$ , where  $B^{\max} = 12$  kWh, and  $V = V^{\max}$ . (a) Actual load profile. (b) Constructed load profile.

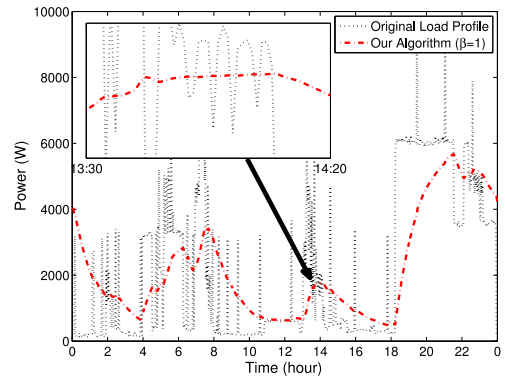


Fig. 3. Load profile given by our algorithm for the actual load profile, where  $\beta = 1$ ,  $B^{\max} = 12$  kWh, and  $V = V^{\max}$ .

load profile given by our algorithm during the period between 13:30 and 14:20, in which the fast-time-scale fluctuations in the original load profile due to the appliance switch-on/off events are smoothed out. However, one can still observe the slow-time-scale fluctuations in Fig. 3, which are due to the small capacity of the battery. With a larger battery capacity, the slow-time-scale fluctuations in Fig. 3 can be smoothed out. Fig. 4 illustrates the load profile provided by the proposed algorithm when  $B^{\max} = 100$  kWh and  $\beta = 1$ , where the slow-time-scale fluctuations are smoothed out.

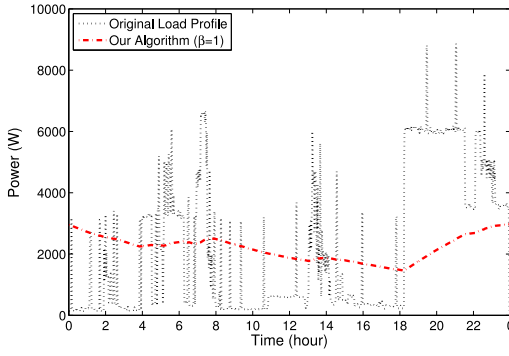


Fig. 4. Load profile given by our algorithm for the actual load profile, where  $\beta = 1$ ,  $B^{\max} = 100$  kWh, and  $V = V^{\max}$ .

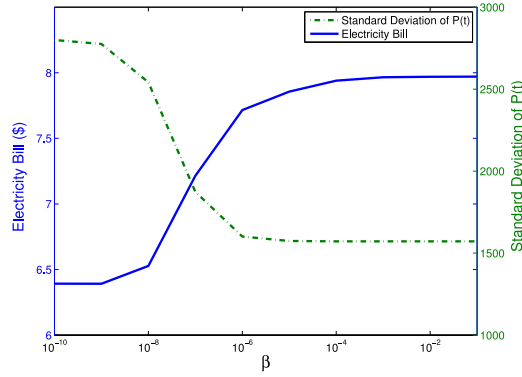


Fig. 5. Tradeoff between the cost of electricity and privacy protection under different values of  $\beta$  using the actual load profile, where  $B^{\max} = 12$  kWh, and  $V = V^{\max}$ .

When  $\beta = 0$ , our algorithm minimizes only the cost of electricity. As shown in Fig. 2, the proposed algorithm stores the energy in the battery in the off-peak price period and uses the energy in the battery as much as possible in the on-peak price period to reduce the cost of electricity.

Fig. 5 illustrates the tradeoff between the cost of electricity and smart meter data privacy under different values of  $\beta$  using the actual load profile. In Fig. 5, the privacy protection is quantified by using the standard deviation of  $P(t)$  given by the proposed algorithm. As  $\beta$  increases, the proposed algorithm focuses more on data privacy, and the resulting  $P(t)$  becomes more “flat.” Accordingly, the cost of electricity increases with  $\beta$ . Fig. 5 can be used for the user to determine the value of  $\beta$  that he or she would consider appropriate.

### C. Privacy Protection Versus Battery Capacity

As discussed, the privacy information is contained in appliance switch-on/off events, i.e., the differences between successive power measurements. Let  $dP(t) = P(t) - P(t-1)$  represent the difference between successive power measurements. NILM algorithms (see [18]–[20]) explore the differences between successive power measurements to identify the appliance switch-on/off events. These differences are called features. In Table I, we compare the number of features in the load profiles given by the proposed online control algorithm under different values of  $\beta$  and battery capacity  $B^{\max}$  with the NILL

TABLE I  
FEATURE REDUCTION BY DIFFERENT ALGORITHMS

Online Control Algorithm		
$\beta$	$B^{\max} = 12$ kWh	$B^{\max} = 24$ kWh
0	343	331
$10^{-8}$	317	206
$10^{-7}$	130	79
$10^{-6}$	60	14
$10^{-5}$	37	2
Non-intrusive Load Leveling Algorithm [10]		
	$B^{\max} = 12$ kWh	$B^{\max} = 24$ kWh
Number of features	19	12
Best-Effort Algorithm [9]		
	$B^{\max} = 12$ kWh	$B^{\max} = 24$ kWh
Number of features	11	4
Original Load Profile		
Number of features	393	

algorithm [10] and the best-effort algorithm [9], in which the differences less than 50 W (lights) are not accounted for. From Table I, it is observed that features are significantly reduced by the proposed online control algorithm as  $\beta$  increases. When  $\beta = 10^{-5}$  and  $B^{\max} = 24$  kWh, only two features are left, compared with 393 features in the original load profile. Although in terms of feature reduction, the NILL algorithm [10] and the best-effort algorithm [9] can perform comparable to the proposed online control algorithm, the system cost given by the proposed online control algorithm is much lower than these algorithms as demonstrated in the next section. Moreover, as pointed out in [14], the methods proposed in [9] and [10] suffer from precise load change recovery attacks such that the original load profile can be recovered using the leakage of load-change information from these algorithms. In contrast, the proposed online control algorithm determines the observed load profile by solving a well-designed optimization problem with unobservable parameters ( $U(t)$ ,  $V$ , and  $\beta$ ), without which the original load profile cannot be recovered.

### D. System Cost Versus Battery Capacity

We now study the impact of the battery capacity on the performance of the proposed algorithm. As shown in Theorem 1, the system cost under the proposed online control algorithm converges to the optimal value as the battery capacity increases. Based on (30), if the electricity price is given,  $V^{\max}$  is determined by the battery capacity. For different values of the battery capacity, the system cost is evaluated by using the actual load profile. To examine the convergence of the proposed algorithm, the system cost given by the proposed algorithm is normalized by the optimal offline solution to **P1**. The optimal offline solution to **P1** is solved by assuming that the load profile and the electricity price are known perfectly. Fig. 6 compares the normalized system cost given by the proposed algorithm with the NILL algorithm [10] and the best-effort algorithm [9]. As illustrated in Fig. 6, the normalized system cost given by the proposed algorithm decreases with the battery capacity, and converges to 1, indicating that it converges to the optimal system cost. Furthermore, it is observed from Fig. 6 that the performance



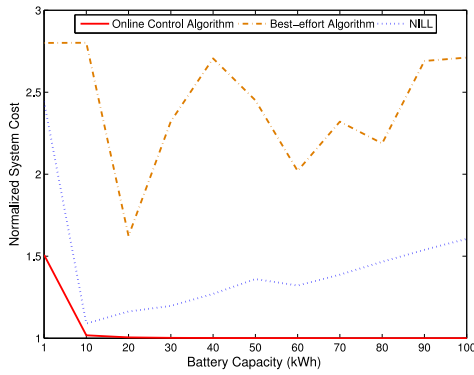


Fig. 6. System cost under different values of the battery capacity, where  $\beta = 1$  and  $V = V^{\max}$  for each value of the battery capacity.

of the proposed algorithm with a battery of small capacity is reasonably good. When the battery capacity is 10 kWh, the system cost given by the proposed algorithm is very close to the optimal solution. However, the system costs given by the NILL algorithm [10] and the best-effort algorithm [9] are much higher than the proposed algorithm, and do not converge to the optimal value with the increase of the battery capacity.

## VI. CONCLUSION

This paper has studied cost-effective smart meter data privacy protection by using batteries. A dynamic programming framework has been designed for consumers to jointly protect smart meter data privacy and reduce the cost of the electricity. By exploring the underlying structure of the original problem, an equivalent problem has been derived, which can be solved by using only the current observations. Then an online control algorithm has been developed to solve the equivalent problem based on the Lyapunov optimization technique. It has been shown that without requiring any knowledge of the statistics of the load requirements and electricity prices, the proposed online control algorithm is within  $O(1/V)$  of the optimal solution to the original problem, where the maximum value of  $V$  is limited by the battery capacity. Using real data, numerical results have corroborated that our algorithm can protect smart meter data privacy in a cost-effective manner.


For future work, it is of great interest to integrate demand response management into the current framework. Another interesting direction is to integrate renewable generation into the energy management to protect smart meter data privacy as considered in [12].

## ACKNOWLEDGMENT

The authors would like to thank Dr. G. Kalogridis from Toshiba Research Europe Limited, Telecommunications Research Laboratory, for providing the data of the real-time measurements at a Georgian apartment used in this paper.

## REFERENCES

- [1] X. Fang, S. Misra, G. Xue, and D. Yang, "Smart grid—The new and improved power grid: A survey," *IEEE Commun. Surveys Tuts.*, vol. 14, no. 4, pp. 944–980, Oct. 2012.
- [2] L. Yang, J. Zhang, and D. Qian, "Risk-aware day-ahead scheduling and real-time dispatch for plug-in electric vehicles," in *Proc. IEEE Global Commun. Conf.*, Anaheim, CA, USA, 2012, pp. 3026–3031.
- [3] L. Yang, J. Zhang, and H. V. Poor, "Risk-aware day-ahead scheduling and real-time dispatch for electric vehicle charging," *IEEE Trans. Smart Grid*, vol. 5, no. 2, pp. 693–702, Mar. 2014.
- [4] Y. Yuan, Z. Li, and K. Ren, "Modeling load redistribution attacks in power systems," *IEEE Trans. Smart Grid*, vol. 2, no. 2, pp. 382–390, Jun. 2011.
- [5] E. Quinn, "Smart metering and privacy: Existing laws and competing policies," A Report for the Colorado Public Utilities Commission, Electronic Frontier Foundation, 2009.
- [6] A. Molina-Markham, P. Shenoy, K. Fu, E. Cecchet, and D. Irwin, "Private memoirs of a smart meter," in *Proc. ACM BuildSys*, Zurich, Switzerland, 2010, pp. 61–66.
- [7] S. Papadimitriou, F. Li, G. Kollios, and P. S. Yu, "Time series compressibility and privacy," in *Proc. 33rd Int. Conf. Very Large Data Bases*, Vienna, Austria, 2007, pp. 459–470.
- [8] L. Sankar, S. R. Rajagopalan, S. Mohajer, and H. V. Poor, "Smart meter privacy: A theoretical framework," *IEEE Trans. Smart Grid*, vol. 4, no. 2, pp. 837–846, Jun. 2013.
- [9] G. Kalogridis, C. Efthymiou, S. Denic, T. Lewis, and R. Cepeda, "Privacy for smart meters: Towards undetectable appliance load signatures," in *Proc. IEEE SmartGridComm*, Gaithersburg, MD, USA, 2010, pp. 232–237.
- [10] S. McLaughlin, P. McDaniel, and W. Aiello, "Protecting consumer privacy from electric load monitoring," in *Proc. ACM CCS*, Chicago, IL, USA, 2011, pp. 87–98.
- [11] J. Koo, X. Lin, and S. Bagchi, "PRIVATUS: Wallet-friendly privacy protection for smart meters," in *Proc. 17th Eur. Symp. Res. Comp. Security*, Pisa, Italy, 2012, pp. 343–360.
- [12] O. Tan, D. Gündüz, and H. V. Poor, "Increasing smart meter privacy through energy harvesting and storage devices," *IEEE J. Sel. Areas Commun. Smart Grid Commun.*, vol. 31, no. 7, pp. 1331–1341, Jul. 2013.
- [13] Z. Chen and L. Wu, "Residential appliance DR energy management with electric privacy protection by online stochastic optimization," *IEEE Trans. Smart Grid*, vol. 4, no. 4, pp. 1861–1869, Dec. 2013.
- [14] W. Yang et al., "Minimizing private data disclosures in the smart grid," in *Proc. ACM CCS*, 2012, pp. 415–427.
- [15] L. Yang, X. Chen, J. Zhang, and H. V. Poor, "Optimal privacy-preserving energy management for smart meters," in *Proc. IEEE INFOCOM*, 2014, pp. 513–521.
- [16] L. Georgiadis, M. J. Neely, and L. Tassiulas, "Resource allocation and cross-layer control in wireless networks," *Found. Trends Netw.*, vol. 1, no. 1, pp. 1–149, Apr. 2006.
- [17] M. J. Neely, "Stochastic network optimization with application to communication and queueing systems," *Synthesis Lect. Commun. Netw.*, vol. 3, no. 1, pp. 1–211, 2010.
- [18] M. Marceau and R. Zmeureanu, "Nonintrusive load disaggregation computer program to estimate the energy consumption of major end uses in residential buildings," *Energy Convers. Manage.*, vol. 41, no. 13, pp. 1389–1403, Sep. 2000.
- [19] F. Sultanem, "Using appliance signatures for monitoring residential loads at meter panel level," *IEEE Trans. Power Del.*, vol. 6, no. 4, pp. 1380–1385, Oct. 1991.
- [20] A. Prudenzi, "A neuron nets based procedure for identifying domestic appliances pattern-of-use from energy recordings at meter panel," in *Proc. IEEE Power Eng. Soc. Winter Meeting*, 2002, pp. 941–946.
- [21] R. Uргаonkar, B. Uргаonkar, M. Neely, and A. Sivasubramaniam, "Protecting consumer privacy from electric load monitoring," in *Proc. of ACM Sigmetrics*, 2011, pp. 221–232.
- [22] S. P. Boyd and L. Vandenberghe, *Convex Optimization*. Cambridge, U.K.: Cambridge Univ. Press, 2004.
- [23] I. Richardson, A. Thomson, D. Infield, and C. Clifford, "Domestic electricity use: A high-resolution energy demand model," *Energ. Buildings*, vol. 42, pp. 1878–1887, Oct. 2010.
- [24] (2013, Jul. 26). *SRP Time-of-Use Price Plans* [Online]. Available: <http://www.srpnet.com/prices/home/toufaq.aspx>



**Lei Yang** (M'13) received the B.S. and M.S. degrees in electrical engineering from Southeast University, Nanjing, China, in 2005 and 2008, respectively, and the Ph.D. degree from the School of Electrical, Computer, and Energy Engineering, Arizona State University, Tempe, AZ, USA, in 2012.

He is currently a Post-Doctoral Scholar with Princeton University, Princeton, NJ, USA. He has been an Assistant Research Professor at the School of Electrical, Computer, and Energy Engineering, Arizona State University, since 2013. His current

research interests include stochastic optimization and big data analytics for renewable energy integration, grid integration of plug-in electric vehicle, networked control of cyber-physical systems, modeling and control of power systems, network security and privacy, network optimization and control, and cognitive radio.

Dr. Yang was the recipient of the Best Paper Runner-up Award of IEEE International Conference on Computer Communications in 2014.



**Xu Chen** (S'10–M'12) received the B.Eng. degree in electronic engineering from the South China University of Technology, Guangzhou, China, in 2008, and the Ph.D. degree in information engineering from the Chinese University of Hong Kong, Hong Kong, in 2012.

From 2012 to 2014, he was a Post-Doctoral Research Fellow at the School of Electrical, Computer, and Energy Engineering, Arizona State University, Tempe, AZ, USA. Since 2014, he has been a Humboldt Scholar Fellow at the University of

Göttingen, Göttingen, Germany. His current research interests include mobile social networks, mobile computing and networking, cognitive radio networks, wireless resource allocation, and game theory.

Dr. Chen was the recipient of the Best Paper Runner-up Award of the IEEE International Conference on Computer Communications 2014, and the Honorable Mention Award of the IEEE International Conference on Intelligence and Security Informatics 2010.



**Junshan Zhang** (F'12) received the Ph.D. degree from the School of Electrical and Computer Engineering at Purdue University, West Lafayette, IN, USA, in 2000.

He joined the School of Electrical, Computer, and Energy Engineering, Arizona State University, Tempe, AZ, USA, in 2000, where he has been a Professor since 2010. His current research interests include cyber-physical systems, communications networks, network science, fundamental problems in information networks and energy networks,

including modeling and optimization for smart grid, network optimization/control, mobile social networks, crowdsourcing, cognitive radio, and network information theory.

Prof. Zhang was the recipient of the Office of Naval Research Young Investigator Award in 2005, the National Science Foundation CAREER award in 2003, and the Outstanding Research Award from the IEEE Phoenix Section in 2003. He has co-authored a paper that won IEEE International Conference on Communications 2008 Best Paper Award and two papers that won the Best Paper Runner-up Award of IEEE INFOCOM 2009 and IEEE INFOCOM 2014. He was a Technical Program Committee (TPC) Co-Chair for a number of major conferences in communication networks, including INFOCOM 2012, IEEE/CIC International Conference on Communications in China 2012, International Wireless Internet Conference 2008, and International Performance Computing and Communications Conference (IPCCC'06), and TPC Vice Chair for International Conference on Computer Communications and Networks (ICCCN'06). He was the General Chair for the IEEE Communication Theory Workshop 2007. He was an Associate Editor for the IEEE TRANSACTIONS ON WIRELESS COMMUNICATIONS, an Editor for the *Computer Network Journal*, and an Editor for the IEEE WIRELESS COMMUNICATION MAGAZINE. He is currently serving as an Editor-at-Large for the IEEE/ACM TRANSACTIONS ON NETWORKING and an Editor for *IEEE Network Magazine*. He is also a Distinguished Lecturer of the IEEE Communications Society.



**H. Vincent Poor** (S'72–M'77–SM'82–F'87) received the Ph.D. degree in Electrical Engineering and Computer Science from Princeton University, Princeton, NJ, USA, in 1977.

From 1977 to 1990, he was on the faculty of the University of Illinois at Urbana-Champaign, Urbana, IL, USA. Since 1990, he has been on the Faculty at Princeton University, where he is the Michael Henry Strater University Professor of Electrical Engineering, and the Dean of the School of Engineering and Applied Science. His current

research interests include the areas of stochastic analysis, statistical signal processing, information theory, and their applications in wireless networks and related fields, such as social networks and smart grid. Among his publications in these areas are the recent books *Principles of Cognitive Radio* (Cambridge, 2013) and *Mechanisms and Games for Dynamic Spectrum Allocation* (Cambridge University Press, 2014).

Dr. Poor was the recipient of a Guggenheim Fellowship in 2002 and the IEEE Education Medal in 2005. He is a member of the National Academy of Engineering, the National Academy of Sciences, and a Foreign Member of Academia Europaea and the Royal Society. He is also a Fellow of the American Academy of Arts and Sciences, the Royal Academy of Engineering, U.K., and the Royal Society of Edinburgh. In 1990, he served as a President of the IEEE Information Theory Society, and from 2004 to 2007, he served as the Editor-in-Chief with the IEEE TRANSACTIONS ON INFORMATION THEORY. Recent recognition of his work includes the 2014 International Scientific Radio Union Booker Gold Medal, and honorary doctorates from Aalborg University, Aalborg, Denmark; the Hong Kong University of Science and Technology, Hong Kong; and the University of Edinburgh, Edinburgh, U.K.