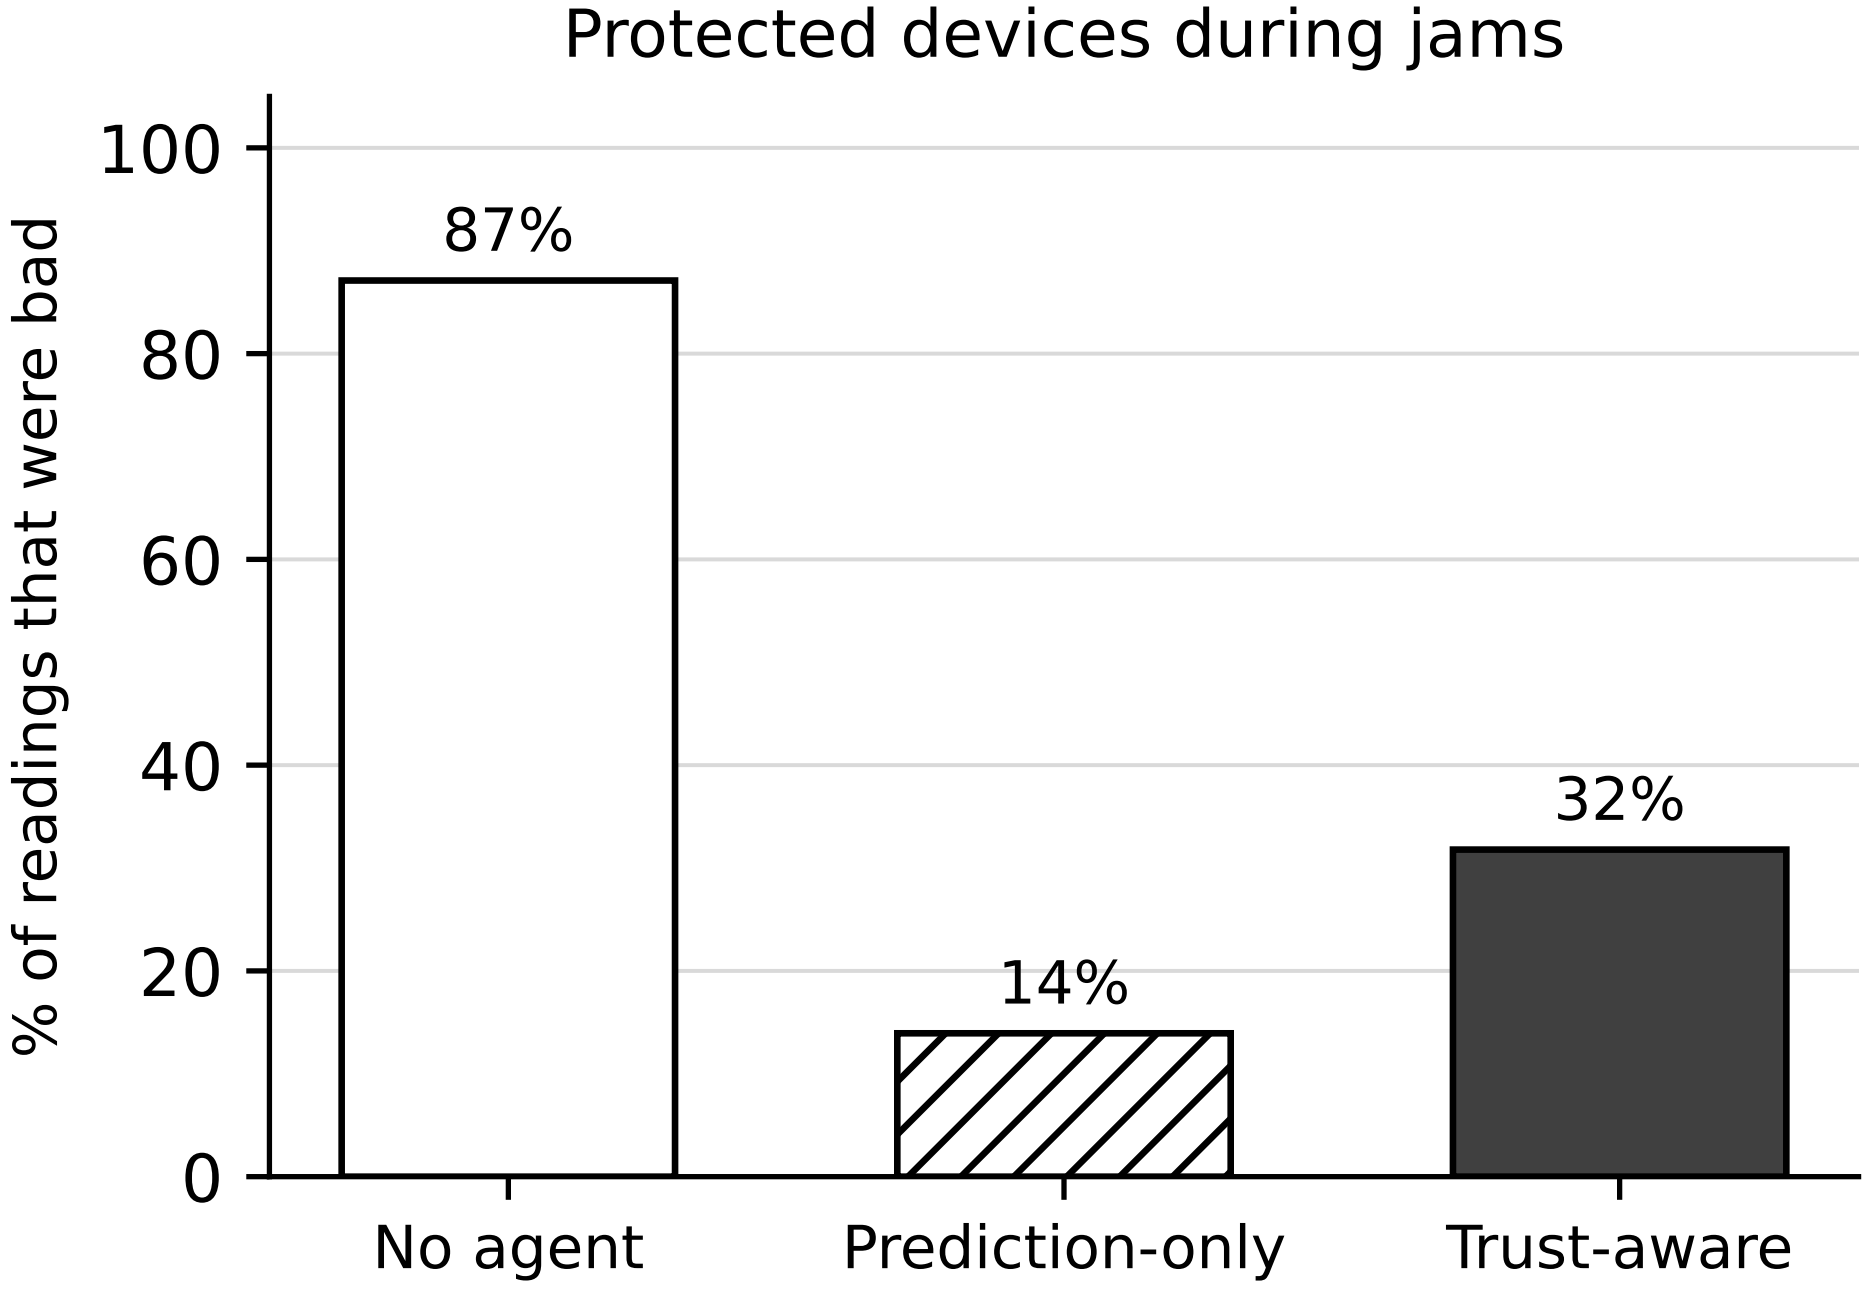
Protected devices during jams
% of readings that were bad
100
80
60
40
20
0
87%
14%
32%
No agent
Prediction-only
Trust-aware