



Lidl US, LLC
3500 S. Clark St.
Arlington , Virginia 22202
P: (571) 398-5435

Project: 1517 Norcross GA - Jimmy Carter Blvd
4990 Jimmy Carter Blvd
Norcross, Georgia 30093

Submittal #33-1.0 - Fire Main 33 - UTILITIES

Revision	0	Submittal Manager	Christopher Manes (21327198 CHA Consulting, INC.)
Status	Open	Date Created	Aug 26, 2026
Issue Date	Aug 26, 2026	Spec Section	33 - UTILITIES
Responsible Contractor	Place Services Inc.	Received From	Luis Marcelino (Place Services Inc.)
Received Date	Aug 31, 2026	Submit By	Aug 26, 2026
Final Due Date		Lead Time	
		Cost Code	
Location		Type	Cutsheet
Submittal Package	#1: Site Utilities Submittal Package		
Approvers			
Ball in Court	Christopher Manes (21327198 CHA Consulting, INC.)		
Distribution	Bobby McTeague (Place Services Inc.), Christopher Manes (21327198 CHA Consulting, INC.), JaWanna English-Neal (21327198 CHA Consulting, INC.), Jeff Belyea (21327198 CHA Consulting, INC.), Jens Byer (28101155 Lidl US, LLC), Tim Mauldin (Place Services Inc.), Tucker Teague (Place Services Inc.)		
Description			

Submittal Workflow

Name	Sent Date	Due Date	Returned Date	Response	Attachments
General Information Attachments					

Lidl 1517 Norcross, GA - Ground Up

4990 Jimmy Carter Blvd. Norcorss, GA 30093

Report generated by Luis Marcelino (Place Services, Inc.)



Submittal #PSI-0001 - Site Utility Submittal Package

Creator	Luis Marcelino (Place Services, Inc.)	Submission due	-
Assignee	Tucker Teague (Place Services, Inc.)	Response due	09/11/2026
Reviewers	-	Closed on	-
Status	Pending approval	Reference number	-
Type	Other	Specification	-
Description	-		

Approval (rev. 0)

Responded by	-	Responded on	-
Response	-		
Notes	-		
Attachments	-		

Submission (rev. 0)

Submitted by	Luis Marcelino (Place Services, Inc.)	Submitted on	08/26/2026
Notes	-		
Attachments	PDF attachments are included in this export. Lidl #1517 - Submittals Water, Fire, Sanitary, Storm - Coles Construction.pdf (Page 2)		

SUBMITTAL PACKAGE

Lidl Grocery Store #1517

4990 Jimmy Carter Blvd, Norcross, GA 30093 — Gwinnett County

Prepared By: Coles Construction
Contact: Clay Hotchkiss, Preconstruction Manager | 470-495-7547
Submitted To: GC Grocery Construction (Place Services Inc.)
Attn: Luis Marcelino / Tucker Teague
Scope: Site Utility Submittals – Storm, Sanitary Sewer, Domestic Water & Fire Main (Core & Main)

Table of Contents

Section	Pages
1. Storm – HDPE Pipe	2–5
2. Sanitary Sewer – Pipe & Fittings, Cleanouts, Heavy Duty Covers	6–17
3. Domestic Water & Irrigation – Pipe & Fittings, Tap Assemblies, DCV Assembly, Irrigation, RPZ Assembly	18–51
4. Fire Main – Pipe & Fittings, Tap Assembly, Fire Hydrant, DCDA BFP Vault, Post Indicator Valve, Gate Valve Assembly	52–89

Coles Construction | Civil Site Development & General Contracting

Total Pages in Package: 89

SHOP DRAWING / SUBMITTAL REVIEW

- ☒ NO EXCEPTION TAKEN
☐ REVISE AND RESUBMIT
☐ MAKE CORRECTIONS NOTED
☐ REJECTED

SUBMITTAL WAS REVIEWED FOR DESIGN CONFORMITY AND GENERAL CONFORMANCE TO CONTRACT DOCUMENTS ONLY. THE CONTRACTOR IS RESPONSABLE FOR CONFIRMING AND CORRELATING DIMENSIO SN AT JOBSITE FOR TOLERANCE, CLEARNACE, QUANTITIES, FABRICATION PROCESSES AND TECHNIQUES OF CONSTRUCTION, COORDIINATION OF HIS WORK WITH OTHER TRADES AND FULL COMPLIANCE WITH CONTRACT DOCUMENTS.

By: Luis Marcelino

Date: 08/26/2026

Place Services, Inc
Canton, GA 30115

Submittal Documents

LIDL 1517



Overview

Bid Date: 08-25-2026
Bid Number: 5166172

Section

FIRE MAIN

Submittal Documents

LIDL 1517



Overview

Bid Date: 08-25-2026
Bid Number: 5166172

Section

PIPE & FITTINGS

ANSI/AWWA STANDARDS

ANSI/AWWA C151/A21.5, Ductile Iron Pipe, Centrifugally Cast for Water.

Ductile Iron Tyton Joint Pipe is centrifugally cast in metal molds in accordance with ANSI/AWWA C151/A21.5.

The asphaltic outside coating is in accordance with ANSI/AWWA C151/A21.51.

As specified in ANSI/AWWA C151/A21.51, pipe weights have been calculated using standard barrel weights and weights of bells being produced.

ANSI/AWWA C104/A21.4, Cement-Mortar Lining for Ductile-Iron Pipe and Fittings for Water.

The cement-mortar lining and inside coating are in accordance with ANSI/AWWA C104/ A21.4. Special linings and/or coatings can be furnished for specific conditions.

ANSI/AWWA C111/A21.11, Rubber-Gasket Joints for Ductile-Iron Pressure Pipe and Fittings.

Tyton Gaskets are furnished in accordance with ANSI/AWWA C111/A21.11.

ANSI/AWWA C105/A21.5, Polyethylene Encasement for Ductile Iron Pipe Systems.

If specifiers and users believe that corrosive soils will be encountered where our products are to be installed, please refer to ANSI/AWWA C105/A21.5, for proper external protection procedures.

ASTM A746-03 "Standard specification for Ductile Iron Gravity Sewer Pipe."**ASTM A716-08 "Standard Specification for Ductile Iron Culvert Pipe."****ASTM A536 "Standard Specification for Ductile Iron Castings."**

Tyton Joint is U.S. Pipe's trademark for pipe with a push-on type connection. Simplicity, sturdiness and watertightness are built into the system by design. Convincing proof of its worldwide acceptance is shown by the fact that more than 95% of the pipe now sold by U.S. Pipe is Tyton Joint.

Tyton Joint Pipe is available in sizes 3" through 64". Sizes 3" through 42" are available in nominal 18-foot laying lengths. 4" through 30" sizes, along with sizes 48" through 64", are available in nominal 20-foot laying lengths.

Tyton Joint Pipe in sizes 4" through 36" are UL listed, and sizes 4" through 16" are FM Approved.

When Tyton Joint Pipe is used for bridge crossings or other above-ground installations, each length of pipe must be supported in a manner to restrict both vertical and horizontal movement.

A Tyton Gasket is the only accessory required when installing Tyton Joint Pipe. It is a circular rubber gasket that has a modified bulb shape in cross section. Gaskets are furnished in accordance with ANSI/AWWA C111/ A21.1. Composition and dimensions of the gasket have been carefully engineered to ensure a watertight and lasting seal. The standard Tyton Gasket is manufactured of SBR — styrene butadiene rubber. Gaskets of special elastomers may be ordered for special applications. The gasket contour and bell socket contour ensure that the gasket will remain seated during proper assembly of the pipe. When joint restraint is required for push-on joint pipe, two options are available from U.S. Pipe. For joint restraint of 4" through 24", Field Lok 350 Gaskets may be used. Field Lok 350 Gaskets are rated for 350 psi in sizes 4" through 24". In addition, for 4" through 36" sizes, TR Flex Pipe and Fittings may be used, and for 30" through 64" sizes, HP Lok Pipe and Fittings may be used. TR Flex Pipe and Fittings are rated for working pressures for 350 psi in 4" through 24" sizes, 250 psi in sizes 30" through 36". For HP Lok Pipe and Fittings, the working pressure is 350 psi for 30" through 64". For higher pressure applications contact your U.S. Pipe representative. Complete details on Field Lok 350 Gaskets, TR Flex Pipe and Fittings, and HP Lok Pipe and Fittings can be found on our website, www.uspipe.com.

Tyton joint pipe is NSF/ANSI 61 Certified for drinking water system components.

NOTE: U.S. Pipe qualifies for Federal Procurement under Public Law No. 94-580, Section 6002, known as the Resource Recovery Act of 1976, since, due to modern technology, recycled iron and steel scrap are used to a large degree in our Ductile Iron Pipe production.

The plain end of the pipe is furnished beveled or with a quarter ellipse on the edge to allow assembly. More than 40 years of successful experience have proved its sealing capabilities. Hydrostatic tests have shown that the system will withstand pressures far in excess of rated pressures.

NOTE: Each of the following is a nationally recognized standards organization: American National Standards Institute (ANSI), American Water Works Association (AWWA), American Society for Testing and Materials (ASTM), Underwriters Laboratories (UL), National Fire Protection Association (NFPA), National Sanitation Foundation (NSF), Factory Mutual (FM)

SPECIFICATIONS

PRESSURE CLASS (Thickness, Dimension & Weight)

INCHES	PSI	INCHES		POUNDS		
SIZE	PRESSURE CLASS	THICKNESS	OUTSIDE DIAMETER ^a	BARREL WEIGHT PER FOOT	WEIGHT PER LAYING LENGTH ^b	
					18-FOOT	20-FOOT
3	—	—	—	—	—	—
4	350	0.25	4.80	10.9	205	230
6	350	0.25	6.90	16.0	305	335
8	350	0.25	9.05	21.1	400	445
10	350	0.26	11.10	27.1	515	570
12	350	0.28	13.20	34.8	660	730
14	250	0.28	15.30	40.4	780	865
14	300	0.30	15.30	43.3	920	1010
14	350	0.31	15.30	44.7	860	945
16	250	0.30	17.40	49.3	950	1050
16	300	0.32	17.40	52.5	1010	1115
16	350	0.34	17.40	55.8	1065	1175
18	250	0.31	19.50	57.2	1095	1210
18	300	0.34	19.50	62.6	1195	1320
18	350	0.36	19.50	66.2	1260	1390
20	250	0.33	21.60	67.5	1285	1420
20	300	0.36	21.60	73.5	1395	1540
20	350	0.38	21.60	77.5	1465	1620
24	200	0.33	25.80	80.8	1550	1710
24	250	0.37	25.80	90.5	1725	1905
24	300	0.40	25.80	97.7	1855	2050
24	350	0.43	25.80	104.9	1985	2195
30	150	0.34	32.00	103.5	2005	2210
30	200	0.38	32.00	115.5	2220	2450
30	250	0.42	32.00	127.5	2595	2690
30	300	0.45	32.00	136.5	2810	2870
30	350	0.49	32.00	148.4	2685	3110
36	150	0.38	38.30	138.5	2945	—
36	200	0.42	38.30	152.9	2940	—
36	250	0.47	38.30	170.9	3265	—
36	300	0.51	38.30	185.3	3525	—
36	350	0.56	38.30	203.2	3845	—

Table continued on next page. ►

NOTE:

Thicknesses and dimensions of 3" through 64" ductile iron pipe conform to ANSI/AWWA C151/A21.51. Weights may vary from the standard because of differences in bell weights.

^a Tolerance of O.D. of spigot end: 3–12 in., ±0.06 in.; 14–24 in., +0.05 in., -0.08 in.; 30–48 in., +0.08 in., -0.06 in.; 54–64 in., +0.04 in., -0.10 in.

^b Including bell; calculated weight of pipe rounded off to nearest 5 lbs.

PIPE MARKING TAPE

MODELS LVPMTD - LVPMTND

(DETECTABLE)

(NON-DETECTABLE)

UNIFORM COLOR CODE

	WHITE - Proposed excavation
	PINK - Temporary survey markings
	RED - Electric power lines, cables, conduit and lighting cables
	YELLOW - Gas, oil, steam, petroleum or gaseous materials
	ORANGE - Communication, alarm or signal lines, cables or conduit
	BLUE - Potable water
	PURPLE - Reclaimed water, irrigation and slurry lines
	GREEN - Sewers and drain lines

DESCRIPTION:

Lansdale's Pipe Tape provides easy detection and identification of buried pipe and our LVPMTND tape provides identification of non buried pipe. Custom tapes are available if needed and include custom colors, logos, wording, symbols, phone numbers etc.

Biaxially Oriented Polypropylene (BOPP) Resistance to Acids and Alkalis

Biaxially oriented polypropylene (BOPP) films are generally chemically inert and exhibit good resistance to most acids and alkalis, especially at room temperature and moderate concentrations. This is due to the non-polar, hydrophobic nature of polypropylene and its high chemical stability.

DATA SHEET

	DETECTABLE TAPE		NON- DETECTABLE TAPE
COLOR & LEGEND	APWA		APWA
Length (Ft)	1000 FT		1000 FT
Tolerance	± 5%		± 5%
Width (In)	2", 3", 4", 6", 12"		2", 3", 4", 6", 12"
Width Tolerance	± 2%		± 2%
Thickness (Mil)	5 mil - D2103		4 mil - D2103
Thickness Tolerance	± 5%		± 5%
Core Inside Diameter (mm)	76 mm		76 mm
Material	.35 Mil Aluminum Foil + 8 Mil Clear Bopp Film + 3.75 Mil Clear PE* Film		PE*
Yield Strength	MD	52lbf -D882	N/A
	TD	49lbf-D882	N/A
Break Strength	MD	66lbf-D882	N/A
	PSI	7800 PSI-D882	N/A
	TD	50lbf-D882	N/A
	PSI	7800 PSI-D882	N/A
Elongation	MD	80%-D882	803% - D882**
	TD	140%-D882	>1080% - D882**
Tongue Tear	MD	2lb-D1938	ISO 6383-1:2015 196 N/mm
	TD	6lb-D1938	ISO 6383-1:2015 196 N/mm
Tensile Strength	MD	50.8 lbs/in-D882	ASTM D882 52.3
	TD	50.0 lbs/10-D882	ASTM D882 52.3

NON-DETECTABLE

DETECTABLE



PROJECT	APPROVAL STAMP
PROJECT:	☐ APPROVED
ADDRESS:	☐ APPROVED AS NOTED
ENGINEER:	☐ NOT APPROVED
SUBMITTAL DATA:	REMARKS:
NOTES 1:	
NOTES 2:	

C153 DUCTILE IRON MECHANICAL JOINT FITTINGS


C153 DUCTILE IRON MECHANICAL JOINT FITTINGS

BASIC SPECIFICATIONS

- SIZES:**
- 2" - 64"
- MATERIAL:**
- Ductile Iron ASTM A536, Grade 65-45-12, 60-42-10 or 70-50-05.
- PRESSURE:**
- 350 PSI Water Working Pressure 2" - 24".
 - 250 PSI Water Working Pressure 30" - 48".
 - 150 PSI Water Working Pressure 54" - 64".
- TESTING:**
- In accordance with ANSI/AWWA C153/A21.53.
 - In accordance with UL - FM requirements.
 - All fittings are hydrostatically tested in accordance with SIGMA Quality Management Standard.
 - All fittings are heat coded to ensure traceability and verification of metallurgical properties in accordance with the prevailing standards and SIGMA Quality Management Standards.
- LAYING LENGTH:**
- Short body design - straight section of body deleted to provide a compact and lighter fitting without reducing strength or flow characteristics.
 - In accordance with ANSI/AWWA C153/A21.53.
- DEFLECTION:**
- Maximum allowable deflection for MJ Joint on a full length pipe is as mentioned below:
 1. 3" - 4" = 8 Degrees
 2. 6" = 7 Degrees
 3. 8" - 12" = 5 Degrees
 4. 14" - 48" = 3 Degrees
- CEMENT LINING:**
- Maximum Double cement lined in accordance with ANSI/AWWA C104/A21.4.
- COATING:**
- Interior of fitting is seal coated (asphaltic material) in accordance with ANSI/AWWA C104/A21.4 and NSF61 approved.
 - Exterior of fitting is seal coated (asphaltic material) in accordance with ANSI/AWWA C153/A21.53 and NSF61 approved.
- GASKETS:**
- SBR in accordance with ANSI/AWWA C111/A21.11.
 - Also available in EPDM, NBR and CR.
- T-BOLTS:**
- Low Alloy corrosion resistant high strength steel in accordance with ANSI/AWWA C111/A21.11.
- APPROVALS:**
- 3"-16" Underwriters Laboratories listed and Factory Mutual Approved.
- STANDARDS:**
- Certified to NSF61 Standard including Annex G & 372.
 - ANSI/AWWA C153/A21.53 for Compact Ductile Iron Fittings 2"-64" for water and other liquids.
- INSTALLATION:**
- Per ANSI/AWWA C600 and C111 using DIP conforming to C150/C151 and PVC pipe conforming to C900/C905.

For sewer applications that require mandrel passage after installation, SIGMA recommends the end user check the fitting with the respective size mandrel BEFORE installing the fitting. SIGMA Corporation will NOT take responsibility for any back charges incurred due to the fitting not being checked with a mandrel prior to installation.

ONE-LOK™ MODEL SLDE WEDGE RESTRAINT FOR DUCTILE IRON PIPE

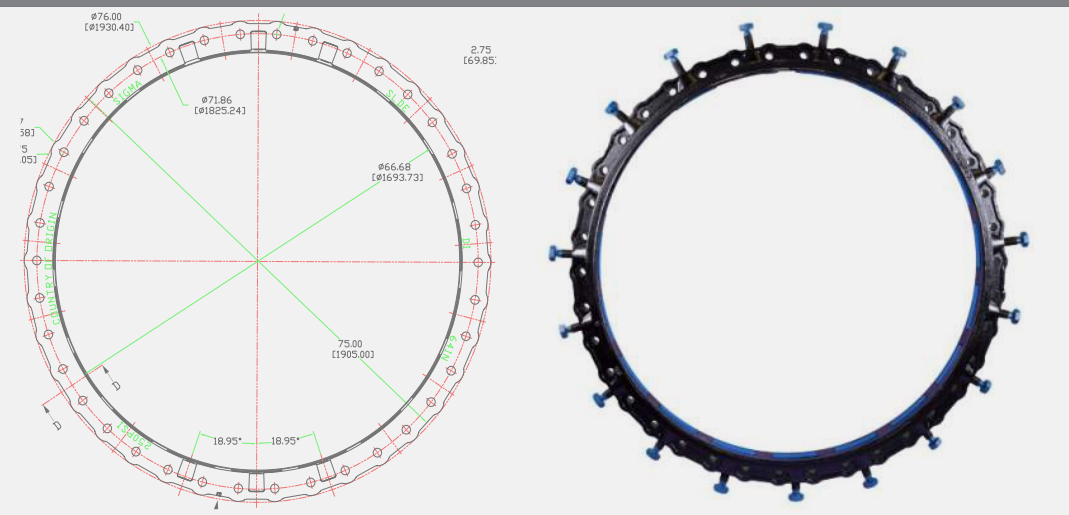

PRODUCT SPECIFICATIONS

- MATERIAL:**
- Gland body, wedge inserts and break-off top actuating bolts are manufactured of high strength ductile iron in accordance with ASTM A536, Grade 65-45-12. Wedge inserts are heat-treated to a hardness of 370 BHN minimum.
- SIZE RANGE:**
- 3" through 64"
- DIMENSION:**
- Conform to ANSI/AWWA C111/A21.11 & ANSI/AWWA C153/A21.53 standards
- PRESSURE RATING:**
- Sizes 3"-16" carry a 350 psi WWP and sizes 18"- 64" carry a 250 psi WWP while providing a minimum 2:1 factor of safety.
- COATING:**
- Asphaltic black enamel
 - Electro-deposition "CORRSAFE™" available upon request. For further information, please refer to our CORRSAFE Product Information sheet at <http://www.sigmaco.com/pipe-restraint-product-coatings-linings/>
- APPROVALS:**
- Underwriters Laboratories' listed in sizes 3"-36" and Factory Mutual approved in sizes 3"-12".
- DEFLECTION:**
- 5° on 3"-12", 2° on 14"-16", 1.5° on 18"-30" and 1° on 36"- 64"
- TRACEABILITY:**
- Gland body, wedge inserts and break-off top actuating bolts are individually cast with exact heat code information.
- INSTALLATION:**
- In accordance with manufacturer's recommendation and applicable AWWA standards.

Submittal Documents

LIDL 1517



Overview

Bid Date: 08-25-2026
Bid Number: 5166172


Section

TAP ASSEMBLY

SPECIFICATION

TAPPING SLEEVE - FABRICATED STEEL

MODEL 622

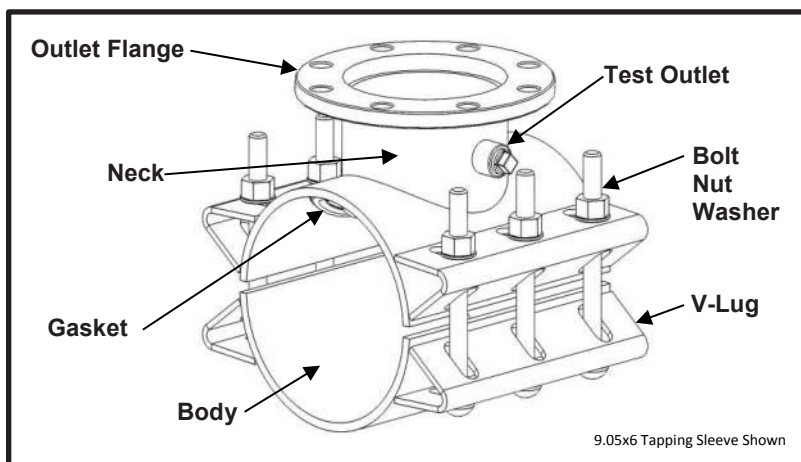

APPLICATIONS

- **Typical Uses**
 - Tapping size-on-size branch connections on new or existing pipe
 - Tapping reducing branch connections on new or existing pipe
 - Installing valves and other miscellaneous service equipment
- **Standard Pipe Sizes**
 - 4" to 30" nominal
- **Outlet Type and Size**
 - 4" to 12"
- **Type of Pipe (see notes)**
 - Carbon Steel, Stainless Steel, Cast Iron, Asbestos Cement, PVC, Ductile Iron, HDPE
- **Working Pressure / Test Pressure (see notes)**
 - Up to 175 PSI / 262PSI

MATERIALS

- **Body**
 - Carbon Steel per ASTM A283 Grade C
 - Material thickness: 4" nominal pipe size(s) = 1/4" (top plate) 3/16" (bottom plate)
6"-30" nominal pipe size(s) = 3/8" (both plates)
- **Neck**
 - Carbon Steel per ASTM A53 or A513
 - Furnished with 3/4" NPT test outlet
 - Accepts full size cutters except size-on-size taps which require a 1/2" undersize shell cutter
- **Outlet Flange**
 - Carbon Steel per ASTM A36
 - Type AWWA C207 Class D steel ring flat face
 - Compatible with ANSI 125# and 150# bolt hole patterns
 - Recessed for tapping valve alignment per MSS SP-60
- **V-Lug**
 - Carbon Steel per ASTM A283 Grade C
 - Material thickness: 4"-6" nominal pipe size(s) = 3/16"
8"-30" nominal pipe size(s) = 1/4"



Smith-Blair
a xylem brand

SPECIFICATION

TAPPING SLEEVE - FABRICATED STEEL

MODEL 622

- **Gasket**
 - Nitrile (Buna-N) per ASTM D2000
 - Compounded to resist water, oil, natural gas, acids, alkalies, most (aliphatic) hydrocarbon fluids, and many other chemicals
 - Temperature range: -20°F to +180°F
 - Gasket is fully cemented in machined recess
- **Bolts**
 - High Strength Low Alloy (HSLA) Steel per AWWA C111/A21.11 – with rolled threads
 - Size:
 - 4"-6" nominal pipe size(s) = 5/8"-11UNC x 6" long, Oval Neck Track Head
 - 8"-24" nominal pipe size(s) = 3/4"-10UNC x 9" long, Oval Neck Track Head
 - 30" nominal pipe size(s) = 3/4"-10UNC x 11.25" long, Oval Neck Track Head
- **Nut**
 - HSLA Steel per AWWA C111/A21.11
 - Size:
 - 4"-6" nominal pipe size(s) = 5/8"-11UNC Heavy Hex Semi-Finished
 - 8"-30" nominal pipe size(s) = 3/4"-10UNC Heavy Hex Semi-Finished
- **Washer**
 - Carbon Steel per ASTM F844
 - Fe/Zn coated per ASTM F1941-10
 - Size:
 - 4"-6" nominal pipe size(s) = 5/8" Type A Plain
 - 8"-30" nominal pipe size(s) = 3/4" Type A Plain
- **Test Outlet**
 - Carbon Steel 3/4" FNPT half coupling per ASTM A865
 - Carbon Steel 3/4" MNPT square head test plug
- **Welding**
 - Welds accomplished using qualified welders
 - GMAW weld process utilized
- **Finish**
 - Flexi-Coat® fusion bonded epoxy

LISTINGS/STANDARDS

- Certified to NSF/ANSI 61 and NSF/ANSI 372
- Flexi-Coat® Fusion-Bonded Epoxy Coating meets requirements of AWWA C213
- Meets applicable portions of AWWA C223

08" C515 MJ X MJ

13.50

10.38

6.88

9.00

13.12

0.67

4 X Ø 0.88 HOLES
2 X Ø 0.88 SLOTS
ON Ø 11.75 B.C.

MJ END:
ANSI A21.11
AWWA C111

08" C515 TYTON X TYTON

13.50

10.38

5.50

9.00

17.13

2.81

4.75

12.56

14.19

Ø 11.00

2 X Ø 1.00 HOLES
TYTON END:
AWWA C111

08" C515 PVC X PVC

13.50

10.38

5.25



9.00

16.23

2.26

Ø 10.50

PVC END:
AWWA C111


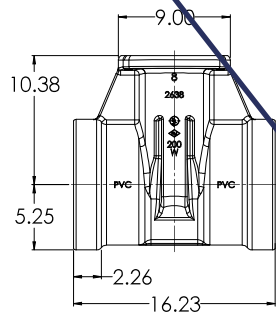
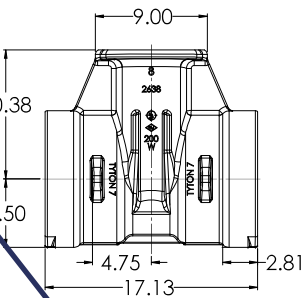


08" C515 MJ X TAP

Technical drawing of the 08" C515 MJ X TAP valve. The drawing includes two views: a front view (left) and a side view (right). The front view shows a circular body with a central opening and a flange at the top. Dimensions include a top flange diameter of 13.50, a body diameter of 13.75, and a central opening diameter of 8.96. There are 8 x 0.88 holes on the 11.75 B.C. (Body Centerline). The side view shows a cross-section of the valve with a top flange diameter of 9.00, a body diameter of 10.38, and a central opening diameter of 6.88. There are 4 x 0.88 holes and 2 x 0.88 slots on the 11.75 B.C. The drawing also includes a note for the TAP END: ANSI B16.1 CLASS 125 and a note for the MJ END: ANSI A21.11 AWWA C111.


08" C515 GRVD X GRVD

Technical drawing of the 08" C515 GRVD X GRVD valve. The drawing includes two views: a front view (left) and a side view (right). The front view shows a circular body with a central opening and a flange at the top. Dimensions include a top flange diameter of 13.50, a body diameter of 8.57, and a central opening diameter of 8.57. The side view shows a cross-section of the valve with a top flange diameter of 9.00, a body diameter of 10.38, and a central opening diameter of 4.29. There are 8 x 0.88 holes and 2 x 0.88 slots on the 11.75 B.C. The drawing also includes a note for the GRVD END: ANSI B16.1 CLASS 125 and a note for the GRVD END: ANSI A21.11 AWWA C111.


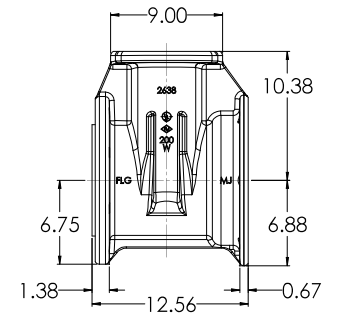


1. STANDARD INFORMATION (STANDARD AND REQUIREMENTS) (FORM 400-10) (STANDARD) (STANDARD) (STANDARD)		2. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)		3. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)		4. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)	
5. STANDARD INFORMATION (STANDARD) (STANDARD) (STANDARD)		6. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)		7. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)		8. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)	
9. STANDARD INFORMATION (STANDARD) (STANDARD) (STANDARD)		10. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)		11. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)		12. PROPERTY OF RECORD INFORMATION ALL RIGHTS ARE RESERVED BY THE UNITED STATES GOVERNMENT (PROPERTY OF RECORD) (PROPERTY OF RECORD) (PROPERTY OF RECORD)	

OPERATING NUT WITH
O-RING PLATE

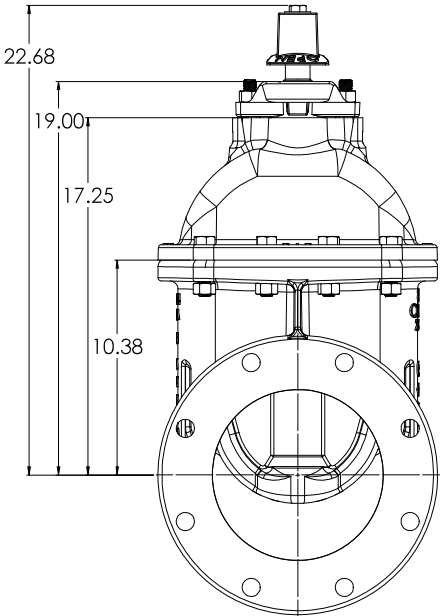

COMPANY: SAFETY VALVE MANUFACTURING CO.		ADDRESS: 12345 INDUSTRIAL BLVD., SUITE 200, CHICAGO, IL 60601		PHONE: (312) 555-1234	
E-MAIL: SALES@SAFETYVALVE.COM		FAX: (312) 555-5678		WEBSITE: WWW.SAFETYVALVE.COM	
CUSTOMER: ABC COMPANY		PROJECT: NEW GATE VALVE		DATE: 12/2/2020	
DRAWN BY: J. SMITH		CHECKED BY: M. JONES		APPROVED BY: D. BROWN	
MATERIAL: 08" CS18 NRS RESILIENT WEDGE		WEIGHT: 150 LBS.		SCALE: 1:5	
REVISION: 1.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 2.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 3.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 4.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 5.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 6.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 7.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 8.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 9.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 10.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 11.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 12.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 13.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 14.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 15.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 16.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 17.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 18.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 19.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 20.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 21.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 22.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 23.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 24.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 25.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 26.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 27.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 28.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 29.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 30.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 31.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 32.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 33.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 34.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 35.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 36.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 37.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 38.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 39.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 40.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 41.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 42.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 43.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 44.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 45.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 46.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 47.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 48.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 49.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 50.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 51.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 52.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 53.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 54.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 55.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 56.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 57.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 58.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 59.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 60.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 61.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 62.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 63.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 64.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 65.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 66.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 67.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 68.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 69.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 70.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 71.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 72.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 73.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 74.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 75.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 76.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 77.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 78.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 79.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 80.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 81.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 82.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 83.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 84.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 85.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 86.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 87.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 88.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 89.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 90.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 91.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 92.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 93.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 94.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 95.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 96.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 97.0		DATE: 12/2/2020		BY: J. SMITH	
REVISION: 98.0		DATE: 12/2/2020		BY: M. JONES	
REVISION: 99.0		DATE: 12/2/2020		BY: D. BROWN	
REVISION: 100.0		DATE: 12/2/2020		BY: J. SMITH	

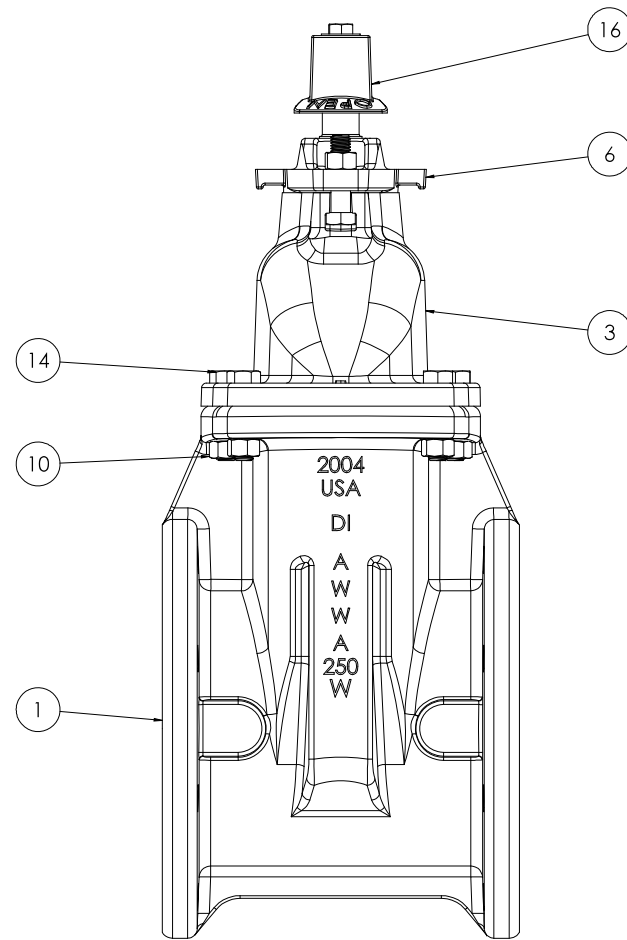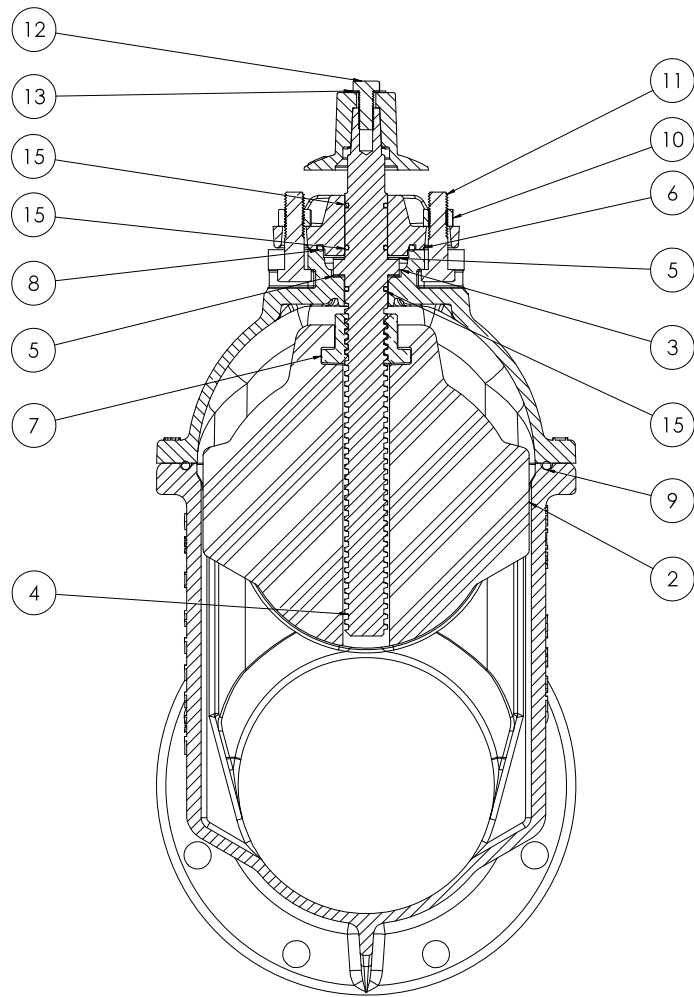

COMPANY INFORMATION COMPANY: AWW ADDRESS: 1000 W. 10th St. CITY: LAKE CHARLES, LA 70601 PHONE: 504-735-1100 FAX: 504-735-1101 E-MAIL: info@aww.com WEBSITE: www.aww.com		PROJECT INFORMATION PROJECT: 08" CS18 NRS RESILIENT WEDGE GATE VALVE SCALE: 1:5 DATE: 12/2/2020 DRAWN BY: SW CHECKED BY: SW APPROVED BY: SW		REVISIONS 1. 08" CS18 NRS RESILIENT WEDGE GATE VALVE 2. 1:5 3. 12/2/2020 4. SW 5. SW 6. SW		AWW 1000 W. 10th St. Lake Charles, LA 70601 Phone: 504-735-1100 Fax: 504-735-1101 E-Mail: info@aww.com Website: www.aww.com
--	--	--	--	---	--	--

<u>ITEM NO.</u>	<u>COMPONENT</u>	<u>QTY.</u>	<u>SIZE</u>	<u>STANDARD MATERIAL</u>	<u>MATERIAL OPTIONS</u>
1	BODY	1	-	DUCTILE IRON	-
2	WEDGE	1	-	EPDM/DUCTILE IRON	-
3	COVER	1	-	DUCTILE IRON	-
4	STEM	1	-	C99500	C86700, 304 SS, 316 SS
5	THRUST WASHER	2	-	ACETAL	C26000
6	GLAND	1	-	DUCTILE IRON	-
7	STEM NUT	1		C99500	C87850
8	O-RING	1	#335	EPDM	BUNA-N
9	O-RING	1	#447	EPDM	BUNA-N
10	HEX NUT	10	5/8"-11	18-8 S	316 SS
11	HEX HEAD CAP SCREW	2	5/8"-11 X 2 1/4	18-8 SS	316 SS
12	HEX HEAD CAP SCREW	1	1/2"-13 X 1 1/4	18-8 SS	316 SS
13	WASHER	1	1/2"	18-8 SS	316 SS
14	HEX HEAD CAP SCREW	8	5/8-11 X 2 1/2	18-8 SS	316 SS
15	O-RING	3	#216	EPDM	BUNA-N
16	OPERATING NUT	1	-	CAST IRON	DUCTILE IRON, C86700, **Ø 14" HANDWHEEL**

- VALVES CONFORM WITH THE FOLLOWING STANDARDS
 - AWWA C515
 - NSF 61
- LOW ZINC BRASS STEM AND STEM NUT AVAILABLE
- 100% DOMESTIC FASTENERS AND ORINGS OPTIONS AVAILABLE
- *OPEN LEFT* (COUNTERCLOCKWISE) AND *OPEN RIGHT* (CLOCKWISE) OPTIONS AVAILABLE
- TURNS TO OPEN FROM FULLY CLOSED: 26
- AWWA MAXIMUM ALLOWABLE CLOSING TORQUE 150 FT-LBS
- OPTIONAL HANDWHEEL CAN BE SUBSTITUTED FOR STANDARD 2" SQUARE OP. NUTS.
 - ****NOTE: STANDARD HANDWHEEL SIZE LISTED OUT IN PARTS LIST.****

COMPANY: SWISS VALVE CO. ADDRESS: 1000 N. 10TH ST. SUITE 100, DENVER, CO 80202 PHONE: 303.733.1100 FAX: 303.733.1101 WWW: WWW.SWISSVALVE.COM		PROJECT: 08" CS15 NRS RESILIENT WEDGE GATE VALVE DATE: 12/2/2020 DRAWN BY: SW CHECKED BY: SW APPROVED BY: SW		SCALE: 1:5 SHEET NO: 5 TOTAL SHEETS: 6 PROJECT NO: 2018-SP2		
---	--	---	--	--	--	---

REQUIREMENT:

- ☐ Class 30B
☐ Class 35B
☐ Ductile Iron



Quality – Service – Commitment – Delivered.

MUNICIPAL VALVE AND SERVICE BOXES

SIZE RANGE:

- Adjustable Slip and Screw Type with standard assembled lengths ranging from 15" to 72" (Lengths do not include risers and/or extensions).

STANDARDS:

- Manufactured from cast iron in accordance with and meet all applicable terms and provisions as per ASTM A48 standard and will meet the minimum tensile strength requirements.
- Sigma Valve Boxes when properly installed can be used for projects related to American Association of State and Highway Officials (AASHTO) standards.

INSTALLATION:

- Per AWWA M44

COATING:

- Black Asphaltic Bituminous paint. Coating thickness of 1 to 2mil is applied on the product.

Extention Height	Components	2 Pc Screw Type	2 Pc Slip Type	Extention Height	Components	3 Pc Screw Type	Extention Height	Components	Screw Type Service Box
19-22	10T + 15B	VB261	VB461	27-37	10T + 12B	VB630AA	24-33	15T + 21B	VB791C
27-37	16T + 24B	VB262	VB462	33-42	10T + 18B	VB630A	30-39	15T + 27B	VB792C
39-50	16T + 36B	VB264	VB464	39-49	16T + 24B	VB630B	30-42	18T + 27B	VB792D
39-60	26T + 36B	VB266	VB466B / VB466N*	45-54	16T + 30B	VB630C	36-48	18T + 33B	VB793D
50-71	26T + 48B	VB267	VB467	51-60	16T + 36B	VB630CC	36-54	24T + 33B	VB793E
63-81	26T + 60B	VB268	VB468	45-66	26T + 30B	VB630D	42-60	24T + 39B	VB794E
				51-72	26T + 36B	VB630DD	41-64	30T + 39B	VB795E
				63-84	26T + 48B	VB630F			
				74-94	26T + 60B	VB630G			
			B = With Flange N = Without Flange	NOTE: Requires use of base - Above ships with VB6306 base standard - Other sizes available					

**** ADD -35 TO ITEM # FOR CLASS 35B GREY IRON REQUIREMENTS / ADD -D FOR DUCTILE IRON REQUIREMENTS**
RISERS, EXTENSIONS AND VARIOUS SPECIALLY LETTERED LIDS AVAILABLE FOR ALL ITEMS




700 Goldman Drive
 Cream Ridge, NJ 08514
 CRMCSR@sigmaco.com

5000 Askins Lane
 Houston, TX 77093
 HTNCSR@sigmaco.com

4652 E. Guasti Rd
 Ontario, CA 91761
 ONTCRSR@sigmaco.com

21699 Torrence Avenue
 Sauk Village, IL 60411
 CHICSR@sigmaco.com

Highway 22 West
 Alexander City, AL 35010
 ALXCSR@sigmaco.com

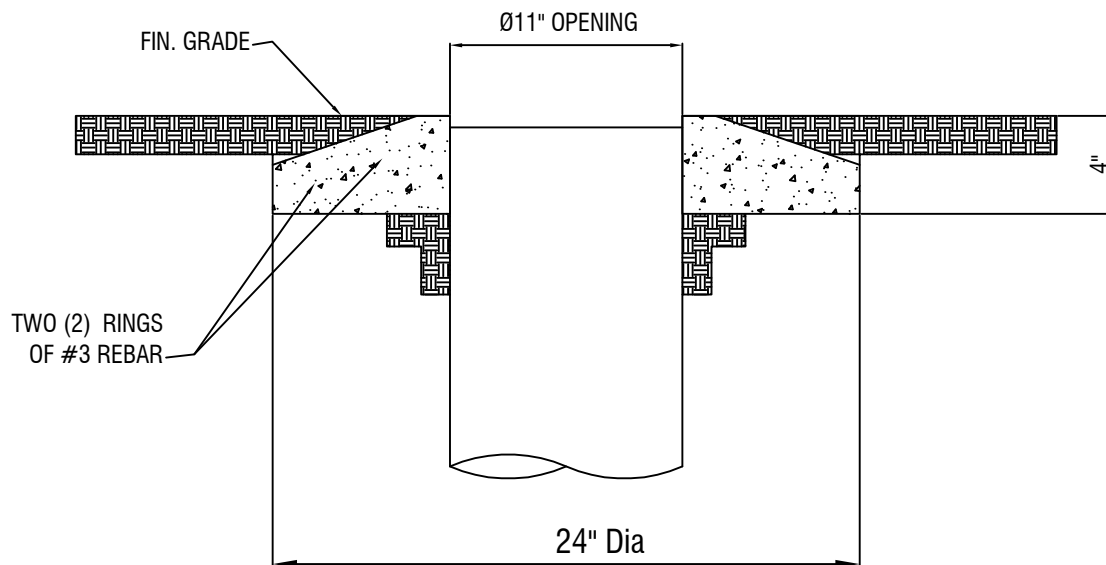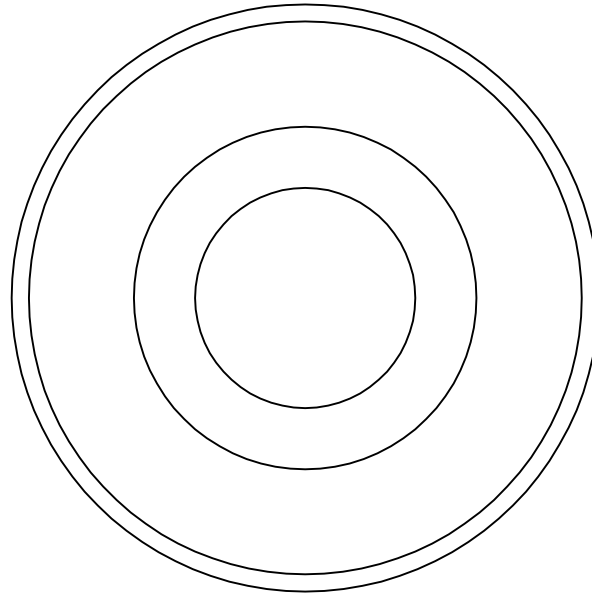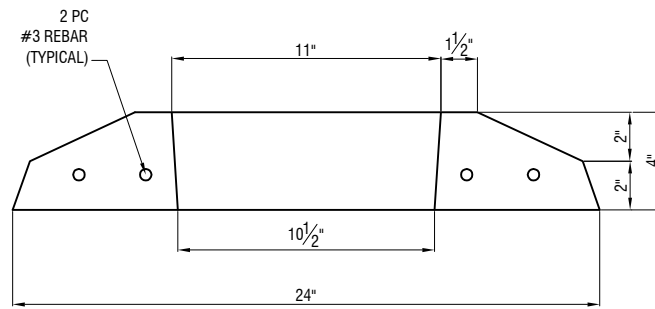

SECTION "A - A"

Masonry Supply, Inc

P.O. BOX 943

SELMA, NC 27576


PH: (919) 351-4014 (office), (919) 291-8761 (cell) FAX: (919) 351-4047

EMAIL: masonrysupply@hotmail.com

ITEM: 24" CONCRETE VALVE BOX COLLAR

PART # MSVB - 24

MATERIAL SPEC: A - 3 CONCRETE (4000 psi @28 DAYS)

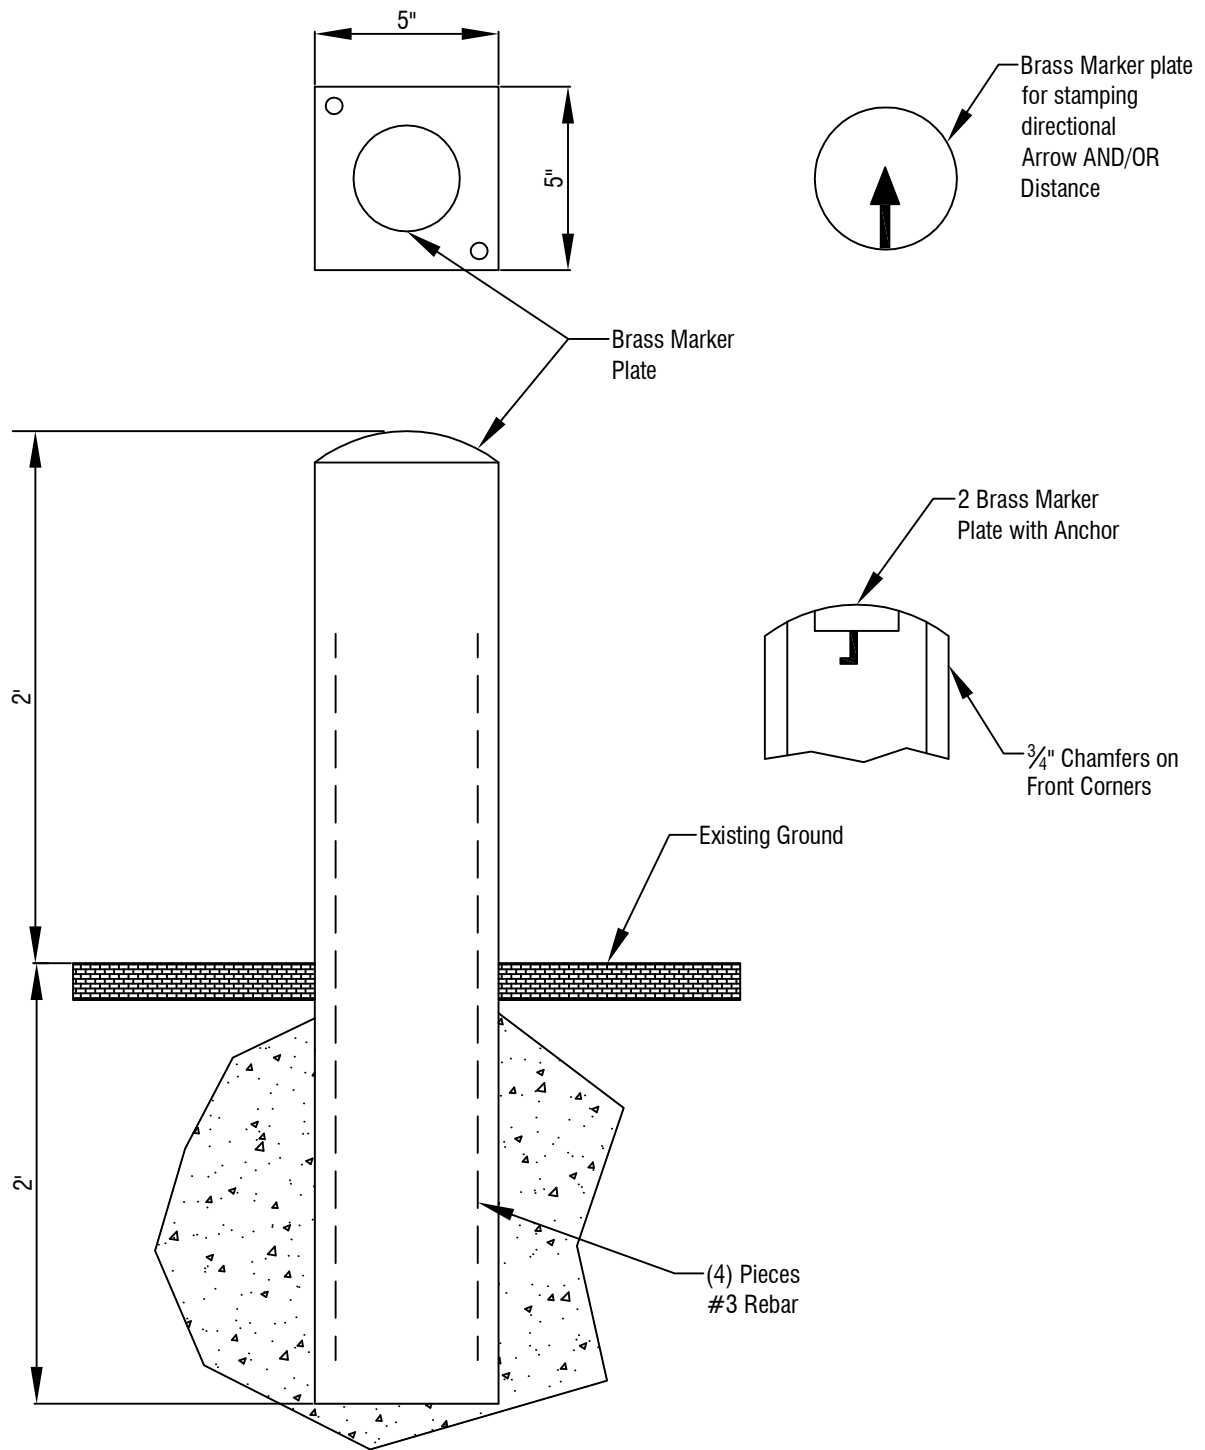

Notes:

1. Made of minimum 4000 PSI Concrete
2. Height - 4', width of sides - 5"
3. 3/4" chamfers on front corners
4. Four pieces of #3 rebar
5. Two inch brass marker plate with anchor
6. Lettering stamped on marker as specified in 3" letters
 Standard Marker = MV (Main Valve) top front
 = BO (Blow-off) bottom front
 = AV (Air Release Valve)
 = LM (Line Marker)

Masonry Supply, Inc

P.O. BOX 943
 SELMA, NC 27576

PH: (919) 351-4014 (office), (919) 291-8761 (cell) FAX: (919) 351-4047
 EMAIL: masonrysupply@hotmail.com

ITEM: PRECAST CONCRETE 4 FT TALL MARKING POSTS W/BRASS

PART # MMVB 04 W/BR

MATERIAL SPEC: A - 3 CONCRETE (4000 psi @28 DAYS)

Submittal Documents

LIDL 1517




Overview

Bid Date: 08-25-2026
Bid Number: 5166172

Section

FIRE HYDRANT

PRODUCT DATA

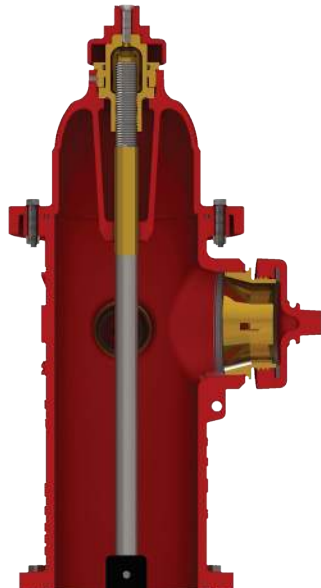

*Nozzle height ground line

ACCESSORIES

SEAT REMOVAL WRENCH — A light-weight universal combination tool is used to remove the main valve components. The bronze alloy seat ring unthreads from the drain ring by engaging the wrench at the bottom of the break coupling.

HOLD DOWN NUT WRENCH — The wrench fits the hold down nut for easy removal.

LUBRICATION — The hydrant features a dual lubrication system. Simply add grease or oil by removing the lubrication bolt on top of the weathershield.

EXTENSION KIT — Contains everything required to extend the stem and barrel. Available in 6" increments.

SAFETY FLANGE REPAIR KIT — Includes safety flanges, stem coupling, pins and clips, flange O-rings, all bolts, nuts, and hardware to repair a hydrant damaged by a traffic accident.

MAIN VALVE SEAT REPAIR KIT — Contains drain valve facings, SS rivets, main valve seat, lock washer, and all required O-rings.

RECOMMENDED SPECIFICATIONS

1. Fire hydrant shall be manufactured in accordance with AWWA standard C502, utilizing dry barrel dry top design.
2. Fire hydrant shall be rated at 250 PSI working pressure and tested to 500 PSI hydrostatic pressure.
3. Fire hydrant shall be of dual lubrication design featuring a lubrication bolt in the top of the weathershield for oil or grease.
4. Fire hydrant shall feature o-ring seals at the bonnet, break line, and elbow.
5. The traffic break coupling shall be comprised of cast iron with the seat wrench mounting-point located on the squared bottom.
6. Break flanges shall be made of cast iron and allow 360 degrees of rotation.
7. The nozzle section and one piece bonnet shall be comprised of cast iron coated in durable polyester powder coat.
8. Nozzles shall be threaded and screwed into the nozzle section and mechanically secured with a set screw.
9. The stand pipe and elbow shall be comprised of ductile iron utilizing stainless steel bolts/nuts below ground level.
10. The upper drain valve shall consist of bronze alloy and contain rubber facings secured in place by stainless steel rivets.
11. The seat ring shall be comprised of bronze alloy and utilize a double O-ring seal.
12. Fire hydrant shall be manufactured with a one piece bottom plate that limits travel in the elbow of the hydrant and is secured in place by a lock washer on the lower stem threading.
13. Fire hydrant shall be the M&H model 129 manufactured by M&H Valve Co.

SUGGESTED SPECIFICATIONS (1 of 2)

M&H AWWA C502 FIRE HYDRANTS

- ◆ Model 129
- ◆ Traffic Model
- ◆ 250 PSI Working Pressure – 500 PSI Hydrostatic Test - AWWA
- ◆ UL / FM Approved

GENERAL	Fire hydrants shall comply in all respects with AWWA Standard C-502, latest revision. Fire hydrants shall be of the compression type, with the main valve opening against the pressure and closing with the pressure. The main valve opening shall be (4 ½" or 5 ¼") in diameter. Fire Hydrant shall be of a dry barrel, dry top design. The nozzle section shall consist of two (2) hose nozzles and one (1) pumper nozzle or other as specified.
RATING	Fire hydrants shall be rated at 250 psi water working pressure, tested at 500 pounds hydrostatic for structural soundness in the following manner: 500 pound hydrostatic test supplied from the inlet side, first with the main valve closed for the testing of the valve seat: second, with the main valve open for testing of the drain valves and the hydrant barrel. Testing to be complete in accordance with AWWA C-502 and UL & FM requirements.
END CONFIGURATION	Hydrants shall be connected to the main by a 4" or 6" fusion bonded, epoxy coated mechanical joint or flanged shoe. Mechanical joint shoes shall be fitted with strapping lugs.
DESIGN	The main valve seat of the hydrant shall be made of rubber and be supported by a one-piece bronze top plate / drain valve mechanism. Drain valve shall have replaceable rubber facings. The bottom stem threads of the main valve rod shall be fitted with an epoxy coated, cast iron bottom plate, sealing lower rod threads from the water. Changes in size or shape of the waterway (hydrant nozzles) shall be accomplished by means of easy curves. Exclusive of the main valve opening, the net area of the waterway of the barrel and the foot piece at the smallest part shall not be less than 120% of that of the net opening of the main valve. Hose and pumper nozzles shall be threaded and screwed into the nozzle section. And then mechanically locked to prevent turning. Hose and pumper caps shall be chained to the hydrant The hydrant shall be so designed that when it is in place, no excavation will be required to remove the main valve and movable parts of the drain valve. Further, the hydrant shall be of the type that can be extended without excavating. Hydrants shall be so designed that, in the event of accident, or breaking of the hydrant above or near grade level; the main valve will remain closed. The main valve rod shall be made in two parts and fitted with breakable coupling at the ground line flange. The ground line connection between nozzle section and the barrel shall incorporate the use of two traffic flange. This connection shall be so designed that the nozzle section can be rotated in any increment of 360°. The ground line connection between the barrel and nozzle sections shall have a rubber o-ring gasket to provide a seal. The operating threads of the hydrant shall be so designed as to avoid the working of any iron or steel parts against either iron or steel. The operating stem and operating nut threads shall be square or acme type.

SUGGESTED SPECIFICATIONS (2 of 2)

DESIGN

(Continued)

The operating thread shall be lubricated at factory with food grade grease. Access shall be provided to field lubricate the operating mechanism.

The operating thread shall be sealed from water at all times when the valve is either in the opened or closed position. The operating rod shall be bronze sheathed where it passes through the double "O" ring seal in the bonnet.

The bonnet shall be weather proof and utilize a weather shield integral with the external wrench operating nut.

The operating nut shall be made of bronze with a self-lubricating design.

Hydrants shall be of the dry barrel type and hydrant shoe shall have two positive acting non-corrosive drain valves that shall drain the hydrant completely by opening when the main valve is closed, and close tightly in accordance with AWWA C-502 requirements when main valve is open.

The main valve assembly shall be seated in the hydrant with a bronze-to-bronze interface to facilitate removal of the main valve, should maintenance be required. The nozzle section shall consist of two-2 1/2" hose nozzles to the specified thread designation (NST or other, as specified) and one pumper nozzle 4 1/2" in diameter to the specified thread designation (NST or other, as specified), or other combination of nozzle outlets, including independent hose gate valves, as specified.

Two O-ring seals shall be utilized where the main hydrant rod passes through the 1 piece bonnet.

Hydrant standpipe shall be ductile iron and single piece for all bury depths.

All like parts of hydrants of the same size and model produced by the same manufacturer shall be interchangeable.

Hydrant shall open by turning to the (left or right). Direction of opening to be permanently marked on hydrant bonnet.

Threads on hose and steamer nozzles shall be National Standard unless otherwise specified.

Size and shape of operating nuts cap nuts shall conform to National Standard unless otherwise specified.

Bury shall be (specify depth of bury) measuring depth from grade line to bottom of trench or connecting pipe.

Auxiliary shut-off (isolation) gate valves, when required, shall be of the same manufacture as the hydrant.

COATING

Hydrant shoes shall have an interior and exterior thermosetting epoxy coating of 5 to 6 mils meeting AWWA C550. Exterior of hydrant nozzle section shall be Fire Hydrant Red (or as specified).

MARKINGS

Hydrant shall be marked with the name of the manufacturer, size of valve opening, direction of opening and the year of manufacture all in accordance with the AWWA C-502. Country of origin to be cast on all major hydrant castings.

SOURCE

Hydrants shall be M&H Model 129 or approved equal

Submittal Documents

LIDL 1517



Overview

Bid Date: 08-25-2026
Bid Number: 5166172

Section

8"DCDA BFP VAULT

PRODUCT INFORMATION

8'x5'x6' (ID) WITH FLOOR
8" BACKFLOW VAULT

VAULT = 17,000 #
LID = 3,400 #

SPECIFICATIONS

MEETS ASTM C858 & C857

RATING: A-8 (H-10)

CONCRETE TO BE 4,000 PSI
@ 28 DAYS

REINFORCING BAR MEETS
ASTM A 615

10" STEPS ON 12" CENTERS

BUTYL SEALANT MEETING ASTM
C 990 TO BE USED ON JOINTS

ACCESS HATCH SHALL BE
FABRICATED WITH 1/4"
ALUMINUM DIAMOND PLATE
DESIGNED TO SUPPORT 300 psf
36"x36" FRAME OPENING
EQUIPPED WITH: SLAM LOCK,
MOUNT LIFT HANDLE, HOLD-
OPEN ARM, SS HARDWARE
AND HINGES

PENETRATIONS SIZE AND
LOCATION VARY PER JOB

CALL FOR ADDITIONAL SPECS






DRAWING INFORMATION

Drawn By: CTP
Checked By: JJG
Revision: 1
Date: 1/12/2022

APPROVED BY:

print: _____

sign: _____

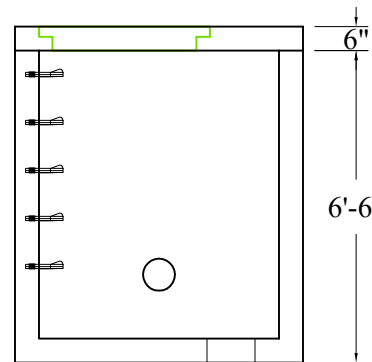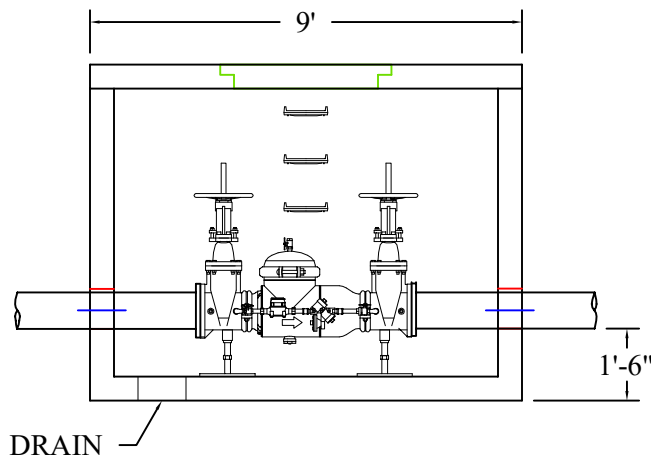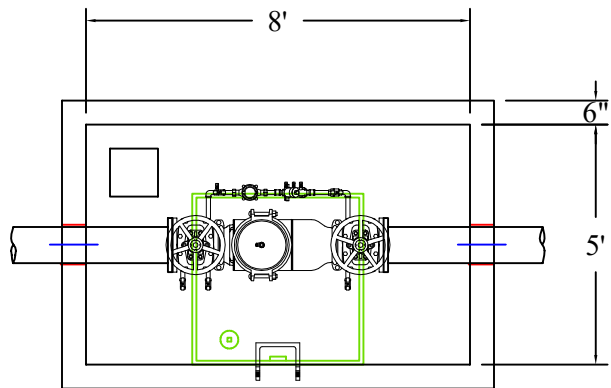

Scale: 1/4" = 1'



**BARTOW
PRECAST**

770.382.4462
sales@bartowprecast.com
WWW.BARTOWPRECAST.COM



Model 350ASTDA

Double Check Detector Assembly

Application

Designed for installation on water lines in fire protection systems to protect against both backsiphonage and backpressure of polluted water into the potable water supply. Model 350ASTDA shall provide protection where a potential health hazard does not exist. Incorporates metered by-pass to detect leaks and unauthorized water use.

Standards Compliance (Horizontal & Vertical)

- ASSE® Listed 1048
- AWWA Compliant C510 (with gates only) and C550
- UL® Classified
- C-UL® Classified
- FM® Approved
- CSA® Certified B64.5
- Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California
- Meets the requirements of NSF/ANSI/CAN 61* (0.25% MAX. WEIGHTED AVERAGE LEAD CONTENT)

By-Pass Backflow Assembly 3/4" Model 950XLD

Materials

Main valve body	304L Stainless steel
Access covers	304L Stainless steel
Internals	Stainless steel, 300 Series NORYL™
Fasteners & springs	Stainless Steel, 300 Series
Elastomers	EPDM (FDA approved)
	Buna Nitrile (FDA approved)
Polymers	NORYL™

Features

Sizes:	2 1/2", 3", 4", 6", 8", 10"
Maximum working water pressure	175 PSI
Maximum working water temperature	140°F
Hydrostatic test pressure	350 PSI
End connections (Grooved for steel pipe)	AWWA C60C
(Flanged)	ANSI B16.42
	Class 150

Dimensions & Weights (do not include pkg.)

MODEL 350ASTDA SIZE	WEIGHT							
	WITH OS&Y GATES (GXF)		WITH OS&Y GATES (GXG)		WITH BUTTERFLY VALVES (GXG)		WITH BUTTERFLY VALVES (FXG)	
	in.	mm	lbs.	kg	lbs.	kg	lbs.	kg
2 1/2	65	126	57	116	53	93	42	103
3	80	143	65	131	60	97	44	110
4	100	218	99	198	90	101	46	123
6	150	352	160	322	147	164	74	194
8	200	667	303	613	278	350	159	373
10	250	885	401	827	375	463	210	521

MODEL 350ASTDA SIZE		DIMENSION (approximate)																	
		A		A WITH BUTTERFLY VALVES		B LESS GATE VALVES		C		D		E OS&Y OPEN		E OS&Y CLOSED		E WITH BUTTERFLY VALVES		F	
		in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm
2 1/2	65	31 7/8	810	28 3/4	730	n/a	n/a	12	305	7 1/4	184	17 3/4	451	15 3/8	391	8 1/4	210	5	127
3	80	32 7/8	835	29 3/8	746	n/a	n/a	12	305	7 1/4	184	20 1/4	514	17	432	8 1/4	210	5	127
4	100	34 7/8	886	30 1/4	768	n/a	n/a	12	305	8	203	22 1/2	572	18 1/4	464	9	229	5	127
6	150	43 1/2	1105	36 1/2	927	n/a	n/a	10 1/2	267	10	254	30 1/2	775	24 1/4	616	10 1/4	260	6	152
8	200	52 3/4	1340	45 3/4	1162	n/a	n/a	15 1/8	384	11	279	37	940	28 1/2	724	18 1/2	470	8 3/8	213
10	250	55 3/4	1416	49 3/4	1264	n/a	n/a	15 1/8	384	12	305	45 5/8	1159	34 3/4	883	18 1/2	470	8 3/8	213



MODEL 350ASTDABF
(SHOWN WITH OPTIONAL
FLANGED END BUTTERFLY VALVES)


Options



(Suffixes can be combined)

- ☒ - with flanged end OS & Y gate valves (standard)
- ☐ LM - less water meter
- ☐ - with gallon meter (standard)
- ☐ CFM - with cu ft meter
- ☐ CMM - with cu meter meter
- ☐ G - with grooved end OS&Y gate valves
- ☐ FG - with flanged inlet gate connection and grooved outlet gate connection
- ☐ PI - with Post Indicator Gate Valves
- ☐ BG - with grooved end butterfly valves with integral supervisory switches
- ☐ BF - with flanged end butterfly valves with integral supervisory switches
- ☐ RV - with By-pass on right hand side

Accessories

- ☐ [Repair kit](#)
- ☐ Thermal expansion tank ([Model XT- Spec Sheet](#))
- ☐ OS & Y Gate valve tamper switch ([OSY-40](#))

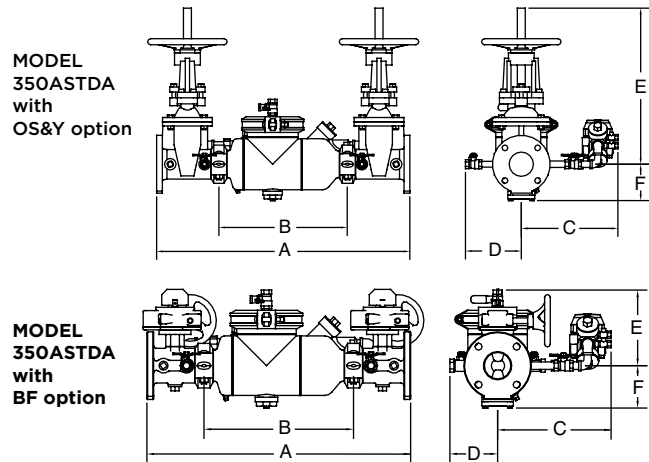

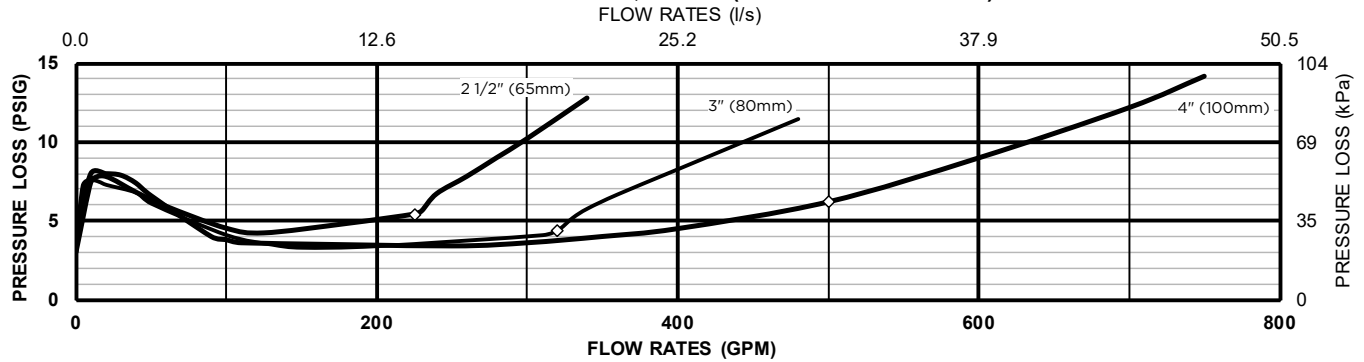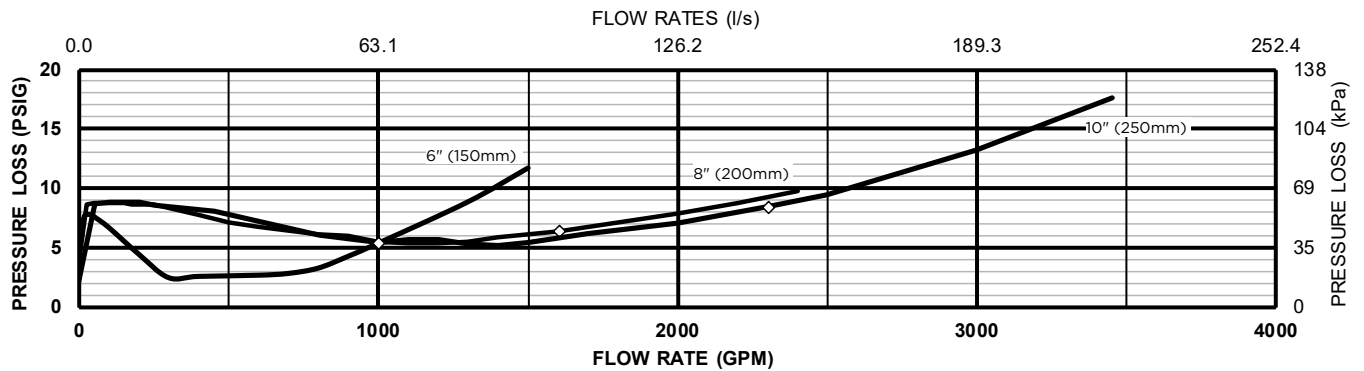MODEL 350ASTDA 2 1/2", 3" & 4" (STANDARD & METRIC)**MODEL 350ASTDA 6" 8" & 10" (STANDARD AND METRIC)****Suggested PRV Pairing:**

[Model ZW5000](#) Hose Valve ([Spec Sheet](#))

[Model ZW5004](#) Floor Control - Sprinkler Valve ([Spec Sheet](#))

[Model ZW209FP](#) Fire Protection Pressure R. ([Spec Sheet](#))



Typical Installation

([Installation & Maintenance Instruction Sheet](#)) 2 1/2" - 6"

([Installation & Maintenance Instruction Sheet](#)) 8" - 10"

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

Capacity thru Schedule 40 Pipe (GPM)				
Pipe size	5 ft/sec	7.5 ft/sec	10ft/sec	15 ft/sec
2 1/2"	75	112	149	224
3"	115	173	230	346
4"	198	298	397	595
6"	450	675	900	1351
8"	780	1169	1559	2339
10"	1229	1843	2458	3687
12"	1763	2644	3525	5288

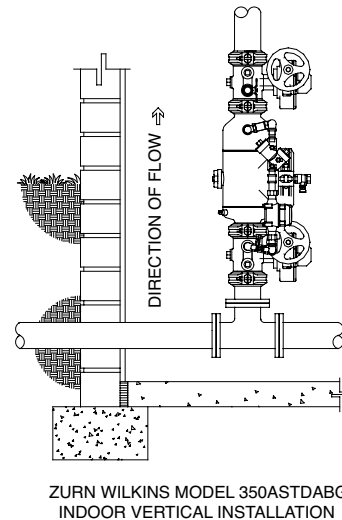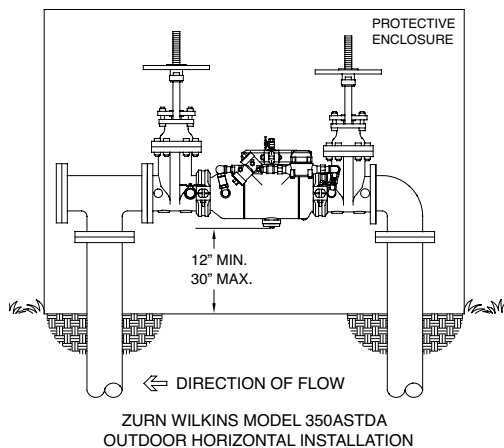**Specifications**

The Double Check Detector Backflow Prevention Assembly shall be certified to NSF/ANSI/CAN 61, ASSE® Listed 1048, and supplied with full port gate valves. The main body and access cover shall be 304L Stainless Steel, the seat ring and check valve shall be Noryl™, the stem shall be stainless steel (ASTM A 276) and the seat disc elastomers shall be EPDM. The first and second check valves shall be accessible for maintenance without removing the device from the line. The Double Check Detector Backflow Prevention Assembly shall be a ZURN WILKINS Model 350ASTDA.

Zurn Water, LLC | Wilkins

1747 Commerce Way, Paso Robles, CA U.S.A. 93446 Ph. 855-663-9876, Fax 805-238-5766

In Canada | **Zurn Industries Limited**

7900 Goreway Drive, Unit 10, Brampton, Ontario L6T 5W6, 877-892-5216

www.zurn.com

Submittal Documents

LIDL 1517



Overview	Bid Date:08-25-2026 Bid Number:5166172
Section	8" POST IND VALVE

POST INDICATOR VALVE WITH FLANGE ENDS


MODEL - LVPIVFF, LVPIVMJMJ



DESCRIPTION:

- Valves comply with AWWA C515-15 Standard
- Non-Rising Stem, resilient seated (EDPM encapsulated wedge)
- Triple O-Ring Seal
- Available with optional test plug on valve body (special order)
- Post Indicator Valves provided with universal "Indicator Post Plate"
- Mechanical Joint Ends to AWWA C153/A21.53
- Flanged Ends to ANSI B16.1, CLASS 125
- UL/Listed/FM Approved at 300 PSI water working pressure rating
- NSF/ANSI/CAN 61 certified as lead-free for use in drinking water systems
- Temperature range: 42°-180° F
- Fusion bonded epoxy coated interior and exterior to AWWA C550 standard
- Flanged Valves available with hand wheel or operating nut

*Flanged ends shown, LVPIVFF.
Available with Mechanical Joint
(MJ) ends. Model # LVPIVMJMJ

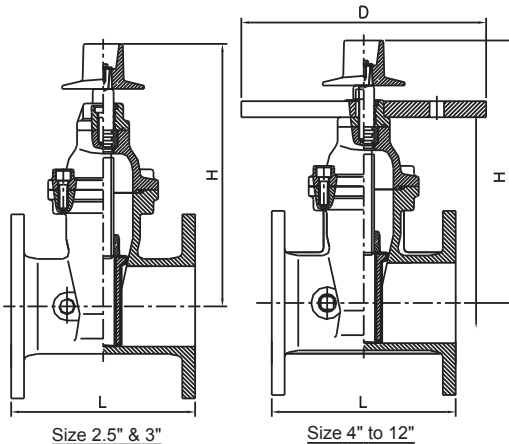

MATERIAL SPECIFICATIONS

PART	MATERIAL	ASTM SPEC.
Body	Ductile Iron	A536 65-45-12
Wedge	Ductile Iron	EPDM Encapsulated
Wedge Nut	Bronze	B62 C83600
Stem	Stainless Steel	ISI 304
Bonnet	Ductile Iron	A536 65-45-12
Gasket	Rubber	EPDM
Gland	Ductile Iron	A536 65-45-12
Thrust Collar	Bronze	B62 C83600
O-Ring	Rubber	EPDM
Post Flange	Ductile Iron	A536 65-45-12
Operating Nut	Ductile Iron	A536 65-45-12
NPT Plug	Bronze	Commercial
Post Flange	Bolt	Stainless Steel AISI 316
Bonnet Bolt	Stainless Steel	AISI 304


VALVE DIMENSIONS

Size (in.)	3	4	5	6	8	10	12
L (in.)	8	9	10	10-1/2	11-1/2	13	14
H (in.)	11-5/8	13-3/4	16-1/8	17-5/16	21-7/16	25-5/8	28-3/4
D (in.)		12	12	12	12	12	12
Weight (lbs.)	41	64	79	103	161	235	339

PROJECT		APPROVAL STAMP
PROJECT:		☐ APPROVED
ADDRESS:		☐ APPROVED AS NOTED
ENGINEER:		☐ NOT APPROVED
SUBMITTAL DATA:		REMARKS:
NOTES 1:		
NOTES 2:		

ADJUSTABLE VERTICAL INDICATOR POST

MODEL LVVIP

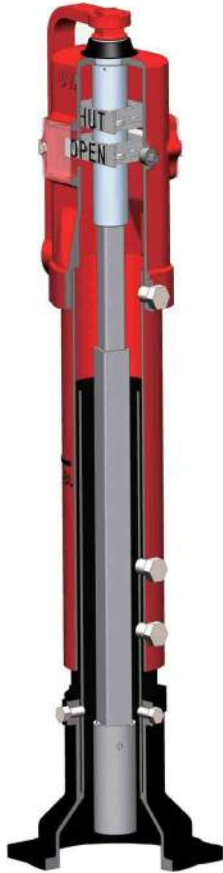

FEATURES:

- Meet or Exceed the Requirements of NFPA 24 Standard
- Indicates the State of the Valve OPEN or SHUT Position
- Target Nut to allow 13 to 45 Turns
- “L” Shaped Wrench Handle fitted with a Secure Padlock (provided by user).
- Protected Windows
- Telescoping Operating Rod
- Easily Adjustable Indicator OPEN and SHUT Targets
- UL/ULC 789 Listed and FM1110 Approved

CORROSION PROTECTION:


- Spray Painted Interior and Exterior meet or exceed all applicable of AWWA C550 Standard.
- Stand Barrel: Black Bitumen Coated

FIELD ADJUSTMENTS:

- Remove the post head to adjust OPEN and SHUT signs as required.
- Adjust telescoping rod and pipe to desired length.
- Re-attach the post to the post flange on the valve

ADJUSTABLE VERTICAL INDICATOR POST

MODEL LVVIP

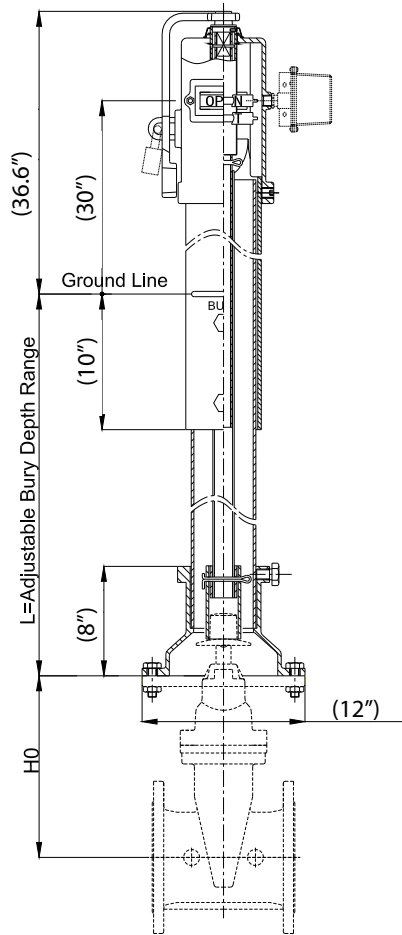

SIZES 4" TO 14"

MATERIAL SPECIFICATIONS

PART	MATERIAL	ASTM SPECIFICATION
Post Head	Gray Cast Iron	A126 Class B
Operating Wrench	Ductile Iron	A536 Grade 65-45-12
Retaining Ring	Stainless Steel	A276 Type 304
Weather Cap	Polyethylene	Commercial
Threaded Sleeve	Stainless Steel	A276 Type 304
Pipe Plug	Malleable Iron	A47 Grade 22010
Target Plate	Aluminum Alloy	ASTM B26
Screw	Carbon Steel	A105
Target Plate	Aluminum Alloy	ASTM B26
Windows	Plexiglass	Commercial
Gasket	Rubber	D2000 NBR
Upper Barrel	Carbon Steel	A53 Type S Grade B
Lower Barrel	Carbon Steel	A53 Type S Grade B
Upper Rod	Carbon Steel	A53 Type S Grade B
Lower Rod	Carbon Steel	A53 Type S Grade B
Base Flange	Cast Iron	A126 Class B
Locking Bolts	Carbon Steel	A307 Grade B
Locking Nuts	Carbon Steel	A 105
Cotter Pin	Stainless Steel	A276 Type 304
Crane Coupling	Carbon Steel	A53 Type S Grade B

DIMENSIONS DATA FOR LANSDALE ADJUSTABLE VERTICAL INDICATOR POST (In)

SIZE	4	6	8	10	12	14
URNS TO OPEN	13	20	26	33	39	45
H0	9.92	13.97	17.48	21.06	24.29	28.62

L= ADJUSTABLE BURY DEPTH RANGE

L	A	B	C	D	E	F	G
MIN	18.25	36	57	78	99	120	148.5
MAX	39.5	60.5	81.5	102.5	123.5	144.5	168

PROJECT	APPROVAL STAMP
PROJECT:	☐ APPROVED
ADDRESS:	☐ APPROVED AS NOTED
ENGINEER:	☐ NOT APPROVED
SUBMITTAL DATA:	REMARKS:
NOTES 1:	
NOTES 2:	




P.I.V (WALL OR VERTICAL POST) TAMPER SWITCH MODEL LVPIVSS



FEATURES:

- **Weight:** .1.323 lbs
- **Temperature Rating:** -40°F - 140°F
- **Enclosure:**
 - Cover:** Die Cast
 - Finish:** Red Powder Coat
 - Base:** Die Cast
 - All parts have corrosion resistant finishes
- **Cover Tamper:**
 - Tamper Resistant Screws
 - Cover Tamper Switch Available
 - 33amps/5amps at 125/250VAC
- **Contact Ratings:**
 - Two sets of SPDT
 - 10amps at 125/250VAC. 2.5 Amps 30VDC resistive
- **Conduit Entrances:** One knockout and one hole for ½" conduit provided
- **Service Use:** NFPA 13, 13D, 13R, 72
- UL/ULC Listed/FM Approved

Dimensions/Inches

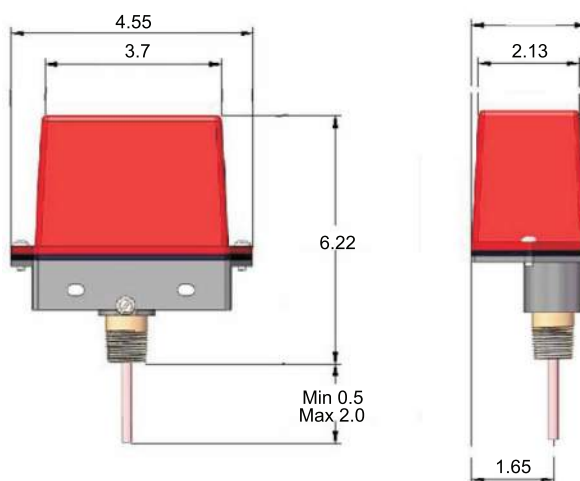

PROJECT		APPROVAL STAMP	
PROJECT:		☐ APPROVED	
ADDRESS:		☐ APPROVED AS NOTED	
ENGINEER:		☐ NOT APPROVED	
SUBMITTAL DATA:		REMARKS:	
NOTES 1:			
NOTES 2:			

Submittal Documents

LIDL 1517



Overview

Bid Date: 08-25-2026
Bid Number: 5166172

Section

8" GATE VALVE ASSEMBLY

The original, and the definitive standard.

RESILIENT WEDGE GATE VALVES

**4" THROUGH 20"
STYLE 7000**



AWWA C515 250 PSI • UL/FM Approved 200 PSI • NSF 61 Certified •
Full Water Way • Fusion Bond Epoxy Coated • 10 Year Limited Warranty



M&H VALVE COMPANY

M&H Valve is a division of McWane, Inc.

www.mh-valve.com



For Generations


RESILIENT WEDGE VALVE

In 1975, M&H recognized the increased requirements and escalating maintenance cost of water systems in the United States.


M&H responded by introducing the first R/W (Resilient Wedge) Valve in America. This introduction revolutionized the valve market in the U.S.

M&H is the first to introduce, and still leads in the design and technical development, of the bubble-tight resilient seating valve.


The M&H Resilient Wedge Valve, with its unique features and benefits, is the first to be manufactured with both AWWA and UL/FM approval for all water system requirements.




**7571
MECHANICAL JOINT
4" - 20"**




**7561
FLANGED
4" - 20"**




**7572
FLANGED X
MECHANICAL JOINT
4" - 20"**




**7597
PUSH ON FOR
SDR PVC
4" - 12"**




**7576
MECHANICAL
CUTTING IN JOINT
4" - 12"**




**7901
TYTON ENDS FOR D.I.
AND C900 PVC PIPE
4" - 16"**




**7902
FLANGED X TYTON
4" - 12"**




**7590
TAPPING X MJ
TAPPING VALVE
4" - 20"**




**7571-P
MECHANICAL JOINT
POST INDICATOR VALVE
4" - 16"**




**7068
FLANGED OS&Y
4" - 16"**




**BEVEL GEARING
HORIZONTAL
INSTALLATION
ALL END STYLES
14" - 20"**



**SPUR GEARING
VERTICAL
INSTALLATION
ALL END STYLES
14" - 20"**



**OS&Y BEVEL GEARING
HORIZONTAL INSTALLATION
ALL END STYLES
14" - 20"**



**OS&Y SPUR
GEARING VERTICAL
INSTALLATION
ALL END STYLES
14" - 20"**

NOTE:

It is recommended that valves be installed with stems vertical when used in raw sewage or sludge applications or in water with excessive sediment. Flanged end connections not recommended for buried service.

VALVE SIZE																	NO. OF TURNS TO FULL OPEN				
	A	B	C	E	G	H	J	K	M	N	P	Q	R	S	U	V	NO GEAR	GEARED	W	X	Y
4"	9	4-1/2	6-3/4	14-3/4	4-5/8	6-3/4	-	-	-	-	4-1/2	22-3/4	18-1/4	10	6-3/4	9-1/4	13-1/2	-	-	-	-
6"	10-1/2	5-1/2	7-7/8	19	5-1/4	8	-	-	-	-	5	30-1/8	23-3/4	12	8	10-1/2	19-1/2	-	-	-	-
8"	11-1/2	8-1/8	8-1/2	22-1/2	5-5/8	9-3/4	-	-	-	-	5-1/2	37-3/4	29-1/4	14	10-3/4	13-1/4	25-1/2	-	-	-	-
10"	13	10-1/2	10	26-1/2	7	11-3/4	-	-	-	-	7	45-3/4	35-3/8	18	11-3/4	14-7/8	31-1/2	-	-	-	-
12"	14	10-3/4	11-1/4	30	8-1/2	12-7/8	-	-	-	-	8-1/2	53-1/8	40-3/8	18	12-3/8	15	37-3/4	-	-	-	-
14"	15	10	-	37-3/4	10-1/2	13-1/2	52-1/8	8	48-5/8	9-1/8	-	74-3/4	59-3/4	22	13-1/4	16-3/4	52	100	76	59-7/8	64-1/2
16"	16	10	-	37-3/4	10-1/2	13	51-1/8	8	47-5/8	9-1/8	-	74-3/4	59-3/4	22	12-3/4	16-1/4	52	100	76	59-7/8	64-1/2
18"	17	11-3/4	-	-	-	14-7/8	58	12	55-3/4	10-1/8	-	-	-	-	14-5/8	18-1/8	-	189	90-7/8	70-1/8	74-5/8
20"	18	11	-	-	-	14-1/2	57	12	54-3/4	10-1/8	-	-	-	-	14-1/2	18	-	189	90-7/8	70-1/8	74-5/8

ENGINEERING FEATURES

THRUST BEARINGS

Delrin thrust bearings above and below the thrust collar reduce friction and minimize operating torques.

STAINLESS STEEL HARDWARE

304 stainless steel nuts and bolts provide long-life corrosion protection.

COPPER ALLOY STEM

Long, trouble free life with high strength, non-corrosive copper alloy stem and stem nut.

100% COATED WEDGE

100% coated wedge ensures bubble-tight seal every time up to 250 PSI. With twin seal design.

ELLIPTICAL BOLT HOLES

Hole design on MJ connection eliminates the need for anti-rotation bolts (4" – 12").

EASY STORAGE

Pads on the bottom of all valves keep valve in upright position for easier storage and protection from the elements.

REPLACEABLE O-RINGS

Two O-ring seals are replaceable with the valve fully open and subjected to full-rated working pressure.

NO FLAT GASKETS


O-ring seals at stuffing box and bonnet to body flanges to ensure the best possible seal.

MINIMAL FLOW LOSS

Smooth, unobstructed waterway is free of pockets, cavities, and depressions allowing for minimal flow loss and lower pumping costs. All valves accept full size tapping cutter.

EPOXY COATING

Clow corrosion resistant fusion-bonded epoxy coating, conforming to AWWA C550 and NSF 61 Certified, protects both inside and outside of valve.

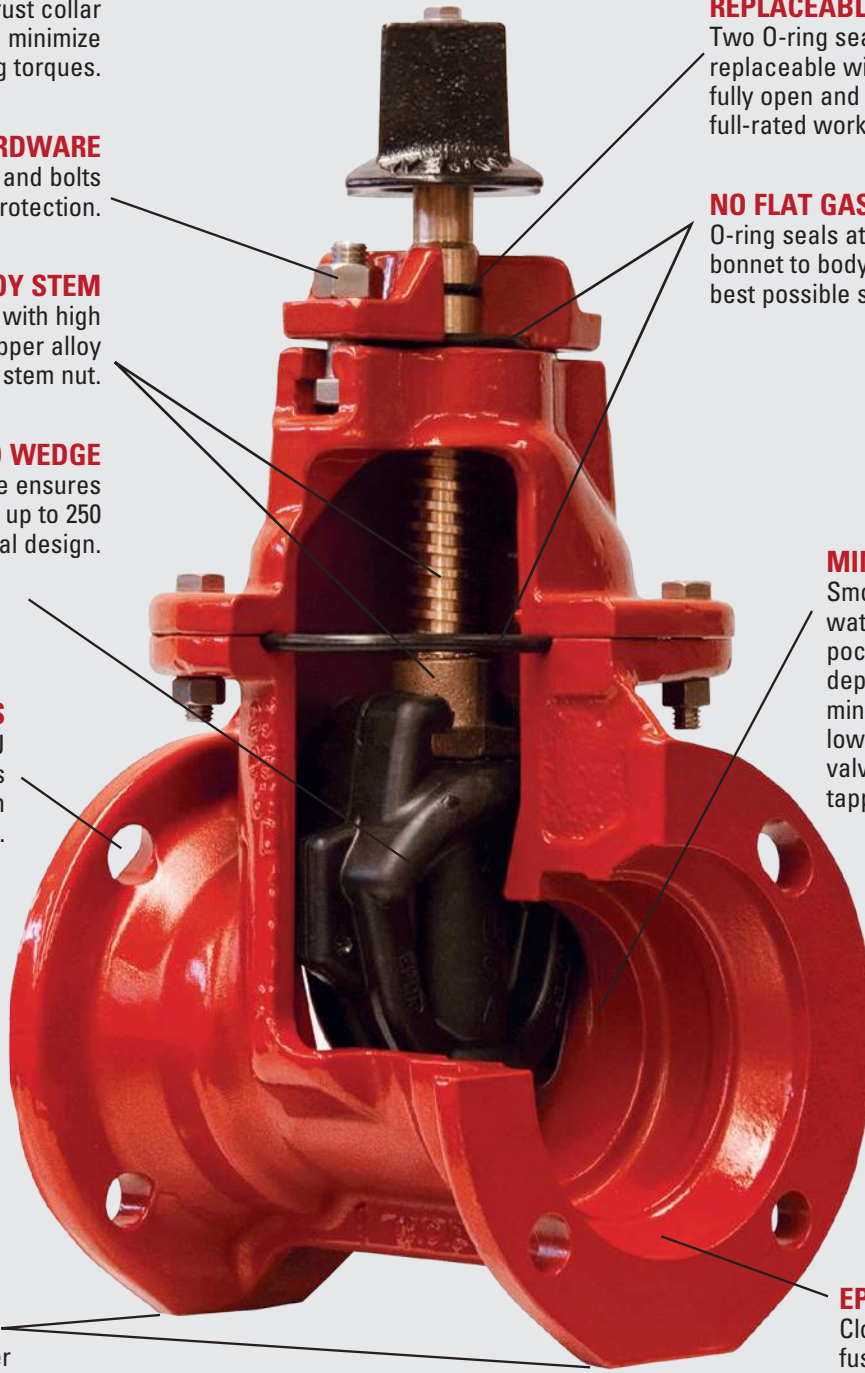

VALVE RATING: All valves are rated at 250 PSI for AWWA service and hydrostatically tested to 500 PSI. Valves through 16" are rated at 200 PSI for UL/FM service.



COMMITTED TO ENVIRONMENTAL RESPONSIBILITY

M&H VALVE COMPANY IS COMMITTED TO PROTECTING OUR NATURAL RESOURCES THROUGH ENVIRONMENTALLY RESPONSIBLE MANUFACTURING PRACTICES, INCLUDING THE USE OF 80+% RECYCLED CONTENT IN OUR HYDRANTS AND VALVES.

To learn more about our commitment to the environment, call 256-237-3521

RECOMMENDED SPECIFICATIONS

1. Valves shall conform to the latest revision of AWWA Standard C515 covering resilient seated gate valves for water supply service.
2. The valves shall have a ductile iron body, bonnet, and O-ring plate. The wedge shall be totally encapsulated with rubber.
3. The sealing rubber shall be permanently bonded to the wedge per ASTM D429.
4. Valves shall be supplied with O-ring seals at all pressure retaining joints. No flat gaskets shall be allowed.
5. The valves shall be either non-rising stem or rising stem, opening by turning left or right, and provided with 2" square operating nut or a handwheel with the word "Open" and an arrow to indicate the direction to open.
6. Stems shall be cast copper alloy with integral collars in full compliance with AWWA. All stems shall operate with copper alloy stem nuts independent of wedge and of stem (in NRS valves).
7. Stems shall have two O-rings located above thrust collar and one O-ring below. Stem O-rings shall be replaceable with valve fully opened and subjected to full pressure. The stems on 4" – 20" shall also have two low torque thrust bearings located above and below the stem collar to reduce friction during operation.
8. Waterway shall be smooth, unobstructed and free of all pockets, cavities and depressions in the seat area. Valves 4" and larger shall accept a full size tapping cutter.
9. The body, bonnet and O-ring plate shall be fusion-bond epoxy coated, both interior and exterior on body and bonnet. Epoxy shall be applied in accordance with AWWA C550 and be NSF 61 Certified.
10. Each valve shall have maker's name, pressure rating, and year in which it was manufactured cast in the body. Prior to shipment from the factory, each valve shall be tested by hydrostatic pressure equal to the requirements of AWWA C515 (and UL/FM where applicable).
11. Valves shall have all component parts cast and assembled in the USA and shall be manufactured by the M&H Valve Company.

ISO 9001



www.mh-valve.com



M&H VALVE COMPANY

605 West 23rd Street • Anniston, Alabama 36201
PHONE 256-237-3521 FAX 888-549-5309



For Generations

REQUIREMENT:

- ☐ Class 30B
☐ Class 35B
☐ Ductile Iron



Quality – Service – Commitment – Delivered.

MUNICIPAL VALVE AND SERVICE BOXES

SIZE RANGE:

- Adjustable Slip and Screw Type with standard assembled lengths ranging from 15" to 72" (Lengths do not include risers and/or extensions).

STANDARDS:

- Manufactured from cast iron in accordance with and meet all applicable terms and provisions as per ASTM A48 standard and will meet the minimum tensile strength requirements.
- Sigma Valve Boxes when properly installed can be used for projects related to American Association of State and Highway Officials (AASHTO) standards.

INSTALLATION:

- Per AWWA M44

COATING:

- Black Asphaltic Bituminous paint. Coating thickness of 1 to 2mil is applied on the product.

Extention Height	Components	2 Pc Screw Type	2 Pc Slip Type	Extention Height	Components	3 Pc Screw Type	Extention Height	Components	Screw Type Service Box
19-22	10T + 15B	VB261	VB461	27-37	10T + 12B	VB630AA	24-33	15T + 21B	VB791C
27-37	16T + 24B	VB262	VB462	33-42	10T + 18B	VB630A	30-39	15T + 27B	VB792C
39-50	16T + 36B	VB264	VB464	39-49	16T + 24B	VB630B	30-42	18T + 27B	VB792D
39-60	26T + 36B	VB266	VB466B / VB466N*	45-54	16T + 30B	VB630C	36-48	18T + 33B	VB793D
50-71	26T + 48B	VB267	VB467	51-60	16T + 36B	VB630CC	36-54	24T + 33B	VB793E
63-81	26T + 60B	VB268	VB468	45-66	26T + 30B	VB630D	42-60	24T + 39B	VB794E
				51-72	26T + 36B	VB630DD	41-64	30T + 39B	VB795E
				63-84	26T + 48B	VB630F			
				74-94	26T + 60B	VB630G			
			B = With Flange N = Without Flange	NOTE: Requires use of base - Above ships with VB6306 base standard - Other sizes available					

**** ADD -35 TO ITEM # FOR CLASS 35B GREY IRON REQUIREMENTS / ADD -D FOR DUCTILE IRON REQUIREMENTS**
RISERS, EXTENSIONS AND VARIOUS SPECIALLY LETTERED LIDS AVAILABLE FOR ALL ITEMS




700 Goldman Drive
 Cream Ridge, NJ 08514
 CRMCSR@sigmaco.com

5000 Askins Lane
 Houston, TX 77093
 HTNCSR@sigmaco.com

4652 E. Guasti Rd
 Ontario, CA 91761
 ONTCRSR@sigmaco.com

21699 Torrence Avenue
 Sauk Village, IL 60411
 CHICSR@sigmaco.com

Highway 22 West
 Alexander City, AL 35010
 ALXCSR@sigmaco.com

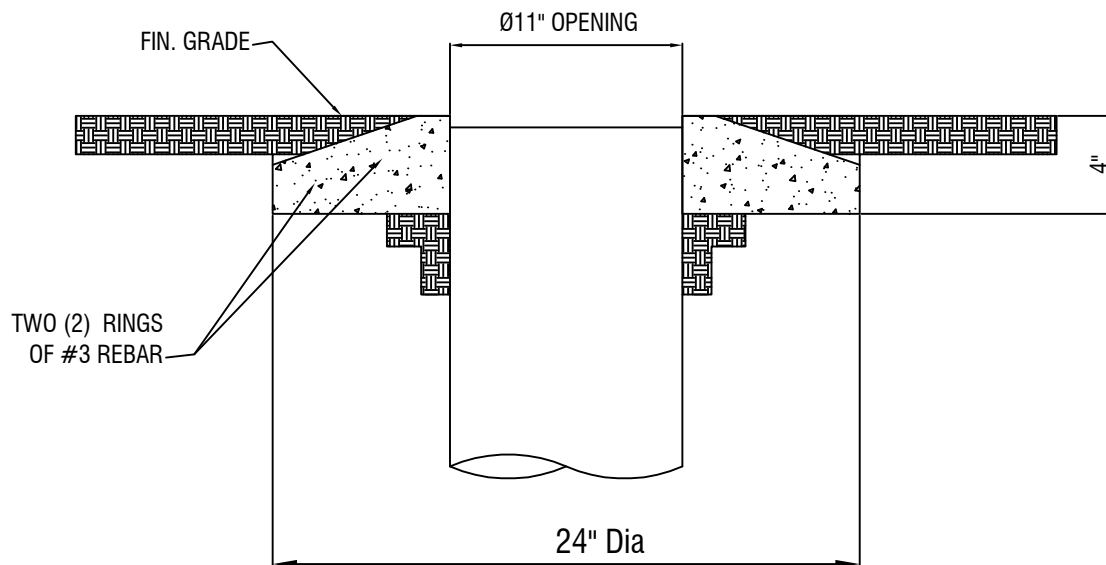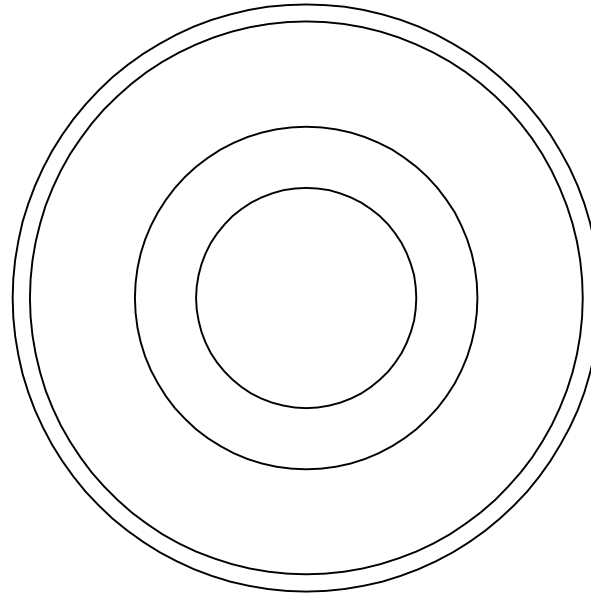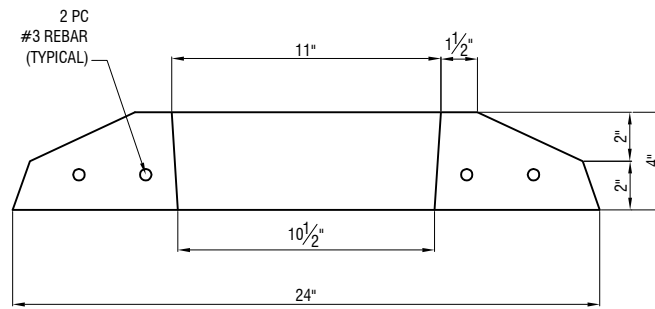

SECTION "A - A"

Masonry Supply, Inc

P.O. BOX 943

SELMA, NC 27576


PH: (919) 351-4014 (office), (919) 291-8761 (cell) FAX: (919) 351-4047

EMAIL: masonrysupply@hotmail.com

ITEM: 24" CONCRETE VALVE BOX COLLAR

PART # MSVB - 24

MATERIAL SPEC: A - 3 CONCRETE (4000 psi @28 DAYS)

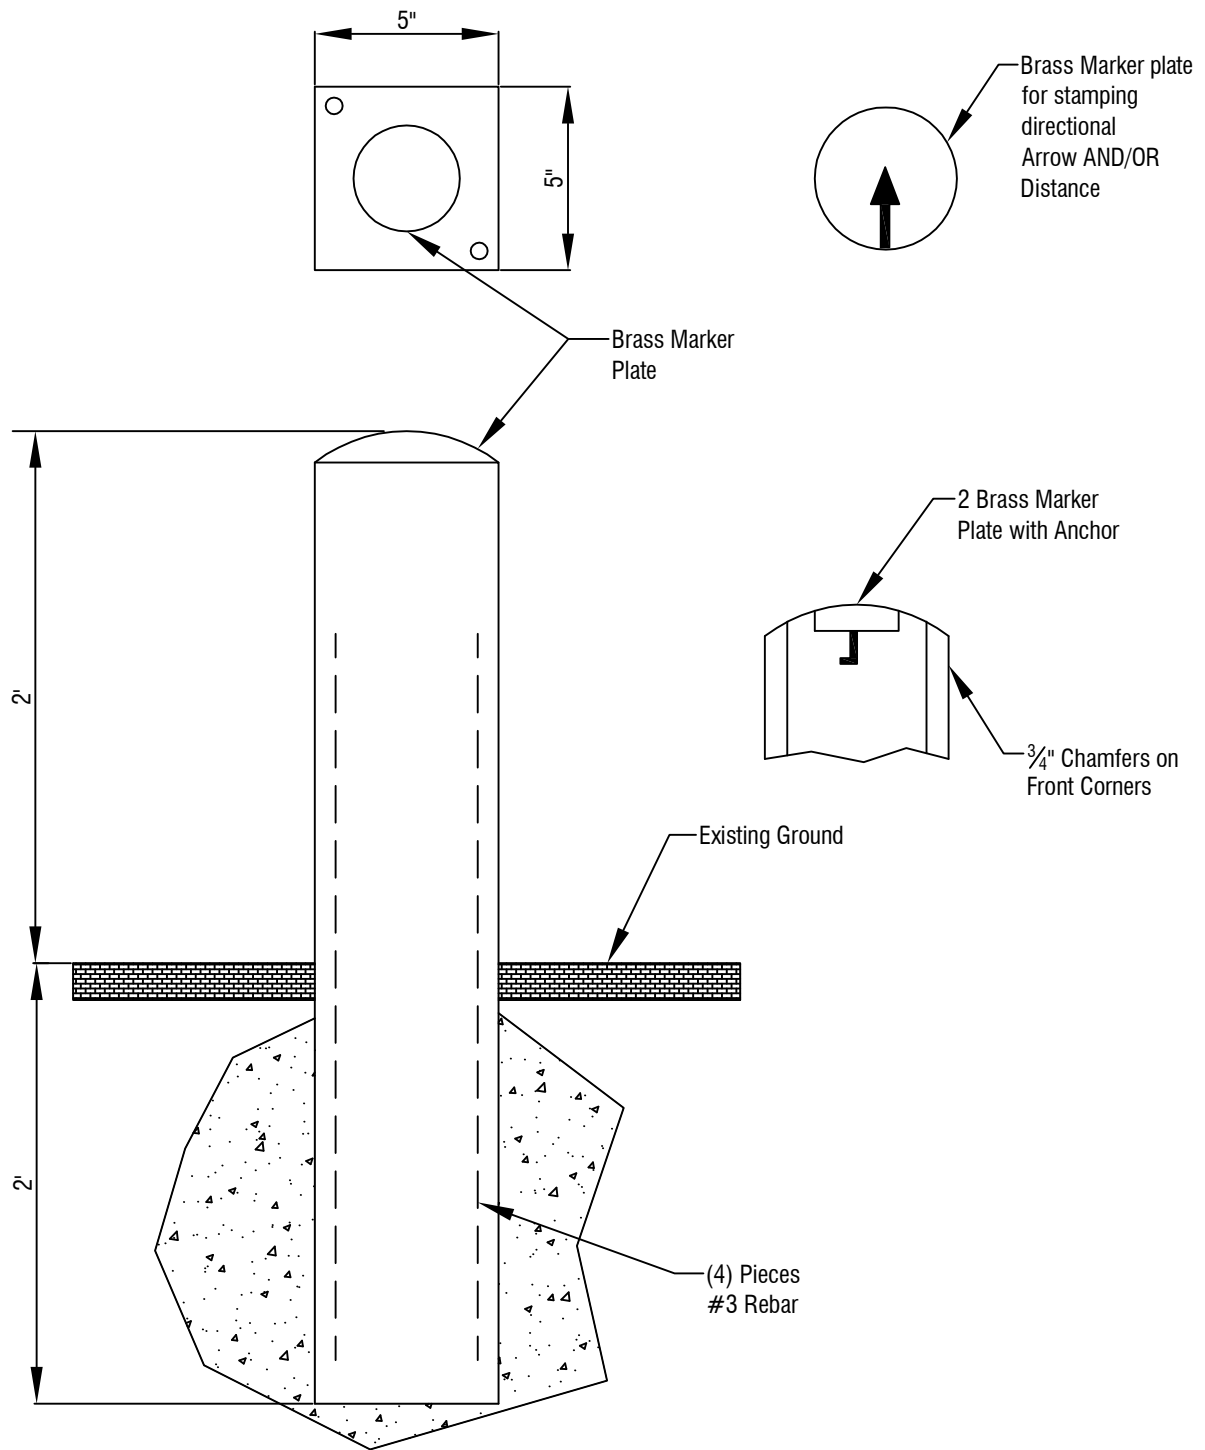

Notes:

1. Made of minimum 4000 PSI Concrete
2. Height - 4', width of sides - 5"
3. 3/4" chamfers on front corners
4. Four pieces of #3 rebar
5. Two inch brass marker plate with anchor
6. Lettering stamped on marker as specified in 3" letters
 Standard Marker = MV (Main Valve) top front
 = BO (Blow-off) bottom front
 = AV (Air Release Valve)
 = LM (Line Marker)

Masonry Supply, Inc

P.O. BOX 943
 SELMA, NC 27576

PH: (919) 351-4014 (office), (919) 291-8761 (cell) FAX: (919) 351-4047
 EMAIL: masonrysupply@hotmail.com

ITEM: PRECAST CONCRETE 4 FT TALL MARKING POSTS W/BRASS

PART # MMVB 04 W/BR

MATERIAL SPEC: A - 3 CONCRETE (4000 psi @28 DAYS)