


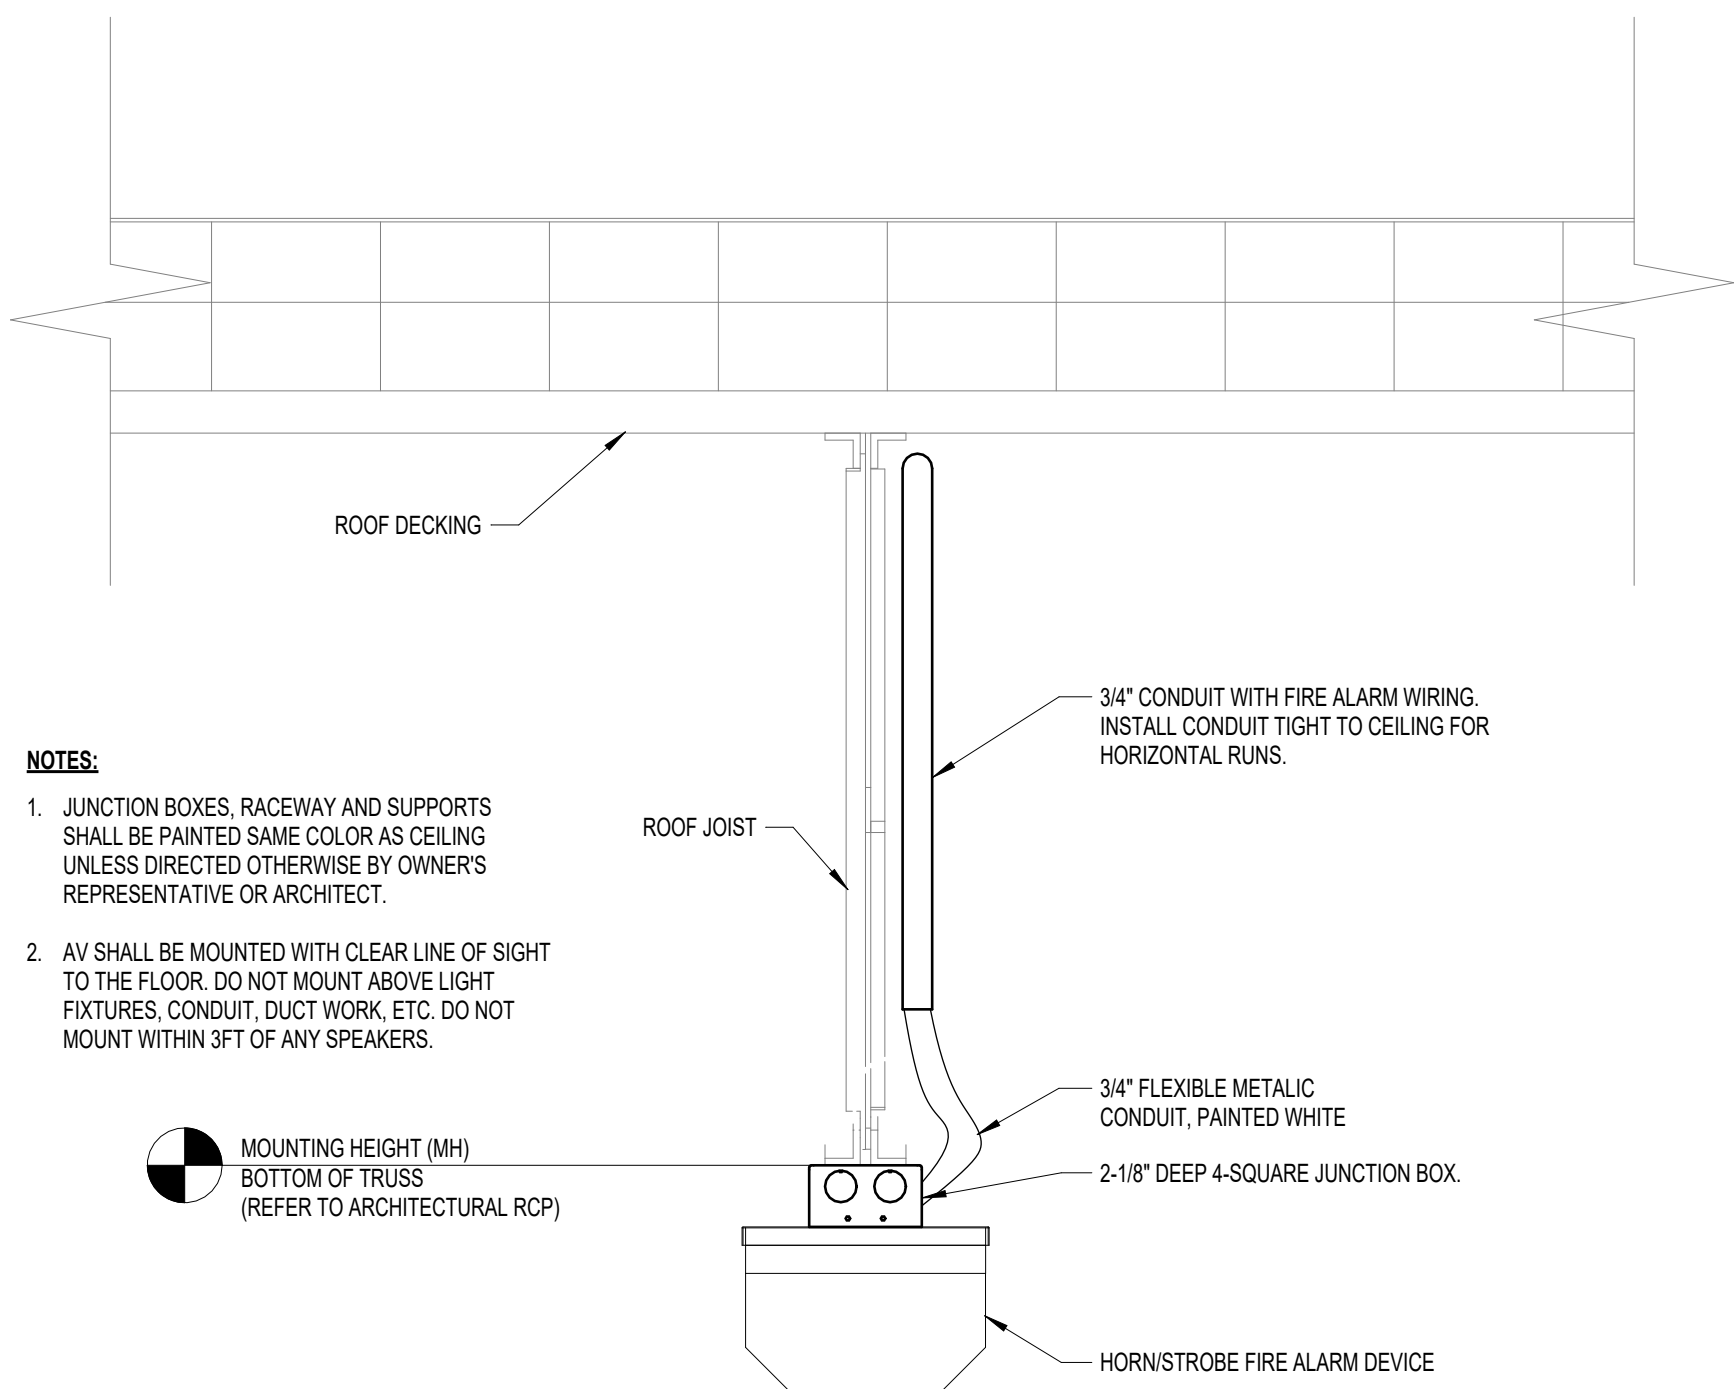

NTS

- A. REFER TO SHEET E000 FOR SYMBOL LIST, ABBREVIATIONS, AND GENERAL NOTES.
- B. ALL DUCT DETECTORS AND RELAYS ARE LOCATED IN ROOFTOP HVAC UNITS. COORDINATE WITH MECHANICAL CONTRACTOR FOR LOCATIONS AND INSTALLATIONS.
- C. MOUNT ALL FIRE ALARM APPLIANCES LOCATED WITHIN SALES 101 TO THE UNDERSIDE OF JOIST (TYPICAL). REFER TO DETAIL #2 ON THIS SHEET.
- D. ALL FIRE ALARM DEVICES TO BE WHITE WITH RED LETTERS.

1. PROVIDE DUCT MOUNTED SMOKE DETECTOR AND FIRE ALARM ADDRESSABLE RELAY MODULE FOR SHUT DOWN OF ROOFTOP HVAC UNITS OVER 2,000CFM. INSTALL DETECTOR IN RETURN AIR DUCT. DETECTOR TO BE PROVIDED AND INSTALLED BY DIV 28. HOUSING TO BE INSTALLED BY DIV 23.
2. REMOVE TEST SWITCHES DUCT MOUNTED SMOKE DETECTORS FOR ROOFTOP HVAC UNITS. PROVIDE SWITCH FOR EACH UNIT/DUCT DETECTOR. LABEL EACH SWITCH WITH ASSOCIATED UNIT/DETECTOR.
3. FIRE SPRINKLER WATER BELL, MOUNT AT 8'-0" AFF TO THE CENTER OF THE BELL. HORN/STROBE TO BE MOUNTED 0'-24" ABOVE THE TOP OF THE BELL. BOTH DEVICES SHALL BE MOUNTED ABOVE THE EXIT DOOR.

		FIRE ALARM SYSTEM OPERATIONAL MATRIX													
		ALARM				TROUBLE				SUPERVISORY		MISC.			
CAUSE	EFFECT	ARMED FIRE	ARMED TROUBLE	ARMED SUPERVISORY	ARMED MISC.	ARMED FIRE	ARMED TROUBLE	ARMED SUPERVISORY	ARMED MISC.	ARMED FIRE	ARMED TROUBLE	ARMED SUPERVISORY	ARMED MISC.		
		HEAT DETECTOR	SMOKE DETECTOR	MANUAL PULL STATION	DUCT MOUNT SMOKE DETECTOR	KITCHEN HOOD FIRE SUPPRESSION SYSTEM	SPRINKLER VALVE TAMPER SWITCH	SPRINKLER WATER FLOW SWITCH	TRANSMITTER FAULT/POWER LOSS	TRANSMITTER TRANSMISSION FAIL	OPEN CIRCUIT OR GROUND FAULT	NOTIFICATION CIRCUIT (NAC) - SHORT	FIRE ALARM AC POWER FAILURE	SYSTEM RESET	FIRE ALARM SYSTEM LOW BATTERY
		●	●	●	●										●
		●	●	●	●										●
		●	●	●	●										●
						●	●	●	●						
		●	●	●	●										●
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						
						●	●	●	●						


GENERAL DETAIL NOTES

- A. ANNUNCIATOR IS A TYPICAL LAYOUT THE CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF THE ANNUNCIATOR IN ACCORDANCE WITH THE SPECIFICATIONS AND ADOPTED CODES AND STANDARDS. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO AHJ.

LEGEND

- YELLOW LED
RED LED
GREEN LED
KEY SWITCH

4990 JIMMY CARTER BLVD. NORCROSS, GA 30093

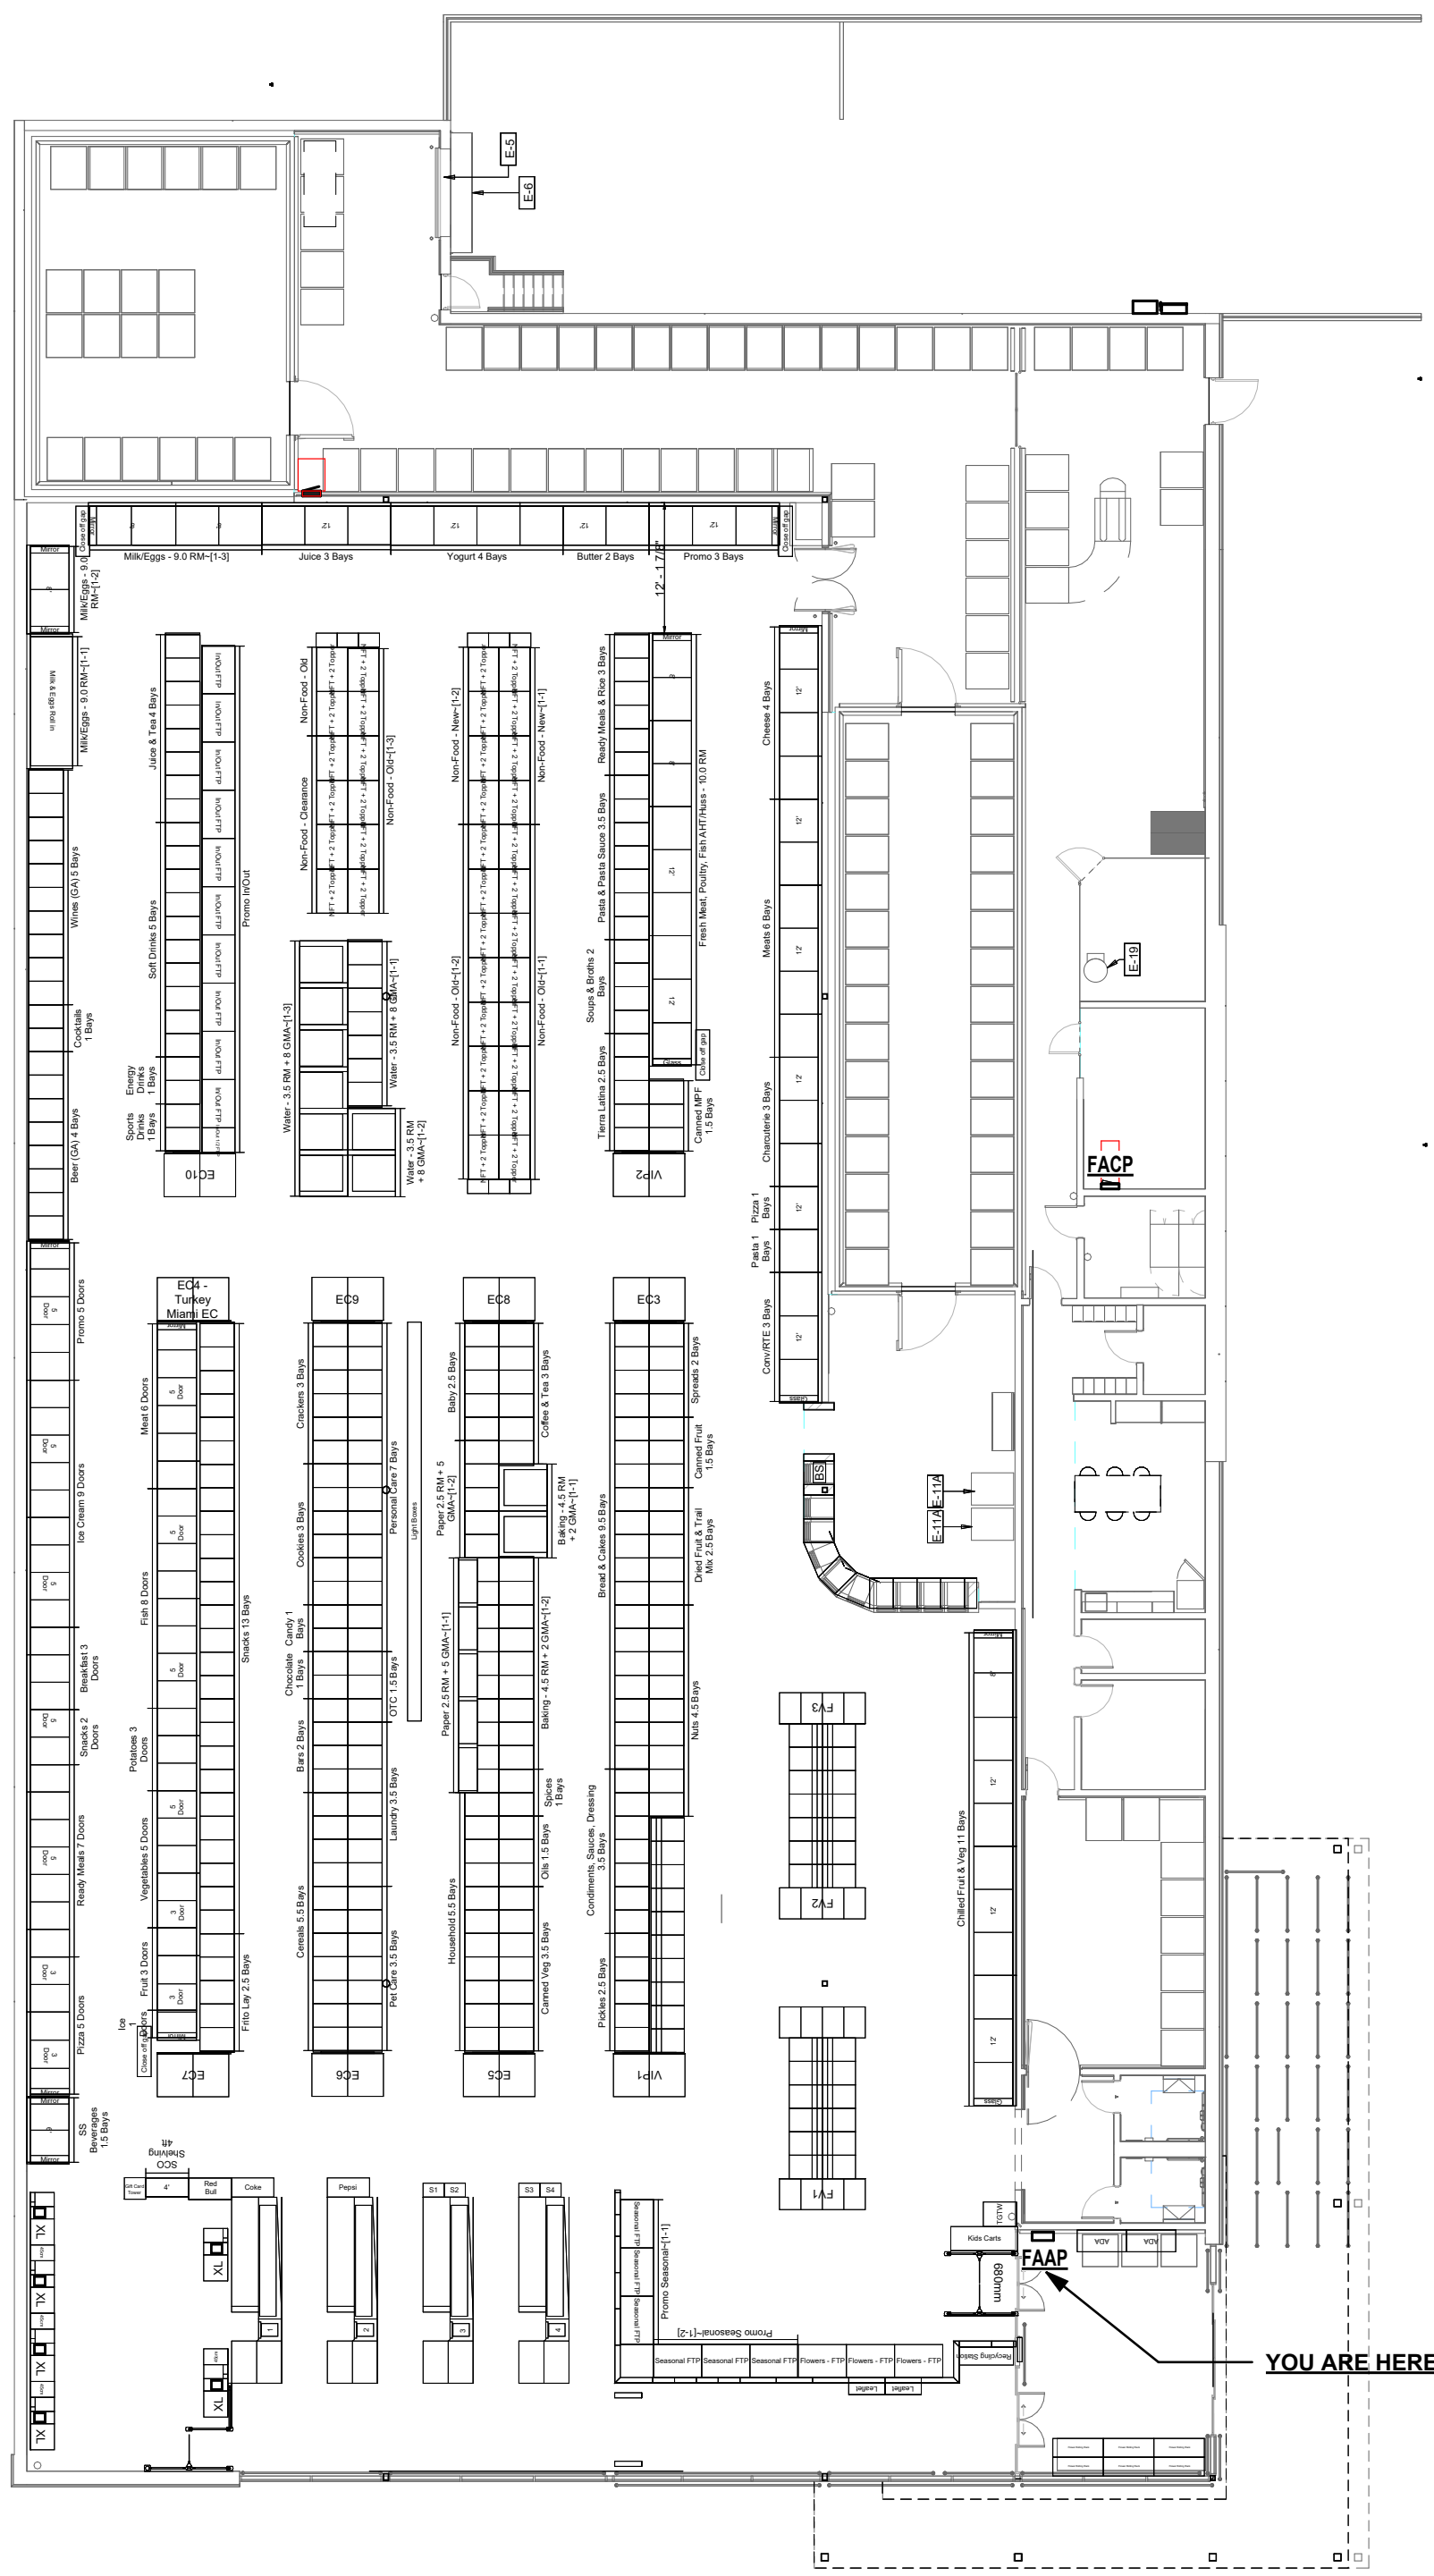

LEVELS

- GROUND FLOOR

ALARM DEVICE

- HEAT DETECTOR
SMOKE DETECTOR
PULL STATION
FLOW SWITCH

SUPERVISORY AND TROUBLE

- TAMPER SWITCH
POST INDICATOR VALVE
DUCT SMOKE DETECTOR
TROUBLE

- POWER

- ALARM SILENCE
ALARM RESET
TROUBLE RESET
LAMP TEST




GENERAL SHEET NOTES

- A. REFER TO SHEET E000 FOR LEGENDS, ABBREVIATIONS AND GENERAL NOTES.

GENERAL DETAIL NOTES

- A. RISER IS DIAGRAMMATICAL AND ONLY SHOWS TYPICAL LAYOUT OF APPLIANCES, DEVICES AND EQUIPMENT. THE CONTRACTOR IS RESPONSIBLE FOR THE DESIGN AND INSTALLATION OF THE SYSTEM IN ACCORDANCE WITH THE SPECIFICATIONS AND ADOPTED CODES AND STANDARDS. CONTRACTOR SHALL SUBMIT SHOP DRAWINGS TO AHJ.

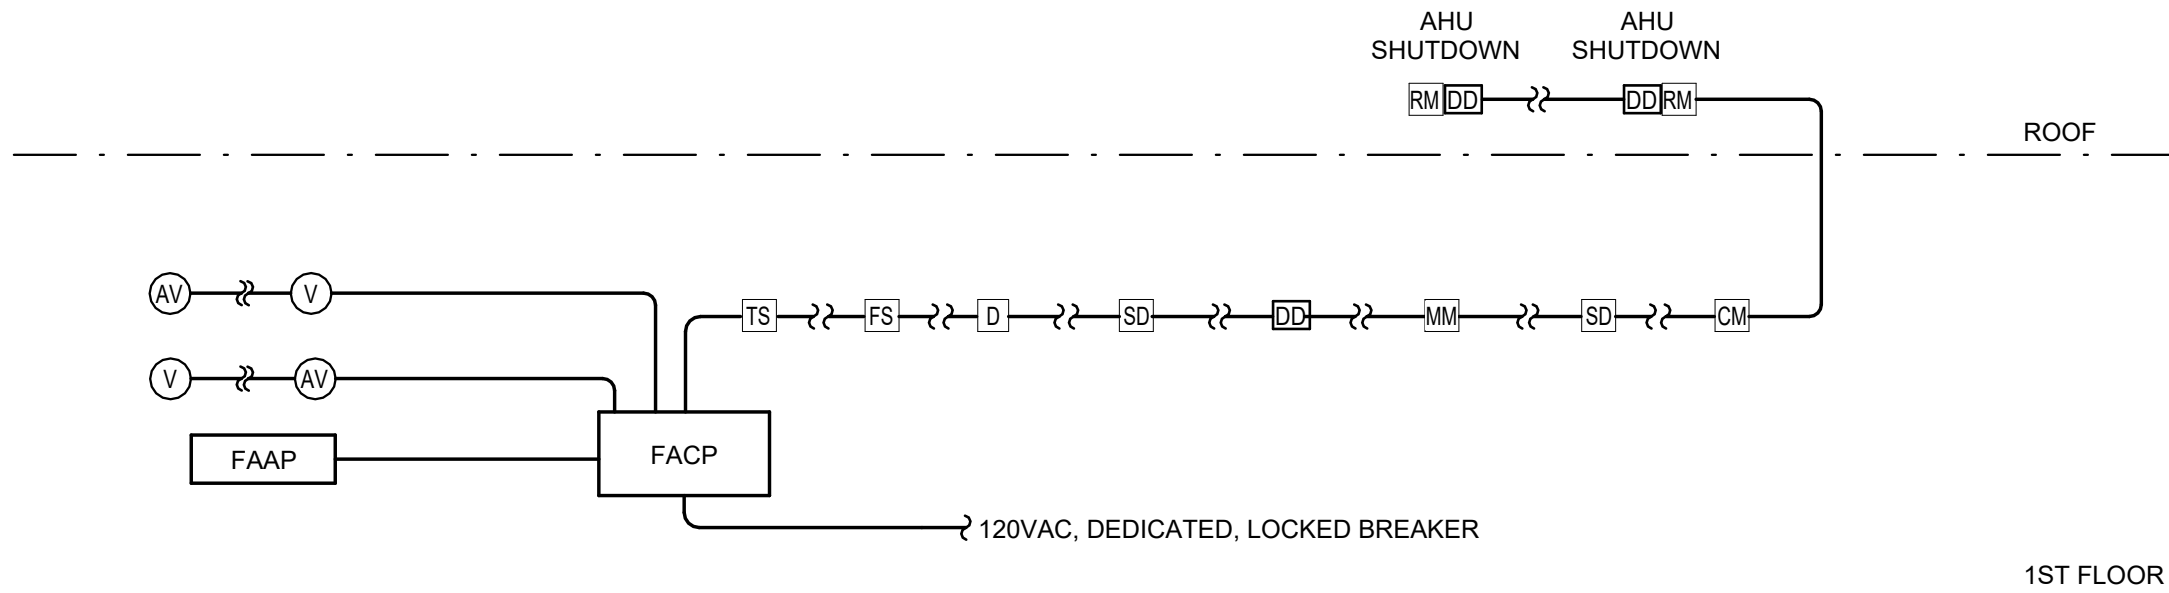

1 FIRE ALARM - GRAPHIC ANNUNCIATOR LAYOUT

NO SCALE

2 TYPICAL RISER DIAGRAM - FIRE ALARM

NO SCALE

ISSUANCE
1 12/18/2025 PERMIT CYCLE 2

PROJECT NUMBER
78650191
PROJECT MANAGER
A. HENGSTEBECK
PROFESSIONAL
D. HERSCHER
DRAWN BY
M. GONZALEZ
CHECKED BY
D. HERSCHER

FIRE ALARM
GRAPHIC PANEL
FA102

LIDL US, LLC
LIDL 1517 NORCROSS, GA

499 JIMMY CARTER BLVD NORCROSS, GA 30093