








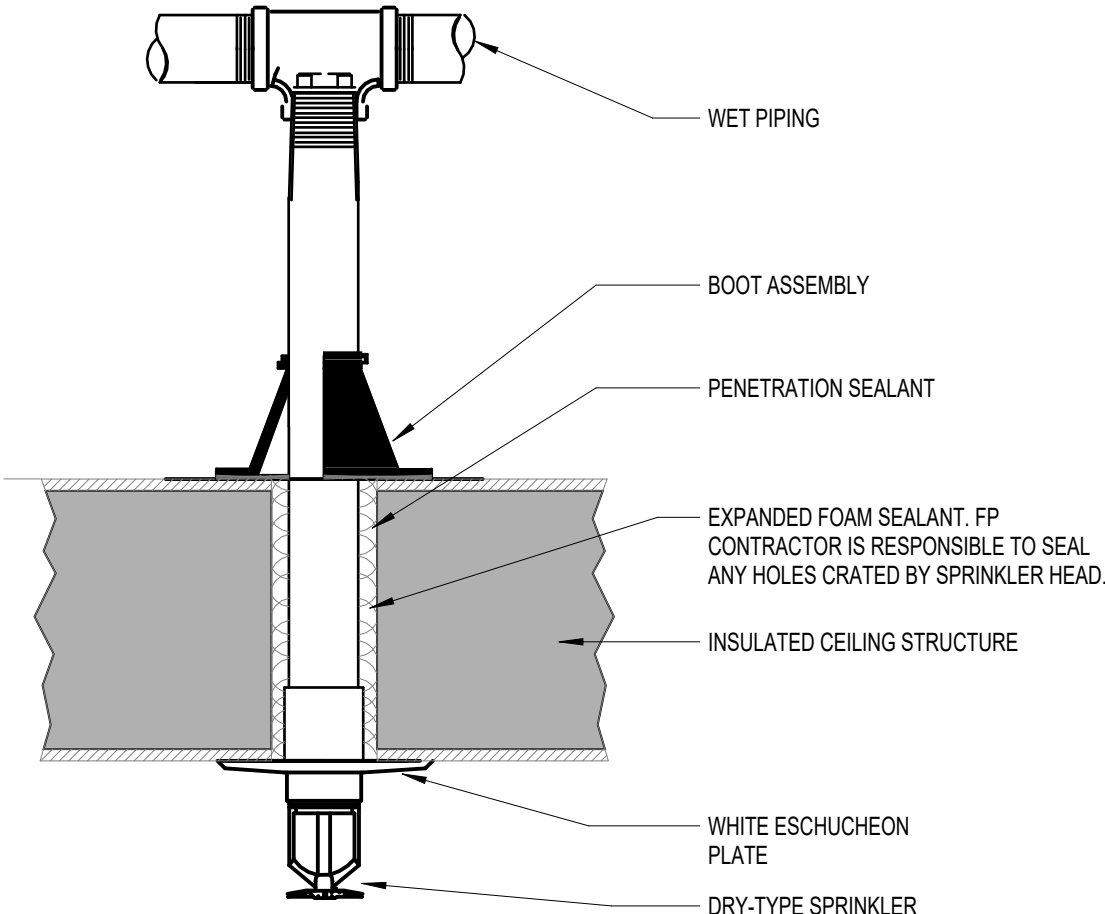


**E5** DRY-TYPE SPRINKLER INSTALLATION  
NOT TO SCALE

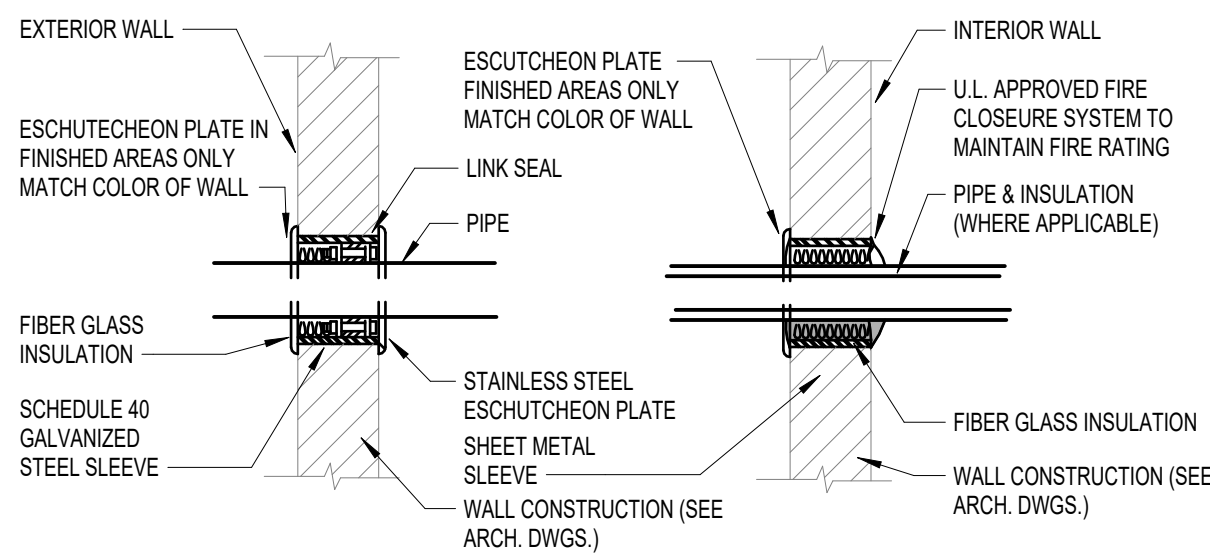



**E3** WALL PENETRATION  
NOT TO SCALE

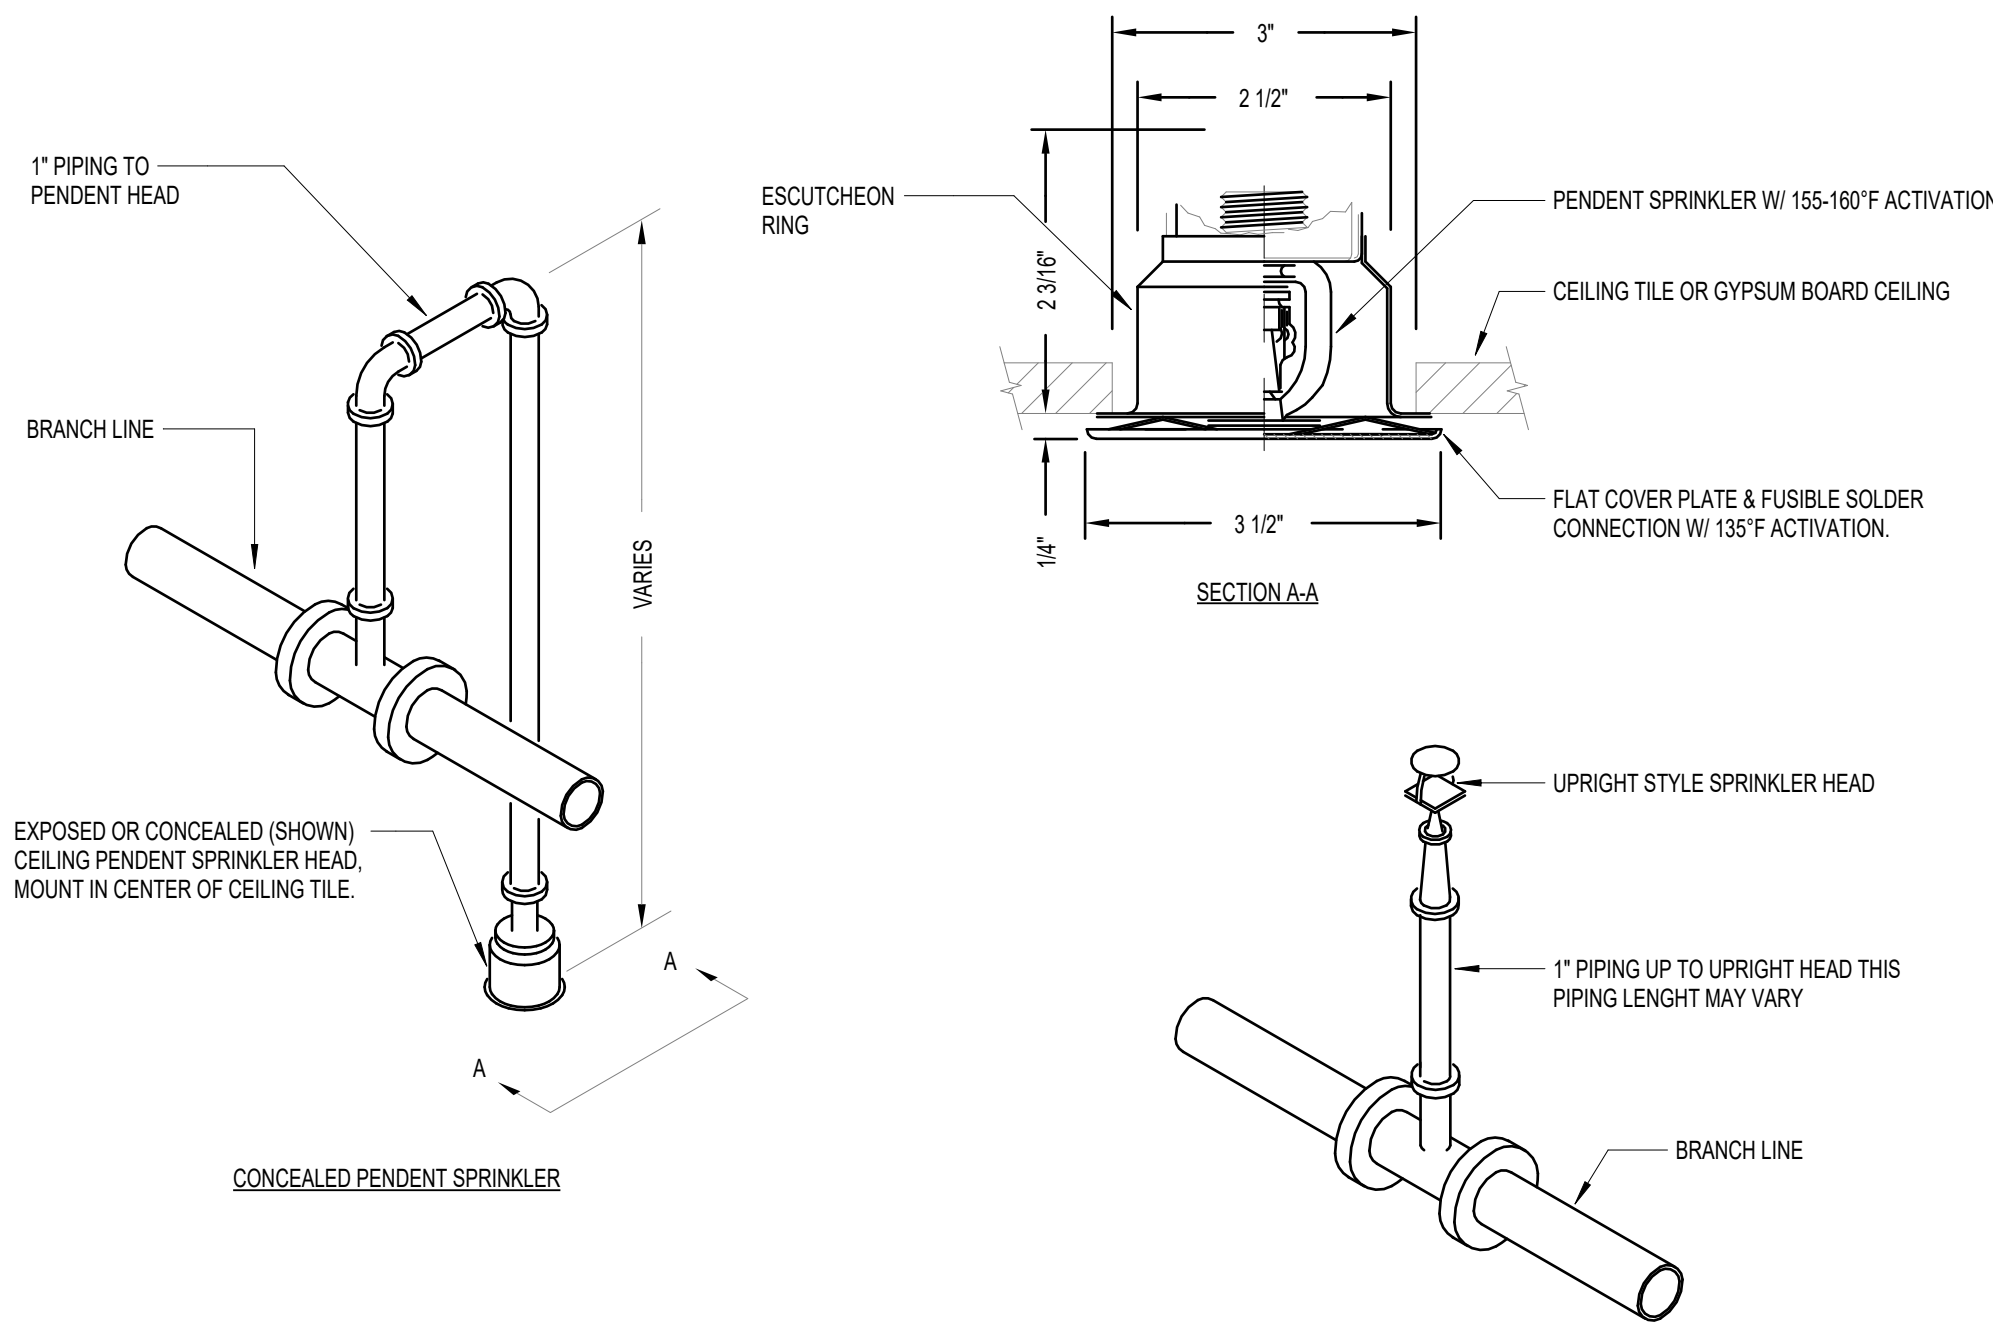

**E2** CONCEALED SPRINKLER ARM OVER AND UPRIGHT SPRINKLER  
NOT TO SCALE

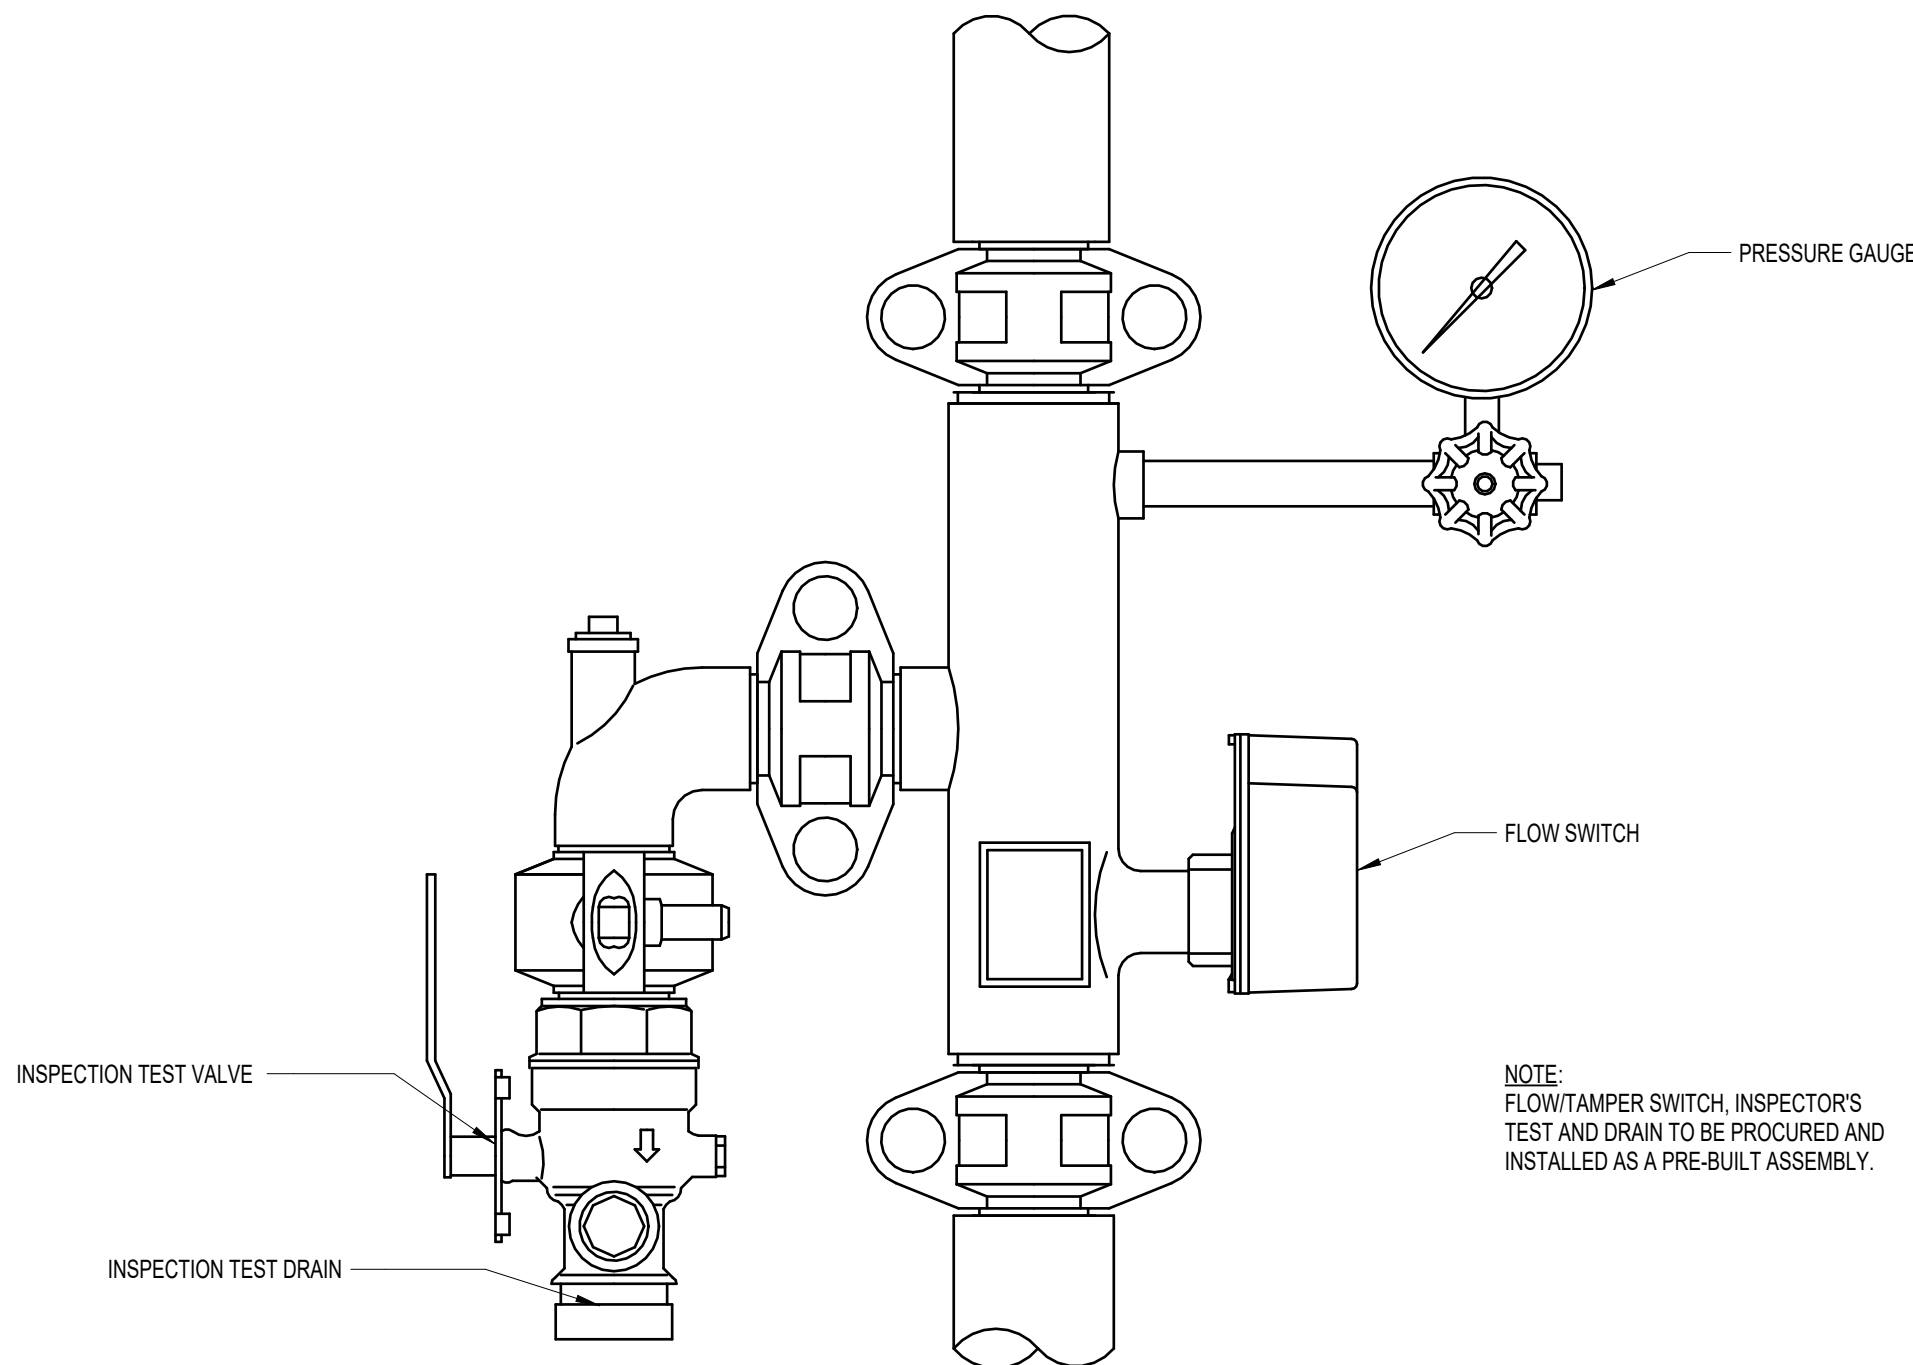

**C2** INSPECTORS TEST AND FLOW SWITCH ASSEMBLY  
NOT TO SCALE

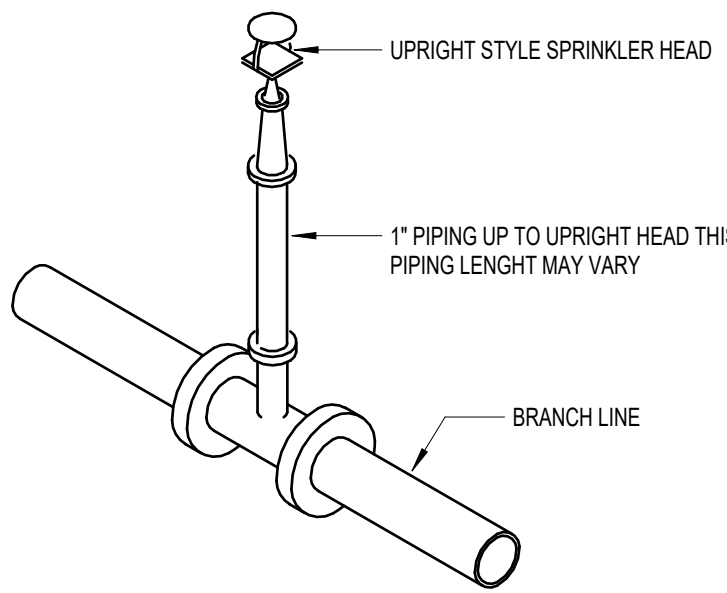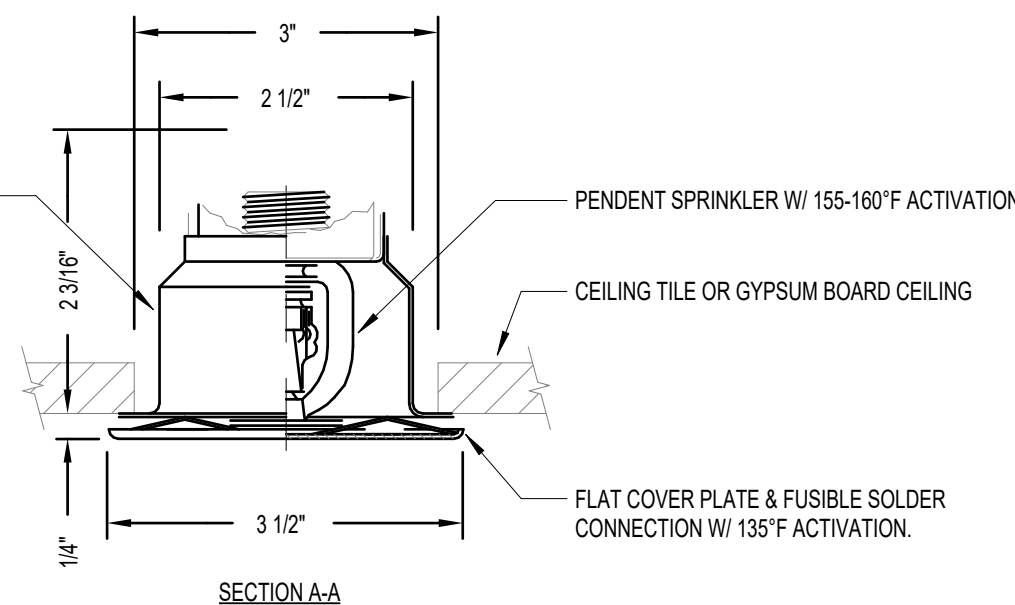

## DEFERRED SUBMISSION

THE FIRE PROTECTION DRAWINGS AND SPECIFICATIONS WITHIN THE PROGRESSIVE COMPANIES DOCUMENT SET ARE PERFORMANCE BASED AND INTENDED TO CONVEY SCOPE OF THE WORK. THE FIRE PROTECTION CONTRACTOR SHALL SUBMIT FOR REVIEW AND APPROVAL AS A DEFERRED SUBMITTAL TO THE LOCAL AHJ SHOP DRAWINGS AND HYDRAULIC CALCULATIONS INDICATING THE SPRINKLER SYSTEM LAYOUT, INCLUDING FINAL HEAD LOCATIONS AND MAIN LEADER PIPING SIZING. THE FIRE PROTECTION CONTRACTOR SHALL PROVIDE THESE DOCUMENTS SEALED BY A LICENSED FIRE PROTECTION ENGINEER.



This item has been electronically signed and sealed by Michael Grose using a Digital Signature and date. Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

ISSUANCE  
11/07/2025 PERMIT CYCLE 1

PROJECT NUMBER  
7950130  
PROJECT MANAGER  
A. HENGSTEBECK  
PROFESSIONAL  
M. GROSE  
DRAWN BY  
T. SMITH  
CHECKED BY  
B. KOOMAN

FIRE PROTECTION DETAILS  
**FP600**

LIDL US, LLC  
**LIDL 1517 NORCROSS, GA**

499 JIMMY CARTER BLVD NORCROSS, GA 30093



PROGRESSIVE ARCHITECTURE ENGINEERING & PLANNING, INC.  
**PROGRESSIVE COMPANIES**  
Charlotte, NC | Detroit, MI | Grand Rapids, MI  
[weareprogressive.com](http://weareprogressive.com)