

TECHNOLOGY SYMBOL LIST

NOTE: This is a standard symbol list and not all items listed may be used.

DATA SYMBOL LEGEND		
SYMBOL	DESCRIPTION	HEIGHT TO MIDDLE OF DEVICE (UNLESS NOTED)
▽ #	DATAPHONE OUTLET, # INDICATES QUANTITY OF ANTICIPATED JACKS	18"
▼ #	ABOVE COUNTERTOP DATAPHONE OUTLET, MOUNT 4" ABOVE BACKSPLASH, # INDICATES QUANTITY OF ANTICIPATED JACKS	46"
≡ #	MULTIOUTLET WIREMOLD ASSEMBLY, MOUNT 4" ABOVE BACKSPLASH OR PROVIDE DATA OUTLETS AS SHOWN ON DRAWING, # INDICATES QUANTITY OF ANTICIPATED JACKS	46"
⌚ #	FLOOR DATAPHONE OUTLET, # INDICATES QUANTITY OF ANTICIPATED JACKS	
⌚ #	CEILING DATAPHONE OUTLET, # INDICATES QUANTITY OF ANTICIPATED JACKS	
⌚	CEILING WIRELESS ACCESS POINT	
TV	TELEVISION OUTLET	18"
⌚	CLOCK	84"
⌚	INTERCOM OUTLET LOCATION	46"
⌚ AV	INTERCOM - AUDIOVISUAL	46"
⌚	SPEAKER (WALL OR CEILING MT.)	84"
⌚	SOUND MASKING EMITTER (WALL OR CEILING MT.)	84"
⌚ ^V	VOLUME CONTROL	46"
⌚	MICROPHONE OUTLET	18"
⌚	PROJECTOR CONTROL OUTLET	18"
⌚	HUMIDISTAT	46"
⌚	THERMOSTAT	46"
⌚	OUTLET IN FLOOR (MICROPHONE SHOWN)	

SECURITY SYMBOL LEGEND		
SYMBOL	DESCRIPTION	HEIGHT TO MIDDLE OF DEVICE (UNLESS NOTED)
DC	DOOR CONTACT, TYPE AS NOTED	
CR	CREDENTIAL READER, TYPE AS NOTED	46"
KP	KEYPAD, TYPE AS NOTED	46"
EA	ELECTRIFIED INTEGRATED CREDENTIAL READER DOOR HARDWARE, TYPE AS NOTED	
EL	ELECTRIC LATCH RETRACTION, TYPE AS NOTED	
ES	ELECTRIC STRIKE, TYPE AS NOTED	
DA	DURESS ALARM BUTTON, TYPE AS NOTED	
GB	WALL MOUNTED GLASS BREAK	90"
GB	CEILINGS MOUNTED GLASS BREAK	
TH	ELECTRIC TRANSFER / HINGE, TYPE AS NOTED	
ML	MAGNETIC LOCK, TYPE AS NOTED	
RE	WALL MOUNTED REQUEST TO EXIT, TYPE AS NOTED	90"
RE	CEILING MOUNTED REQUEST TO EXIT, TYPE AS NOTED	
MD	WALL MOUNTED MOTION DETECTOR, TYPE AS NOTED	90"
MD	CEILING MOUNTED MOTION DETECTOR, TYPE AS NOTED	
C	WALL MOUNTED SURVEILLANCE CAMERA, TYPE AS NOTED	90"
C	WALL MOUNTED SURVEILLANCE CAMERA - PAN-TILT-ZOOM, TYPE AS NOTED	90"
C	EXTERIOR, CORNER MOUNTED SURVEILLANCE CAMERA - PAN-TILT-ZOOM, TYPE AS NOTED	144"
C	EXTERIOR, CORNER MOUNTED SURVEILLANCE CAMERA, TYPE AS NOTED	144"
C	CEILING MOUNTED SURVEILLANCE CAMERA, TYPE AS NOTED	
C	CEILING MOUNTED SURVEILLANCE CAMERA - PAN-TILT-ZOOM, TYPE AS NOTED	
EM	EMERGENCY CALL STATION, MOUNTING AND TYPE AS NOTED	46"
PVM	SURVEILLANCE PREVIEW MONITOR	

COLOR CODING MATRIX	
AV	BLACK
SECURITY	YELLOW
IT	BLUE
FIRE ALARM	RED

GENERAL SHEET NOTES

- A. "FURNISH" MEANS TO "SUPPLY" AND USUALLY REFERS TO DELIVERY OF AN ITEM OF EQUIPMENT TO THE PROJECT SITE, READY FOR INSTALLATION. EQUIPMENT TO THE PROJECT SITE, READY FOR INSTALLATION. "INSTALL" MEANS TO SET IN PLACE, CONNECT AND PLACE IN FULL OPERATIONAL ORDER. "PROVIDE" MEANS TO "FURNISH" AND "INSTALL." "FUTURE", "BY OTHERS", "REFER (DISCIPLINE) DIVISION" AND SIMILAR EXPRESSIONS INDICATE WORK THAT MAY BE PERFORMED UNDER THE CONTRACT DOCUMENTS BUT, NOT NECESSARILY UNDER THE DIVISION OR DISCIPLINE ON WHICH THE NOTE APPEARS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR COORDINATING THE WORK WITH SUPPLIERS, SUBCONTRACTORS, EMPLOYEES, ETC. SHOULD CLARIFICATION OF ANY PORTION OF THE WORK BE REQUIRED, CONTACT THE ARCHITECT/ENGINEER PRIOR TO SUBMITTING BID.
- B. THE WORK SHALL COMPLY WITH LATEST LOCAL BUILDING CODE. THIS WOULD INCLUDE, BUT IS NOT LIMITED TO, THE CURRENT CITY BUILDING CODE, AMENDMENTS, NFPA, ANSI, OSHA, AND ALL OTHER LOCAL OR MUNICIPAL BUREAUS AND DEPARTMENTS WHICH HAVE AUTHORITY OVER THE PROJECT; ANYTHING IN THESE CONTRACT DOCUMENTS NOT WITHSTANDING, THIS SHALL NOT BE CONSTRUED AS WAIVING COMPLIANCE WITH ANY REQUIREMENTS OF THE PLANS AND SPECIFICATIONS WHICH MAY BE IN EXCESS OF ANY REQUIREMENTS OF THESE CODES.
- C. THE CONTRACTOR SHALL CAREFULLY COMPARE THE DRAWINGS AND SPECIFICATIONS, CHECKING THE MEASUREMENTS AND CONDITIONS UNDER WHICH CONSTRUCTION IS TO BE IMPLEMENTED. FOR CLARIFICATION BETWEEN VARIOUS DRAWINGS AND/OR SPECIFICATIONS, THE DISPUTED ISSUE SHALL BE REFERRED TO THE ENGINEER BEFORE ANY WORK IS EXECUTED. THE CONTRACTOR SHALL STATE IN THEIR PROPOSAL ANY EXCEPTIONS NECESSARY TO MAKE THIS WORK A COMPLETE AND READY-TO-USE INSTALLATION. IF NOT SO-STATED IN THE CONTRACTOR'S PROPOSAL, ANY SUCH WORK WILL NOT BE CONSIDERED ADDITIONAL.
- D. THE TECHNOLOGY DRAWINGS ARE DIAGRAMMATIC IN NATURE AND SHALL NOT BE SCALED. TO THIS EXTENT, DATA GIVEN ON THE DRAWINGS IS AS EXACT AS COULD BE SECURED. THE CONTRACTOR SHALL COORDINATE THE EXACT LOCATION OF ALL REQUIRED WORK AND EQUIPMENT WITH THAT OF THE OTHER TRADES, WHERE THERE ARE POTENTIAL CONFLICTS. THE CONTRACTOR SHALL OBTAIN AND VERIFY EXACT LOCATIONS, MEASUREMENTS, LEVELS, SPACE REQUIREMENTS, ETC. AT THE SITE AND SHALL SATISFACTORILY ADAPT HIS WORK TO ACTUAL FIELD CONDITIONS. WALL AND CEILING MOUNTED ITEMS SHALL BE INSTALLED IN ACCORDANCE WITH THE ARCHITECTURAL FLOOR AND REFLECTED CEILING PLANS. IF LOCATION FOR AN ITEM IS NOT SHOWN ON THE ARCHITECTURAL DRAWINGS, VERIFY THE EXACT LOCATION OF THE ITEM WITH THE ARCHITECT PRIOR TO INSTALLATION. THESE REQUIREMENTS APPLY TO ALL FLOOR AND CEILING TYPES IN ALL AREAS.
- E. THE CONTRACTOR SHALL CAREFULLY EXAMINE THE CONTRACT DOCUMENTS, VISIT THE SITE, EXAMINE THE PREMISES, AND MAKE A THOROUGH SURVEY OF THE CONDITIONS UNDER WHICH CONSTRUCTION WILL BE IMPLEMENTED. THE SUBMISSION OF A PROPOSAL WILL BE CONSTRUED AS EVIDENCE THAT SUCH AN EXAMINATION HAS BEEN MADE. FAILURE TO DO SO SHALL NOT RELIEVE THE CONTRACTOR OF THE OBLIGATIONS OF THE CONTRACT. ANY LATER CLAIMS FOR LABOR, EQUIPMENT, OR MATERIALS REQUIRED FOR DIFFICULTIES ENCOUNTERED WHICH COULD HAVE BEEN FORESEEN HAD SUCH AN EXAMINATION BEEN MADE, WILL NOT BE RECOGNIZED.
- F. THE CONTRACTOR SHALL TAKE ALL STEPS NECESSARY TO ENSURE THE SAFETY OF THE CLIENT'S EMPLOYEES, BUILDING EMPLOYEES AND GUESTS AS WELL AS THEIR OWN FORCES, BY ADEQUATELY PROTECTING ANY EXPOSED LIVE CABLE, EQUIPMENT, OR DEVICES THROUGHOUT THE COURSE OF THIS WORK.
- G. ALL CONTRACTORS/BIDDERS SHALL HAVE RECEIVED A COMPLETE SET OF CONSTRUCTION DOCUMENTS FOR REVIEW AND REFERENCE TO WORK INDICATED. CONDUIT LOCATE SERVICES SHALL BE REQUESTED AND COMPLETED BEFORE DISTURBANCE OF ANY EXISTING GRADE OR ON-GRADE CONSTRUCTION, SLAB DEMOLITION, OR OTHER ACTIVITIES THAT MAY IMPACT BURIED UTILITIES OR COMMUNICATION CONDUITS. THE CONTRACTOR SHALL CONFIRM THAT CONDUIT LOCATE SERVICES HAVE BEEN COMPLETED AND THAT NO POTENTIAL CONFLICTS EXIST BEFORE EXISTING GRADE IS EXCAVATED OR EXISTING FLOORING DEMOLISHED, REGARDLESS OF THE LOCATION ON THE PROPERTY. THIS SHALL BE REVIEWED WITH THE OWNER'S PROJECT REPRESENTATIVE.
- H. THE CONTRACTOR SHALL PROVIDE THE COMPLETE TECHNOLOGY INSTALLATION OF WORK AS INDICATED IN THE CONSTRUCTION DOCUMENTS. PRIOR TO COMMENCEMENT, THE CONTRACTOR SHALL SUBMIT FOR REVIEW AND APPROVAL, ANY SEQUENCE OF WORK, MOPS (METHOD OF PROCEDURE) AND/OR COORDINATION SHOP DRAWINGS FOR THE INTENDED THE CONTRACTOR SHALL NOTIFY THE ARCHITECT/ENGINEER OF ANY MATERIALS OR APPARATUS BELIEVED TO BE INADEQUATE, UNSUITABLE, VIOLATION OF LAWS, ORDINANCES, RULES OR REGULATIONS OF AUTHORITIES HAVING JURISDICTION.
- I. ANY PENETRATIONS OR OPENINGS IN FIRE-RATED PARTITIONS (WALLS OR FLOORS) SHALL BE CLOSED AT THE END OF EACH WORK DAY, OR WHENEVER IT IS ANTICIPATED THAT NO FURTHER WORK WILL OCCUR IN THAT OPENING DURING THE DAY. THIS INCLUDES ALL TEMPORARY OPENINGS. CLOSURE SHALL BE IN COMPLIANCE WITH 3M FIREPROOFING TEMPORARY OPENINGS. CLOSURE SHALL BE IN COMPLIANCE WITH 3M FIREPROOFING END OF EACH WORK DAY. ALL TEMPORARY WALL AND FLOOR OPENINGS SHALL BE PROTECTED AND MARKED AT ALL TIMES. PAINTING SHALL BE SCHEDULED SUCH THAT DRYING TIME OCCURS DURING NON-WORKING HOURS FOR OPERATIONS PERSONNEL COMFORT. NO WELDING SHALL TAKE PLACE INSIDE OF OPERATING FACILITY WITHOUT THE WRITTEN AUTHORIZATION OF THE OWNER'S PROJECT REPRESENTATIVE. WELDING SHALL NOT TAKE PLACE WITHIN 5 FEET OF ANY TELECOM EQUIPMENT RACK WITHOUT ADEQUATE PROTECTIVE MEASURES, AS DEEMED APPROPRIATE BY THE OWNER'S PROJECT REPRESENTATIVE.
- J. ALL CUTTING, DRILLING AND PATCHING OF MASONRY STEEL OR IRON WORK BELONGING TO THE BUILDING MUST BE DONE BY THIS CONTRACTOR IN ORDER THAT HIS WORK MAY BE PROPERLY INSTALLED, BUT UNDER NO CONDITIONS MAY STRUCTURAL WORK BE CUT, EXCEPT AT THE DIRECTIONS OF THE ARCHITECT/ENGINEER OR THEIR REPRESENTATIVE.
- K. THE CONTRACTOR SHALL PROVIDE ALL "AS-BUILT" DRAWINGS SCALED 1/4" MINIMUM AND SUBMIT FOR APPROVAL TO THE ARCHITECT/ENGINEER.
- L. ALL PENETRATIONS IN WALLS, FLOORS, OR CEILINGS SHALL BE SUITABLY CLOSED UP AND SEALED WITH A FIRE-STOPPING COMPOUND LISTED IN THE MOST RECENT FACTORY MUTUAL RESEARCH CORPORATION (FMRC) APPROVAL GUIDE. ONLY PRODUCTS MANUFACTURED BY HILTI SHALL BE PREFERRED (NO SUBSTITUTIONS).
- M. THE CONDUIT ROUTINGS INDICATED ARE ONLY DIAGRAMMATIC IN NATURE. FIELD CONDITIONS SHALL DICTATE THE CONTRACTOR'S EXACT CONDUIT ROUTING. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SIZING AND LOCATING PULL BOXES PER THE CBC AND FOR COORDINATION WITH OTHER DISCIPLINES. ALL EXPOSED RACEWAYS SHALL BE INSTALLED PARALLEL OR PERPENDICULAR TO WALLS OR STRUCTURAL MEMBERS, SUCH AS TO FOLLOW STRUCTURAL SURFACE CONTOURS AND NOT OBSTRUCT PASSAGEWAYS. MULTIPLE RACEWAYS SHALL BE RUN TOGETHER, IN GROUPING. ALL EXPOSED CONDUIT SHALL BE ROUTED PERPENDICULAR, PARALLEL AND TIGHT TO COLUMNS AND BEAMS. ALL EXPOSED CONDUIT SHALL BE COORDINATED WITH THE ARCHITECT/ENGINEER PRIOR TO INSTALLATION. EXTRA TIME SHOULD BE ALLOWED FOR THIS REVIEW AND APPROVAL. NO ADDITIONAL COST TO OWNER WILL BE ALLOWED DUE TO LACK OF COORDINATION. ALL CONDUIT SHALL BE ELECTRICAL METALLIC TUBING (EMT) AND MINIMUM SIZE SHALL BE 1" UNLESS NOTED OTHERWISE. CONNECTORS AND COUPLINGS SHALL BE INSULATED THROAT COMPRESSION TYPE ONLY. RIGID GALVANIZED-STEEL (RGS) CONDUIT SHALL BE USED WHEN CONDUIT IS INSTALLED IN OUTDOOR AREAS OR WHERE OTHERWISE EXPOSED TO PHYSICAL EMERGENCY SYSTEMS SHALL BE RUN IN SEPARATE RACEWAY/CONDUIT SYSTEMS. METAL RACEWAY OR CABLE ARMOR/SHIELD SHALL NOT BE USED AS THE PRIMARY EQUIPMENT GROUNDING CONDUCTOR.
- N. ALL MATERIALS AND EQUIPMENT PROVIDED IN THIS WORK SHALL BE NEW AND SHALL HAVE THE APPROPRIATE UL LISTING AND/OR FM APPROVAL.
- O. ALL ANGLES, CHANNELS, AND OTHER MISCELLANEOUS STEEL, BOLTS, THREADED RODS, ETC., REQUIRED TO SUPPORT LIGHT FIXTURES, LADDER TRAY OR OTHER TECHNOLOGY EQUIPMENT OR DEVICES SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. ALL THREADED RODS SHALL BE A MINIMUM OF 3/8" IN DIAMETER. ALL LIGHTING FIXTURES AT SUSPENDED CEILINGS SHALL BE PROPERLY SUPPORTED.
- P. REFER TO ARCHITECTURAL DRAWINGS FOR FINAL DEVICE LOCATIONS AND MOUNTING HEIGHTS.
- Q. CONTRACTOR SHALL COORDINATE INSTALLATION OF ALL OWNER PROVIDED EQUIPMENT.
- R. PROVIDE A MINIMUM (1) 4" SQUARE BY 2-1/8" DEEP DOUBLE GANG JUNCTION BOX WITH MUD RING AT EACH WALL OR CEILING DEVICE OUTLET LOCATION. PROVIDE A MINIMUM (1) 1" CONDUIT BETWEEN THE DEVICE OUTLET AND THE NEAREST TELECOMMUNICATIONS ROOM/TELECOMMUNICATIONS ENCLOSURE OR ACCESSIBLE CABLE PATHWAY.
- S. IN AREAS THAT REQUIRE CABLE TRAY - PROVIDE A MINIMUM 20" X 4" DEEP CEILING MOUNTED CABLE TRAY SYSTEM THROUGHOUT THE CORRIDOR(S) TO SUPPORT THE STRUCTURED CABLING SYSTEM BACK TO THE TELECOMMUNICATIONS ROOM. PROVIDE A MINIMUM (1) 1" CONDUIT BETWEEN THE DEVICE OUTLET STUBBED UP TO THE CABLE TRAY. PROVIDED A MINIMUM (3) 2" CONDUITS ABOVE GYP CEILINGS OR WALL PENETRATIONS FOR CABLE ROUTING. REFER TO THE FIRESTOP AND SEAL REQUIREMENTS.
- T. PROVIDE PULL STRING IN ALL EMPTY CONDUITS.
- U. THE TELECOMMUNICATIONS STRUCTURED CABLING SYSTEM DESIGN INCLUDING THE ABOVE MINIMUM REQUIREMENTS SHALL BE COORDINATED AND CONFIRMED INCLUDING DEVICE LOCATIONS, JUNCTION BOX SIZES AND HEIGHTS, CABLE TRAY SIZE AND HEIGHT AND WITH THE TECHNOLOGY SYSTEM DESIGN DRAWINGS, TELECOMMUNICATIONS DESIGN CONSULTANT AND ARCHITECT.
- V. ALL SECURITY DEVICES, CABLING AND EQUIPMENT SHALL BE PROVIDED BY LIDL PROVIDED VENDOR.

ISSUANCE
11/07/2025 PERMIT CYCLE 1

PROJECT NUMBER
79650191
PROJECT MANAGER
A. HENGSTEBECK
PROFESSIONAL
D. ELYA
DRAWN BY
M. GONZALEZ
CHECKED BY
D. ELYA

SYMBOLS LIST
AND GENERAL
NOTES -
TECHNOLOGY
T000

PROGRESSIVE
COMPANIES
Charlotte, NC | Detroit, MI | Grand Rapids, MI
wearprogressive.com



LIDL US, LLC
LIDL 1517 NORCROSS, GA


499 JIMMY CARTER BLVD, NORCROSS, GA 30093



11/17/2025 5:52:07 PM Autodesk Docs/17855191-1 Lbl 1517 Norcross GA/1517 NORCROSS GA - ELEC-14

GROUND FLOOR - AV AND DATA PLAN

PROGRESSIVE ARCHITECTURE ENGINEERING & PLANNING, LLC
PLANNING, LLC, AN INSTRUMENT OF SERVICE, AND PROGRESSIVE ARCHITECTURE
ENGINEERING, LLC, AN INSTRUMENT OF SERVICE, ARE THE SOLE OWNERS OF THE
COPYRIGHTED MATERIALS HEREIN. ALL RIGHTS ARE RESERVED. NO PART OF
THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY
ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING,
OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION
IN WRITING FROM PROGRESSIVE ARCHITECTURE ENGINEERING & PLANNING, LLC.

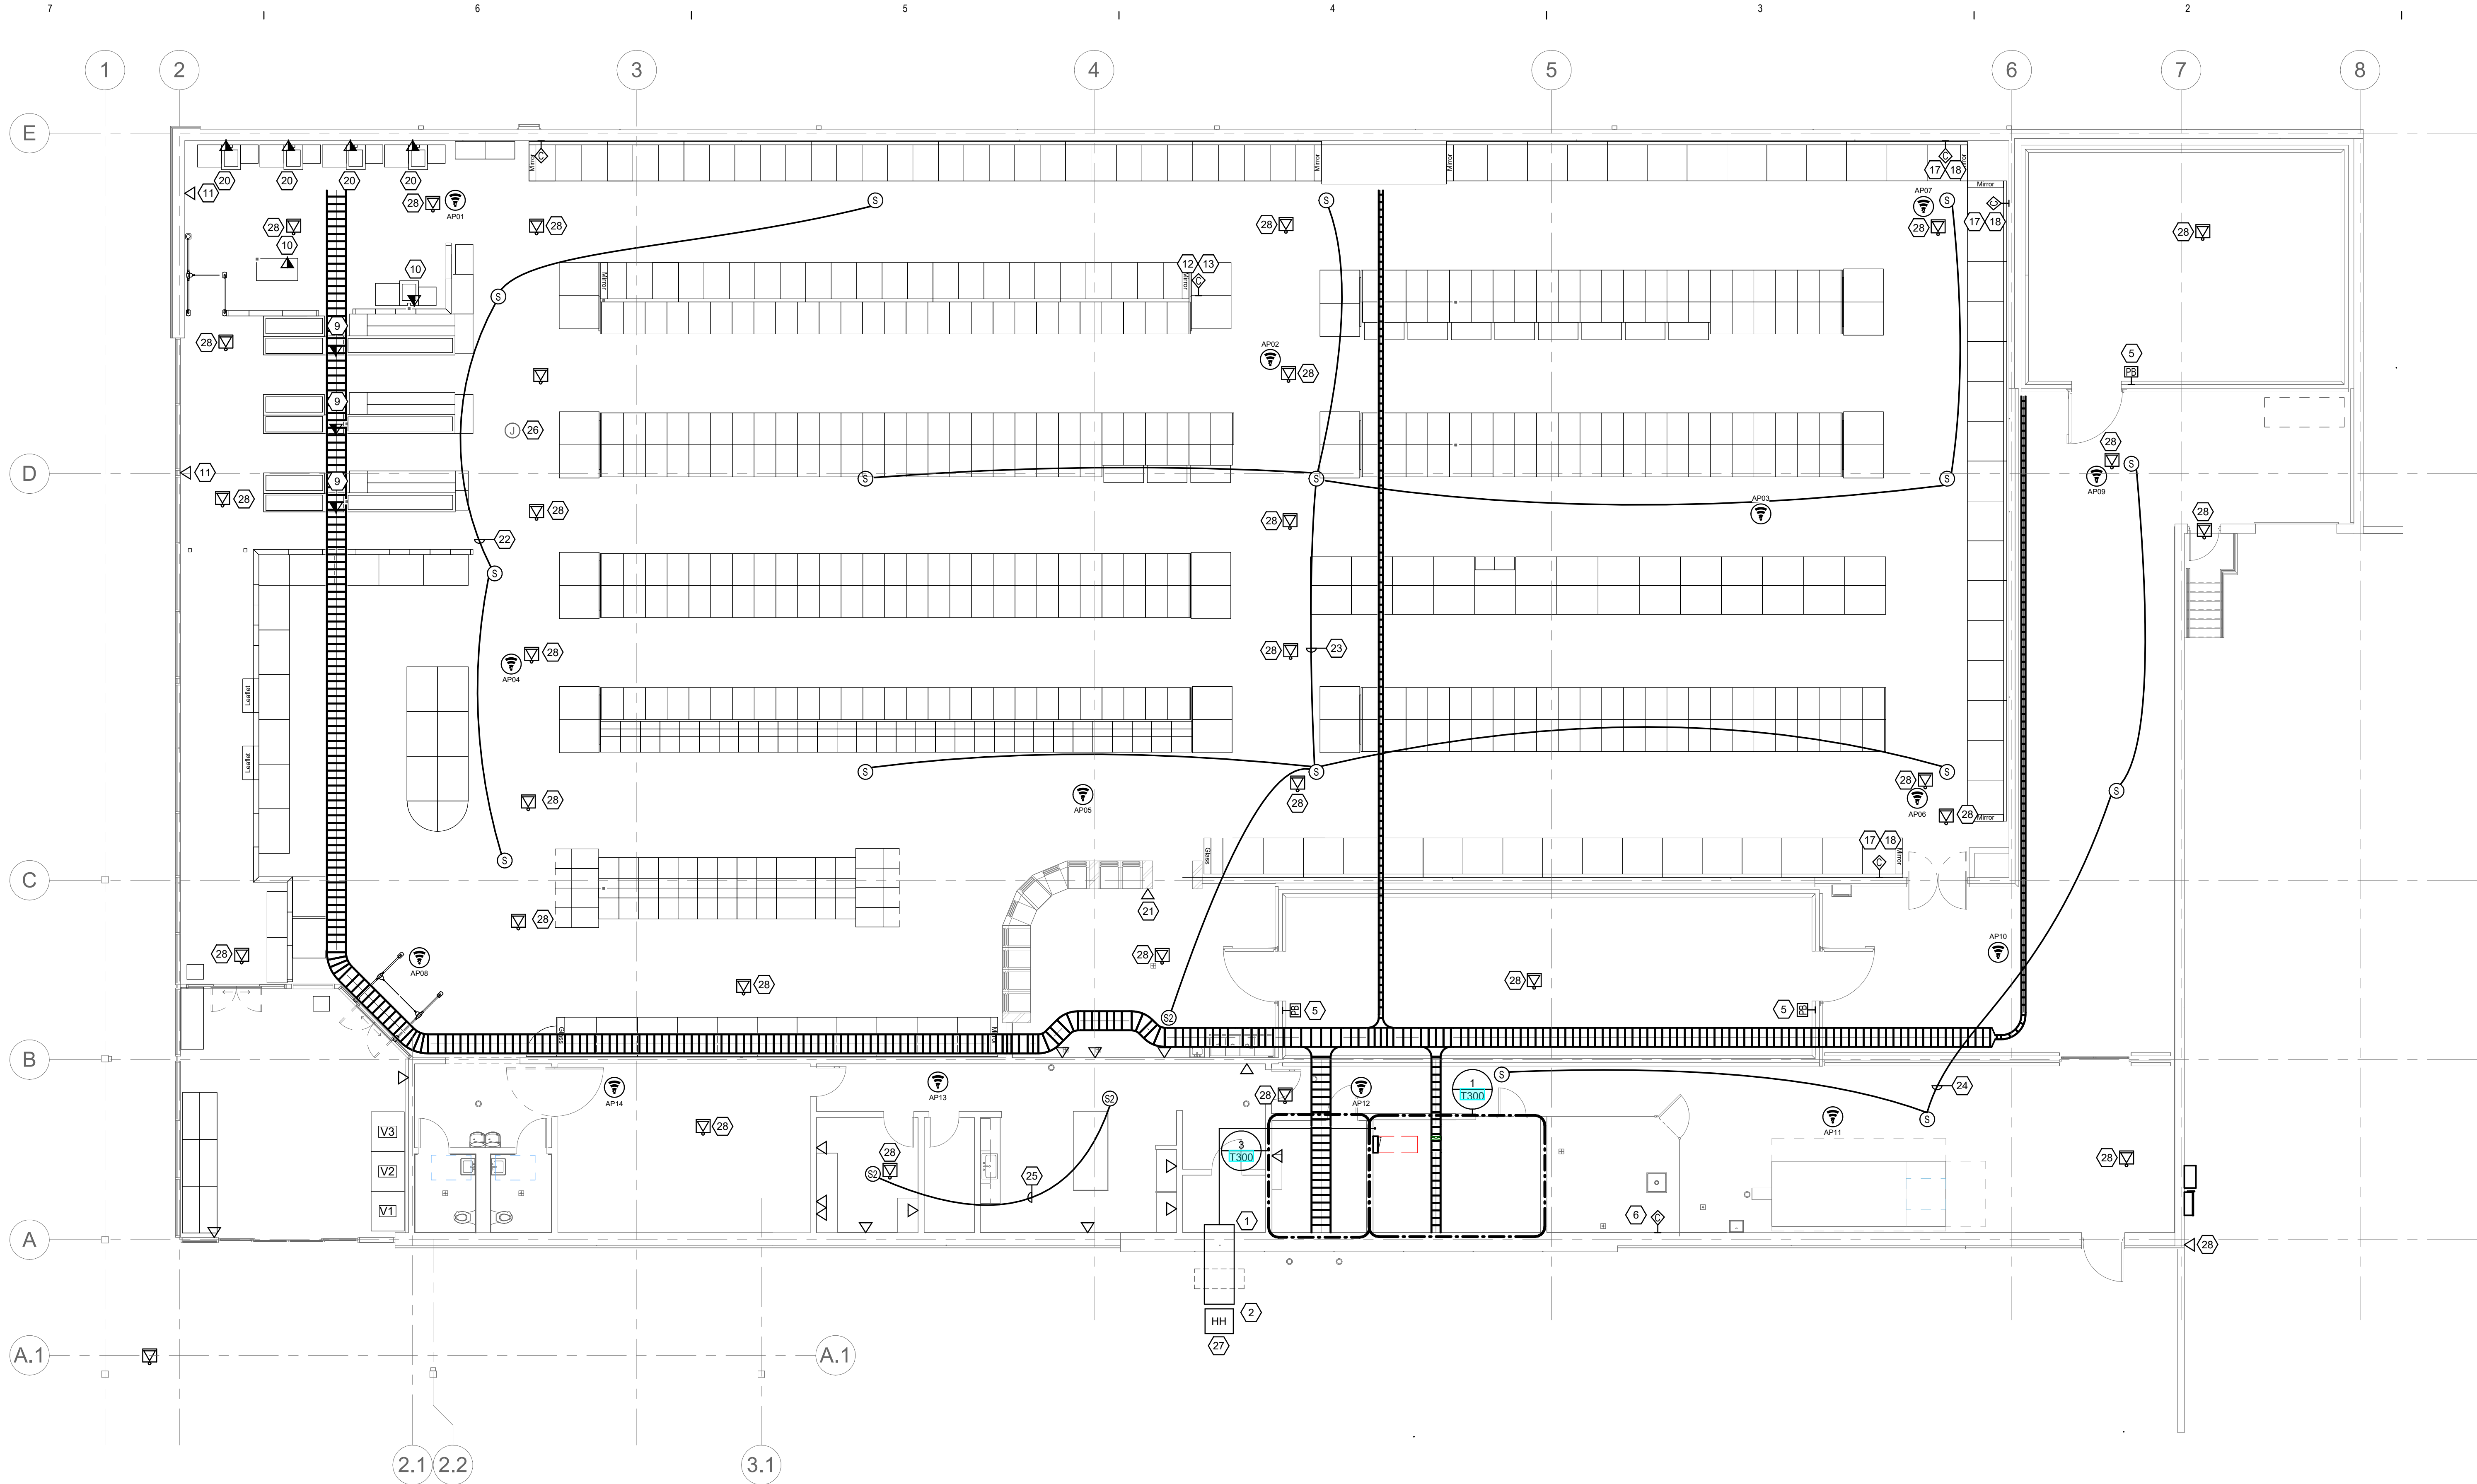

GROUND FLOOR - TECHNOLOGY PLAN
1/8" = 1'-0"

GENERAL SHEET NOTES

- REFER TO SHEET **T100** FOR LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
- REFER TO SHEET **E102** FOR CABLE WIREWAY PLAN.
- EC TO LABEL OR SPRAY INSIDE JUNCTION BOXES TO IDENTIFY PURPOSE OF THE JUNCTION BOX.
- REFER TO HUSSMANN DRAWINGS FOR EXACT TECHNOLOGY LAYOUT.
 - FOR HUSSMANN CASE CONNECTIONS:
 - AT THE FIRST AND LAST CASE IN EACH LINEUP, AN ETHERNET PATCH CABLE WILL BE CONNECTED TO THE WALL JACK. THE OPPOSITE END WILL BE CUT OFF AND STRIPPED BACK NEATLY, AND THE WIRE COLORS SPECIFIED IN E6.1 XWEB CABLE TERMINATION CONNECTION DETAIL WILL BE TERMINATED ON THE CORELINK CONTROLLER.
 - BELDEN 222 CABLE WILL THEN BE USED TO DAISY CHAIN EACH CASE WITHIN A LINEUP.
 - ALL CABLES ON THIS COMMUNICATION LOOP SHOULD BE LABELED RS485.
 - ALL WALL PLATE JACKS SHOULD BE LABELED RS485.
 - WALL JACK TO BE INSTALLED ON SALES FLOOR SIDE OF WALL AND 84" AFF.
 - ISLAND RJ45 JACKS ARE TO BE INSTALLED AT THE BOTTOM OF THE POWER POLLS.

SHEET KEYNOTES

- APPROXIMATE LOCATION OF TELECOMMUNICATION ENTRANCE FACILITY. REFER TO DETAIL 1/7300.
- CONDUITS CONTINUE TO TELECOMMUNICATIONS UTILITY SERVICE PROVIDER POINT OF PRESENCE (POP). COORDINATE THE EXACT LOCATION OF THE POP WITH EACH UTILITY SERVICE PROVIDER PRIOR TO INSTALLATION. REFER TO CIVIL UTILITY PLAN FOR CONTINUATION OF CONDUIT ROUTING.
- PROVIDE A 48"W X 48"T X 36"D HAND HOLE WITH A TRAFFIC RATED LID. REFER TO ELECTRICAL DETAILS. PROVIDE ADDITIONAL HANDHOLES IN CONDUIT ROUTE TO PROPERTY LINE WHEN CONDUIT LENGTH EXCEEDS 100'.
- DATA OUTLET DEDICATED TO TIME CLOCK. COORDINATE EXACT LOCATION WITH LIDL PROVIDED TIME CLOCK.
- SURFACE MOUNTED BOX FOR FREEZER PANIC SWITCH TO BE MOUNTED + 24" A.F.F. TO CENTER OF BOX - PROVIDE 3/4" EMPTY CONDUIT FROM BOX TO NEAREST CABLE TRAY WITH PULL STRING.
- CONTROL FOR EVAC SYSTEM.
- DATA OUTLET FOR COMPUTER WORKSTATION.
- DATA OUTLET FOR SAFE.
- SURFACE MOUNTED DATA OUTLET WITHIN CHECKOUT LANE PROVIDED BY MANUFACTURER. ROUTE CABLING THROUGH THE POWER POLE. REFER TO ELECTRICAL DRAWINGS, SHEET **E301** FOR POWER POLE LOCATION.
- DATA OUTLET DEDICATED TO SELF-CHECKOUT LANE OR SELF-CHECKOUT LANE STATION ATTENDANT MOUNTED IN WIREMOLD 4000 RACEWAY. ROUTE CABLING THROUGH THE POWER POLE. REFER TO ELECTRICAL DRAWINGS, SHEET **E301** FOR POWER POLE LOCATION.
- DATA OUTLET DEDICATED TO DIGITAL ADVERTISEMENT DISPLAY PROVIDED BY LIDL IT. FIELD VERIFY EXACT LOCATION.
- SERIAL DATA CABLING DEDICATED TO FREEZER/CHILLER UNIT. PROVIDE CATEGORY 6 CABLE (PANDUIT P/N: PFP5504IG-UY) FOR CONNECTION TO XWEB CENTRALIZED REFRIGERATION MONITORING SYSTEM. LEAVE 36" SERVICE LOOP AT JUNCTION BOX FOR DEVICE TO BE TERMINATED BY REFRIGERATION CONSULTANT. LABEL AT EACH END OF THE CABLE WITH THE TAG IDENTIFIED FOR EACH DEVICE.
- ROUTE CABLING THROUGH POWER POLE. REFER TO ELECTRICAL DRAWING, SHEET **E301** FOR POWER POLE LOCATIONS. PROVIDE A 1/2" FLEXIBLE METAL CONDUIT ROUTED BETWEEN THE POWER POLE AND THE FREEZER/REFRIGERATOR CONTROL PANEL. COORDINATE CONDUIT TERMINATION AT THE FREEZER/REFRIGERATOR CONTROL PANEL WITH REFRIGERATION CONSULTANT.
- SERIAL DATA CABLING DEDICATED TO AMBIENT HEAT SENSOR. PROVIDE CATEGORY 6 CABLE (PANDUIT P/N: PFP5504IG-UY) FOR CONNECTION TO XWEB CENTRALIZED REFRIGERATION MONITORING SYSTEM. LEAVE 36" SERVICE LOOP AT JUNCTION BOX FOR DEVICE TO BE TERMINATED BY REFRIGERATION CONSULTANT. LABEL AT EACH END OF THE CABLE WITH THE TAG IDENTIFIED FOR EACH DEVICE.
- DATA OUTLET DEDICATED TO XWEB CENTRALIZED REFRIGERATION MONITORING SYSTEM. CONNECT TO LIDL DATA NETWORK IN IT 110. SURFACE MOUNT DATA OUTLET TO BLOCK WALL AND ROUTE SURFACE MOUNTED CONDUIT UP TO ABOVE CEILING AND THE NEAREST ACCESSIBLE CABLE PATHWAY.
- SERIAL DATA CABLING DEDICATED TO ROOFTOP DRY COOLER. PROVIDE CATEGORY 6 CABLE (PANDUIT P/N: PFP5504IG-UY) FOR CONNECTION TO XWEB CENTRALIZED REFRIGERATION MONITORING SYSTEM. LEAVE 36" SERVICE LOOP AT JUNCTION BOX FOR DEVICE TO BE TERMINATED BY REFRIGERATION CONSULTANT. LABEL AT EACH END OF THE CABLE WITH THE TAG IDENTIFIED FOR EACH DEVICE.
- PROVIDE A CATEGORY 6 CABLE (PANDUIT P/N: PFP5504IG-UY) ROUTED BETWEEN REFRIGERATOR/FREEZER/COOLER CONTROL POINTS LEAVING A 36" SERVICE LOOP FOR TERMINATION BY REFRIGERATION CONSULTANT.
- ROUTE REFRIGERATION CABLING THROUGH ACCESSIBLE WIRE CABLE BASKET TRAY. DO NOT ROUTE VISIBLE TO SALES FLOOR.
- REFER TO SHEET **E803**, DETAIL #2 FOR CONDUIT TRENCH DETAIL.
- DATA OUTLET DEDICATED TO SELF-CHECKOUT LANE. OUTLET RECESSED INTO WALL - PROVIDE MINIMUM 1" DIA EMPTY CONDUIT WITH PULL STRING FROM OUTLET TO CABLE TRAY ABOVE.
- DATA OUTLET BEHIND MILL WORK FOR SIGNAL BOOSTER. RSC CONDUIT TO FINISH INSIDE OF BAKERY MILLWORK.
- ZONE 1 - CHECKOUTS. PROVIDE 18-2 CABLE AND ROUTE TO RACK 1B IN IT ROOM VIA CABLE TRAY.
- ZONE 2 - SALES. PROVIDE 18-2 CABLE AND ROUTE TO RACK 1B IN IT ROOM VIA CABLE TRAY.
- ZONE 3 - BOH. PROVIDE 18-2 CABLE AND ROUTE TO RACK 1B IN IT ROOM VIA CABLE TRAY.
- ZONE 4 - BREAK ROOM. PROVIDE 18-2 CABLE AND ROUTE TO RACK 1B IN IT ROOM VIA CABLE TRAY.
- PROVIDE JUNCTION BOX FOR VOCOVO ACCESS POINT RECEIVER WITH 18-2 CABLE TO RACK R1B VIA CABLE TRAY.
- HAND HOLE.
- DATA DROP FOR SECURITY DEVICE.



ISSUANCE
11/07/2025 PERMIT CYCLE 1

PROJECT NUMBER
79650191
PROJECT MANAGER
A. HENGSTEBECK
PROFESSIONAL
D. ELYA
DRAWN BY
M. GONZALEZ
CHECKED BY
D. ELYA




GROUND FLOOR -
AV AND DATA
PLAN
T101

LIDL US, LLC
LIDL 1517 NORCROSS, GA

499 JIMMY CARTER BLVD. NORCROSS, GA 30093

PROGRESSIVE ARCHITECTURE ENGINEERING & PLANNING, LLC
**PROGRESSIVE
COMPANIES**
Charlotte, NC | Detroit, MI | Grand Rapids, MI
weareprogressive.com



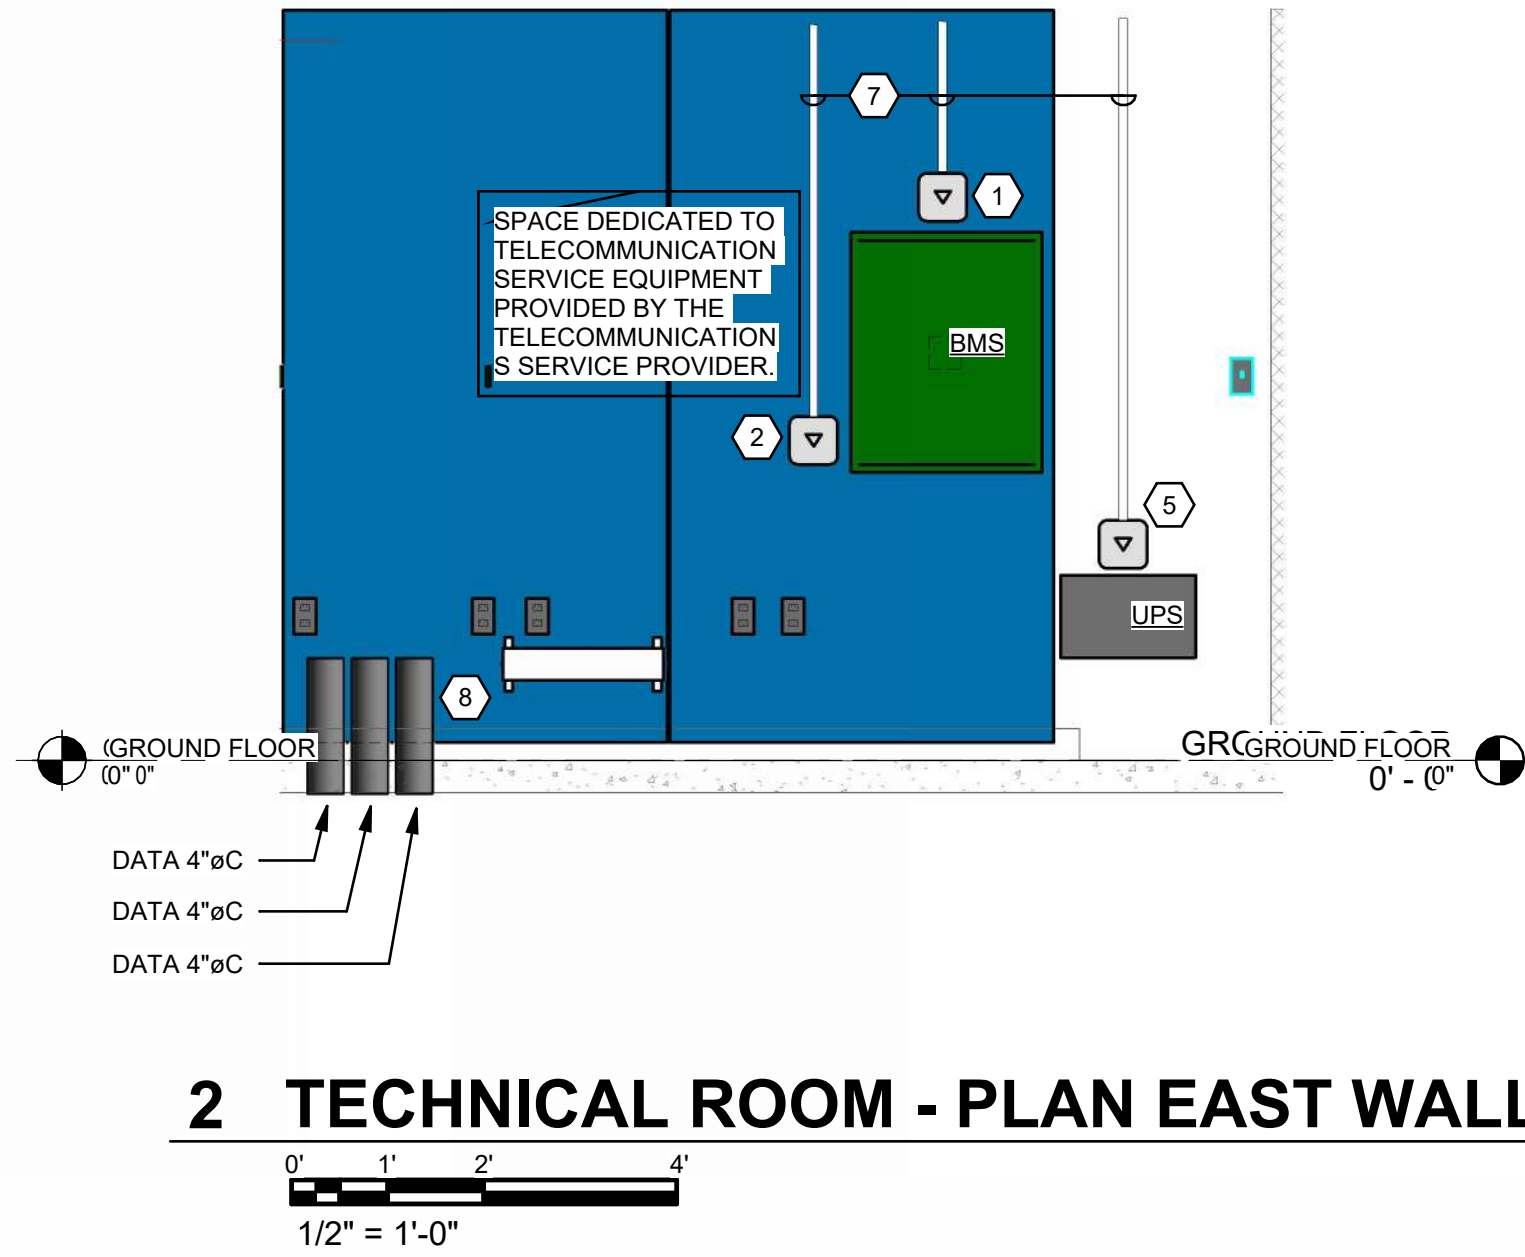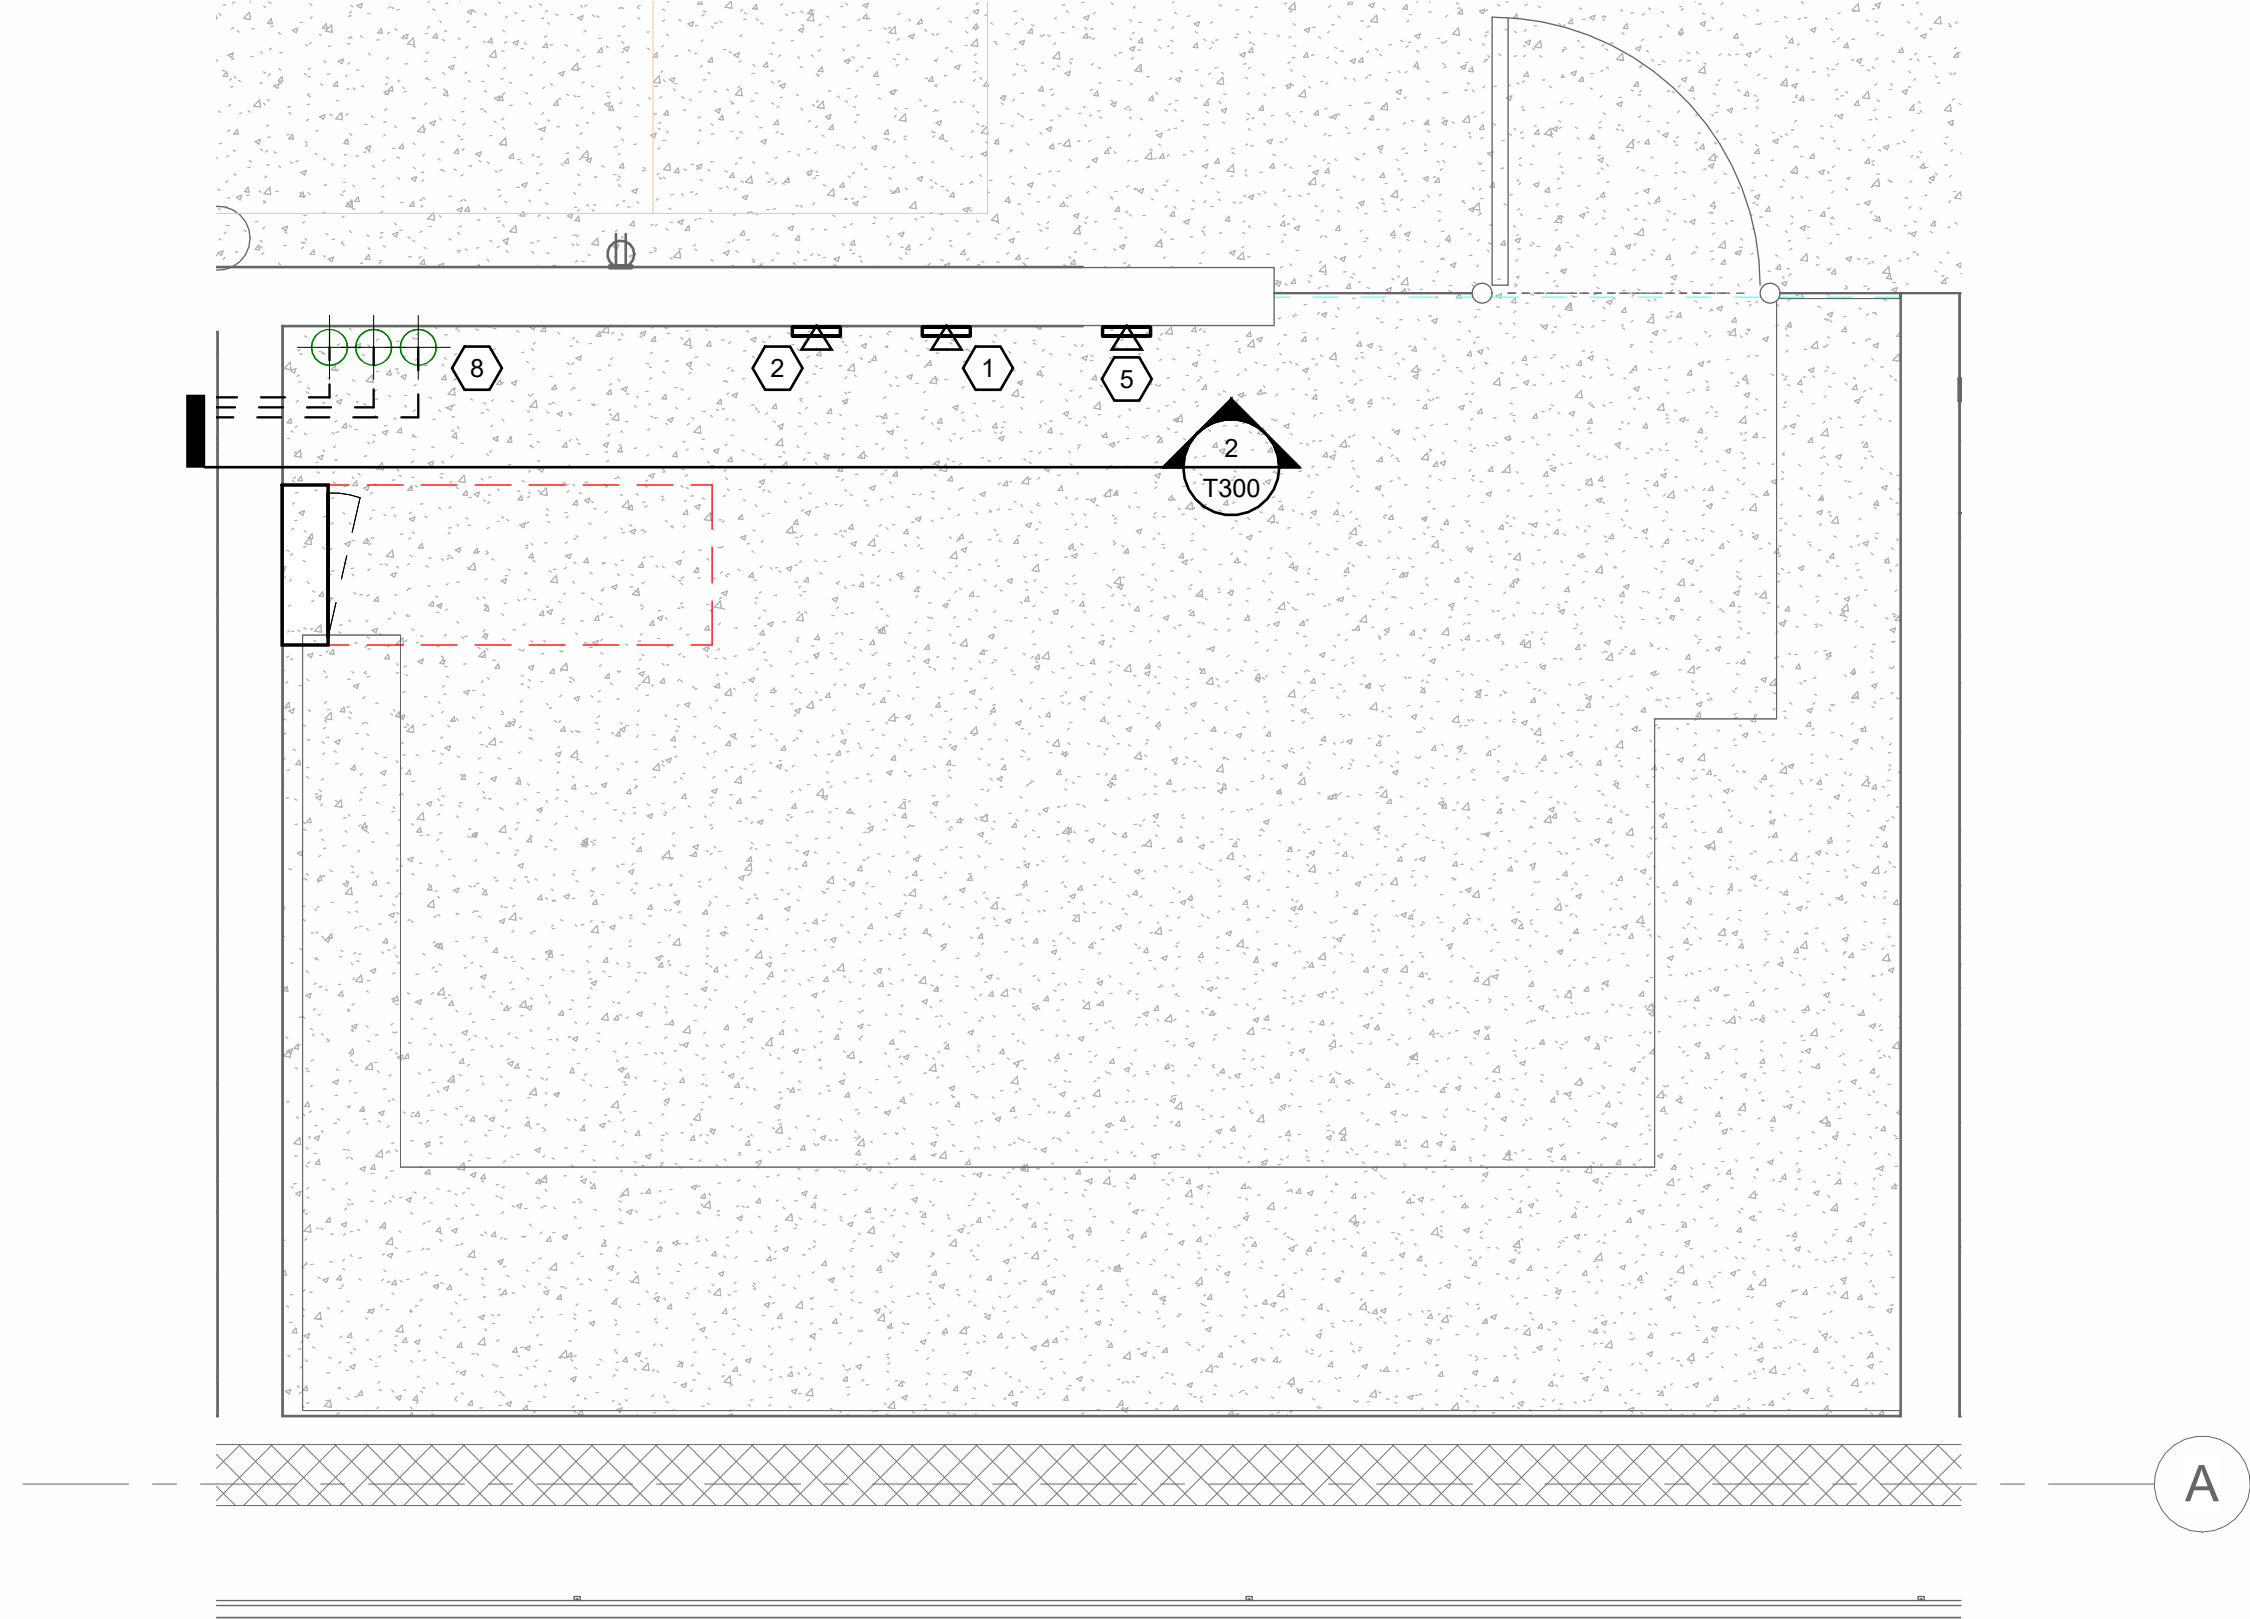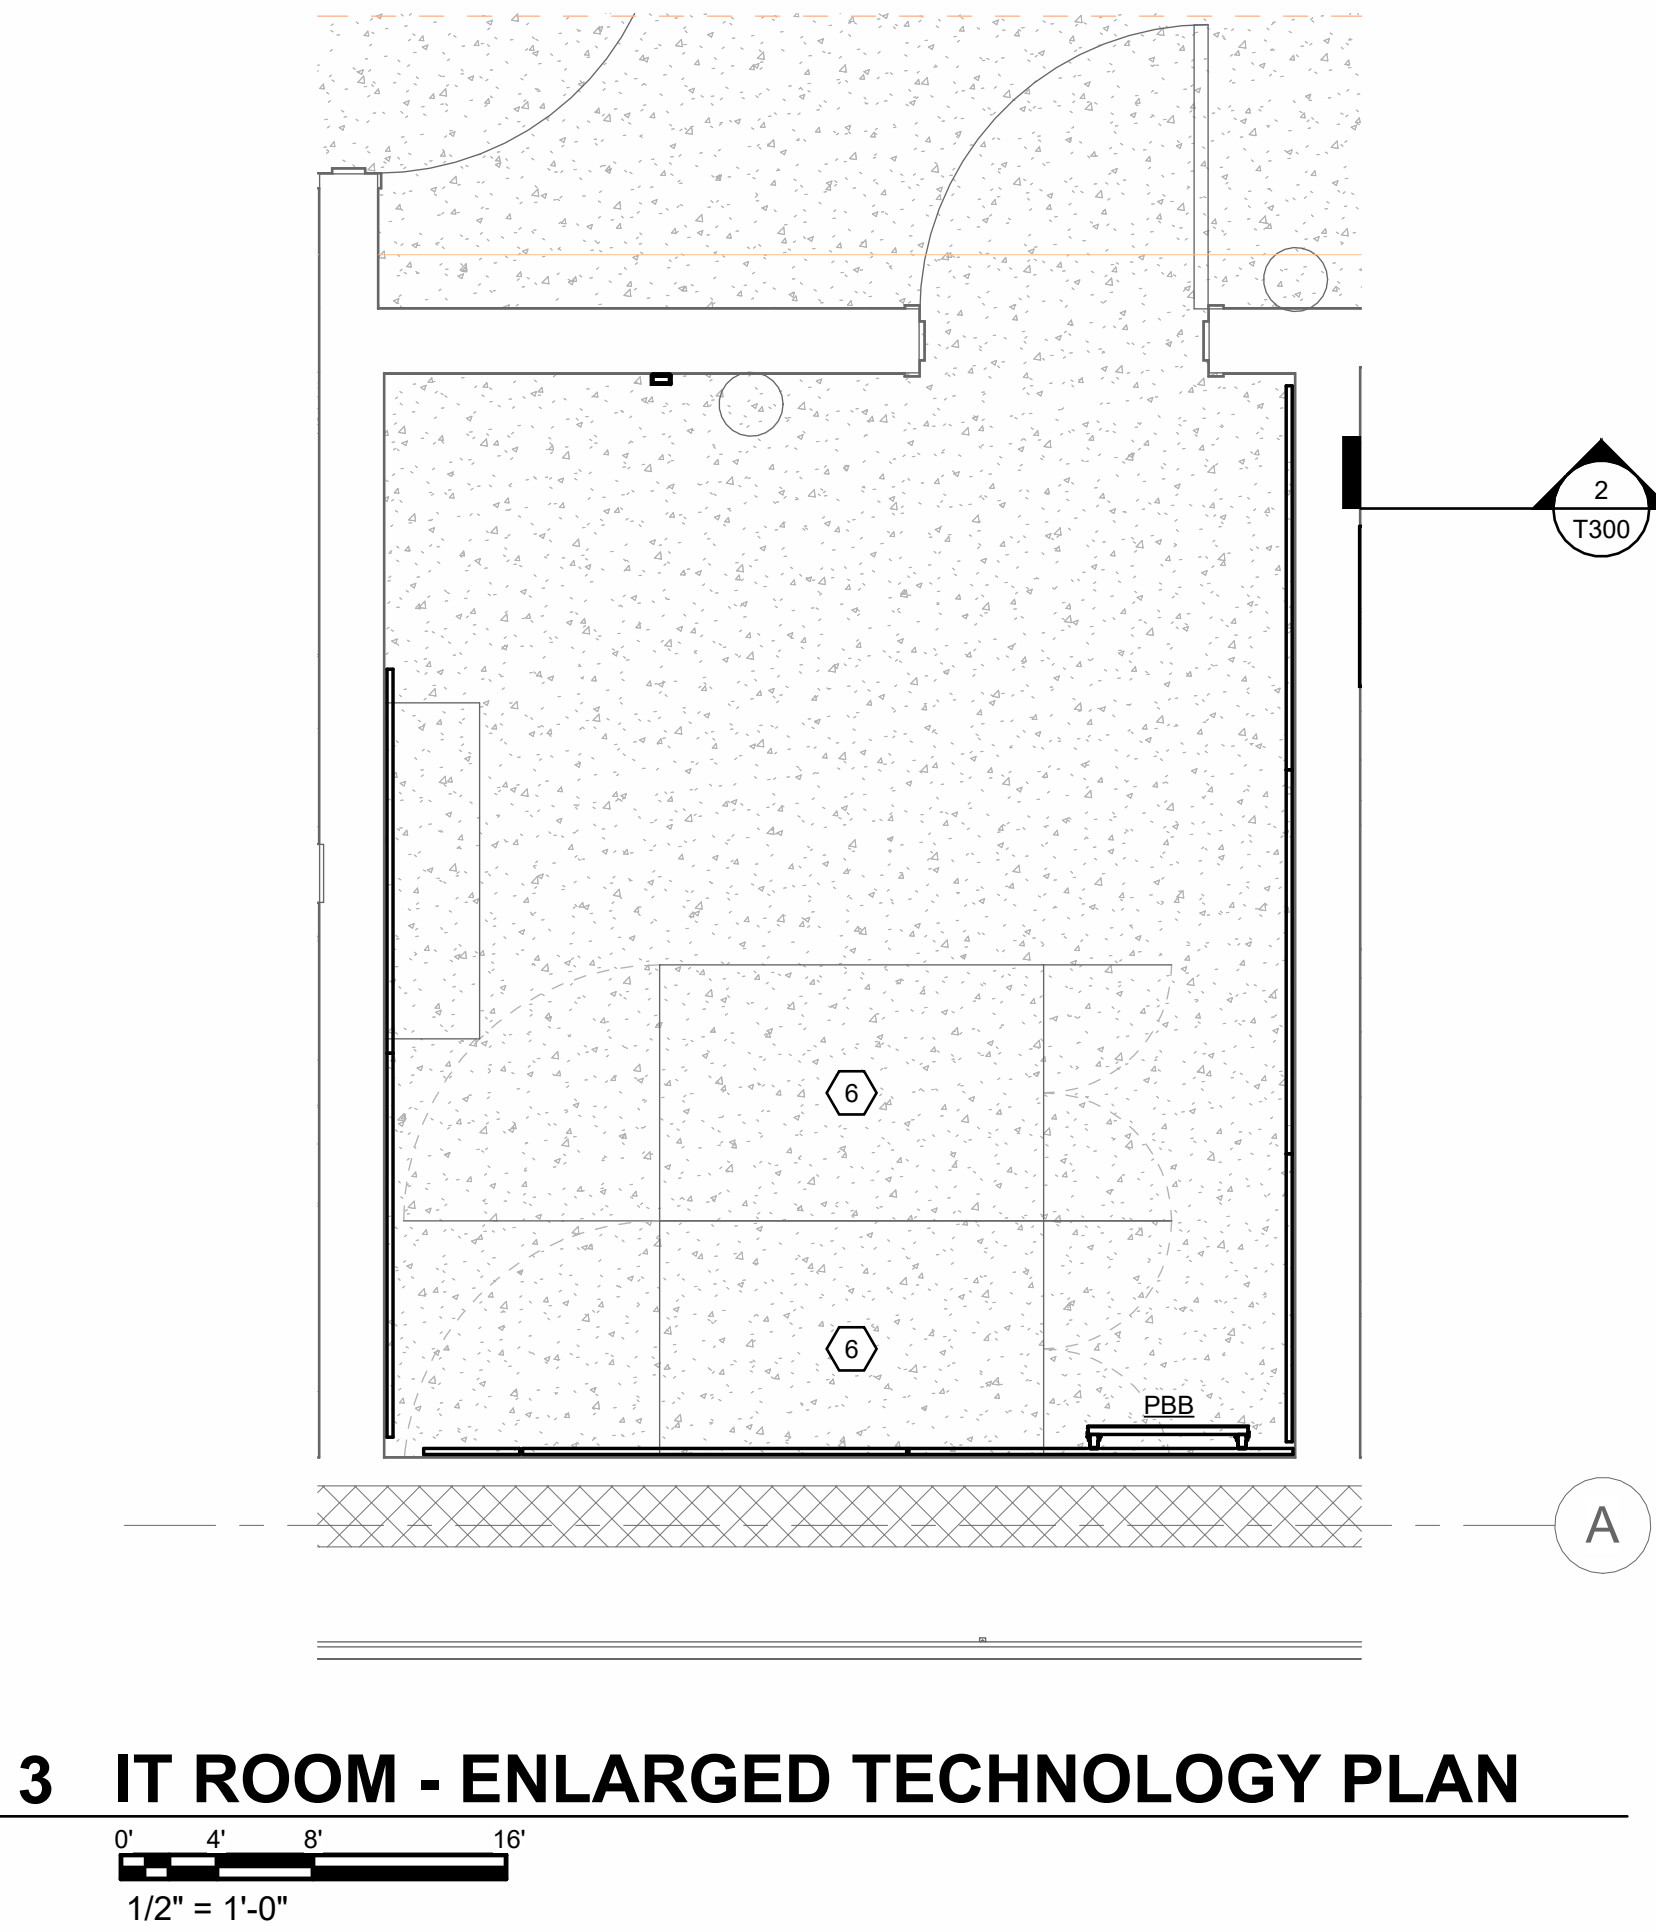

GENERAL SHEET NOTES

A. REFER TO SHEET T000 FOR LEGENDS, ABBREVIATIONS AND GENERAL NOTES.

SHEET KEYNOTES

- 4-PORT DATA OUTLET MOUNTED ABOVE DEDICATED BMS CONTROL PANEL.
- DATA DEDICATED TO INTRUSION DETECTION CONTROL PANEL.
- NOT USED.
- NOT USED.
- DATA OUTLET DEDICATED TO IT UPS.
- IT RACKS PROVIDED BY OWNER.
- 1" CONDUIT TO TECHNICAL ROOM WIRE MESH CABLE TRAY.
- 4" DATA CONDUIT ROUTED FROM BELOW THE SLAB, ROUTE FROM TELEDATA ENTRANCE TO TECHNICAL ROOM.



ISSUANCE
11/07/2025 PERMIT CYCLE 1

PROJECT NUMBER
7855191
PROJECT MANAGER
A. HENGSTEBECK
PROFESSIONAL
D. ELYA
DRAWN BY
M. GONZALEZ
CHECKED BY
D. ELYA


ENLARGED
TECHNOLOGY
PLANS
T300

LIDL US, LLC
LIDL 1517 NORCROSS, GA

499 JIMMY CARTER BLVD NORCROSS, GA 30093




PROGRESSIVE ARCHITECTURE ENGINEERING & PLANNING, LLC
**PROGRESSIVE
COMPANIES**
Charlotte, NC | Detroit, MI | Grand Rapids, MI
weareprogressive.com

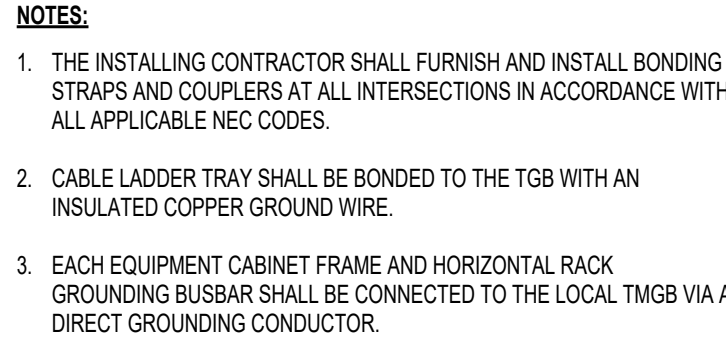

NTS

- NOTES:**
1. COORDINATE THE EXACT LOCATION OF THE DATA OUTLET AND ELECTRICAL RECEPTACLE WITH THE BMS CONTRACTOR PRIOR TO ROUGH-IN.
 2. REFER TO BMS PLANS AND DETAILS FOR THE EXACT PANEL AND EQUIPMENT CONFIGURATION AND DIMENSIONS.
 3. DATA CABLING SHALL CONNECT TO LIDL DATA NETWORK.

NTS

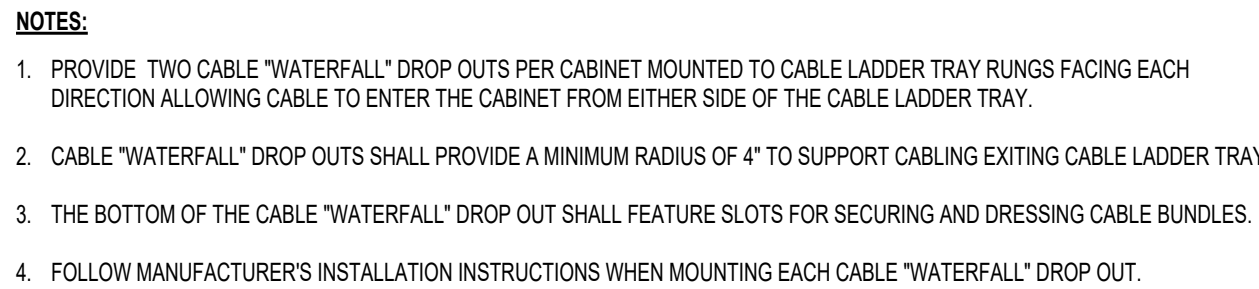


- NOTES:**
1. COORDINATE THE EXACT LOCATION OF THE DATA OUTLET AND ELECTRICAL RECEPTACLE WITH THE FIRE ALARM CONTRACTOR PRIOR TO ROUGH-IN.
 2. REFER TO FIRE ALARM PLANS AND DETAILS FOR THE EXACT PANEL AND EQUIPMENT CONFIGURATION AND DIMENSIONS.
 3. DATA CABLING SHALL BE PROVIDED BY A LIDL PROVIDED CONTRACTOR.

NTS


NTS

2. HUSSMAN XWEB SCHEMATIC WIRING DIAGRAMS NTS

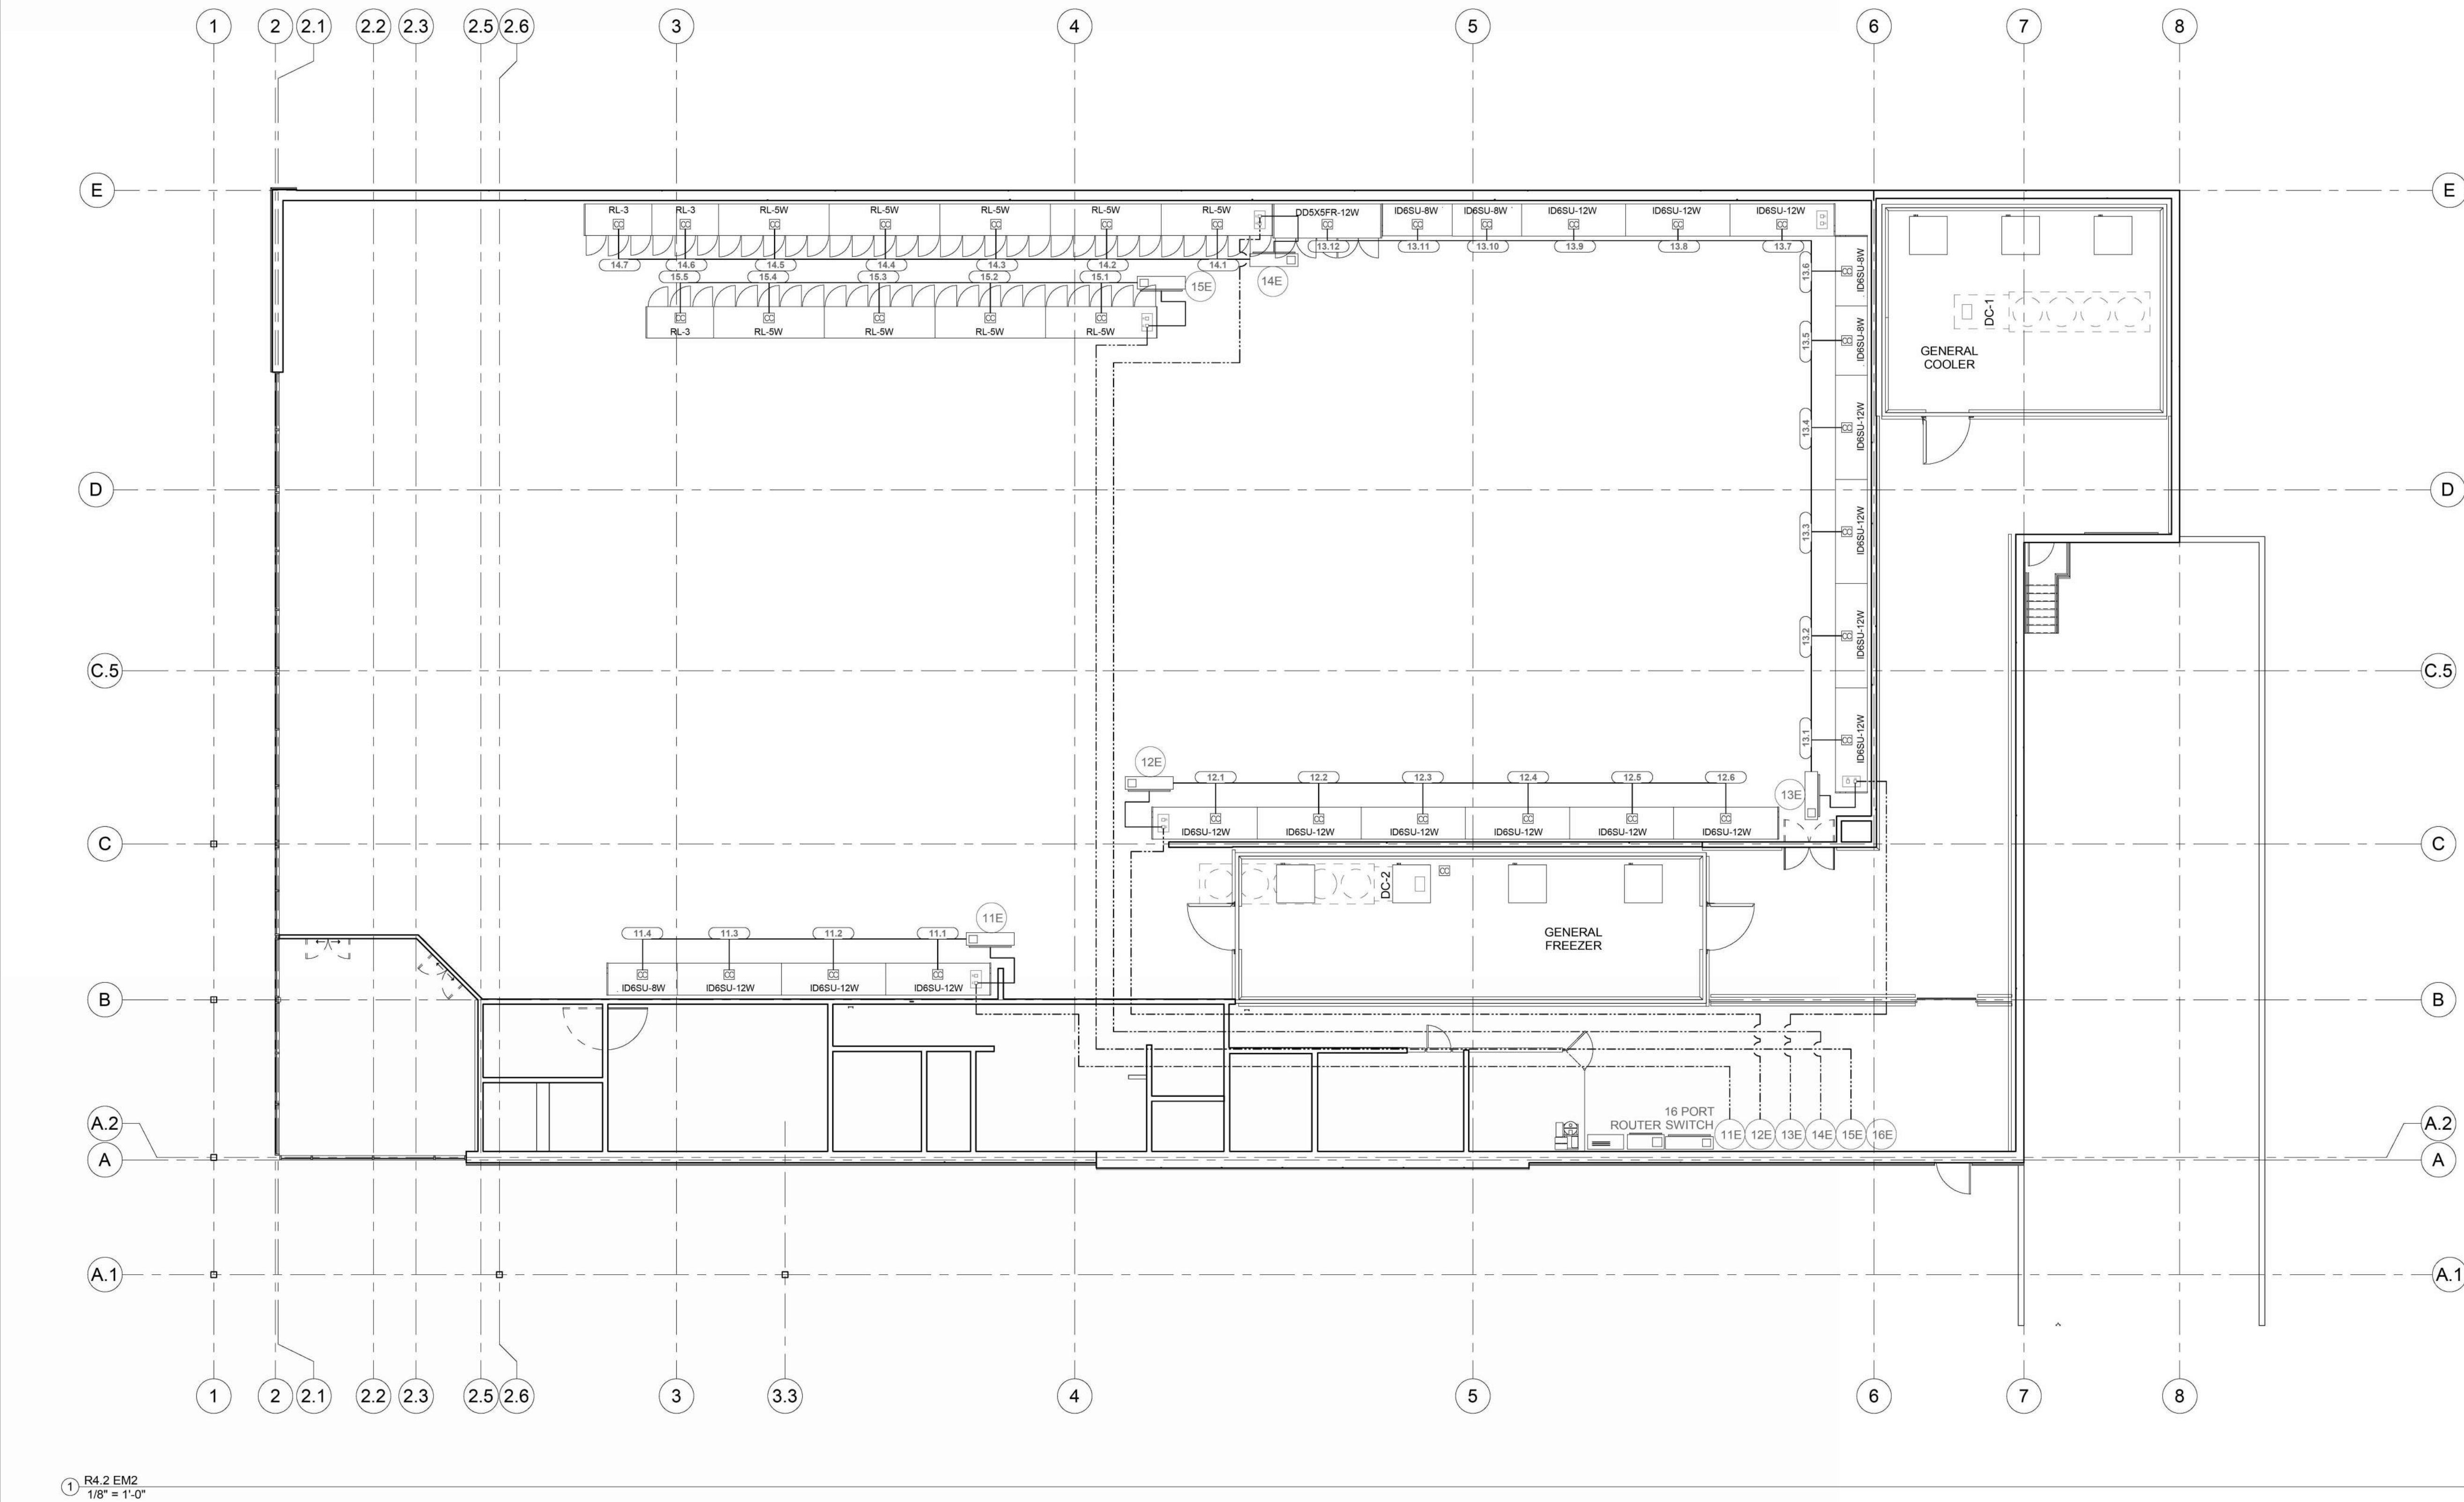


CABLE LEGEND		
NO.	CABLES ES FROM XWEB TO EQUIPMENT	XWEB TERMINATION POINT
1	ROOM SENSOR	CAT-5E MOODBUS
2	ROOM SENSOR POWER	BELDEN 222 24V
3	DRY COOLERS	CAT-5E MOODBUS
4	WALK-INS	CAT-5E MOODBUS
5	WALL CASES - 485 LOOP	CAT-5E MOODBUS
6	C.O.S. CASES	CAT-5E MOODBUS
7	SPARE	CAT-5E MOODBUS
8	SPARE	CAT-5E MOODBUS
9	EVAC SYSTEMS	CAT-4E MOODBUS
10	BAS LIGHTING INPUT	BELDEN 222 XWEB DIGITAL INPUT
11E	HSM CASES - SWITCH 1	CAT-4E NETWORK SWITCH
12E	HSM CASES - SWITCH 2	CAT-4E NETWORK SWITCH
13E	HSM CASES - SWITCH 3	CAT-4E NETWORK SWITCH
14E	HSM CASES - SWITCH 4	CAT-4E NETWORK SWITCH
15E	HSM CASES - SWITCH 5	CAT-4E NETWORK SWITCH
16E	SPARE	CAT-4E NETWORK SWITCH

CONTRACTOR SUPPLIED EQUIPMENT			
QTY	PART	MANUFACTURER	DESCRIPTION
10	TL-SF1016D	TP-LINK	16-PORT SWITCH

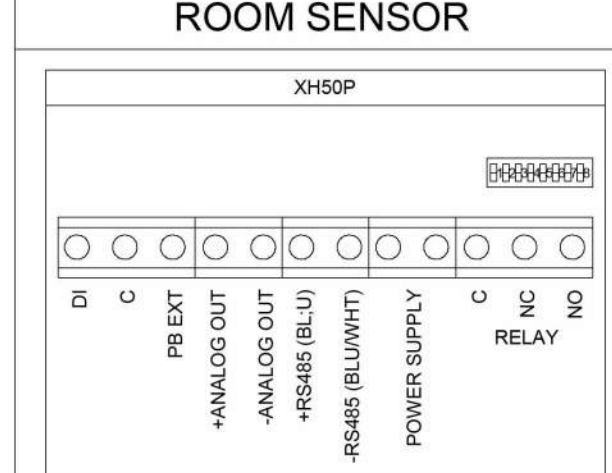

24V POWER FROM XWEB CONTROLLER.
SET DIP SWITCH 1 TO ON FOR ADDRESS "1".
COMMUNICATION WIRES LAND ON "RS485".
BELDEN 222 LANDS ON POWER SUPPLY COMING FROM XWEB.

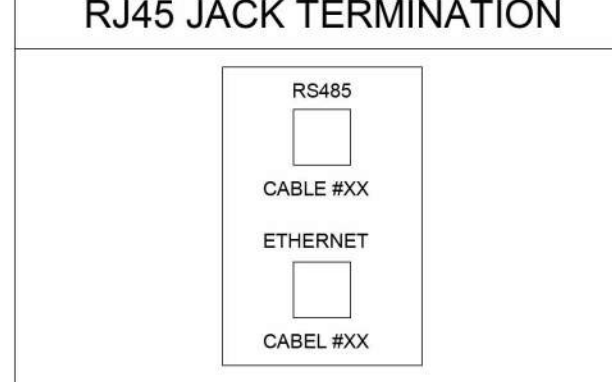

TOP JACK IS FOR RS485 CABLES AND IS TO BE MARKED "RS485".
BOTTOM JACK IS FOR ETHERNET SWITCH CABLES AND IS TO BE MARKED "ETHERNET".
MAIN CABLE NUMBERS FOR RS485 AND/OR ETHERNET TO BE MARKED ON PLATES.
THIS APPLIES TO BOTH WALL MOUNTED AND POWER POLL PLATES.
ALL MALE AND FEMALE RJ45 PLUGS WILL BE TERMINATED AS A "B" PIN OUT.

HUSSMANN CS. CONNECTIONS
AT THE FIRST AND LAST CASE IN EACH LINEUP, AN ETHERNET PATCH CABLE WILL BE CONNECTED TO THE WALL JACK. THE OPPOSITE END WILL BE CUT OFF AND STRIPPED BACK NEATLY, AND THE WIRE COLORS SPECIFIED IN THE ETHERNET CABLE TERMINATION CONNECTION DETAIL WILL BE TERMINATED ON THE CORELINK CONTROLLER.
BELDEN 222 CABLE WILL THEN BE USED TO DAISY CHAIN EACH CASE WITHIN A LINEUP.
ALL CABLES ON THE COMMUNICATION LOOP SHOULD BE LABELED "RS485".
ALL WALL PLATE JACKS SHOULD BE LABELED "RS485".
WALL JACK TO BE INSTALLED ON SALES FLOOR SIDE OF WALL AT 8" AFF (IC8BU, RL-W, D05XSFWR) AND 95.5" AFF (ID6BU).
ISLAND RJ45 JACKS ARE TO BE INSTALLED AT THE BOTTOM OF THE POWER POLLS.

HUSSMANN

Hussmann Corporation
13770 Ramona Avenue
Chino, CA 91710
(909) 890-4910
(909) 890-5113 Fax

LIDL

SALES PERSON

PROJECT MANAGER

THIS DOCUMENT IS THE PROPERTY OF PROGRESSIVE ARCHITECTURE & PLANNING, LLC. NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM PROGRESSIVE ARCHITECTURE & PLANNING, LLC. ALL RIGHTS ARE RESERVED. OTHER RIGHTS AND INTERESTS, INCLUDING THE COPYRIGHT, ARE RESERVED.

ALL CABLES ON THE COMMUNICATION LOOP SHOULD BE LABELED "RS485".
ALL WALL PLATE JACKS SHOULD BE LABELED "RS485".
WALL JACK TO BE INSTALLED ON SALES FLOOR SIDE OF WALL AT 8" AFF (IC8BU, RL-W, D05XSFWR) AND 95.5" AFF (ID6BU).
ISLAND RJ45 JACKS ARE TO BE INSTALLED AT THE BOTTOM OF THE POWER POLLS.

DATE: 10/31/2025
SCALE: As Indicated
DRAWN BY: SEAN A.
CHKD BY: CHRIS G.
APPROV BY: CRAIG P.
DESIGNED BY: TYLER R.
PLAN: 105113R_LIDL1517

Lidl #1517
Norcross, Georgia 30093
New Store
499 JIMMY CARTER BLVD.

Cushing Terrell
cushingterrell.com
800.757.9522

EMS
ETHERNET

R4.2

TECHNOLOGY
DETAILS
T602


REGISTERED COMMUNICATIONS DISTRIBUTION RESOLVER
Bicsi
David A. Bicsi
BICS ID # 114787
EXPIRES 12-31-27
RCDD

ISSUANCE
11/07/2025 PERMIT CYCLE 1

PROJECT NUMBER
79650191
PROJECT MANAGER
A. HENGSTEBECK
PROFESSIONAL
D. ELYA
DRAWN BY
M. GONZALEZ
CHECKED BY
D. ELYA

LIDL US, LLC
LIDL 1517 NORCROSS, GA

PROGRESSIVE ARCHITECTURE ENGINEERING & PLANNING, LLC
PROGRESSIVE
COMPANIES
Charlotte, NC | Detroit, MI | Grand Rapids, MI
weareprogressive.com

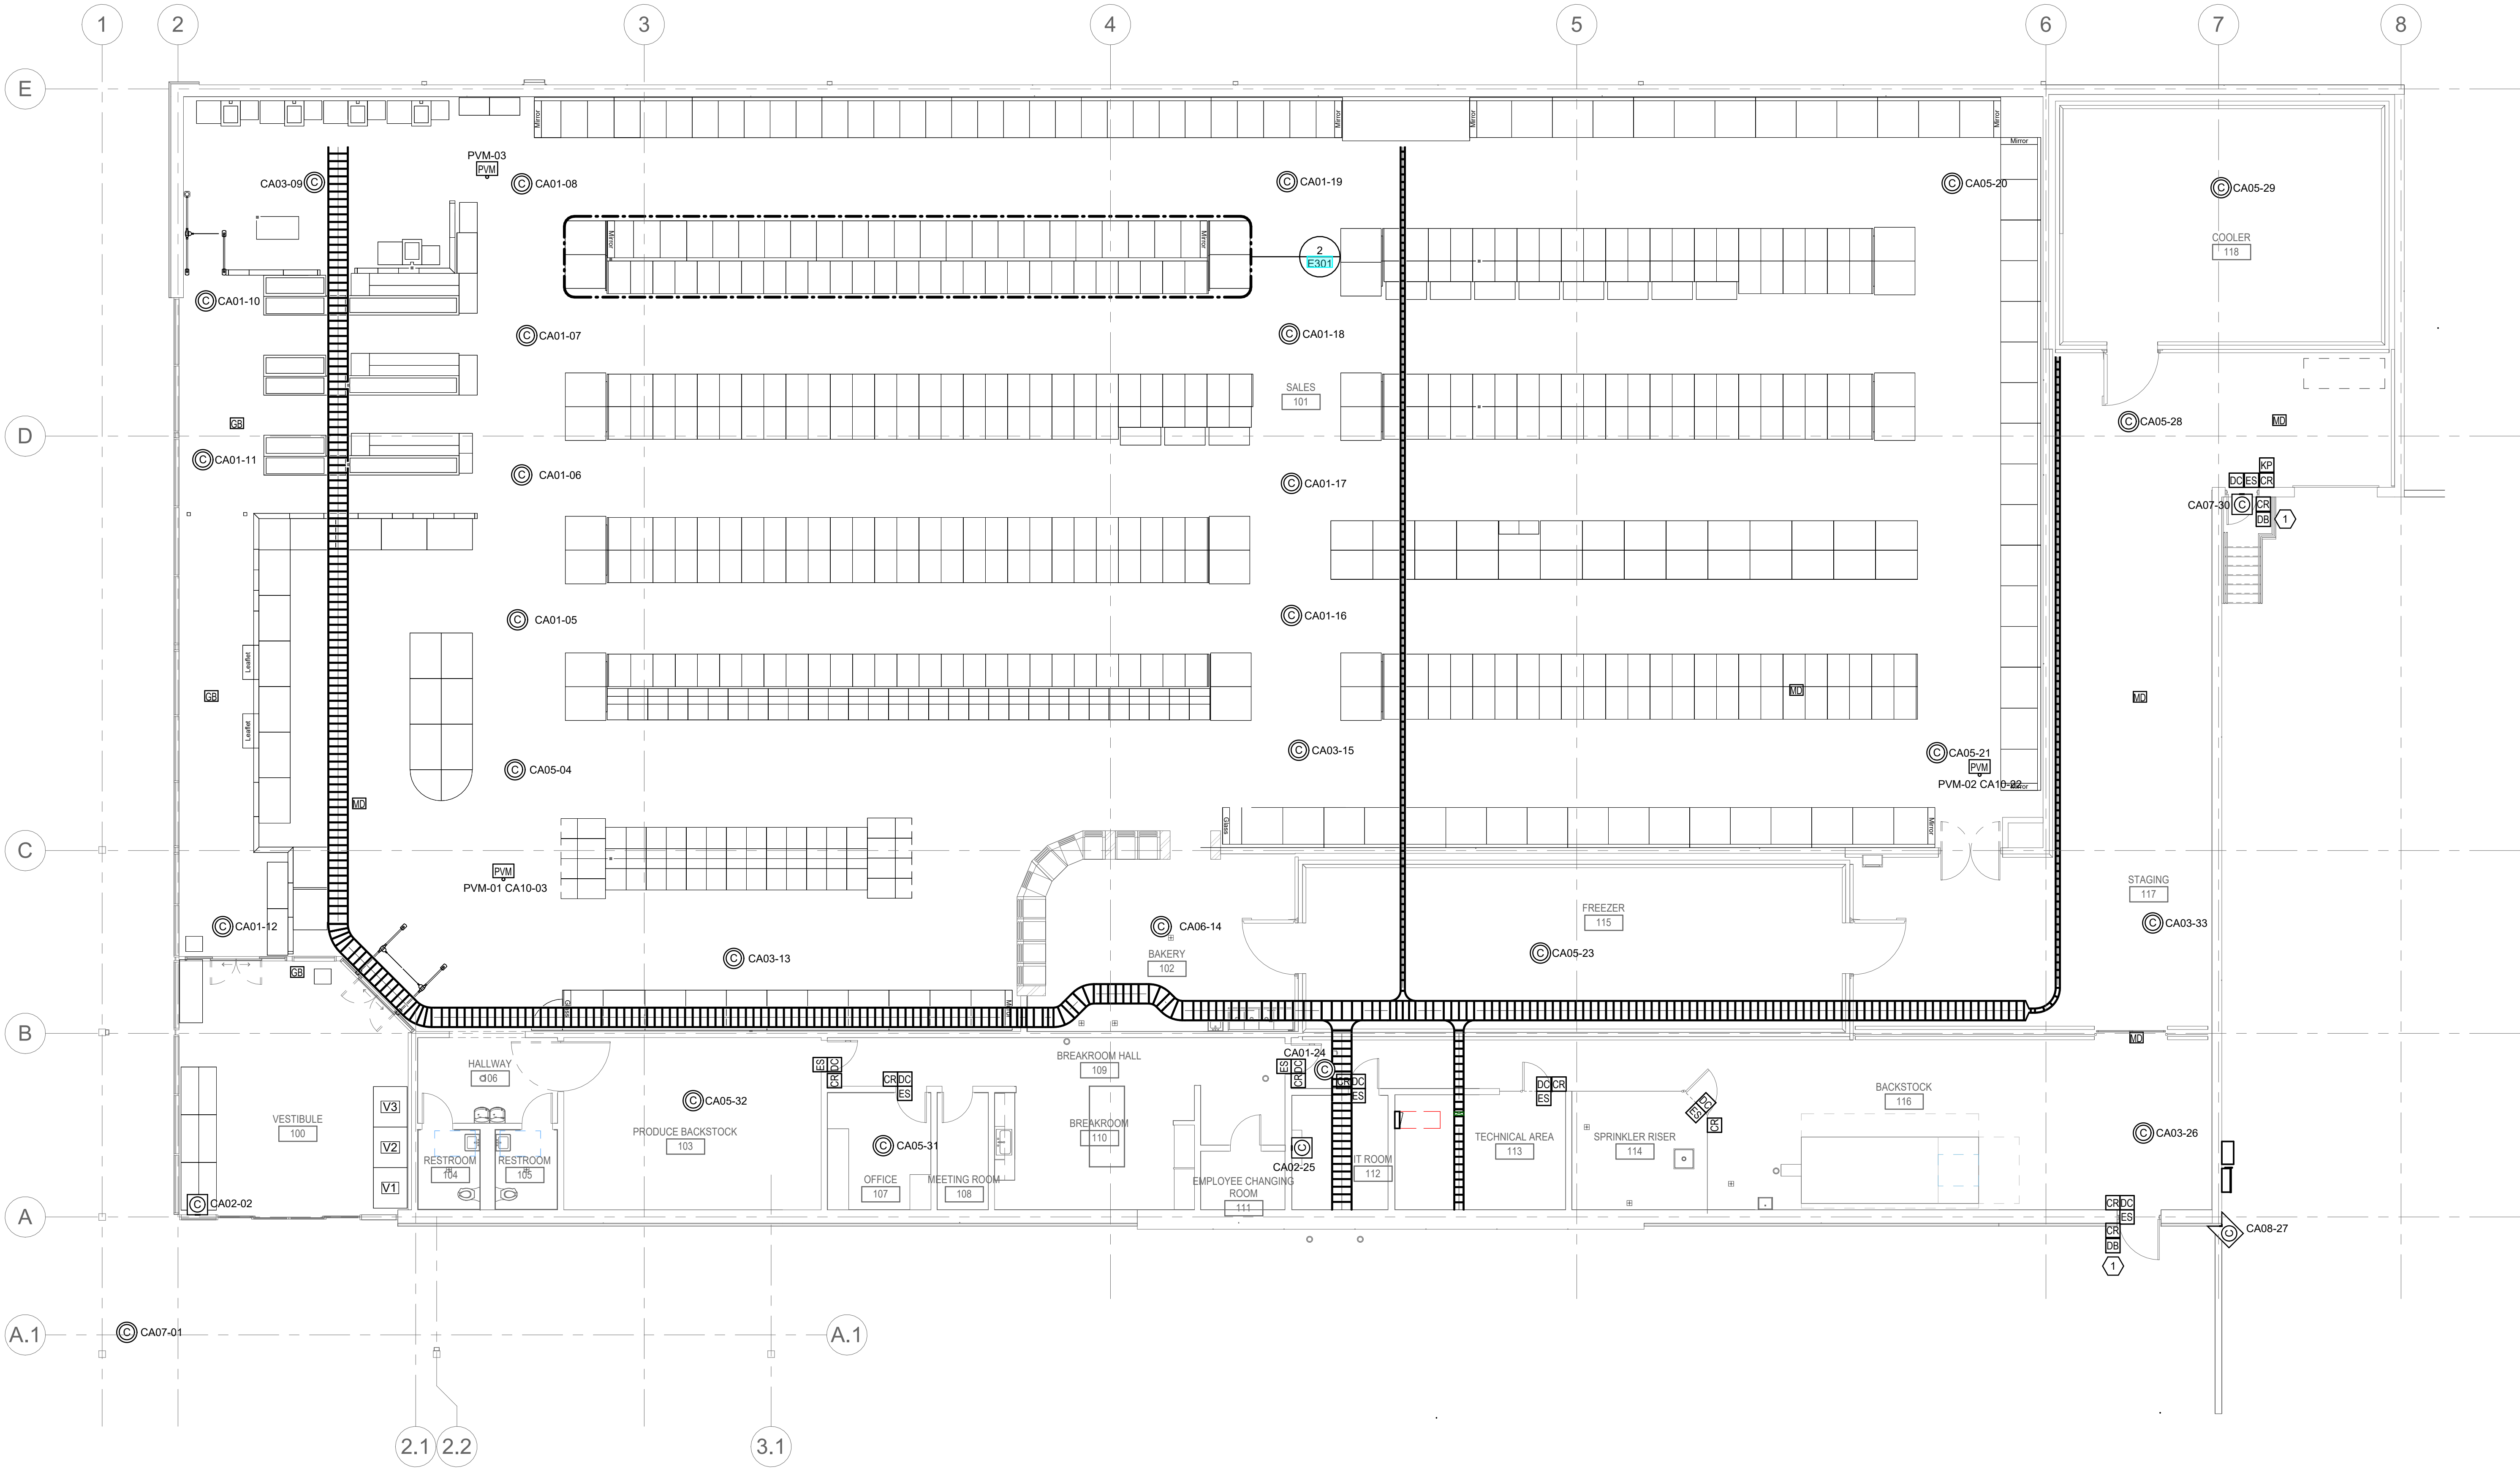

GROUND FLOOR - TECHNOLOGY PLAN
1/8" = 1'-0"

SHEET KEYNOTES

1. ADD RELAY FOR DOORBELL, ROUTE TO RACK 1B.

GENERAL SHEET NOTES

- A. REFER TO SHEET **T000** FOR LEGENDS, ABBREVIATIONS AND GENERAL NOTES.
B. EC TO LABEL OR SPRAY INSIDE JUNCTION BOXES TO IDENTIFY PURPOSE OF THE JUNCTION BOX.

11/7/2025 5:25:08 PM Autodesk Docs/77855191 - LIDL 1517 Norcross CA/7855191 LIDL 1517 NORCROSS GA - ELEC-14
GROUND FLOOR - SECURITY PLAN
THIS DOCUMENT AND ITS CONTENTS ARE THE PROPERTY OF PROGRESSIVE ARCHITECTURE & PLANNING, LLC. NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM PROGRESSIVE ARCHITECTURE & PLANNING, LLC. ALL RIGHTS ARE RESERVED. OTHER RIGHTS MAY BE RESERVED BY THIRD PARTIES. © 2025 PROGRESSIVE ARCHITECTURE & PLANNING, LLC

