

CONDUIT DRAWING NOTES

Notes:
Contact TANAKA at 481-3085 prior to construction.
Cable and transformer installation drawing to follow.
No changes from design, either horizontal or vertical, shall be made without first obtaining permission from the design engineer. Foreman's completed print must show depth of conduit at manholes and depth of manholes. Any change in conduit position shall be shown and any change in depth shall be shown at that point.

All plastic conduit is PVC encased buried (EB) unless otherwise noted.
Cover over all conduit to be 30 inches minimum below gutter grade.


Survey Notes:
Where conduit work requires survey, the location of curbs as shown on the drawing shall be verified and noted at the time of such survey.
Survey will contact design engineer after job has been staked.

MATERIALS LIST

DESCRIPTION	QUANTITY	UNIT
5" PVC EB STRAIGHT DUCT	1281	LF
4" PVC EB STRAIGHT DUCT	336	LF
5" PVC DB 35' RADIUS 22.50 DEG.	21	EACH
5" PVC DB 35' RADIUS 11.25 DEG.	14	EACH
4" PVC DB 35' RADIUS 22.50 DEG.	6	EACH
4" PVC DB 35' RADIUS 11.25 DEG.	4	EACH
5" PVC DB 12.5' RADIUS 11.25 DEG.	32	EACH
4" PVC DB 12.5' RADIUS 11.25 DEG.	8	EACH
5" PVC 5' RADIUS 90 DEG.	2	EACH
5" COUPLING	2	EACH
5" NIPPLE	2	EACH
3 X 12 LUMBER	AS REQUIRED	
5" 1-WIDE SPACER BASE	2	EACH
5" 1-WIDE SPACER INTR.	2	EACH
5" 2-WIDE SPACER BASE	56	EACH
5" 2-WIDE SPACER INT.	201	EACH
ASPHALT CONCRETE	28	T.N.
330-C-1700 (DUCT CONCRETE)	54	C.Y.
DWP19B (BACKFILL SLURRY)	62	C.Y.

ASPHALT EXCAVATION	864	SF.
TOTAL EXCAVATION AREA	864	SF.

SLURRY BACKFILL

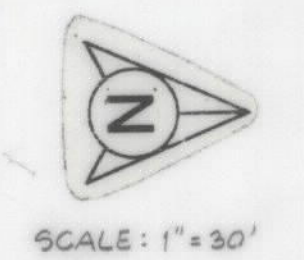

DIST. HQ.
VALLEY

89-11089 BX

KBR 17 (REV 12) QCE 43

CITY OF LOS ANGELES DISTRIBUTION SYSTEM DESIGN UNDERGROUND DEPARTMENT OF WATER AND POWER	
4.8 KV CONDUIT	
MH5547 FULTON AVE. @ BURBANK BLVD. + BURBANK BLVD. @ 400' E/B BELLARE AVE.	
DESIGN TANAKA	DRAWING P. THAM
DATE	DATE
APPROVED	DATE
H-10796	
SHEET 1 OF 1	

PERMIT 11-8681-1030
11-8681-1031
ISSUED 7-23-86


COND. CURVE DATA				
Δ	R	L	T	
1 90°	35'	55'	35'	
2 22°30'	12.6'	4.11'	2.6'	




SECTION "B-B"
9-5' x 2-4'
27' x 2-6'




SECTION "A-A"
Ex. G-5'P

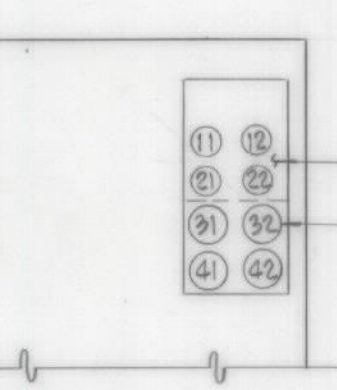

E. WALL
Ex. 4-4' x 4-5'P
Ex. VLT. 12634

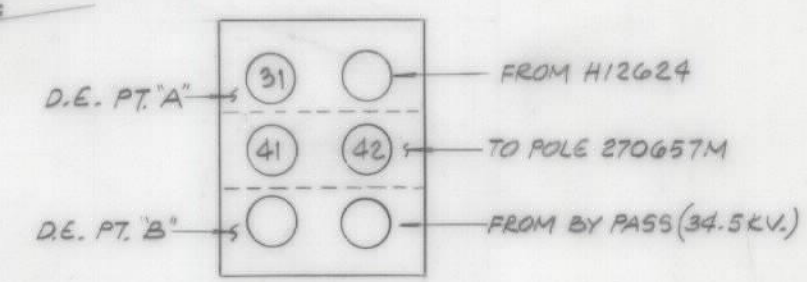

SECTION "C-C"
Ex. G-5'P

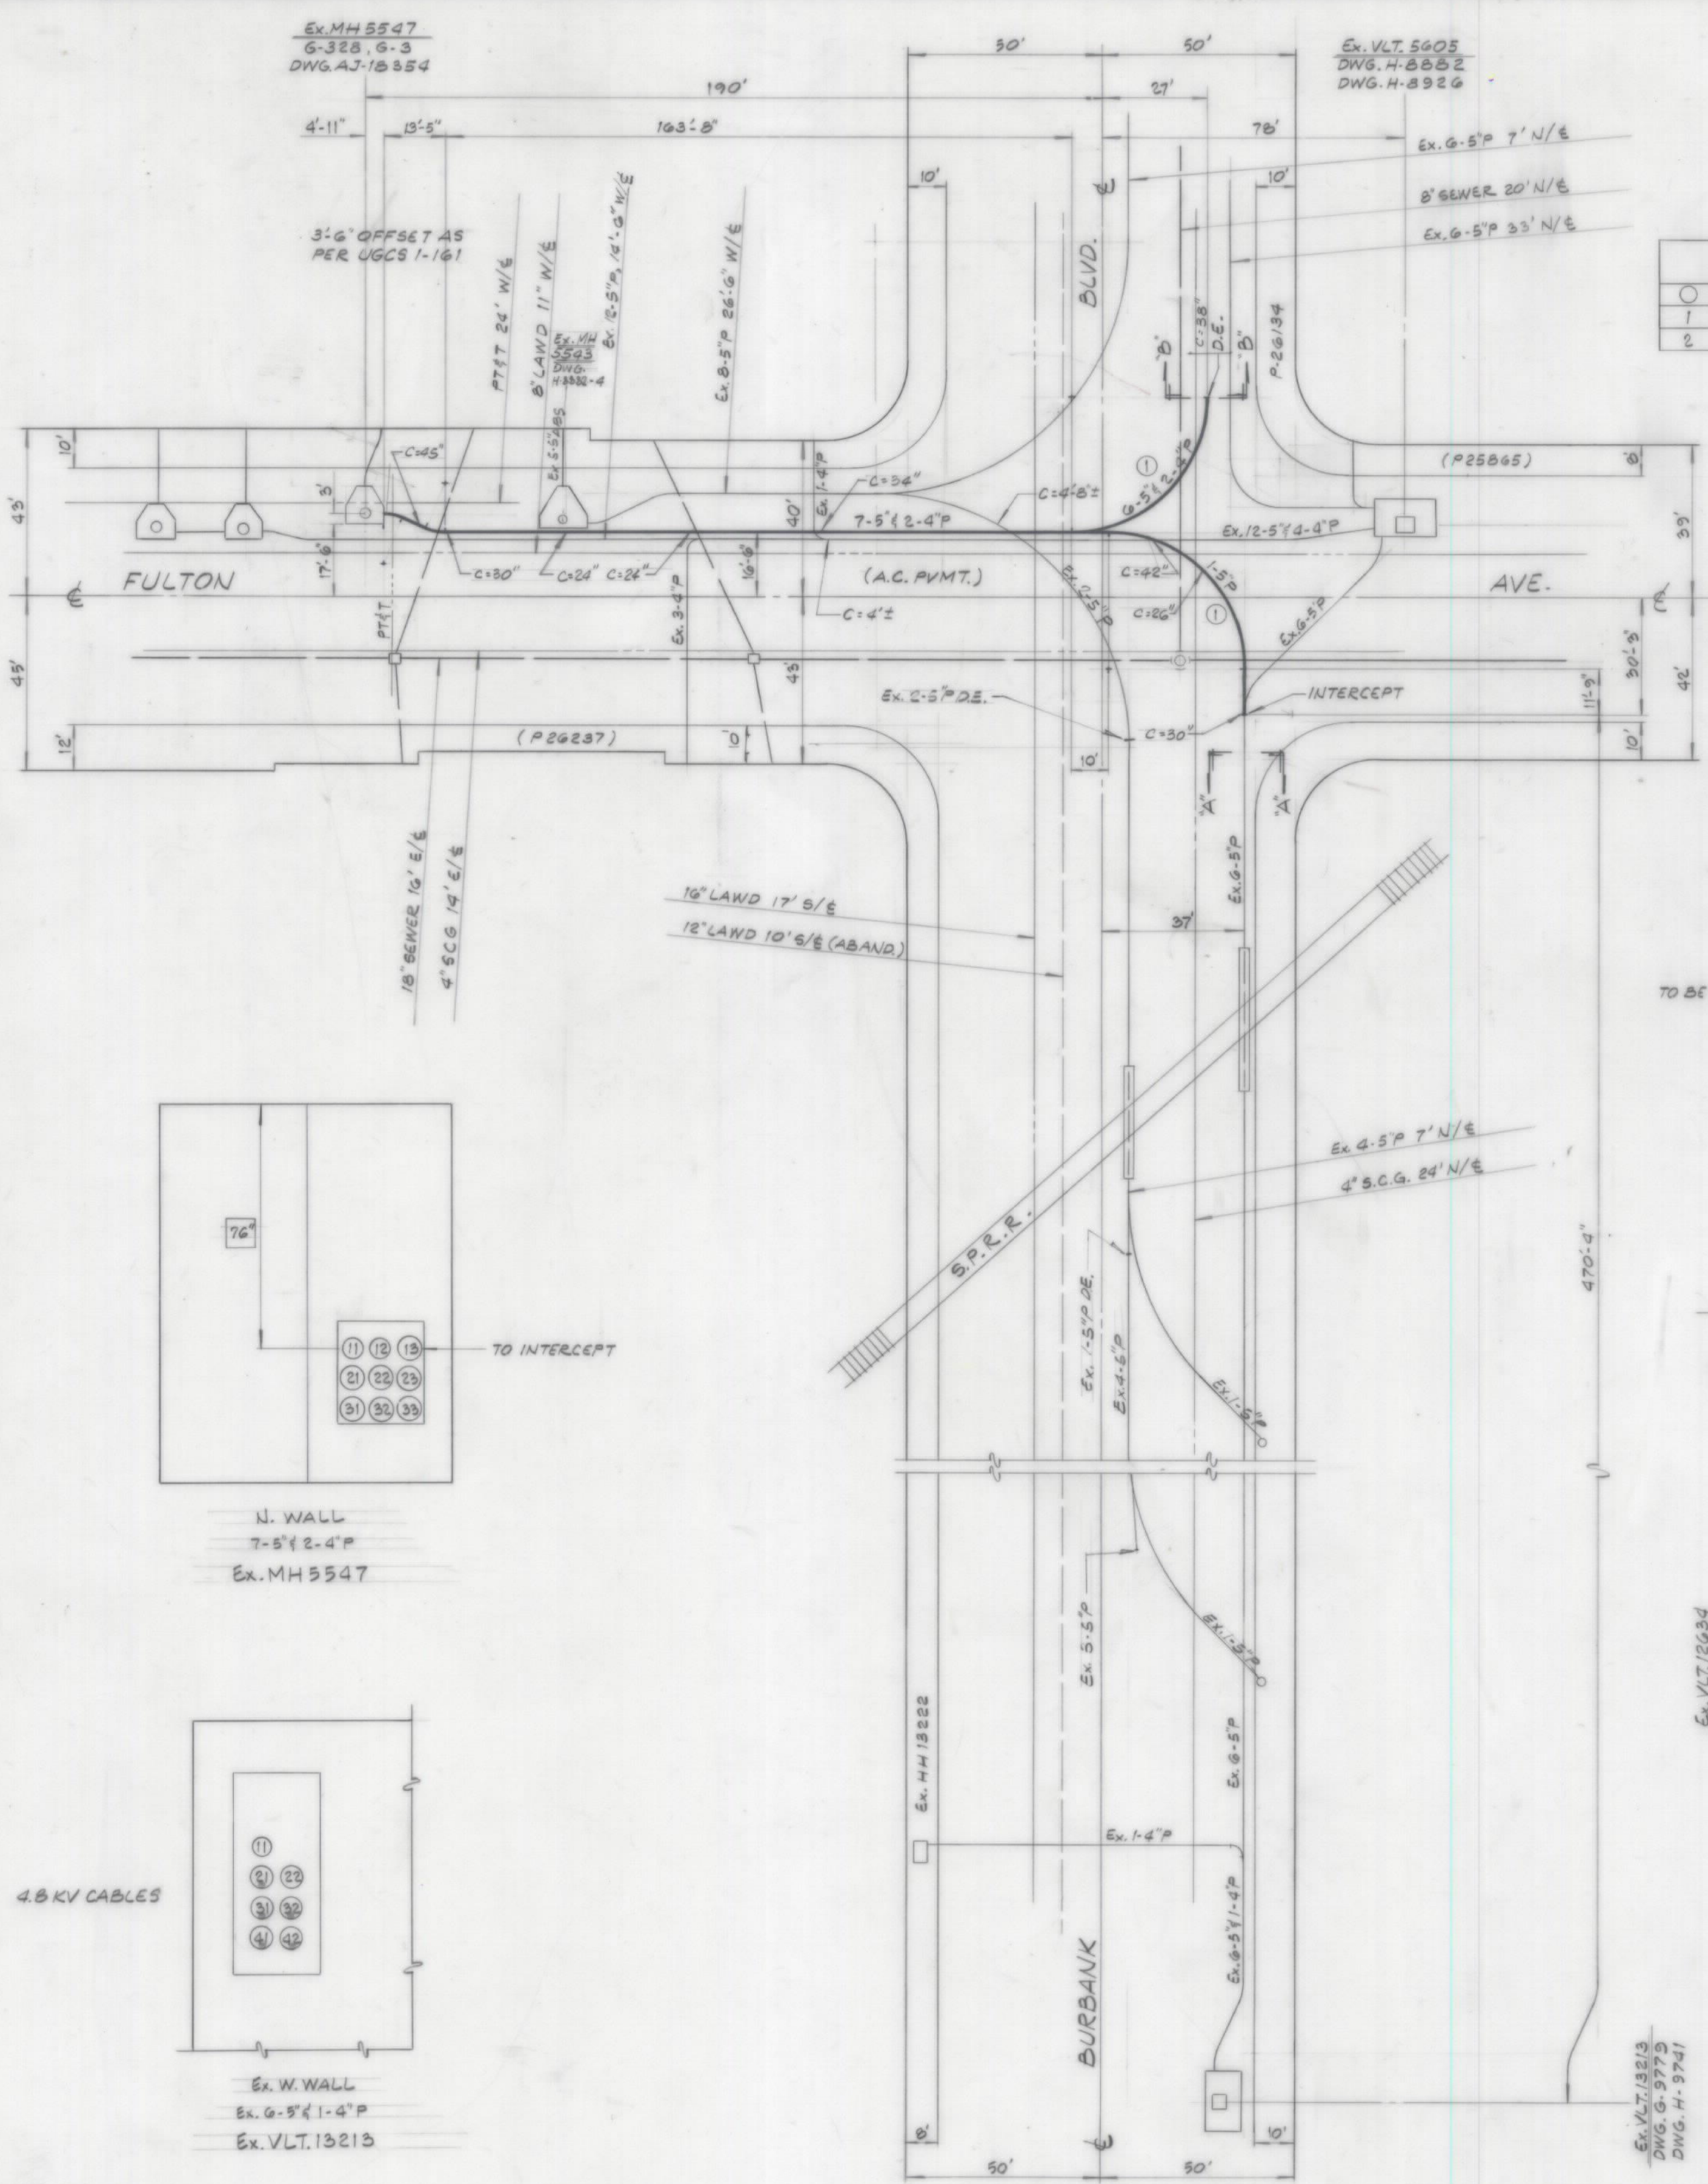

PRELIM	FINAL
EP-5-4	DSD-4
WED-2	DCM-10
FB-2	DCSV-2
SCG-2	
DCSV-1	

DATE	INITIALS	REVISION	APP'D
12-15-80	VOR	REVISED TO CONSTRUCTION	JM