


PRELIM	FINAL
ENGR -1	ENGR -1
SP(V)-1	D(VN)-6
D(VN)-1	SP(V)-1
WOD -1	LSMS -2
MIC -1	DDFT -1
EP -5	CGG -1
VGS2 -1	VGS -1
CSD -1	CSD -1
TOTAL = 12	TOTAL = 14

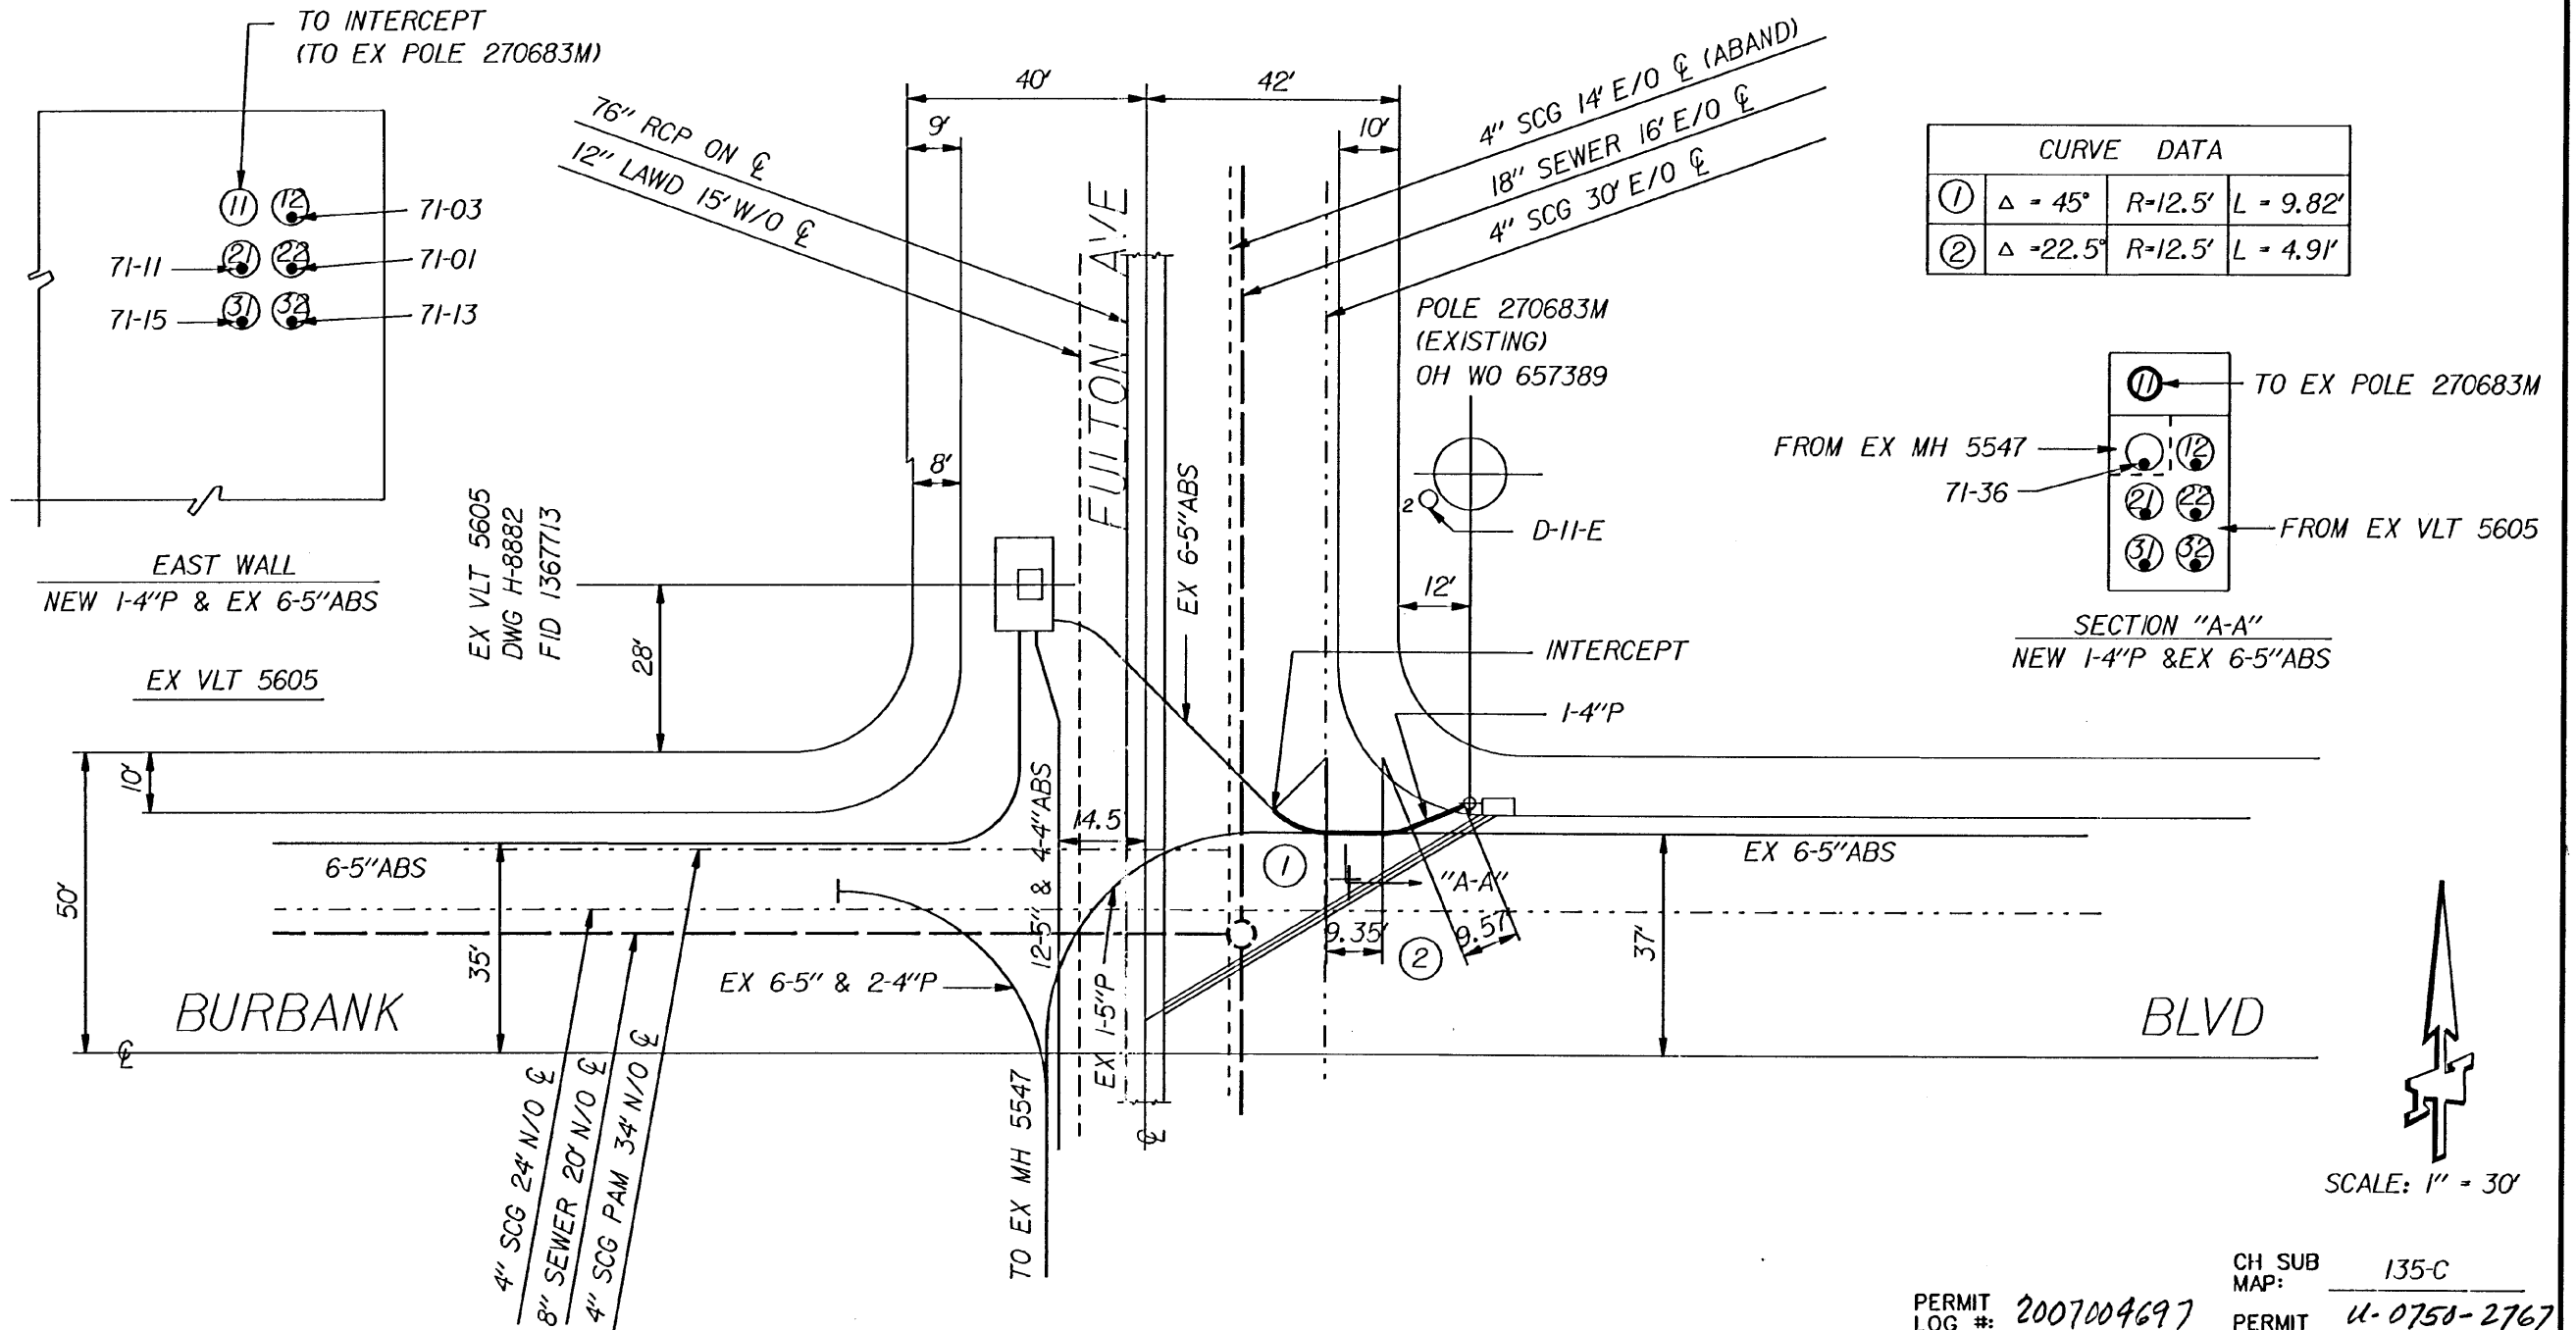

- NOTES:
- CONTACT P. DOMINGO AT (213) 367-2654 PRIOR TO CONSTRUCTION.
 - ALL PLASTIC CONDUIT IS TO BE ENCASED BURIED, EB, U. O. N..
 - SEE WR * 657389, NUX33, DWG 06H2110 FOR CABLE WORK.
 - COVER OVER ALL CONDUIT IS TO BE 30" BELOW GUTTER GRADE.
 - REFERENCES: H-8882 H-8926

No.	DATE	INIT'L	REVISION	APP'V'D
1	5/31/07	PFD	ADD STORM DRAIN & SCG SUBS	

SYS MAP: 172-156
OH MAP: 174-159
T.G.: 562-D1
SERV.:
CKT MAP:
LINE NAME:

SEE ORIGINAL FOR REGISTERED ENGINEER'S APPROVAL	SERVICE CENTER JOB LOCATION VN		SERVICE CENTER CONSTRUCTION VN		WR #: 683336	CONST #: NVQ37	PROJECT #: P234369	NON-CONST #: NVQ36
	CITY OF LOS ANGELES DEPARTMENT OF WATER AND POWER DISTRIBUTION ENGINEERING SECTION							
	DESIGN P. DOMINGO				DRAFTING P. DOMINGO			
	ORIGINAL SIGNED BY OK DARRELL K TOM				CHECKER			
ORIGINAL SIGNED BY APPROVED DARRELL K TOM				DATE 5/14/07				07E8016
								SHEET 1 OF 1

CH SUB MAP: 135-C
PERMIT LOG #: 2007004697
ISSUED 6-11-2007
EXPIRES 12-11-07
EXPECTED CONSTRUCTION COMPLETION: 07/14/07
PERMIT U-0750-2767

SCANNED LOG 2007005366.