

a ERCOT allocation

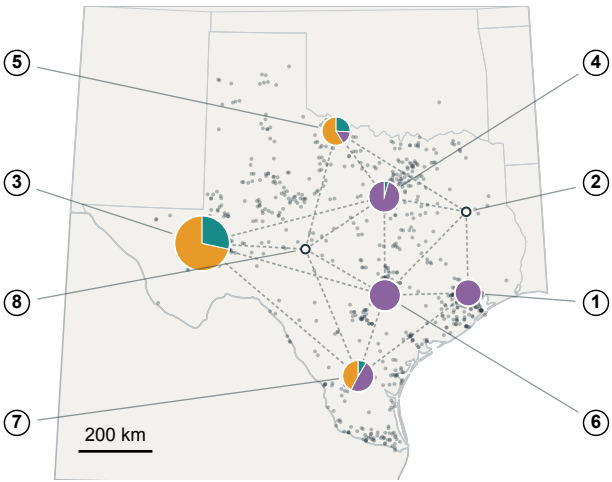

b Far West feeder

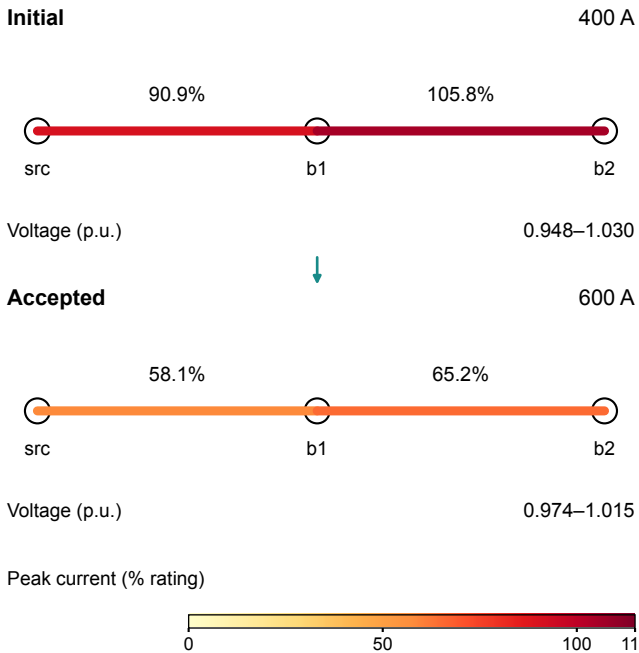

c New power (GW)

Solar	**89.66**
Nuclear	**79.52**
Battery	**35.13**
Battery energy (GWh)	**210.77**

d Verification

Voltage violation (h)	**2 → 0**
Thermal overload (h)	**13 → 0**
Feeders passed	**8 / 8**
Feeder cost ($M/yr)	**183.04**