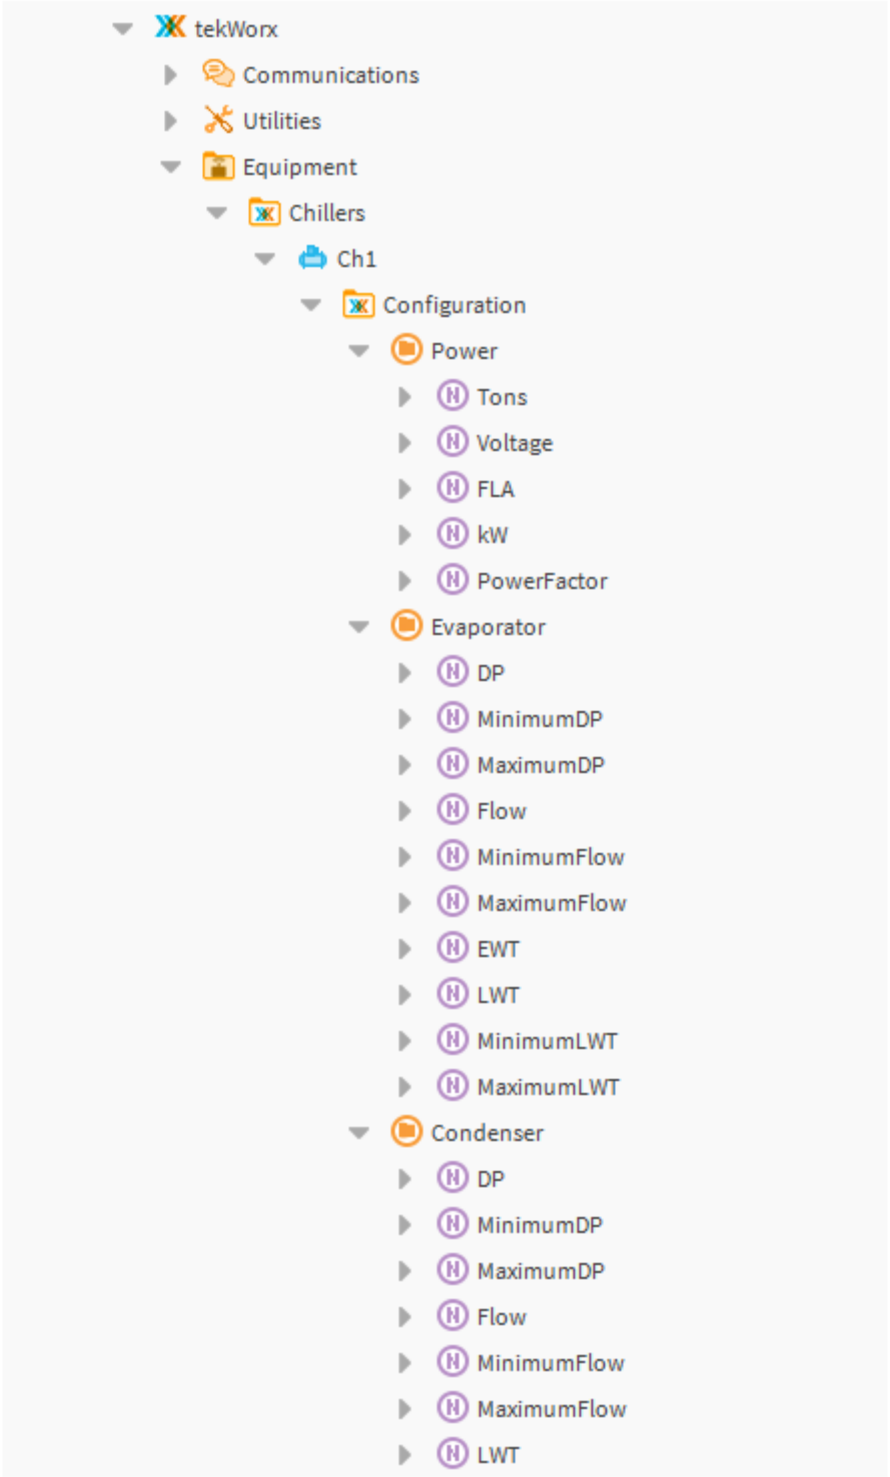
tekWorx
Communications
Utilities
Equipment
Chillers
Ch1
Configuration
Power
Tons
Voltage
FLA
kW
PowerFactor
Evaporator
DP
MinimumDP
MaximumDP
Flow
MinimumFlow
MaximumFlow
EWT
LWT
MinimumLWT
MaximumLWT
Condenser
DP
MinimumDP
MaximumDP
Flow
MinimumFlow
MaximumFlow
LWT

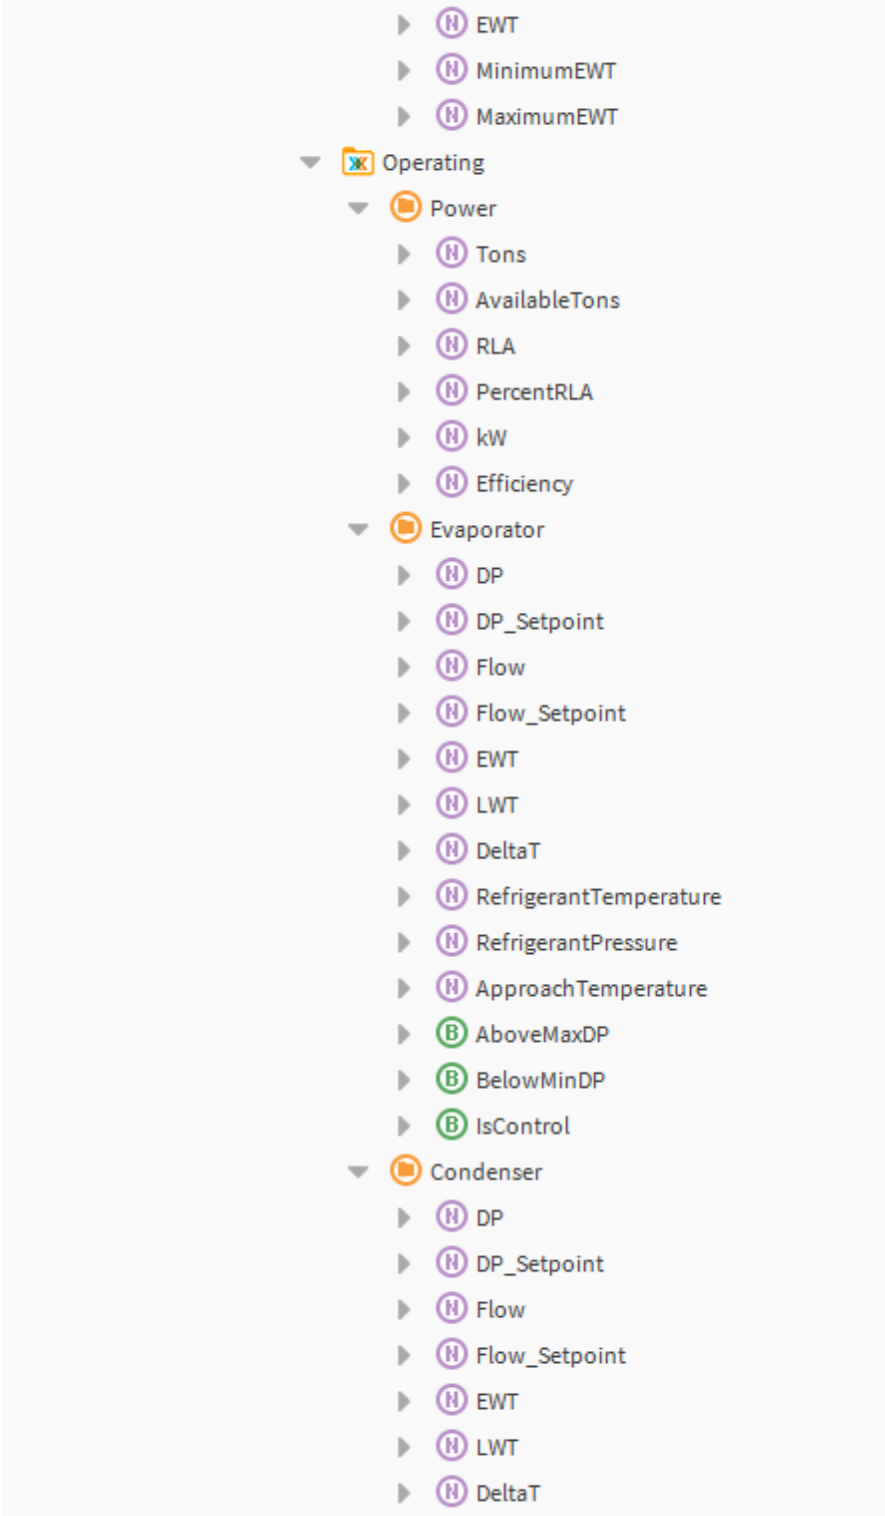
EWT
MinimumEWT
MaximumEWT
Operating
Power
Tons
AvailableTons
RLA
PercentRLA
kW
Efficiency
Evaporator
DP
DP_Setpoint
Flow
Flow_Setpoint
EWT
LWT
DeltaT
RefrigerantTemperature
RefrigerantPressure
ApproachTemperature
AboveMaxDP
BelowMinDP
IsControl
Condenser
DP
DP_Setpoint
Flow
Flow_Setpoint
EWT
LWT
DeltaT

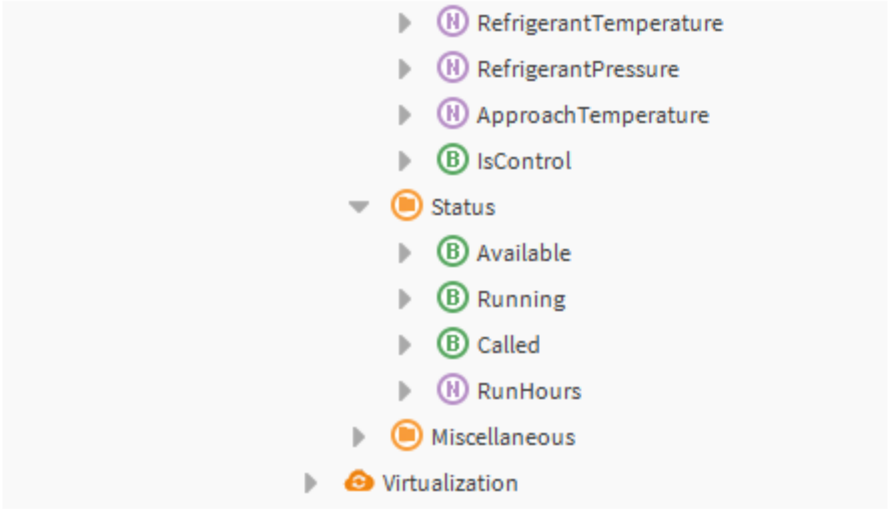
RefrigerantTemperature
RefrigerantPressure
ApproachTemperature
IsControl
Status
Available
Running
Called
RunHours
Miscellaneous
Virtualization