


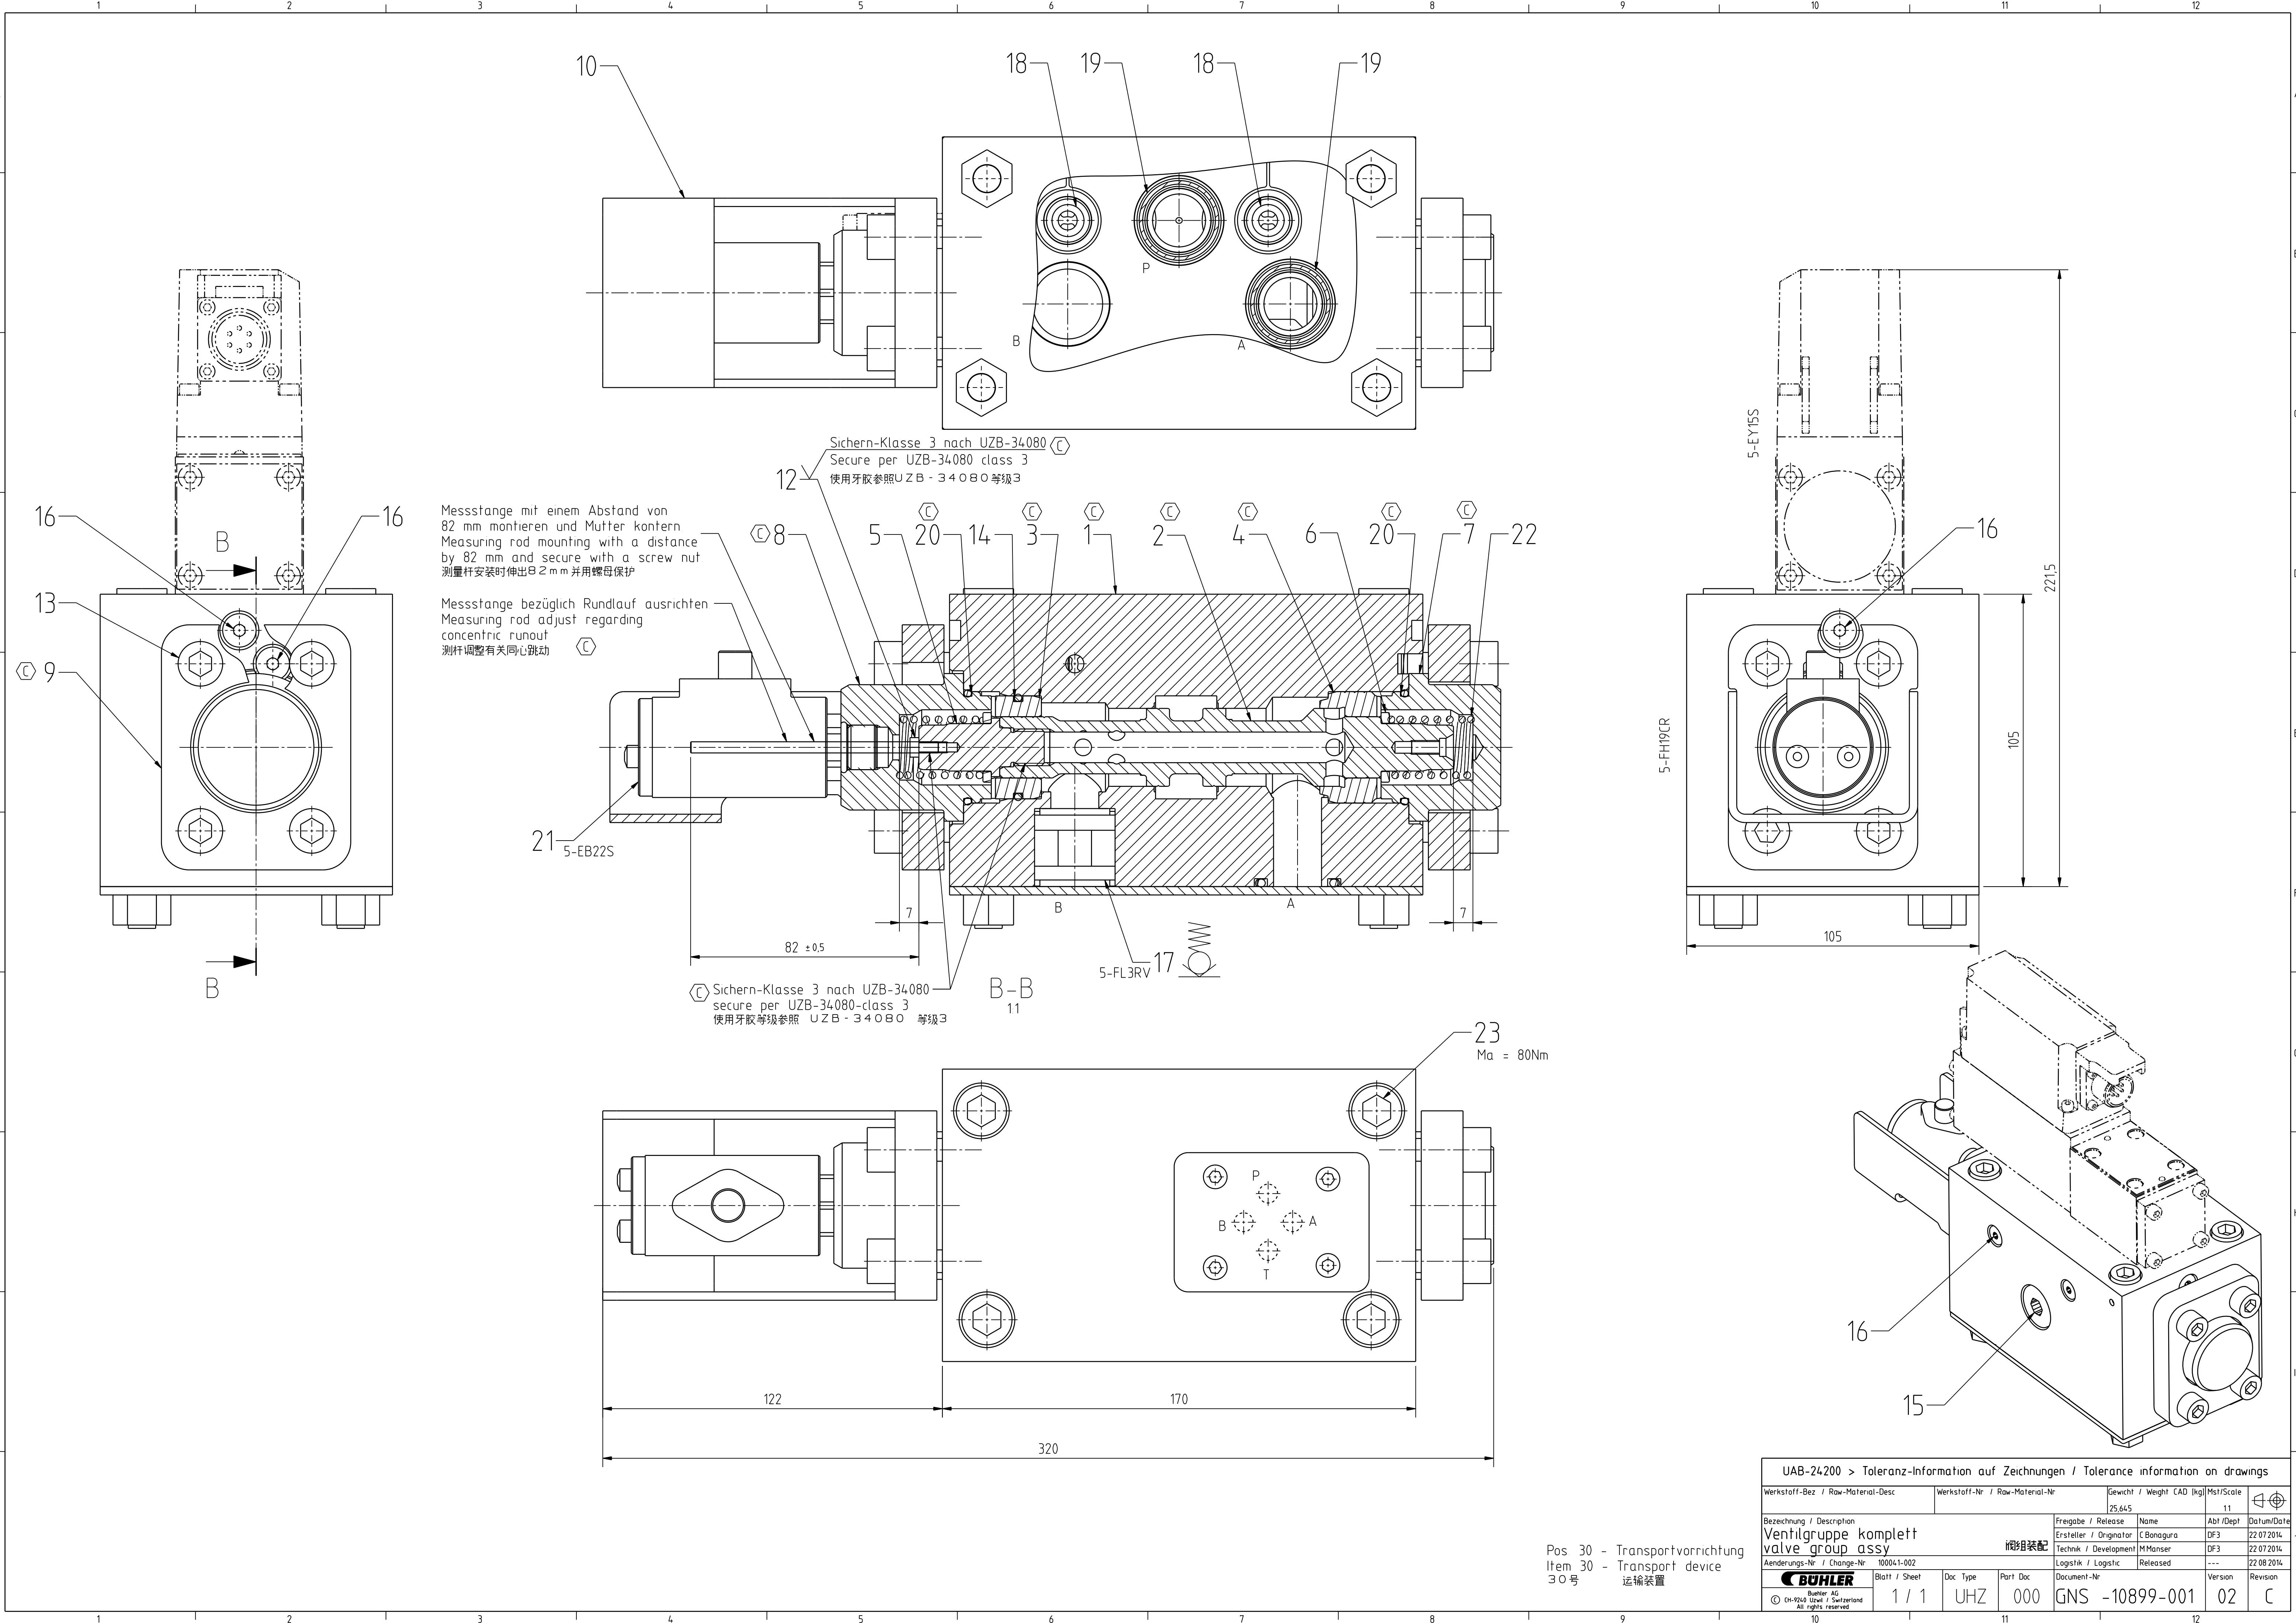

Messstange mit einem Abstand von
82 mm montieren und Mutter kontern
Measuring rod mounting with a distance
by 82 mm and secure with a screw nut
测量杆安装时伸出82mm并用螺母保护

Messstange bezüglich Rundlauf ausrichten
Measuring rod adjust regarding
concentric runout
测杆调整有关同心跳动

Sichern-Klasse 3 nach UZB-34080
Secure per UZB-34080 class 3
使用牙胶参照UZB-34080等级3

5-EB22S

82 ± 0.5

Sichern-Klasse 3 nach UZB-34080
secure per UZB-34080-class 3
使用牙胶等级参照 UZB-34080 等级3

B-B

11

5-FL3RV

17

Pos 30 - Transportvorrichtung
Item 30 - Transport device
30号 运输装置

UAB-24200 > Toleranz-Information auf Zeichnungen / Tolerance information on drawings						
Werkstoff-Bez / Raw-Material-Desc		Werkstoff-Nr / Raw-Material-Nr		Gewicht / Weight CAD [kg]		Mst/Scale
				25,645		11
Bezeichnung / Description		Freigabe / Release	Name	Abt /Dept	Datum/Date	
Ventilgruppe komplett		Ersteller / Originator	C Bonagura	DF3	22.07.2014	
Aenderungs-Nr / Change-Nr		Technik / Development	M Manser	DF3	22.07.2014	
100041-002		Logistik / Logstic	Released	---	22.08.2014	
BUHLER		Blatt / Sheet	Doc. Type	Part Doc	Document-Nr	Version
© CH-9200 Uster / Switzerland All rights reserved		1 / 1	UHZ	000	GNS -10899-001	02
						C