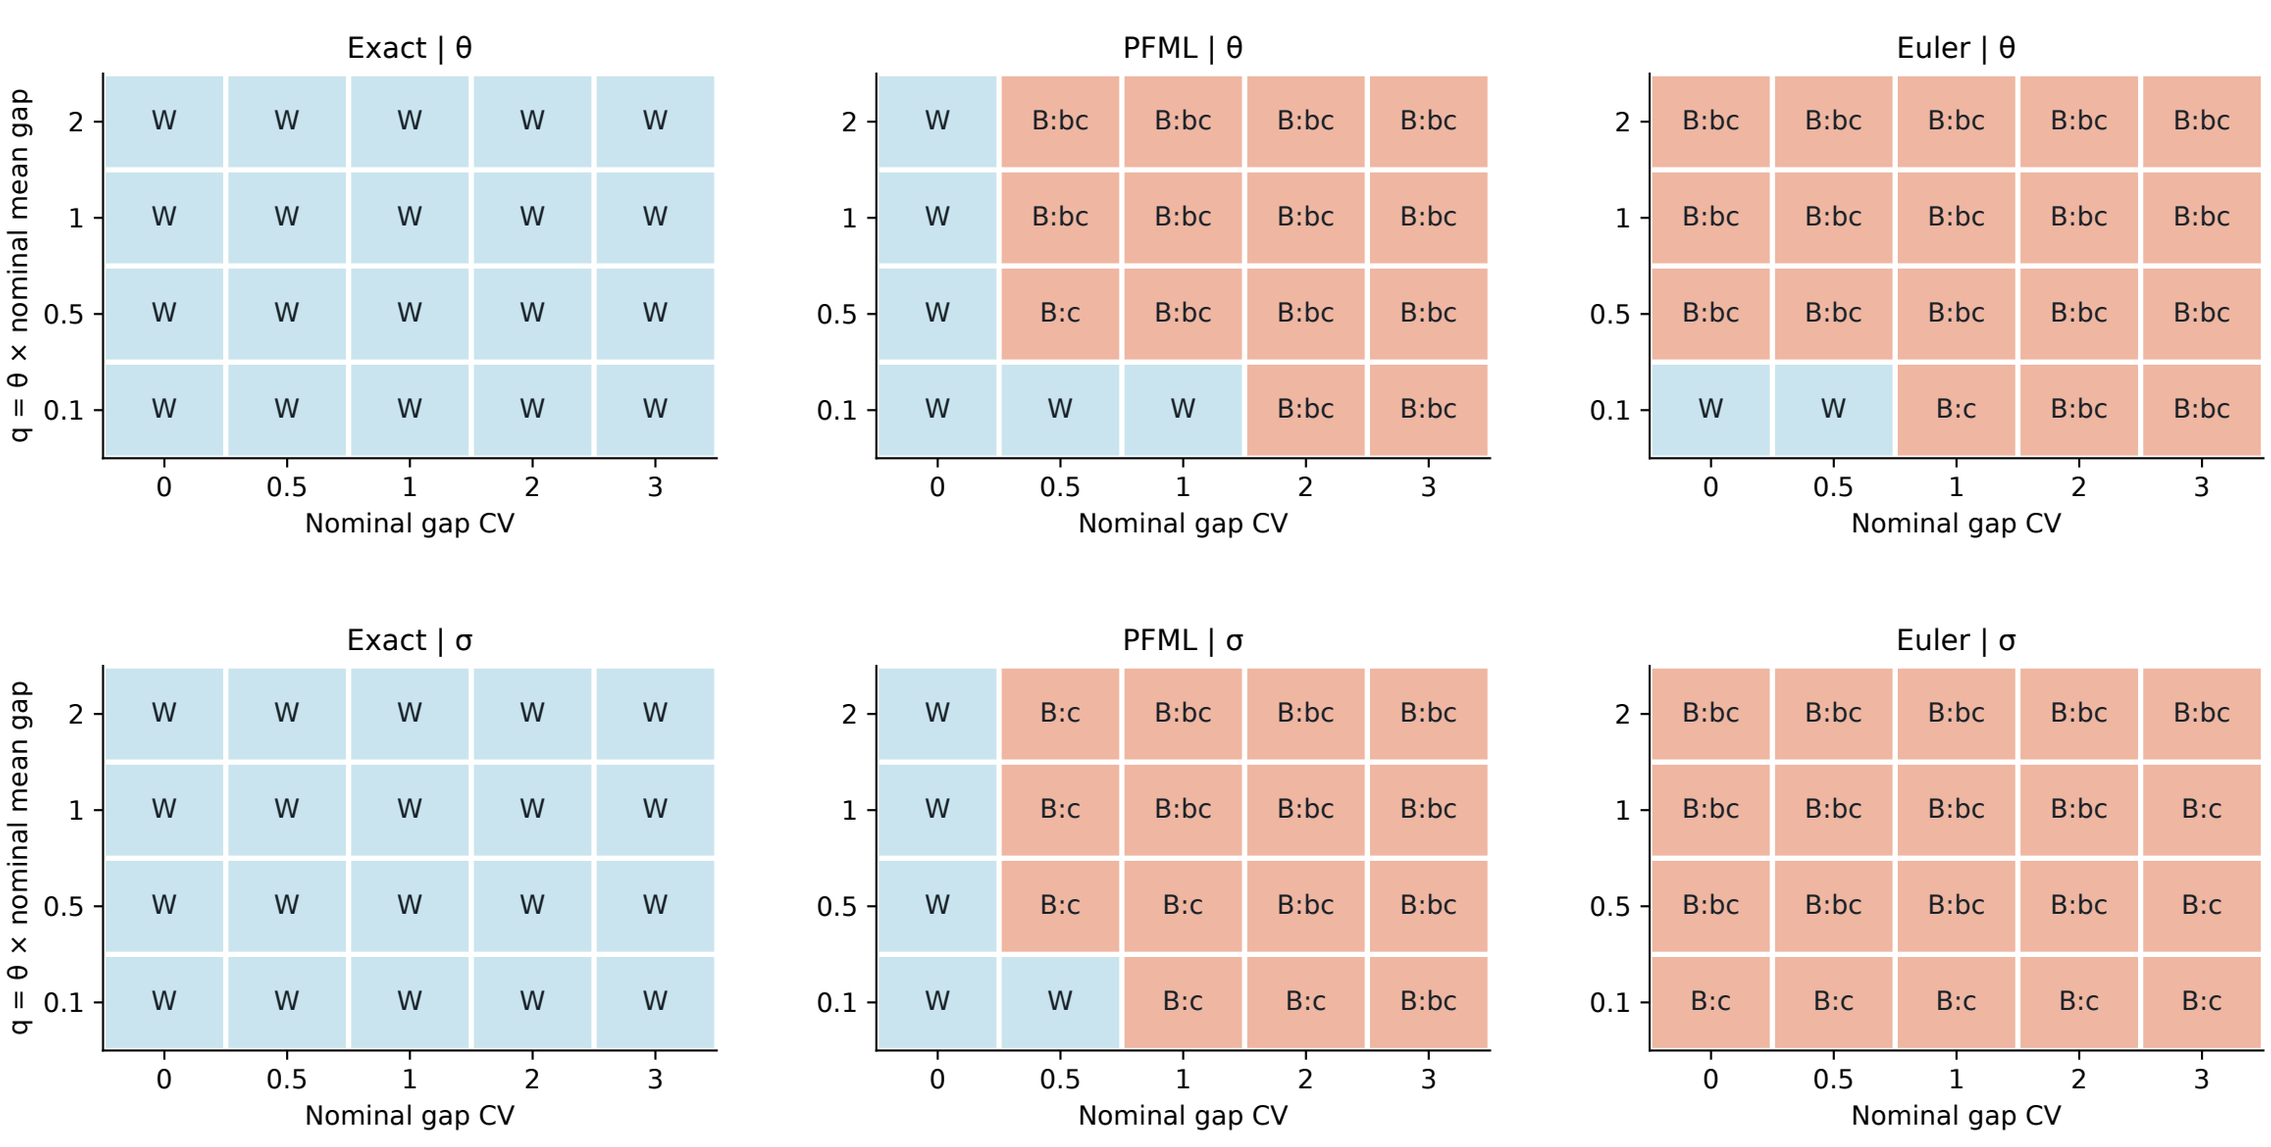
F7 Practical classifications | n = 4,000
Registered E2 | R = 2,000 per cell | θ and σ only | pointwise Monte Carlo classification
Exact | θ
PFML | θ
Euler | θ
Exact | σ
PFML | σ
Euler | σ
q = θ × nominal mean gap
Nominal gap CV
2
1
0.5
0.1
0
0.5
1
2
3
W
B:bc
B:c
W: within criteria; B:b: bias breach; B:c: coverage breach; B:bc: both; U: unresolved.
Criteria: operational coverage ≥80% and absolute relative bias ≤10%, assessed with the registered Monte Carlo intervals.
These broad criteria do not certify 95% coverage. Cells are categorical design points; no continuous boundary is estimated.
Natural-scale Wald intervals use full observed Hessians; PFML/Euler covariance is model-based. Flooring applies at CV ≥1.5.