Matched-control σ RMSE ratio

VALIDATION ONLY — not E4 results | R = 4 per cell | n = 1,000 | θm = 0.5

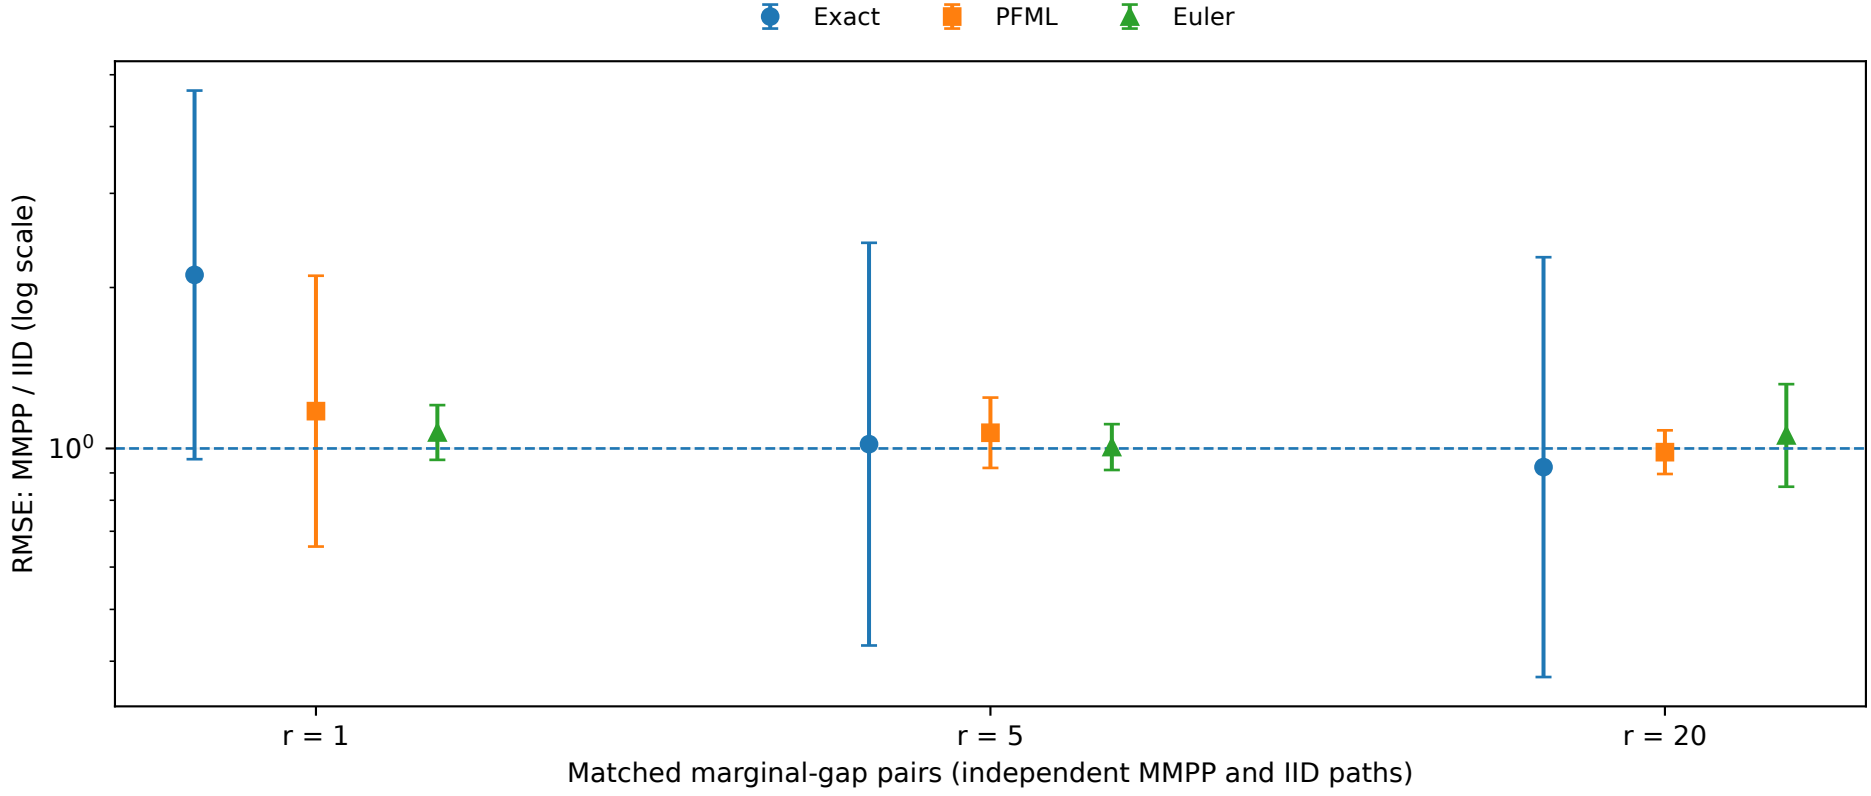

The full one-gap marginal and floor transform match within each MMPP/IID pair; paths are independent. Realized span is not held fixed. Bias/RMSE use each cell's own valid points; operational coverage uses all paths. Bars show pointwise Monte Carlo uncertainty (normal differences; log-delta ratios). NA: undefined point; †: uncertainty unavailable; 0: zero ratio off log scale.