Week 7 Fixed E2 case: CV=0, replication 1424

EXPLORATORY E3 — saved diagnostics of the original E2 source | q=2, n=250

Complete fixed profile grid (signed log y)

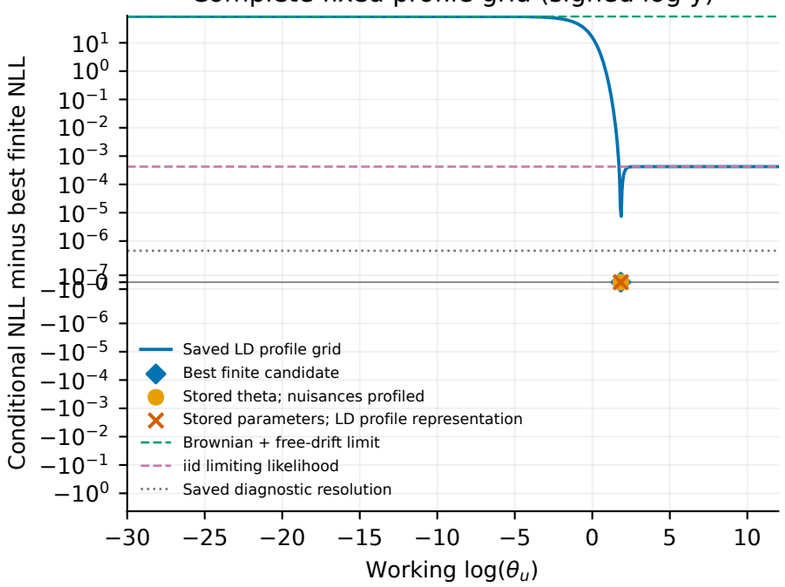

Stored / best neighbourhood; saved grid only

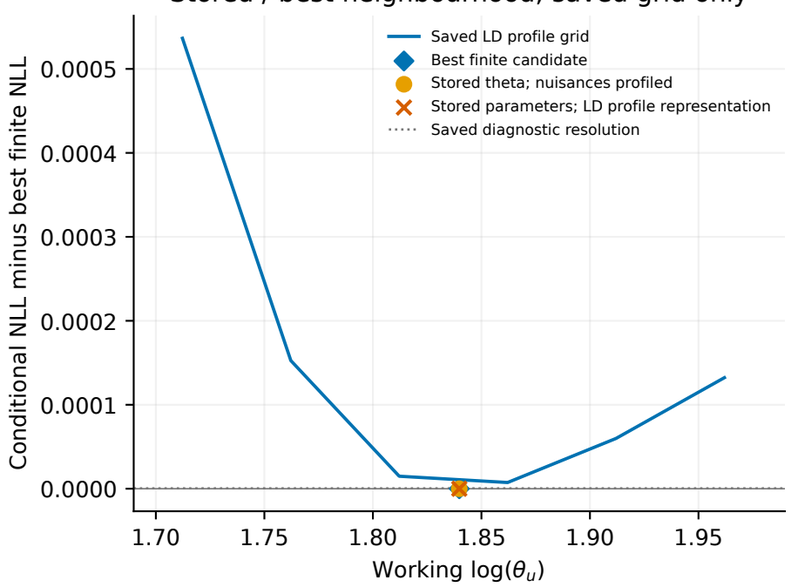

Exact full-Hessian eigenvalues

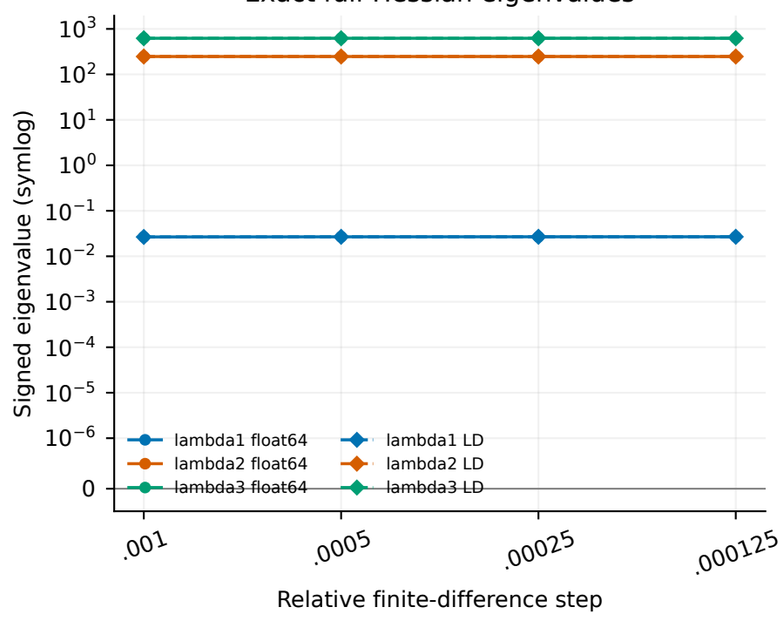

Full-Hessian condition number

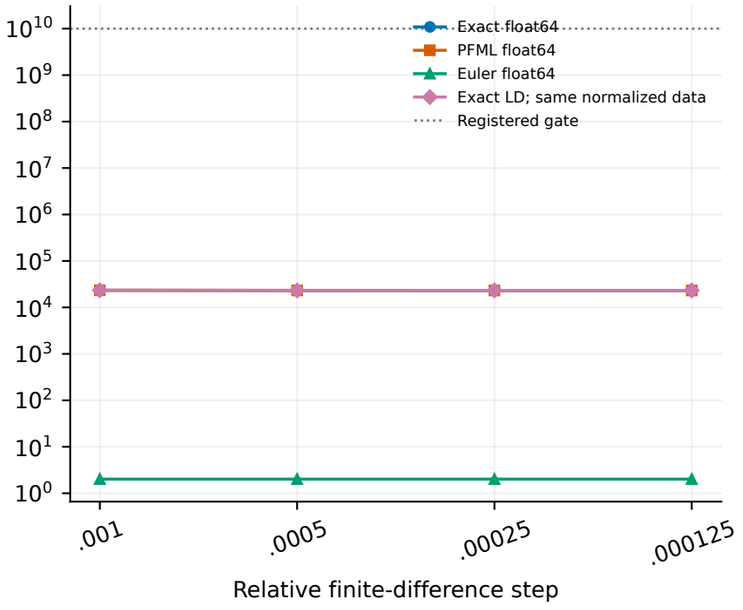

Standardized score at stored point

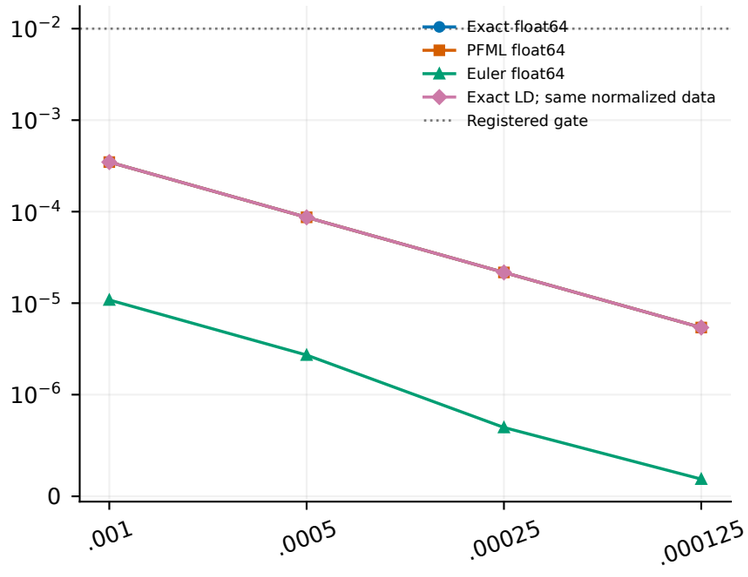

Adjacent-step discrepancy: solid W; dashed F

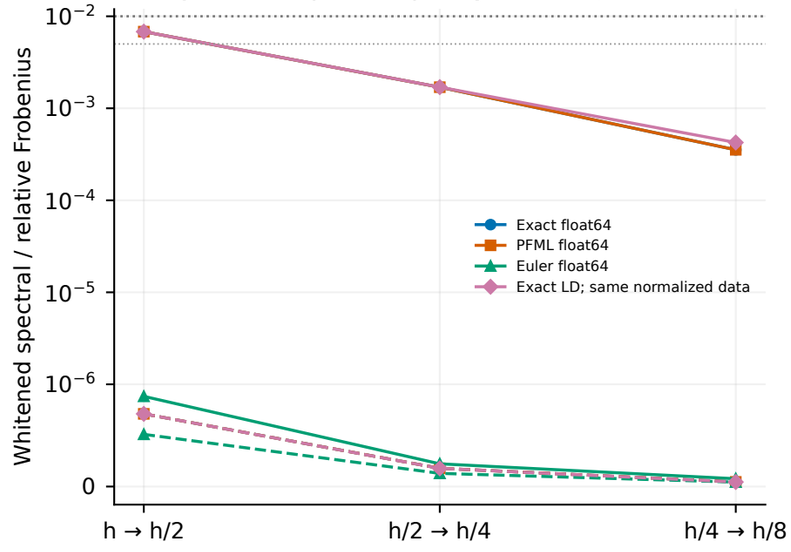

Original exact point/interval status: valid_interior / valid. No replacement fit, interval or covariance.
Saved longdouble: 64 significant binary digits (63 fraction bits), 16 storage bytes; not arbitrary precision.
Registered Hessian ladders use identical float64-normalized inputs; the LD profile normalizes original values/gaps separately.
Saved representation differences: max |delta value|=2.16e-16; max |delta gap|=0.
Saved resolution=4.54e-07; lower/upper tail targets reached: True/True. stored full fit matches finite search within diagnostic resolution
Finite searches do not prove a global optimum. Negative saved objective differences are retained, not clipped.
h/2 is the registered matrix candidate subject to all original gates; h/4 and h/8 are diagnostic only. W gate=.01; F gate=.005; score gate=.01.