



UPS SYSTEM


230 VAC, 50HZ, 1PH, PE, 3W

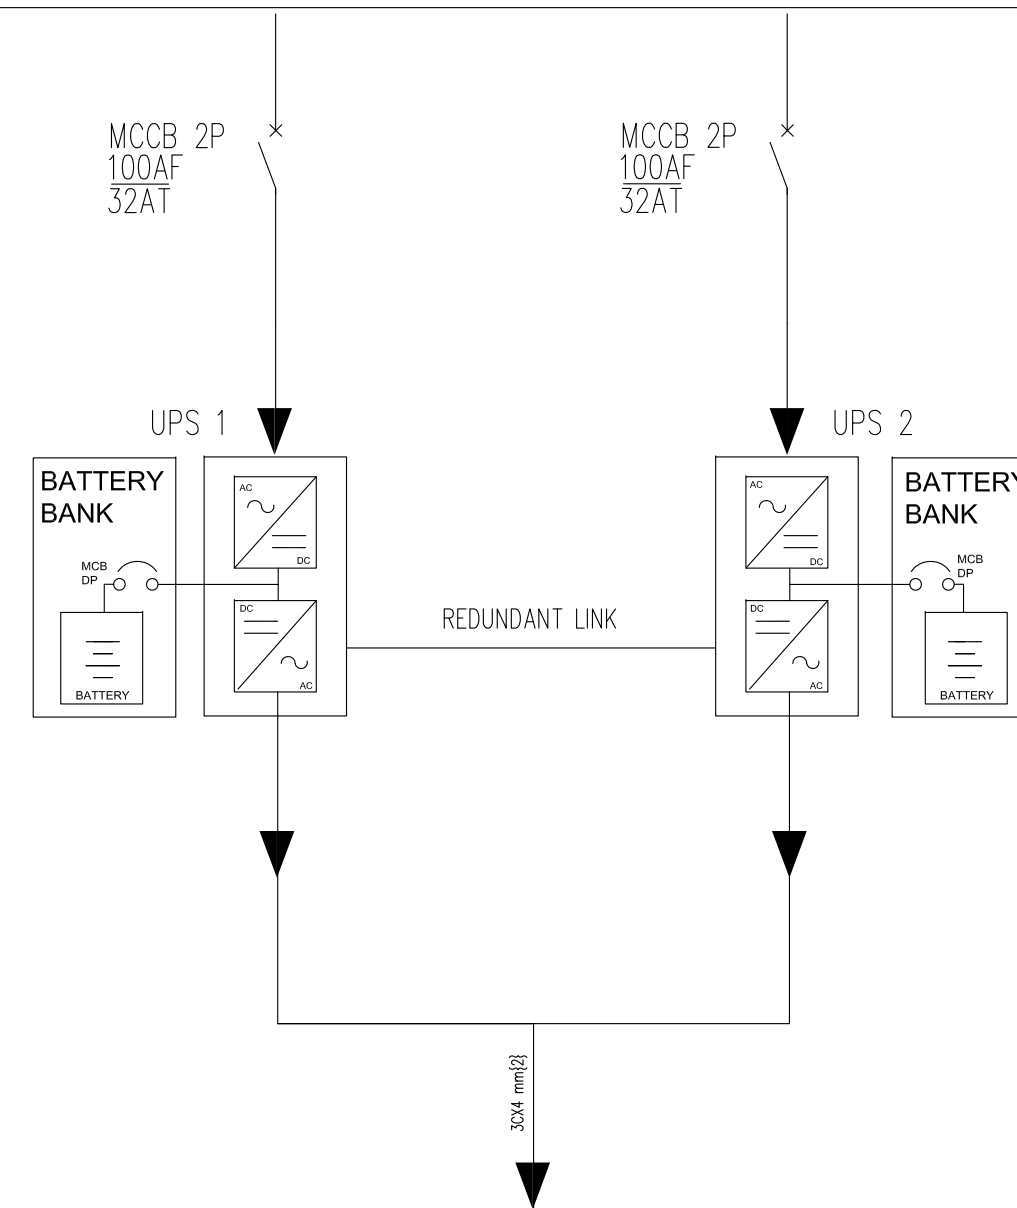


UPS 1 & 2 FOR VITAL USERS
6 kVA 230V AC, 1PH, 3 WIRE, 50Hz
BACK UP TIME 8 HOURS

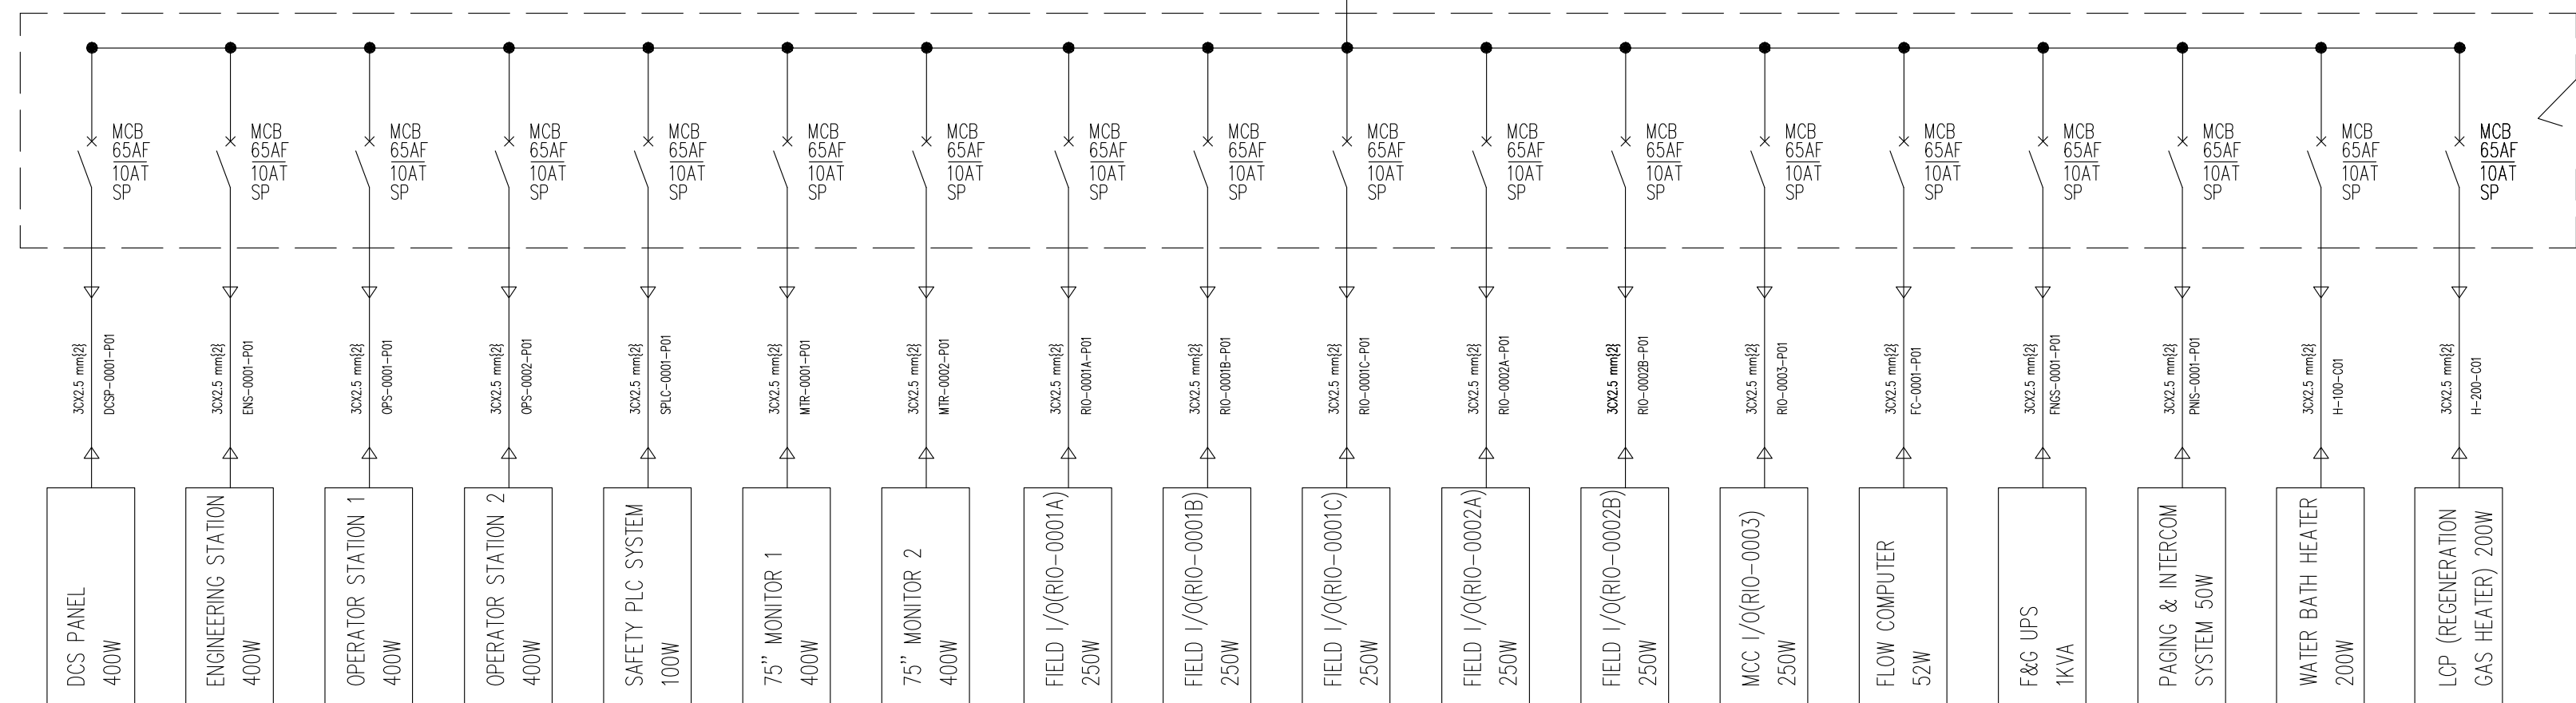




LEGEND



UPS (UNINTERRUPTIBLE POWER SUPPLY)




UPS (UNINTERRUPTIBLE POWER SUPPLY)
WITH EXTERNAL BATTERY BANK


REV	DATE	APPR'D			
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL	AS	MH	VG	2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE
REVISIONS					
FOR					
<div>BANGLADESH PETROLEUM EXPLORATION & PRODUCTION CO. LTD</div>					
<div><div>ZICOM</div><div>CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION</div><div></div></div>					
60 MMSCFD SILICAGEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT					
TITLE					
SINGLE LINE DIAGRAM FOR UPS					
FORMAT	DRAWING NO.				REVISION
A2	240-0214-EMEL-DW00-0006				
	SCALE	NTS	SHEET	1 OF 3	<div><div>A</div></div>
This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.					

UPS SYSTEM


UPS 1 & 2 FOR VITAL USERS
6 kVA 230V AC, 1PH, 3 WIRE, 50Hz
BACK UP TIME 8 HOURS

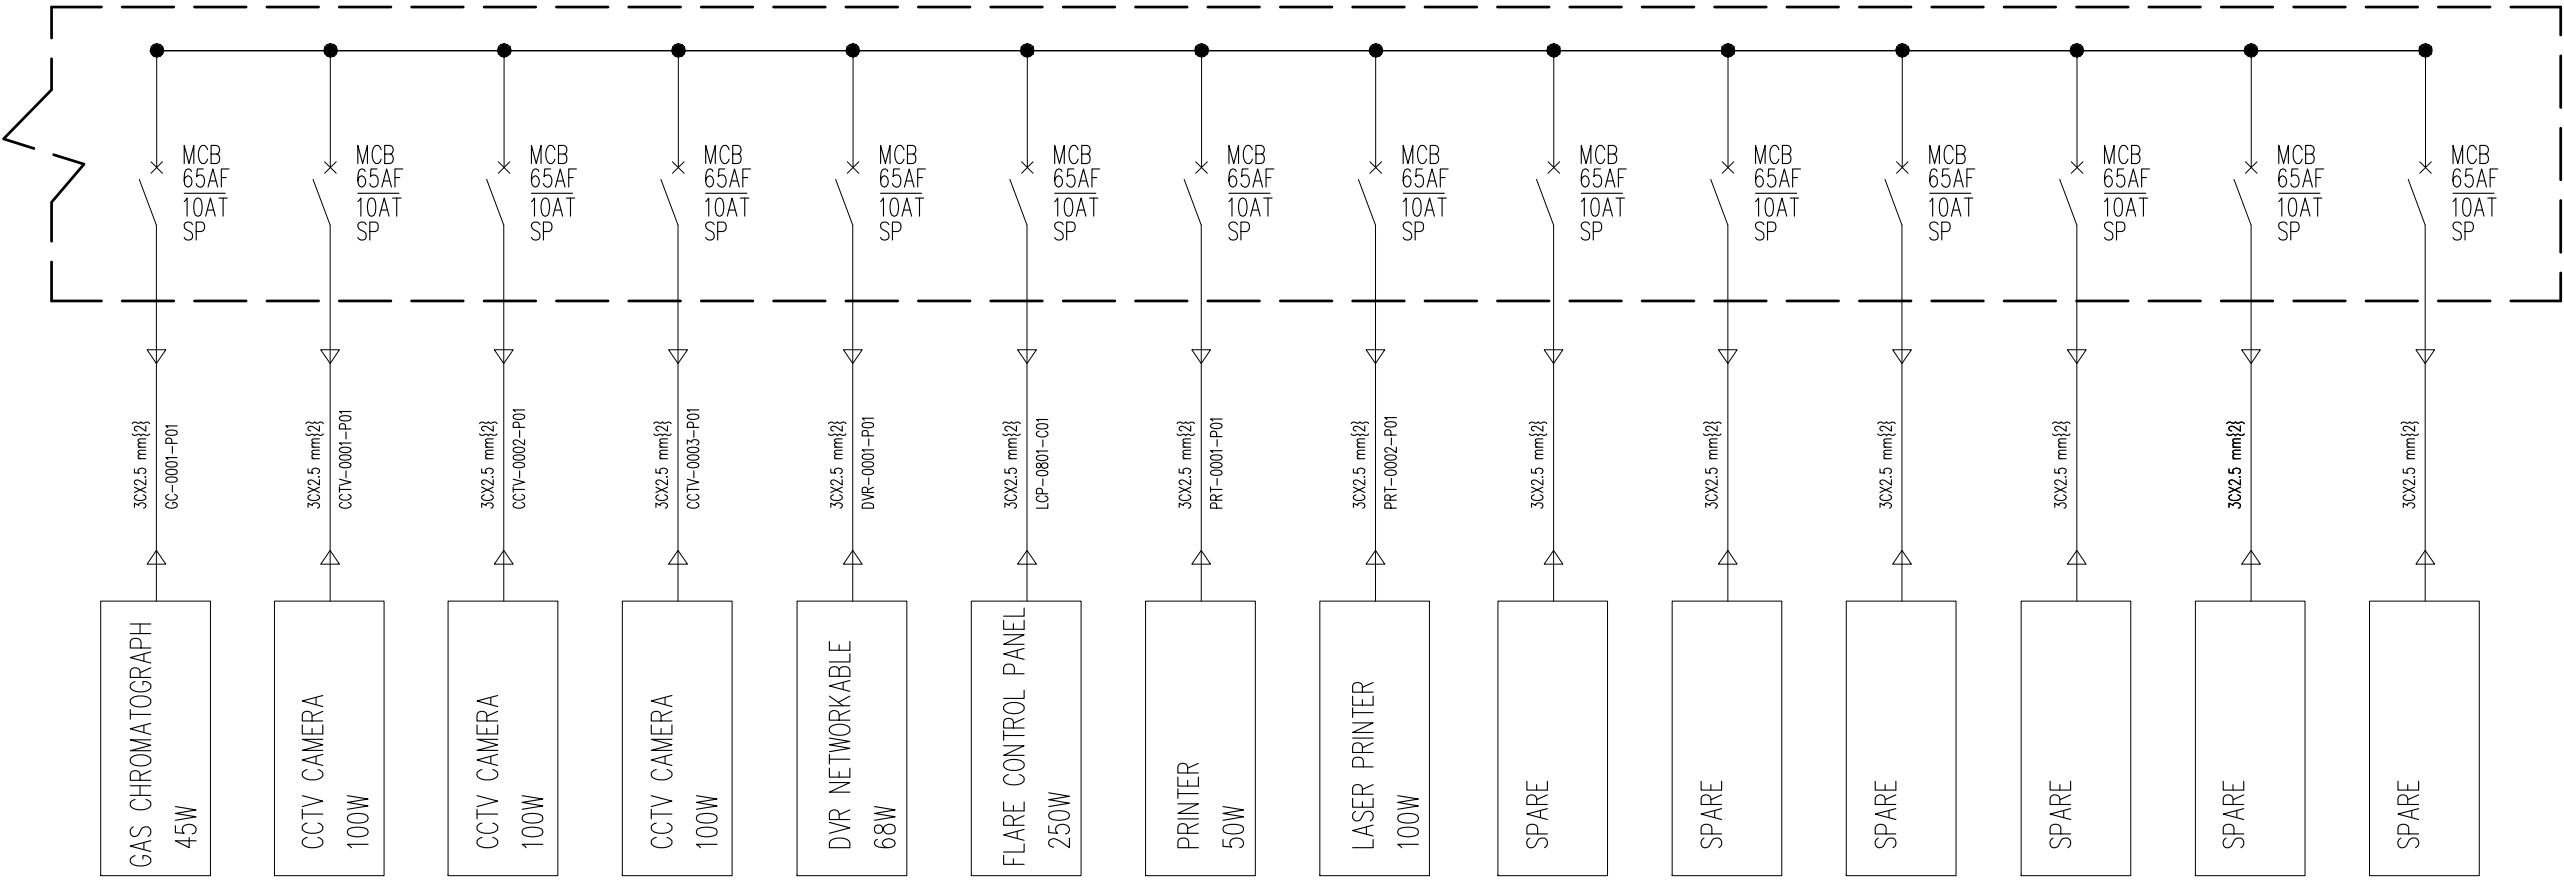




LEGEND



UPS (UNINTERRUPTIBLE POWER SUPPLY)




UPS (UNINTERRUPTIBLE POWER SUPPLY)
WITH EXTERNAL BATTERY BANK


REV		DATE		APPR'D	
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL		AS	MH	VG
REV	DESCRIPTION		PREP'D	CHK'D	APP'D
REVISIONS					
FOR					
<div><div></div><div>BANGLADESH PETROLEUM EXPLORATION & PRODUCTION CO. LTD</div></div>					
<div><div></div><div>CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION</div><div></div></div>					
60 MMSCFD SILICAGEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT					
TITLE					
SINGLE LINE DIAGRAM FOR UPS					
FORMAT					
A2	DRAWING NO.		REVISION		
	240-0214-EMEL-DW00-0006		<div><div></div><div>A</div></div>		
	SCALE	NTS	SHEET	2	OF 3
This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.					

UPS SYSTEM


230 VAC, 50HZ, 1PH, PE, 3W

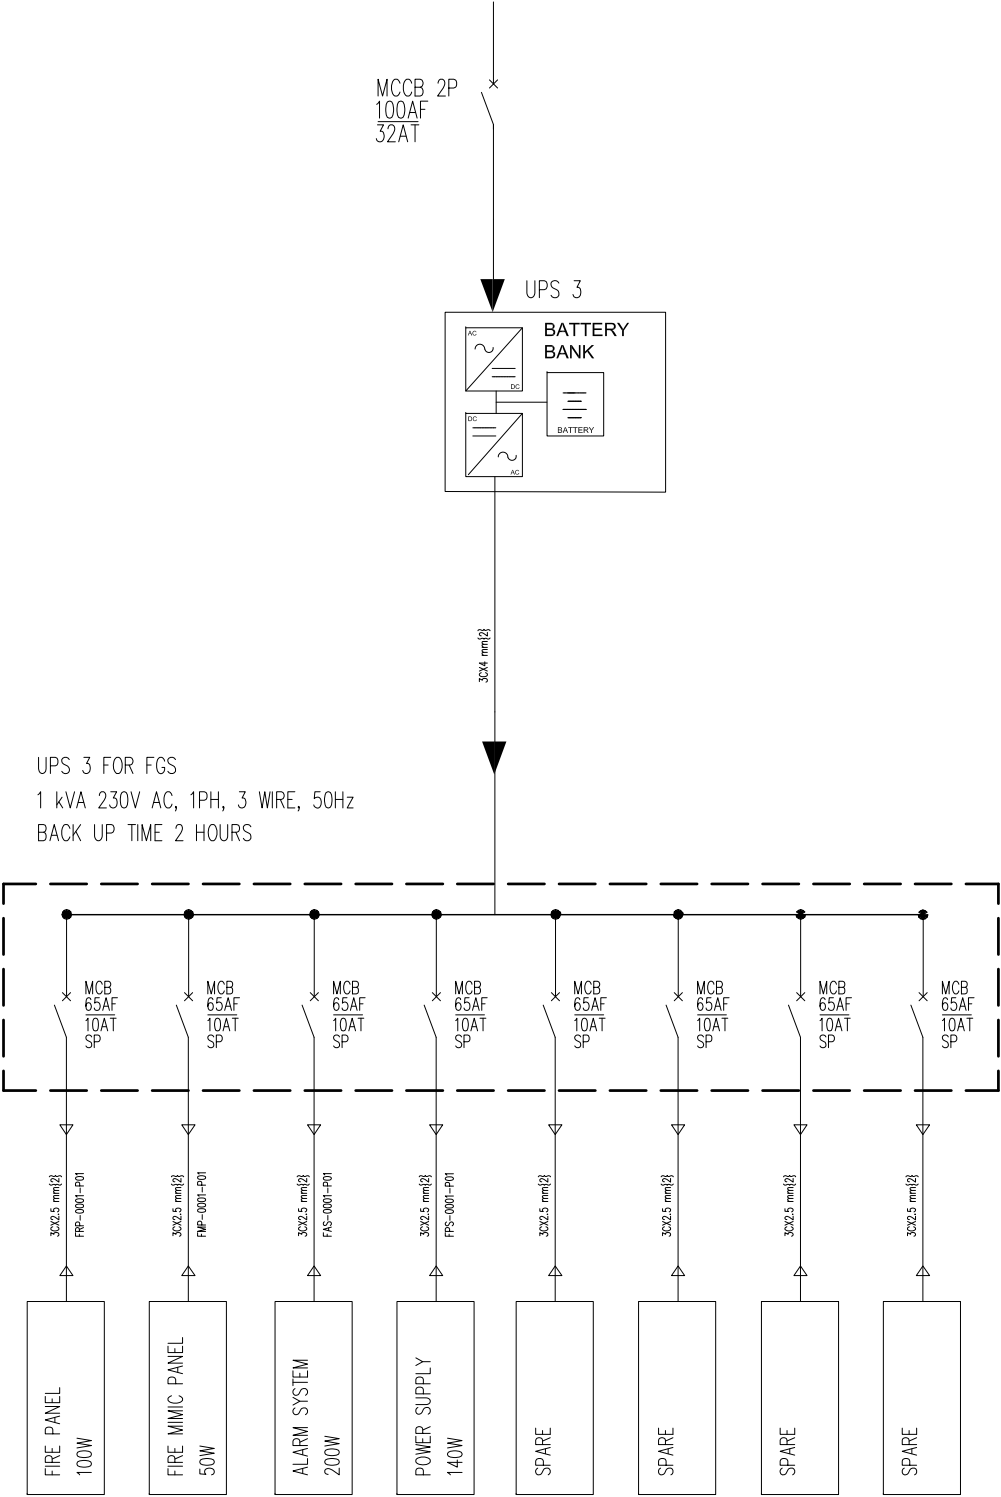





LEGEND



UPS (UNINTERRUPTIBLE POWER SUPPLY)



UPS (UNINTERRUPTIBLE POWER SUPPLY)
WITH EXTERNAL BATTERY BANK

REV	DATE	APPR'D			
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL	AS	MH	VG	2015,10,28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE
REVISIONS					
FOR 					
BANGLADESH PETROLEUM EXPLORATION & PRODUCTION CO. LTD					
 CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION 					
60 MMSCFD SILICAGEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT					
TITLE SINGLE LINE DIAGRAM FOR UPS					
FORMAT	DRAWING NO. 240-0214-EMEL-DW00-0006				REVISION
A2	SCALE	NTS	SHEET	3 OF 3	
This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.					