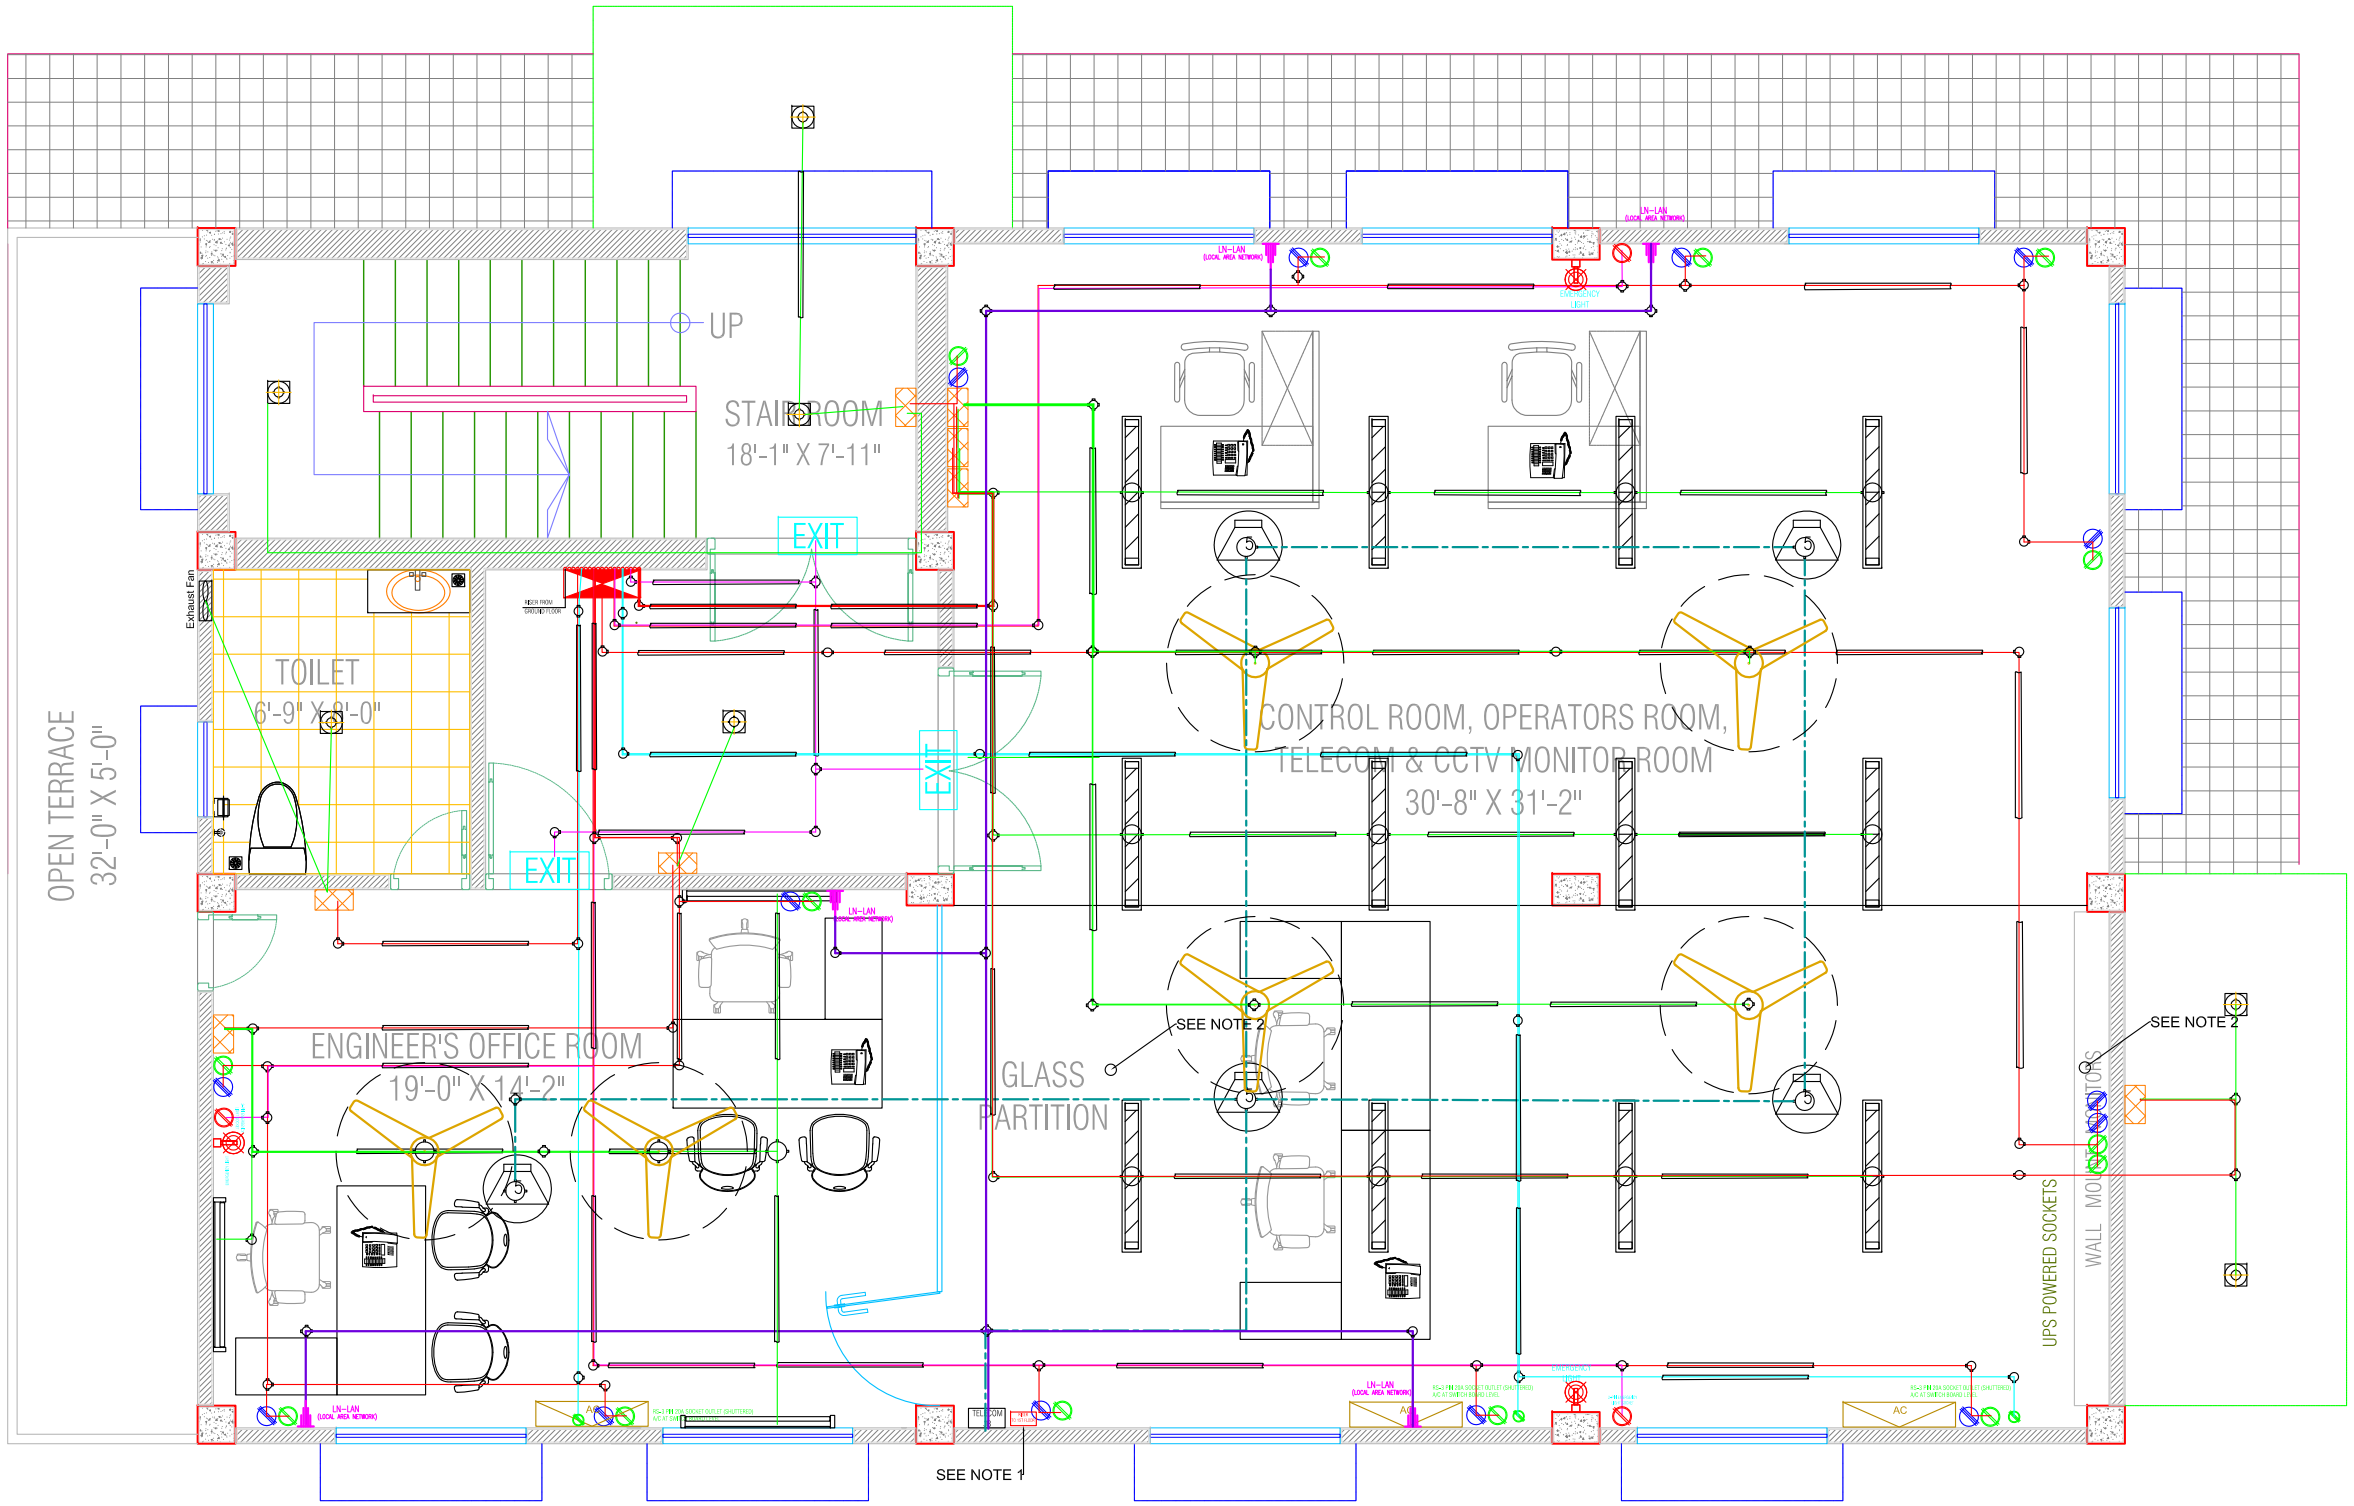

FIRST FLOOR PLAN

1784 Sqft

NOTES

1. RISER FROM GROUND FLOOR TO 1ST FLOOR
2. 2" HOLE FOR CABLE TO RISE FROM GROUND FLOOR UPS & PANEL TO 1ST FLOOR FOR CONNECTION ACCESS TO MONITORS

LEGEND

- MDB–MAIN DISTRIBUTION BOARD AT 900mm LEVEL
- 3–PIN SOCKET OUTLET AT SKIRTING LEVEL
- 2–PIN SOCKET OUTLET AT SKIRTING LEVEL
- RS-3 PIN 20A SOCKET OUTLET (SHUTTERED) A/C AT SWITCH BOARD LEVEL
- SWITCHBOARD AT 1200MM LEVEL
- 2-PIN EMERGENCY LIGHT SOCKET — 2-PIN EMERGENCY LIGHT SOCKET
- EMERGENCY LIGHT — EMERGENCY LIGHTS
- 5 — LOUDSPEAKER FOR PA SYSTEM
- AC — AIR CONDITIONING (AC)
- WALL MOUNTED W FLUORESCENT LIGHTS
- FLUORESCENT LIGHTS
- CEILING FAN 56" SWEEP
- CEILING MOUNTED SPOT LIGHT
- CEILING MOUNTED SPOT LIGHT
- CIRCULAR BOX
- PVC CONDUITS
- DB POWER LINE
- UTILITY POWER LINE
- INTERCOM LINE
- EMERGENCY LIGHT LINE
- HIGH POWERED UTILITY LINE
- LOUDSPEAKER LINE

REV	DATE		APPR'D		
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL	AS	MH	VG	2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE
REVISIONS					

FOR BAPEX — BANGLADESH PETROLEUM EXPLORATION & PRODUCTION CO. LTD

ZICOM — CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION — Sinopec

60 MMSCFD SILICAGEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT

TITLE: DESIGN OF BUILDING ELECTRICAL SYSTEM
CONTROL BUILDING

FORMAT	DRAWING NO.		REVISION
A2	240-0201-EMEL-DW00-0006		A
	SCALE 1:100	SHEET 2 OF 3	

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.