






VENTILATING SYSTEM ARRANGEMENT FOR GENERATOR ROOM 1:100

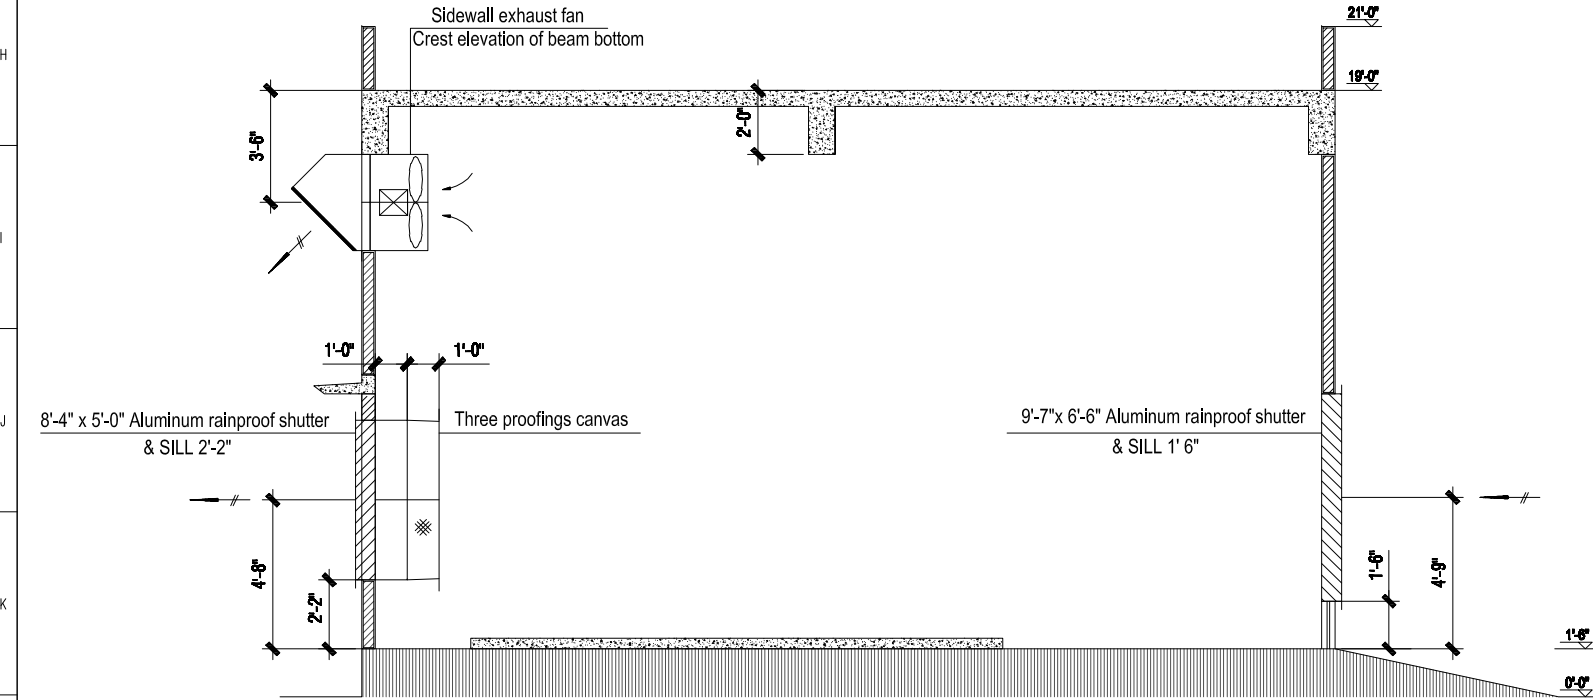

SECTION A-A 1:50

NO.	EQUIPMENT NO.	DESCRIPTION	UNIT	QUANTITY	REMARK
1	0214-PF-01~04	Sidewall exhaust fan	set	4	400V, 1.1kW
		Crest elevation of beam bottom			
		Wall opening size is 945x945mm			
		Volume:13700m³/h; Static Pressure: 100Pa			
		Speed: VTA			
		Accessories: 45° weather cover,			
		Gravity back-draft damper,			
		Stainless steel insectscreen,			
		Safety protective screening			

REV	DATE	APPR'D			
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL	AS	MH	VG	2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE
REVISIONS					
FOR					
		BANGLADESH PETROLEUM EXPLORATION & PRODUCTION CO. LTD			
		CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION			
60 MMSCFD SILICAGEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT					
TITLE					
VENTILATION SYSTEM ARRANGEMENT FOR GENERATOR ROOM					
FORMAT		DRAWING NO.			REVISION
A2		240-0214-EMHV-DW00-0001			
		SCALE 1:100	SHEET 1	OF 1	
This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.					