


VENTILATING SYSTEM ARRANGEMENT FOR GENERATOR ROOM 1:100

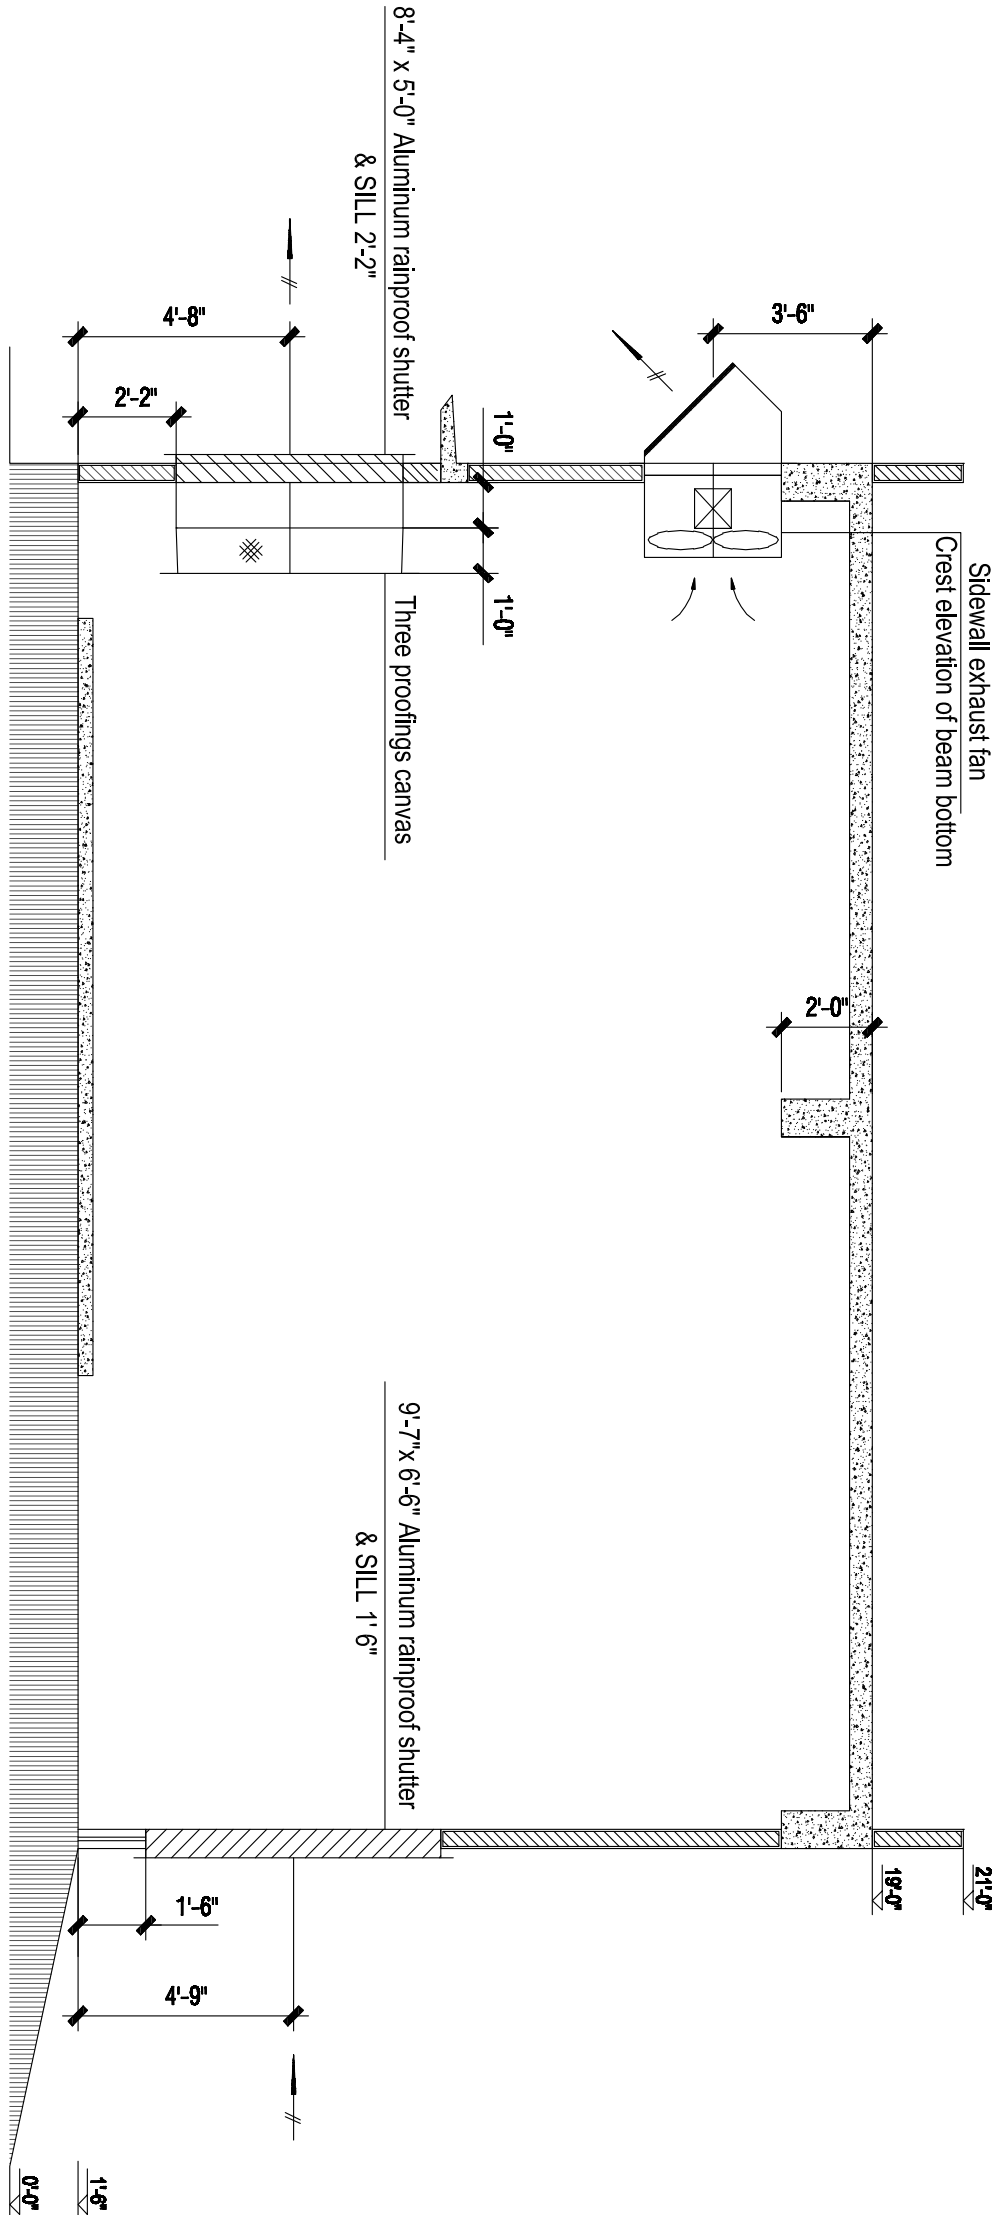

NO.	EQUIPMENT NO.	DESCRIPTION	UNIT	QUANTITY	REMARK
-----	---------------	-------------	------	----------	--------

1	0214-PF-01~04	Sidewall exhaust fan	set	4	400V, 1.1kW
---	---------------	----------------------	-----	---	-------------

		Crest elevation of beam bottom			
--	--	--------------------------------	--	--	--

		Wall opening size is 945x945mm			
--	--	--------------------------------	--	--	--

		Volume:13700m³/h, Static Pressure: 100Pa			
--	--	--	--	--	--

		Speed: VTA			
--	--	------------	--	--	--

		Accessories: 45° weather cover,			
--	--	---------------------------------	--	--	--

		Gravily back-draft damper,			
--	--	----------------------------	--	--	--

		Stainless steel insectscreen,			
--	--	-------------------------------	--	--	--

		Safety protective screening			
--	--	-----------------------------	--	--	--

FOR	BANGLADESH PETROLEUM
-----	----------------------

EXPLORENTIUM OF	EXPLORENTIUM OF
-----------------	-----------------

ZICOM	ZICOM
-------	-------

SINOPEC PETROLEUM ENGINEERING CORPORATION	SINOPEC PETROLEUM ENGINEERING CORPORATION
---	---

60 MWSCFD SUCRAEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT	60 MWSCFD SUCRAEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT
--	--

TITLE	TITLE
-------	-------

VENTILATION SYSTEM ARRANGEMENT FOR GENERATOR ROOM	VENTILATION SYSTEM ARRANGEMENT FOR GENERATOR ROOM
---	---

FORMAT	DRAWING NO.
--------	-------------

A2	SCALE 1:100
----	-------------

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering without Explicit Written Permission from ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation.	REVISION
---	----------