





POWER DISTRIBUTION SYSTEM

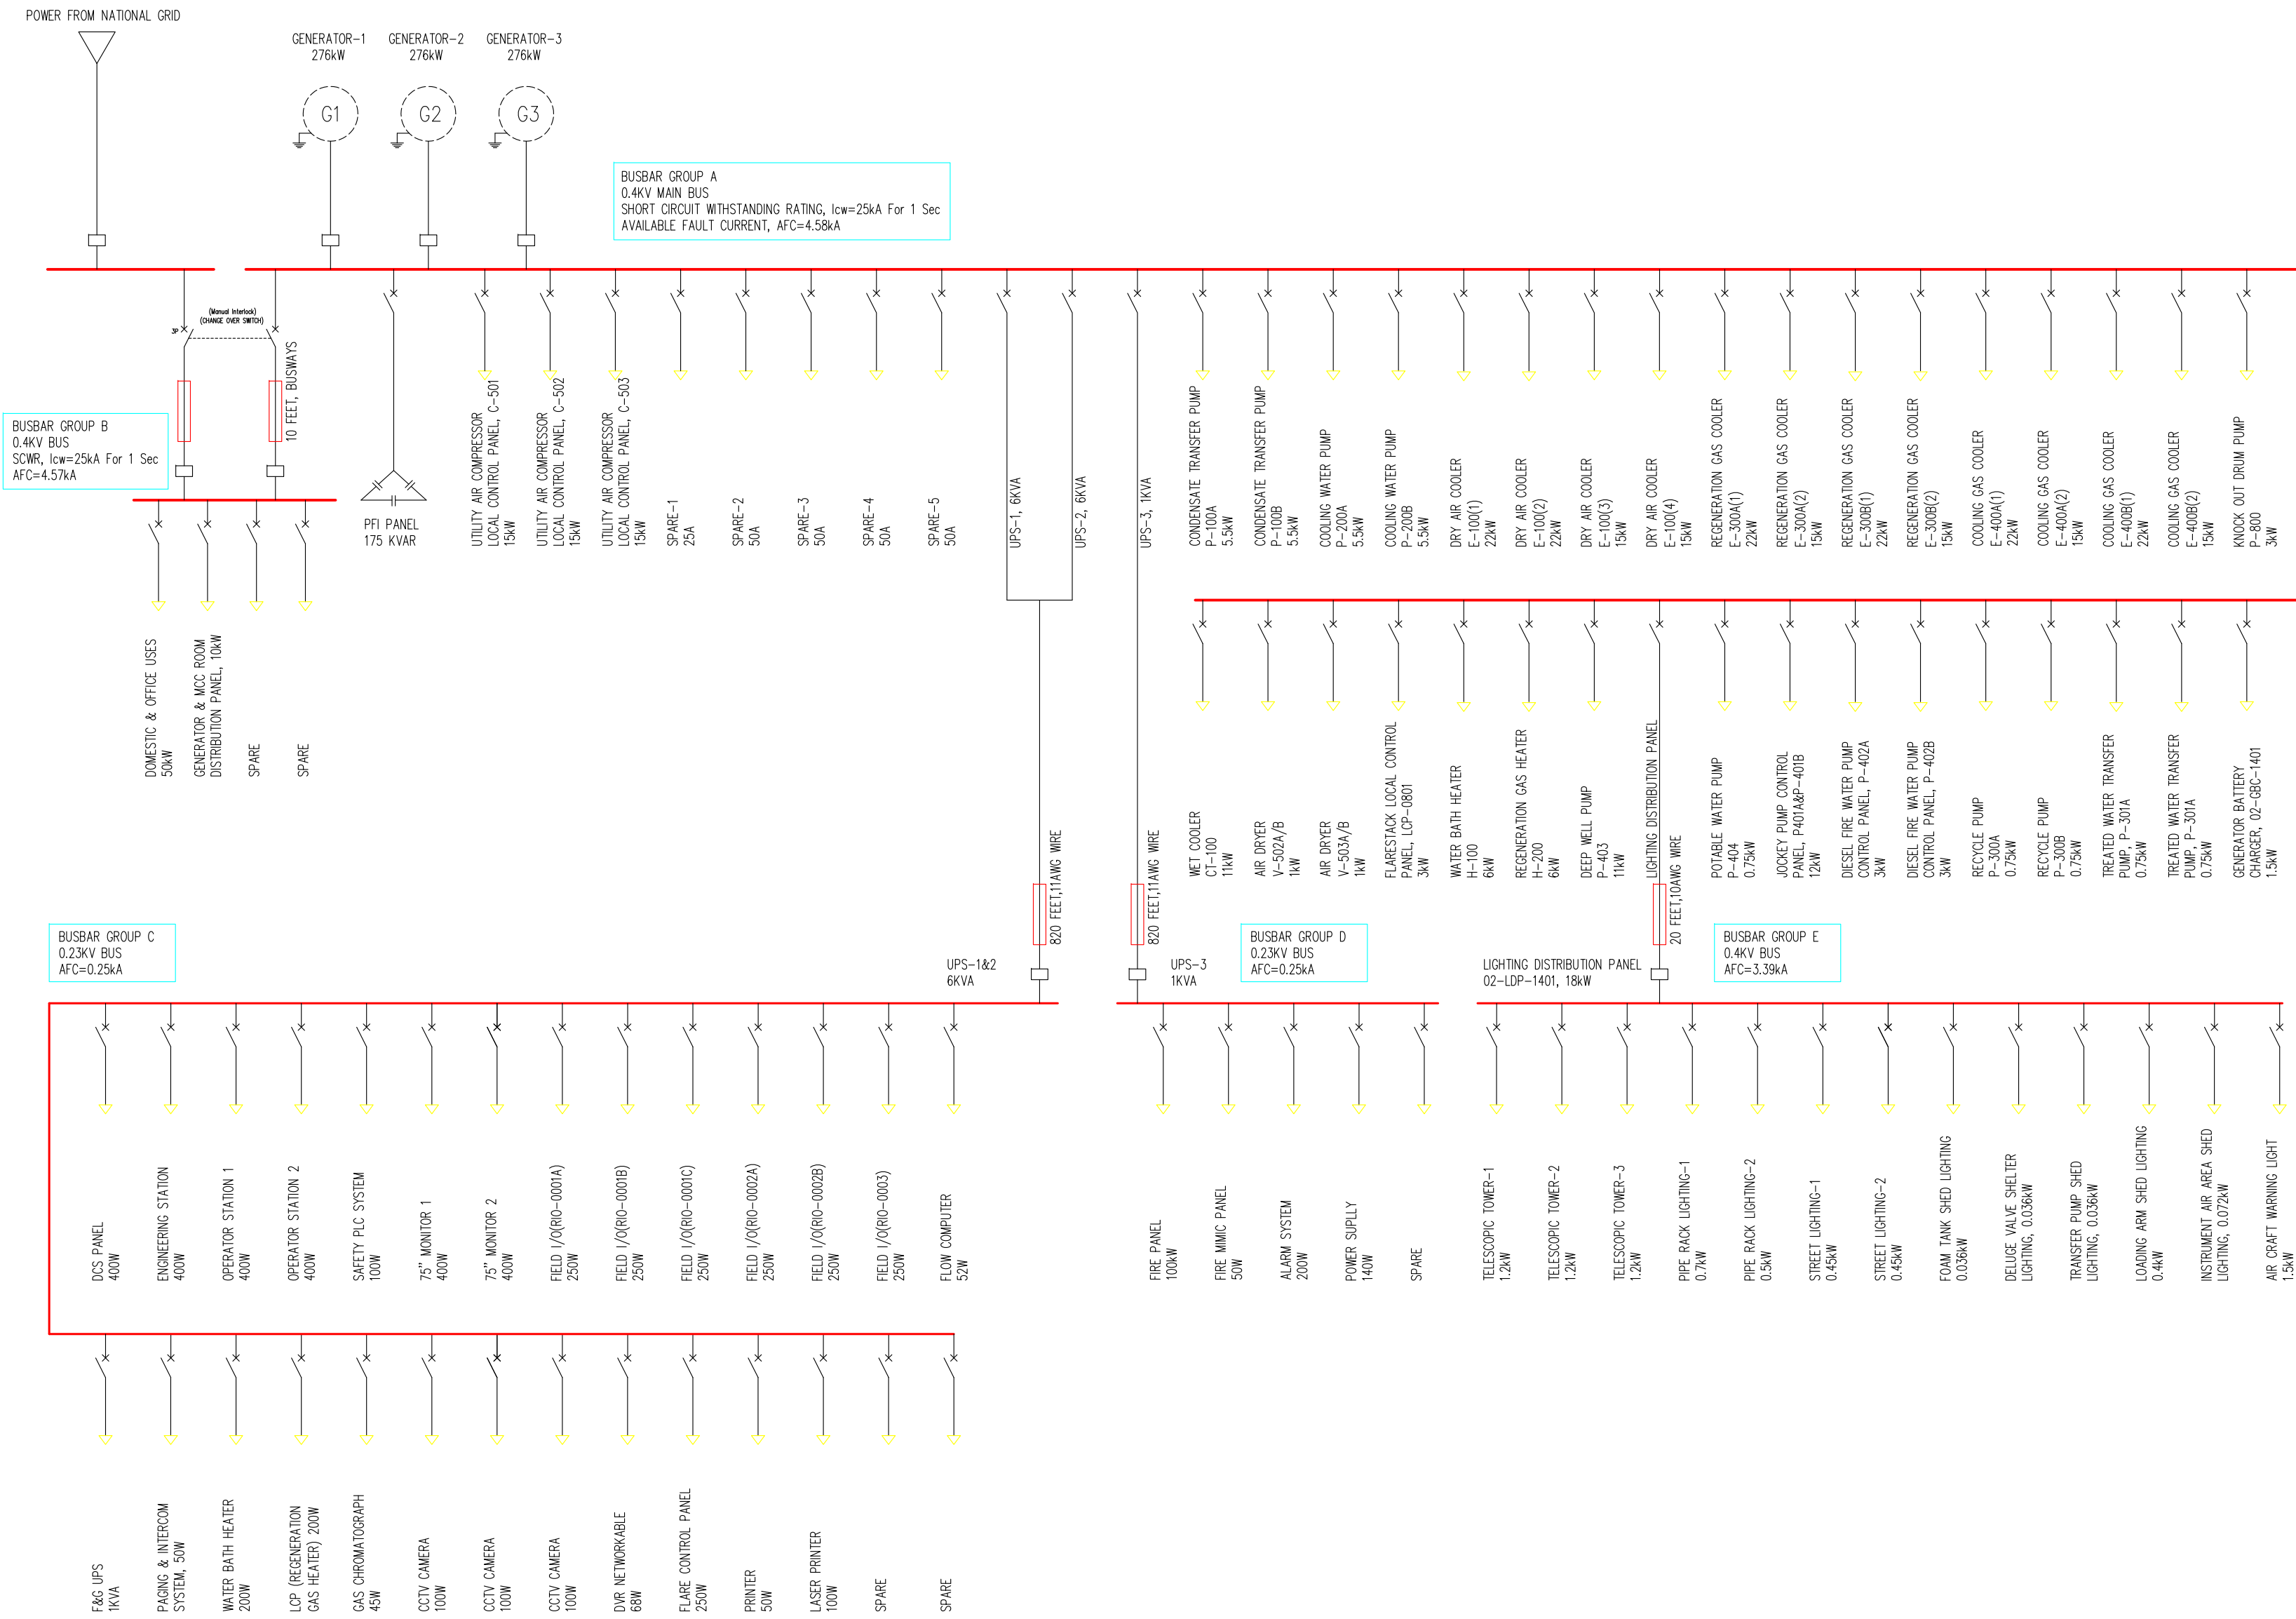

NOTE

Short Circuit Withstanding Rating(SCWR)

Available Fault Current(AFC)

REV	DATE	CLIENT APPROVAL			APPR'D
A	ISSUED FOR APPROVAL	AS	MH	VG	2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE
REVISIONS					
FOR					
		BANGLADESH PETROLEUM EXPLORATION & PRODUCTION CO. LTD			
		CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION			
60 MMSCFD SILICAGEL DEHYDRATION TYPE NATURAL GAS PROCESS PLANT					
TITLE					
POWER DISTRIBUTION SYSTEM					
FORMAT					
DRAWING NO.		REVISION			
A2	240-0214-EMEL-DW00-0008	A			
SCALE		SHEET		1 OF 1	
This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any Information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.					