POWER DISTRIBUTION SYSTEM

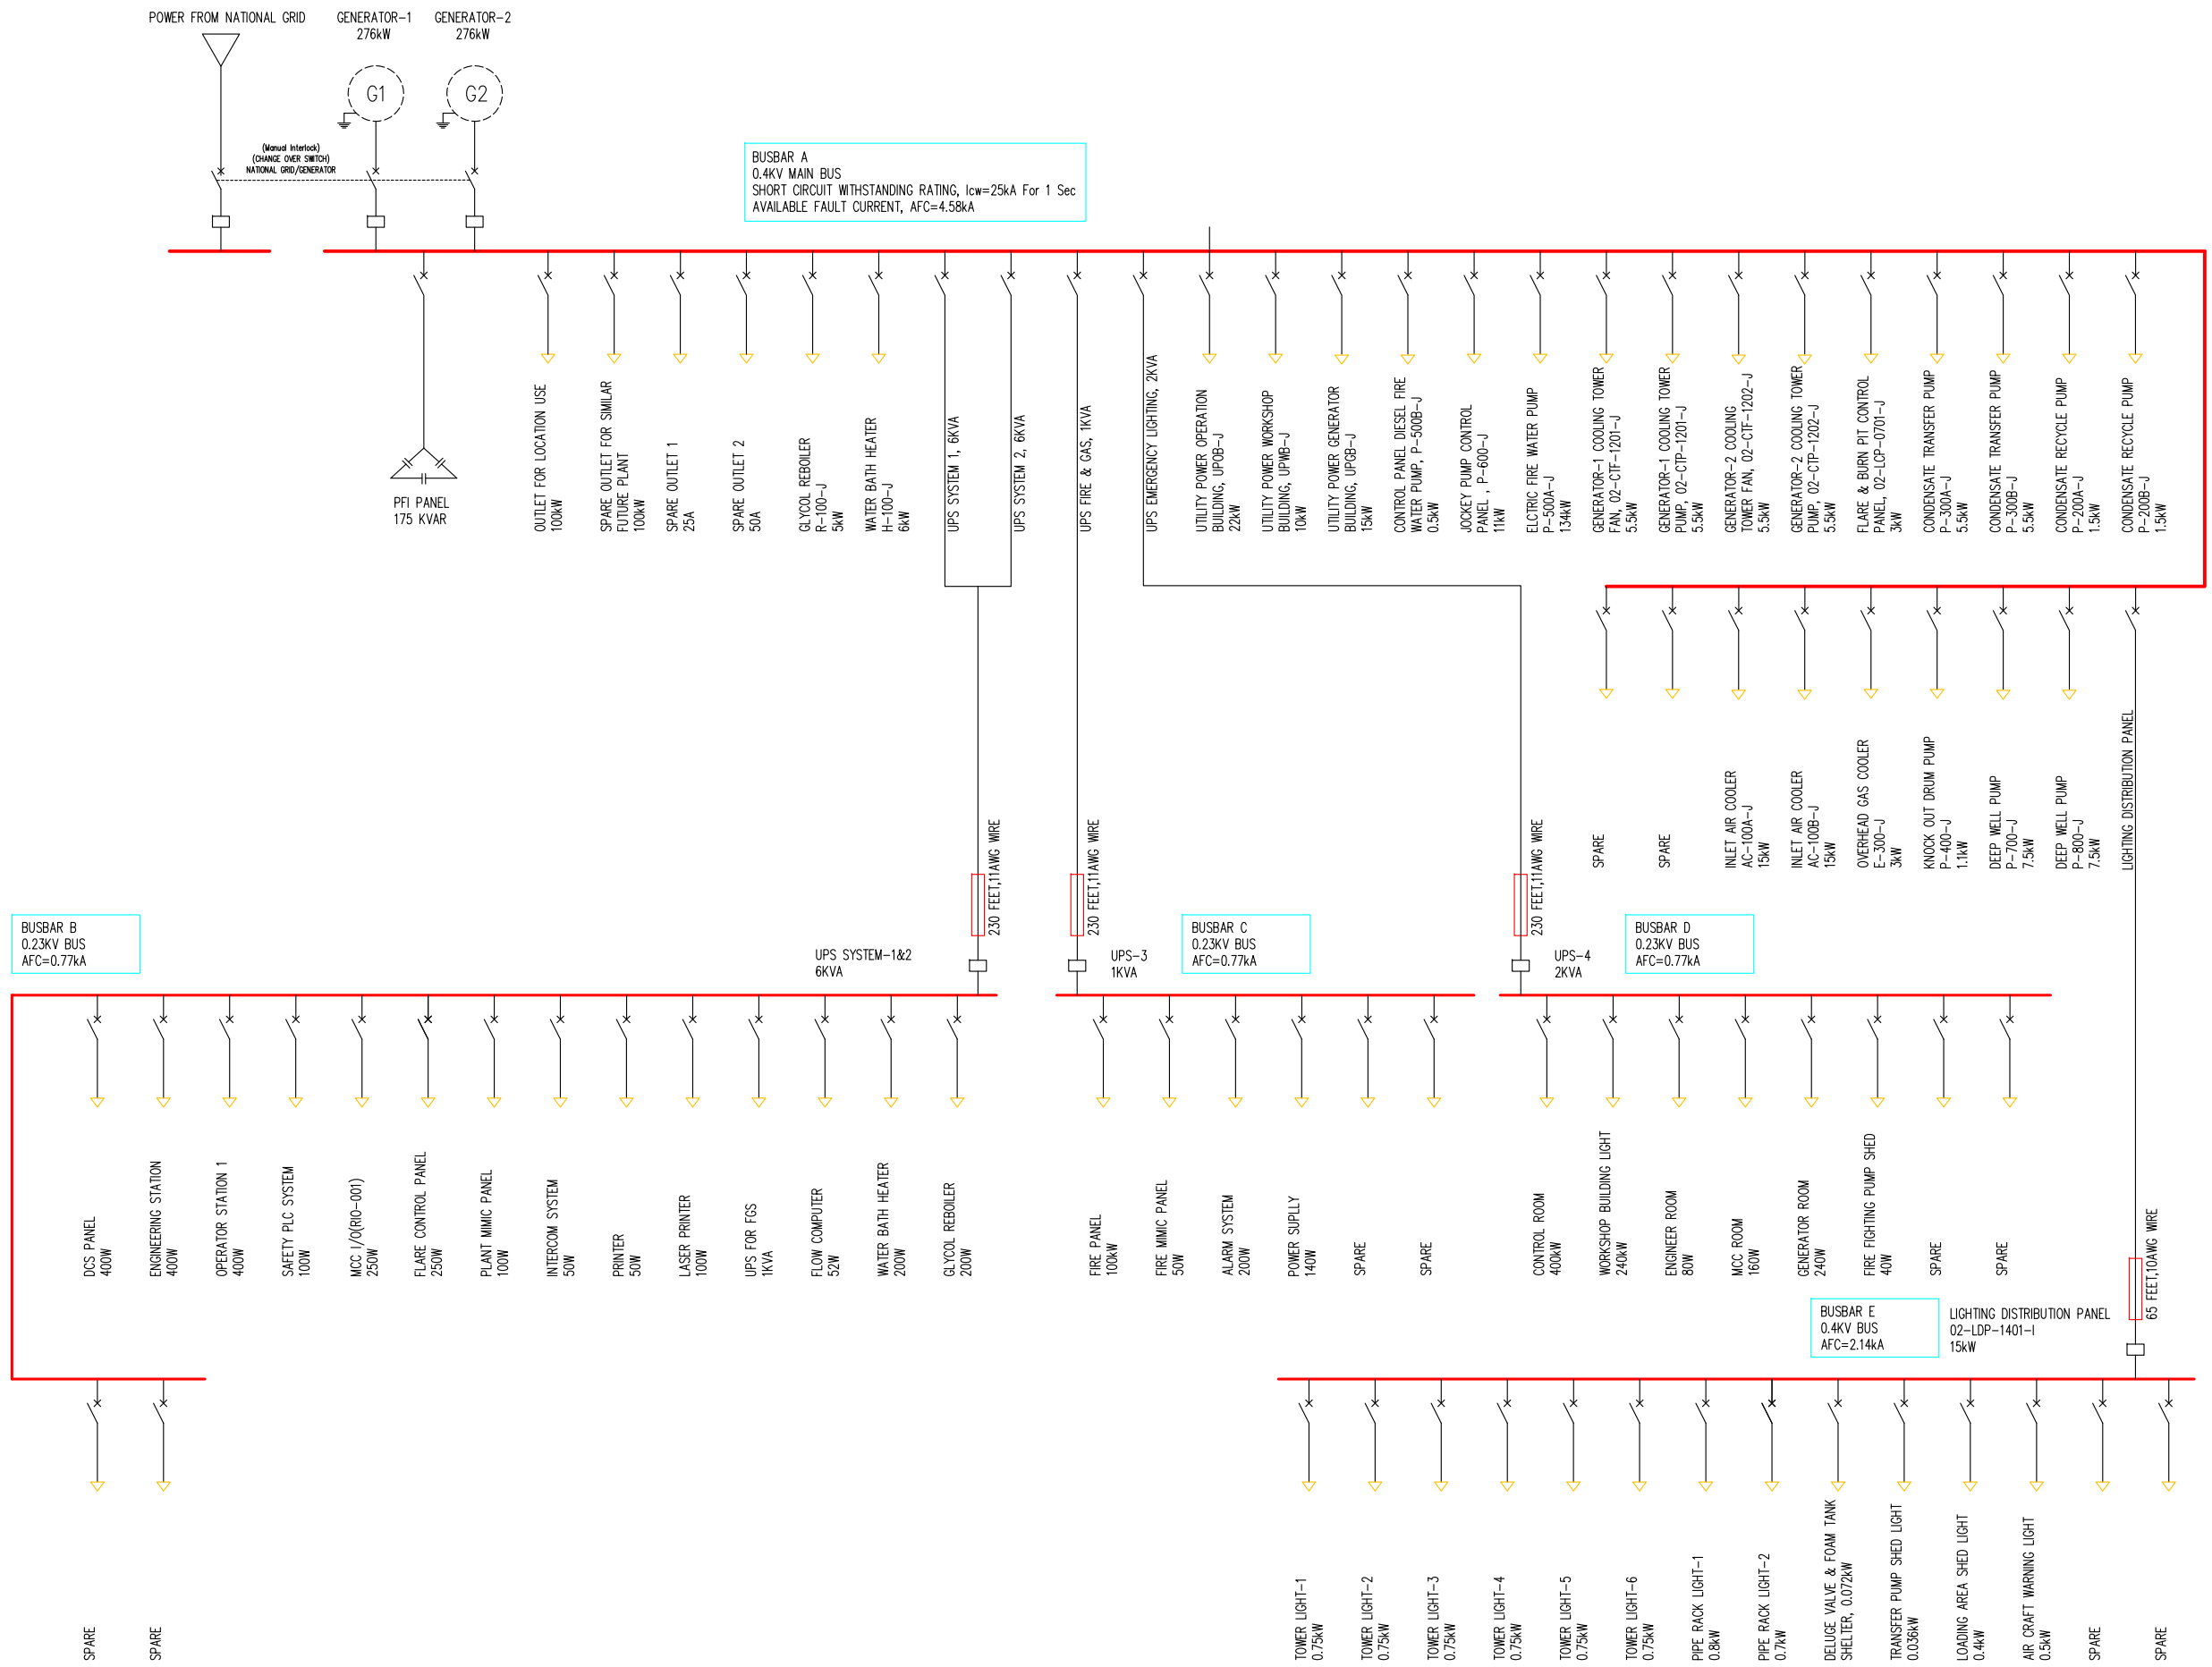

NOTE

Short Circuit Withstanding Rating(SCWR)

Available Fault Current(AFC)

REV	DATE		APPR'D		
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL	AS	MH	VG	2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE
REVISIONS					

FOR

BANGLADESH GAS FIELDS COMPANY LIMITED

ZICOM

CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND
SINOPEC PETROLEUM ENGINEERING CORPORATION

2 * 75 MMSCFD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT

TITLE

POWER DISTRIBUTION PANEL FOR LOCATION J

FORMAT	DRAWING NO.	REVISION
A2	252-0214-EMEL-DW00-0008-J	A
	SCALE NTS / SHEET 1 OF 1	

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any Information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.