



UPS System

230 VAC, 50HZ, 1PH, PE, 3W

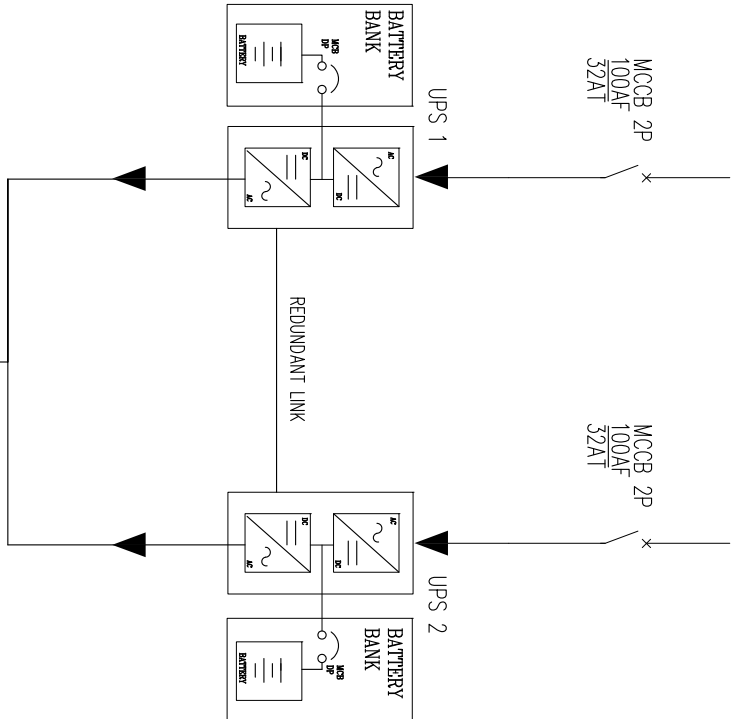

UPS 1 & 2 FOR VITAL USERS
6 kVA 230V AC, 1PH, 3 WIRE, 50Hz
BACK UP TIME 8 HOURS

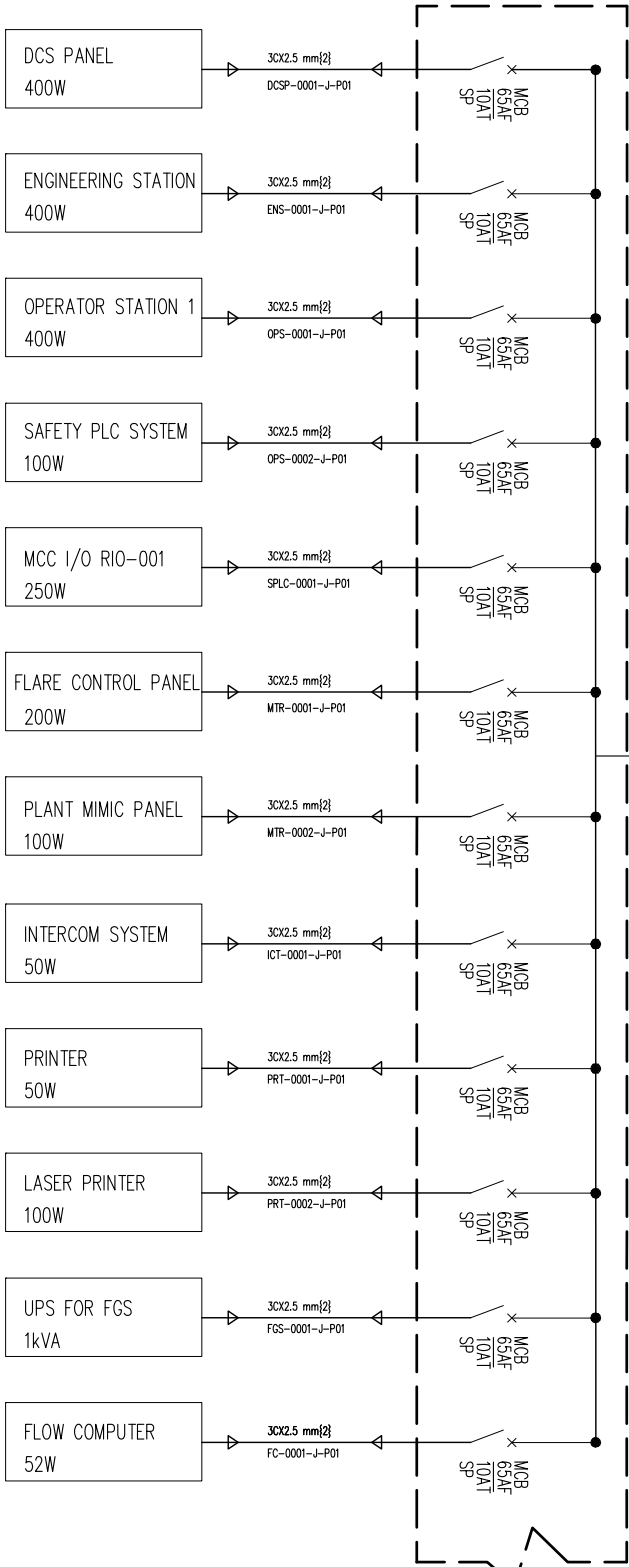

UPS (UNINTERRUPTIBLE POWER SUPPLY)



UPS (UNINTERRUPTIBLE POWER SUPPLY)
WITH EXTERNAL BATTERY BANK

REV	DATE	APPR'D
		CLIENT APPROVAL
A	ISSUED FOR APPROVAL	AS MH VC 2015.10.28
REV	DESCRIPTION	PREP'D CHK'D APP'D DATE
REVISIONS		



BANGLADESH GAS FIELDS COMPANY LIMITED

CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND
SINOPEC PETROLEUM ENGINEERING CORPORATION

ZICOM





2 X 75 MMSCFD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT

UPS SYSTEM DIAGRAM FOR MCC FOR LOCATION J


FORMAT	DRAWING NO.	REVISION
A2	282-0312-EML-DM0-0004	A
SCALE	NTS	SHEET 1 OF 4

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be reproduced, disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation.

UPS System

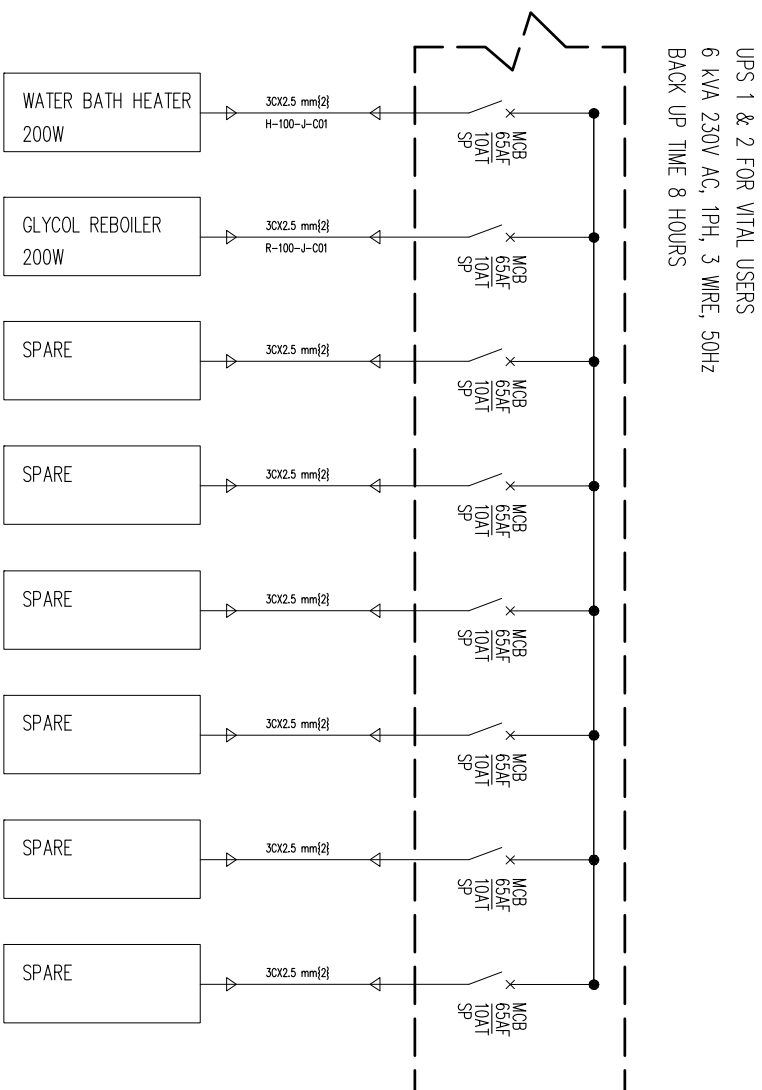

UPS (UNINTERRUPTIBLE POWER SUPPLY)



UPS (UNINTERRUPTIBLE POWER SUPPLY)
WITH EXTERNAL BATTERY BANK

REV	DATE	CLIENT	APPROVAL	APPR'D
A	ISSUED FOR APPROVAL	AS	MH	WG
REV	DESCRIPTION	PREP'D	CHK'D	APP'D
				DATE

BANGLADESH GAS FIELDS COMPANY LIMITED



CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND
PETROLEUM ENGINEERING CORPORATION

2 X 75 MMSOCD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT



TITLE

FORMAT	DRAWING NO 252-0312-ENEL-DWG0-0004				REVISION
A2					A
	SCALE	NTS	SHEET	2 OF 4	

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.

UPS System

230 VAC, 50HZ, 1PH, PE, 3W

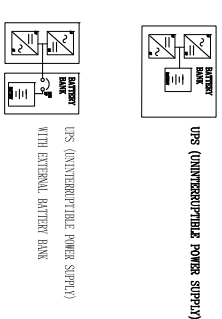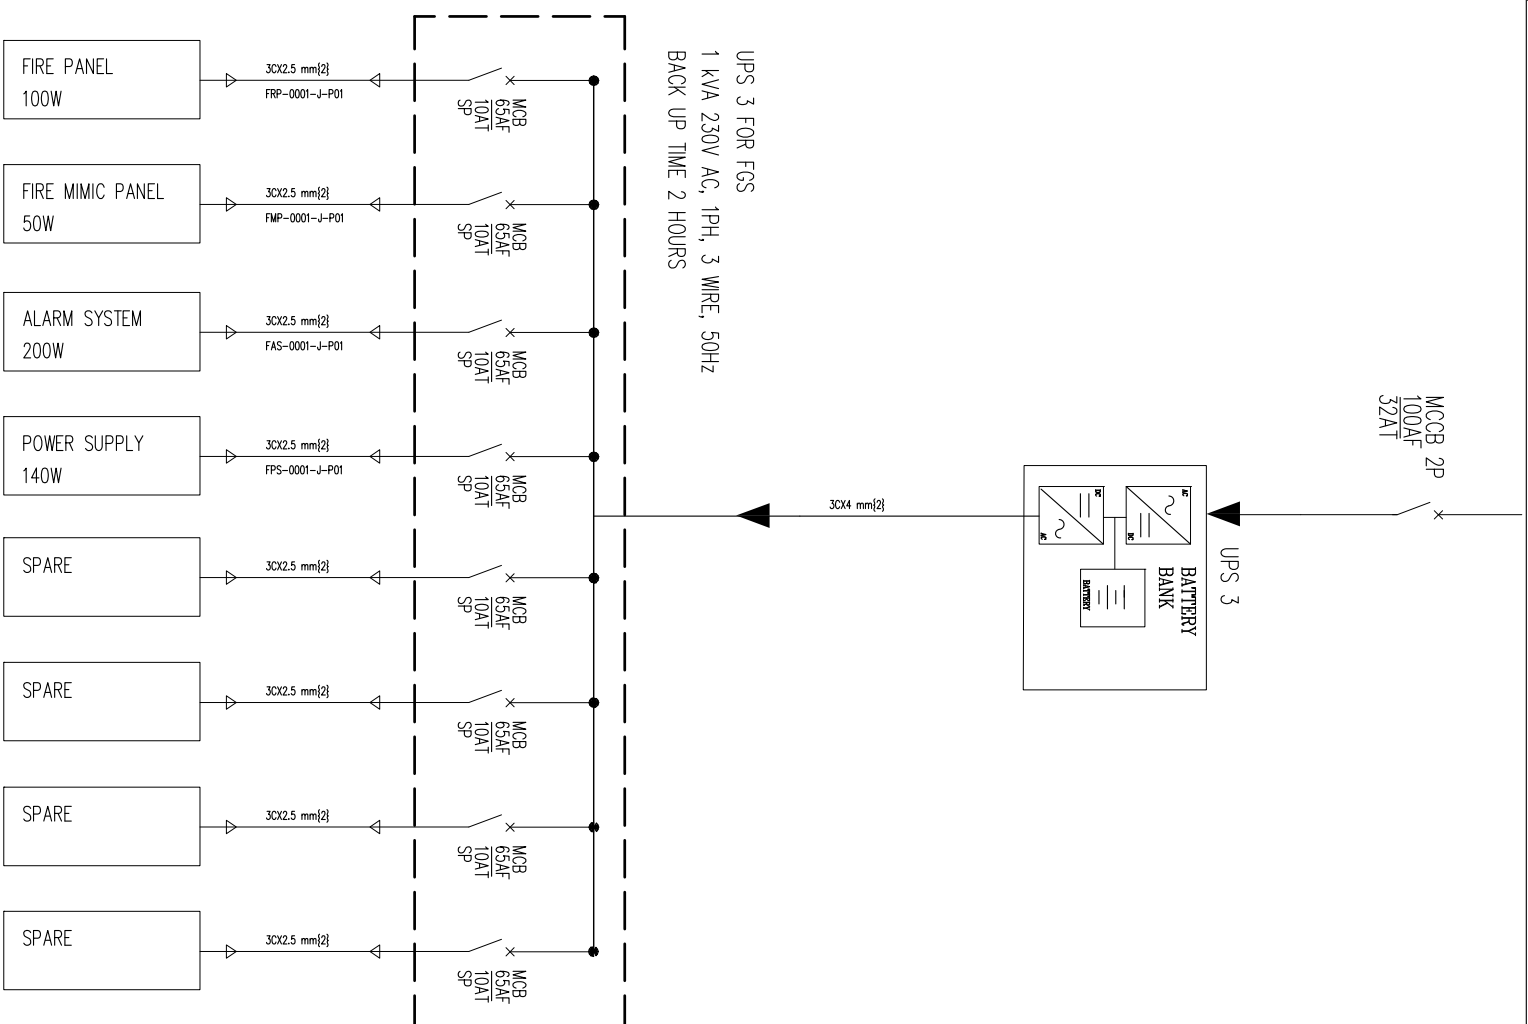

REV	DATE	CLIENT APPROVAL	APPR'D	
A	ISSUED FOR APPROVAL	AS	MH	VC
REV	DESCRIPTION	PREP'D	CHK'D	APP'D
				DATE

BANGLADESH GAS FIELDS COMPANY LIMITED

CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD
AND

ZICOM SINOPEC PETROLEUM ENGINEERING CORPORATION

2 X 75 MMSCFD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT



III

FORMAT	DRAWING NO.				REVISION
	252-0312-EM1-DW00-0004				
A2	SCALE	NTS	SHEET	3 OF 4	<div style="border: 1px solid black; padding: 2px; display: inline-block;">A</div>

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.

UPS System


230 VAC, 50HZ, 1PH, PE, 3W

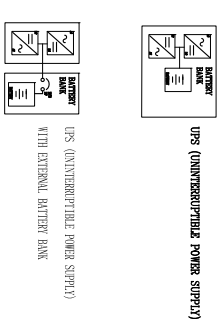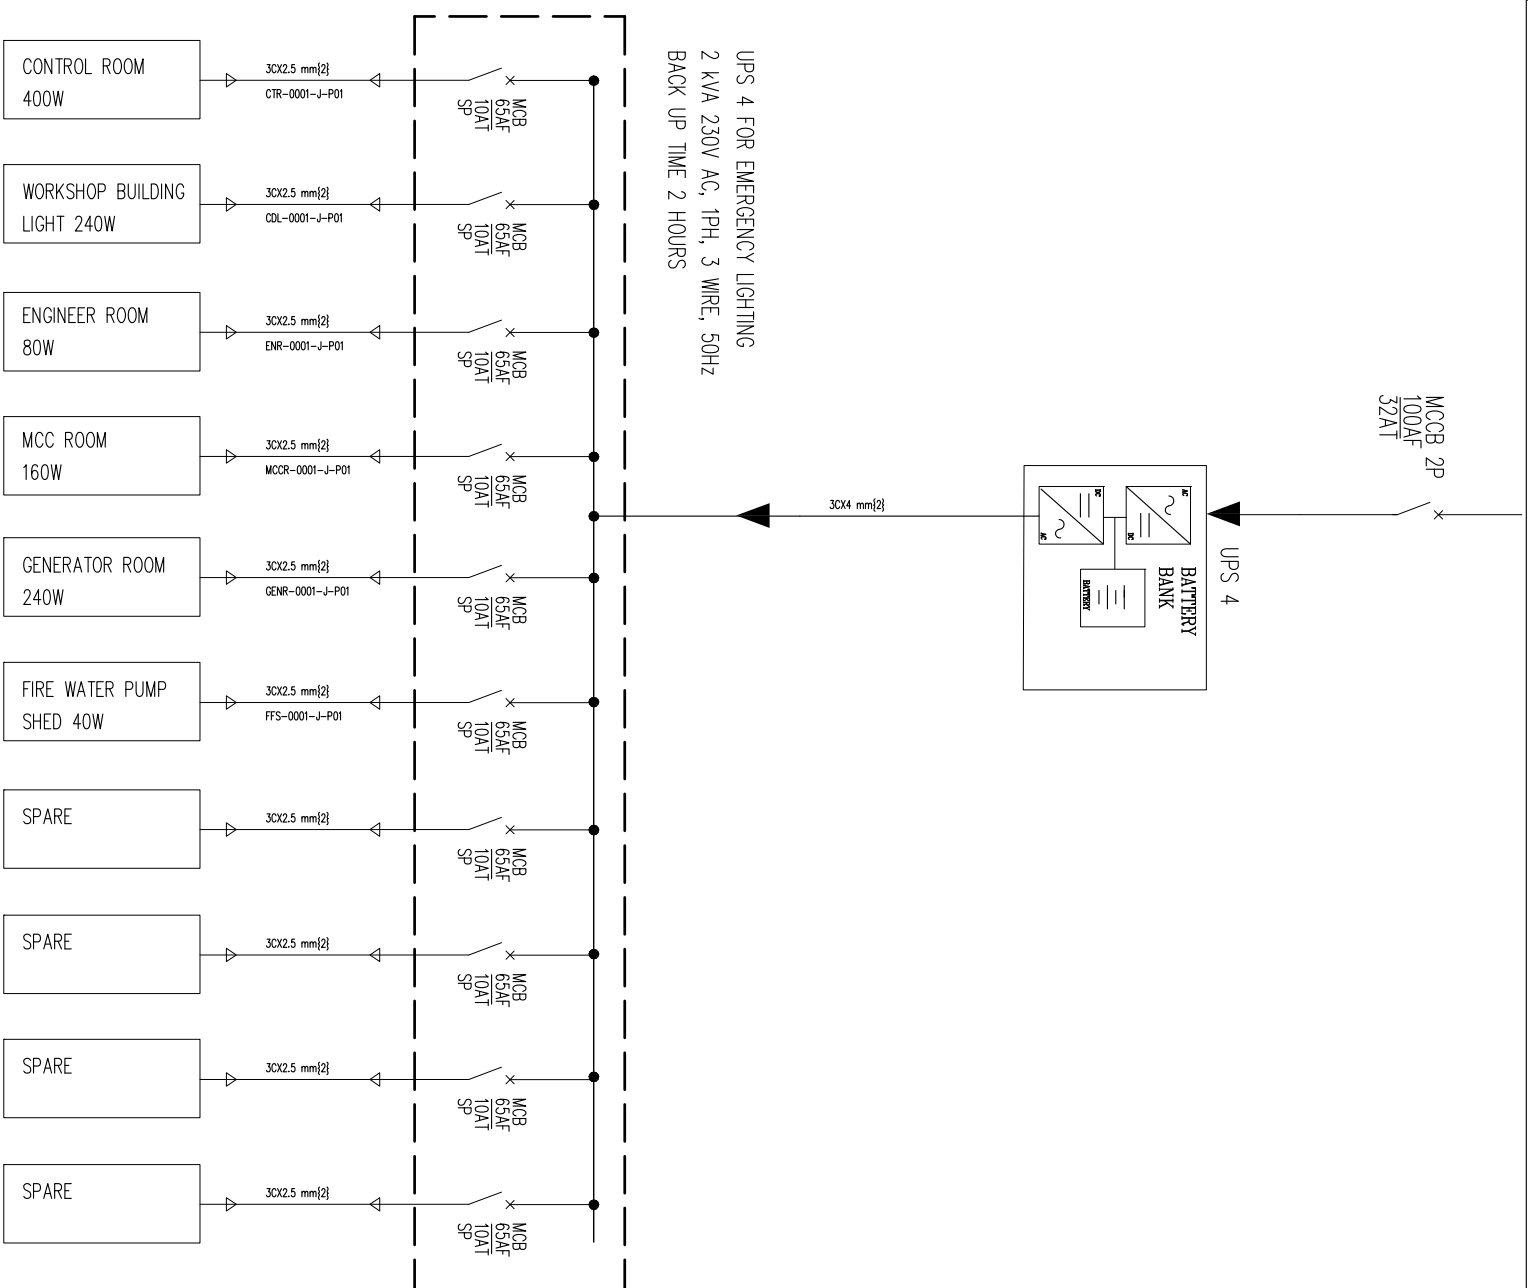

REV	DATE	CLIENT APPROVAL	APPR'D	
A	ISSUED FOR APPROVAL	AS	MH	VC
REV	DESCRIPTION	PREP'D	CHK'D	APP'D
				DATE

2015.10.28
 REVISIONS

BANGLADESH GAS FIELDS COMPANY LIMITED



CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD
AND

2 X 75 MMSCD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT

TITLE
UPS SYSTEM DIAGRAM FOR MCC FOR LOCATION J

FORMAT	DRAWING NO.				REVISION
	252-0312-EM1-DW00-0004				
A2	SCALE	NTS	SHEET	4 OF 4	<div style="border: 1px solid black; padding: 2px; display: inline-block;">A</div>

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd, & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd, & Sinopec Petroleum Engineering Corporation.