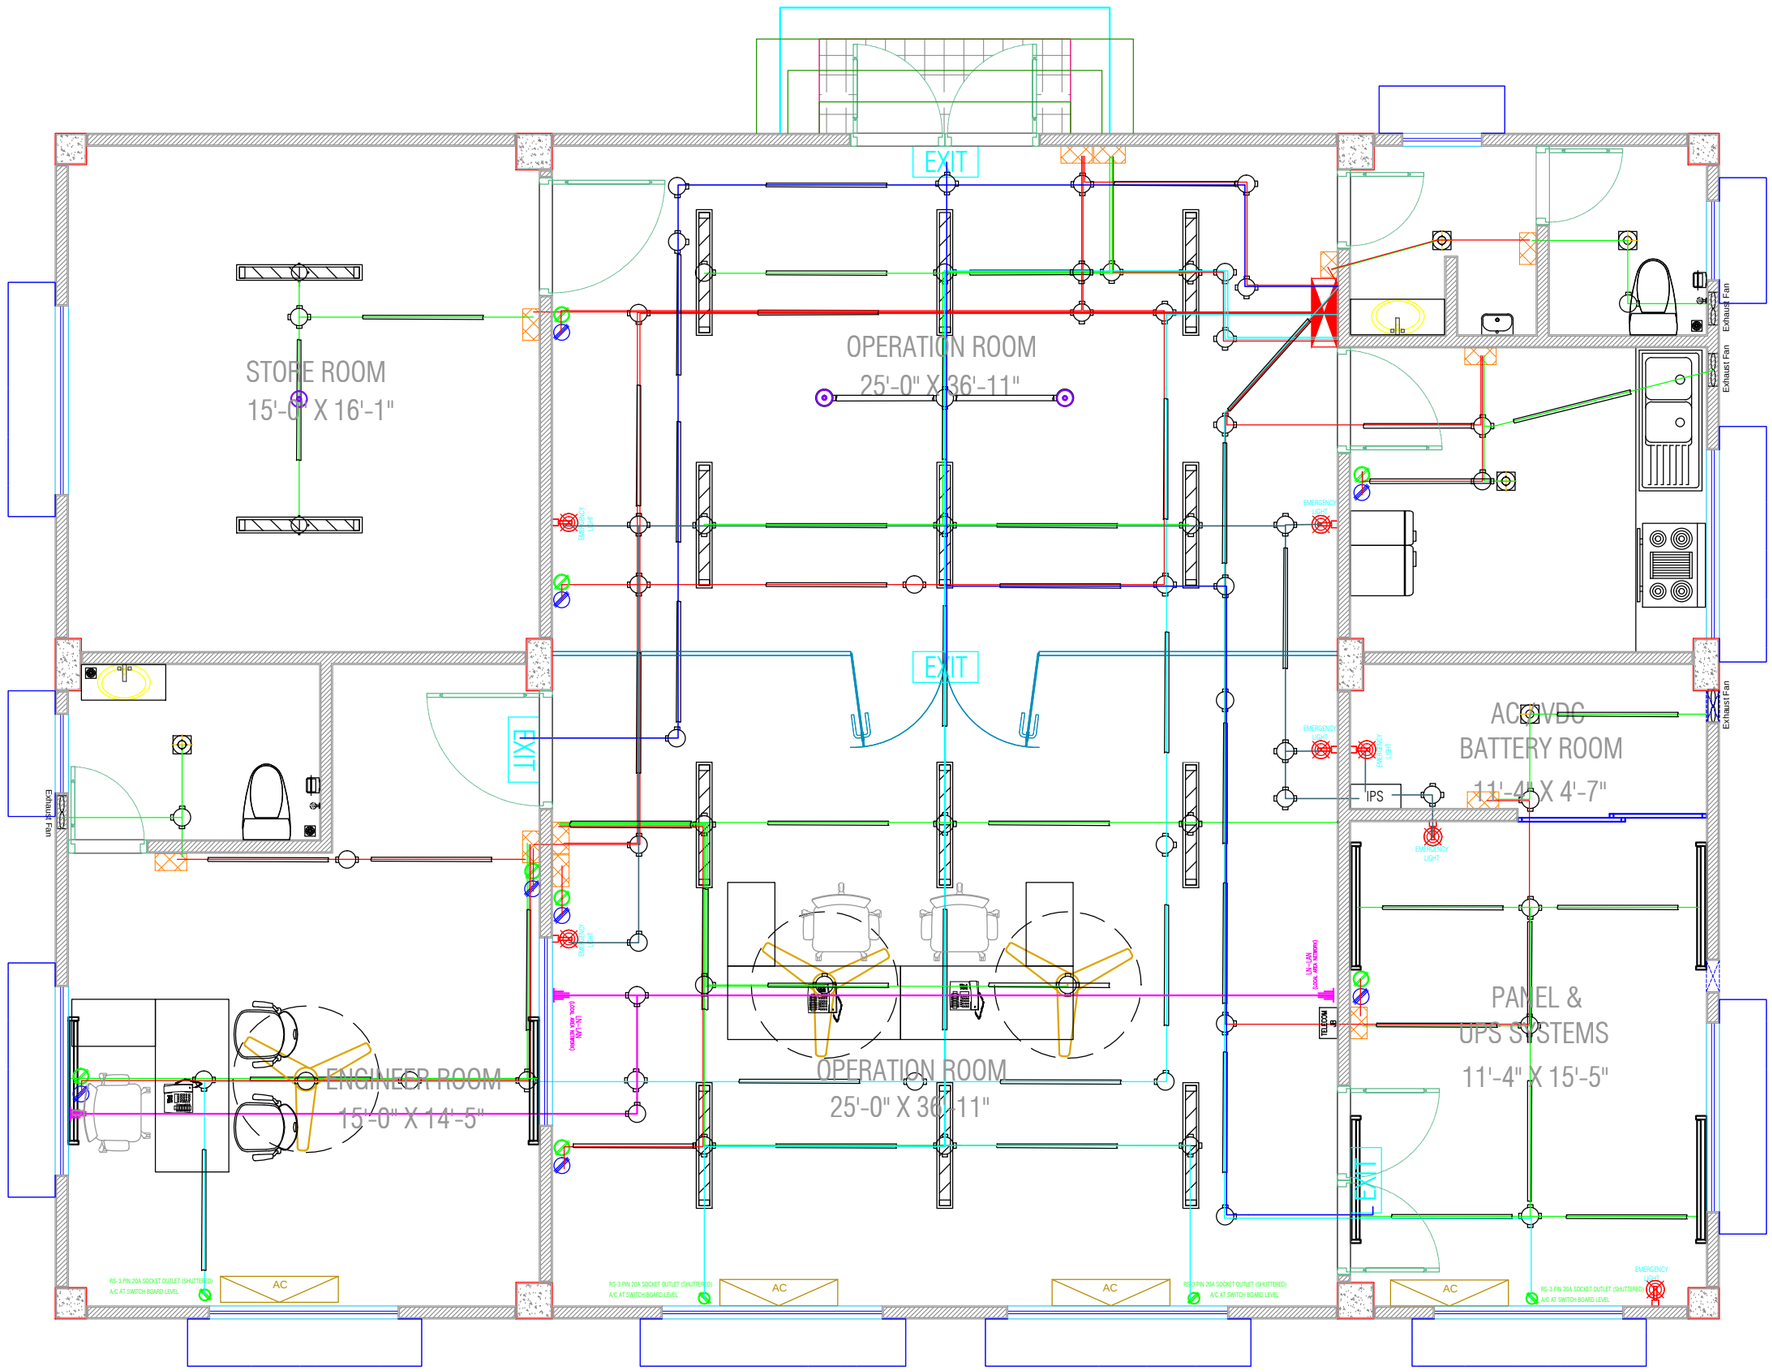

PLAN OF OPERATION BUILDING

2000 Sqft

LEGEND

- MDB–MAIN DISTRIBUTION BOARD AT 900mm LEVEL
- TELECOM JB — EXHAUST FAN
- IPS — IPS (INSTANT POWER SUPPLY)
- EXHAUST FAN
- AC — AIR CONDITIONING (AC)
- 3–PIN 13A SOCKET OUTLET AT SKIRTING LEVEL
- 2–PIN 13A SOCKET OUTLET AT SKIRTING LEVEL
- RS-3 PIN 20A SOCKET OUTLET (SHUTTERED) A/C AT SWITCH BOARD LEVEL
- LN-LAN (LOCAL AREA NETWORK) PORT
- SWITCHBOARD AT 1200MM LEVEL
- WALL MOUNTED W FLUORESCENT LIGHTS
- FLUORESCENT LIGHTS
- EMERGENCY LIGHT — EMERGENCY LIGHTS
- CEILING FAN 56" SWEEP
- EXIT — EXIT SIGNS W LIGHT
- CEILING MOUNTED SPOT LIGHT
- CIRCULAR BOX
- OPTIONAL POINT FOR FAN PLACEMENT
- PVC CONDUITS
- DB POWER LINE
- UTILITY POWER LINE
- EXIT LIGHT LINE
- INTERCOM LINE
- HIGH POWERED UTILITY LINE

REV		DATE		APPR'D	
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL	AS	MH	VG	2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE

REVISIONS

FOR

BANGLADESH GAS FIELDS COMPANY LIMITED

CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND
SINOPEC PETROLEUM ENGINEERING CORPORATION

2 X 75 MMSCFD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT

TITLE

DESIGN OF BUILDING ELECTRICAL SYSTEM

OPERATOR BUILDING, LOCATION–J

FORMAT	DRAWING NO.		REVISION
A2	252-0312-EMEL-DW00-0010		A
	SCALE 1:100	SHEET 2 OF 4	

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.