

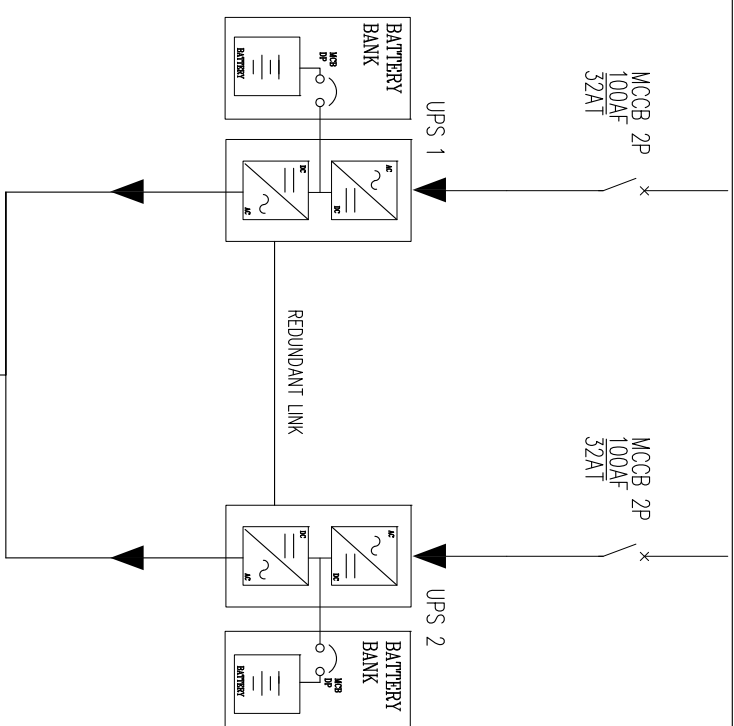


UPS System

230 VAC, 50HZ, 1PH, PE, 3W

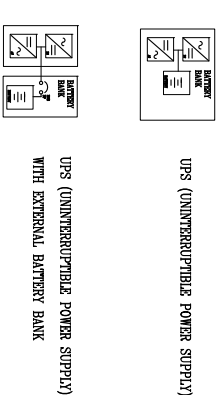

UPS 1 & 2 FOR VITAL USERS
6 KVA 230V AC, 1PH, 3 WIRE, 50HZ
BACK UP TIME 8 HOURS

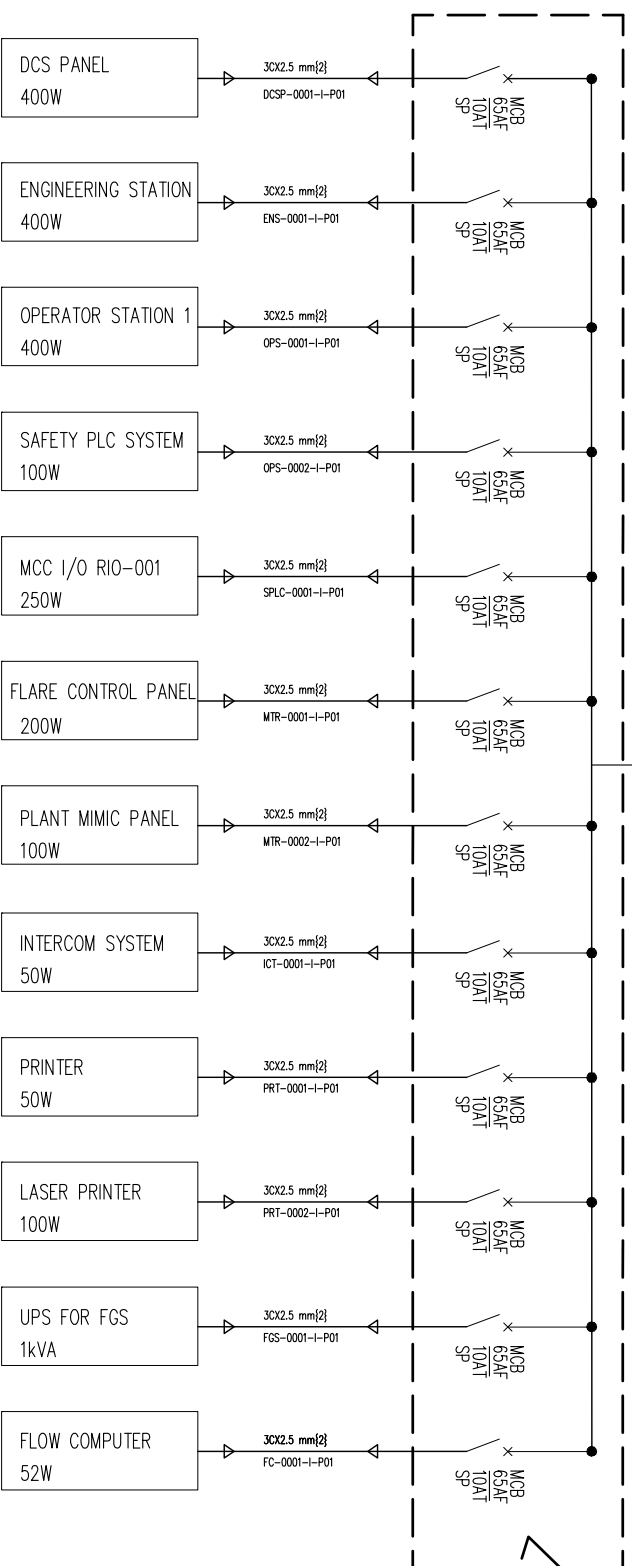

REV	DATE	APPR'D	CLIENT APPROVAL			
A	ISSUED FOR APPROVAL	AS	WH	WG	2015.10.28	
REV	DESCRIPTION	PREF'D	CHK'D	APP'D	DATE	
REVISIONS						

BANGLADESH GAS FIELDS COMPANY LIMITED

CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND

ZICOM AND SINOPEC PETROLEUM ENGINEERING CORPORATION

2 X 75 MMSCD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT


UPS SYSTEM DIAGRAM FOR MCC FOR LOCATION 1


FORMAT	DRAWING NO.				REVISION
	252-0212-EMEL-DW00-0002				
A3	SCALE	NTS	SHEET	1 OF 4	<div style="border: 1px solid black; padding: 2px; display: inline-block;">A</div>

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd, & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd, & Sinopec Petroleum Engineering Corporation.


UPS System

UPS 1 & 2 FOR VTAL USERS
6 KVA 230V AC, 1PH, 3 WIRE, 50Hz
BACK UP TIME 8 HOURS

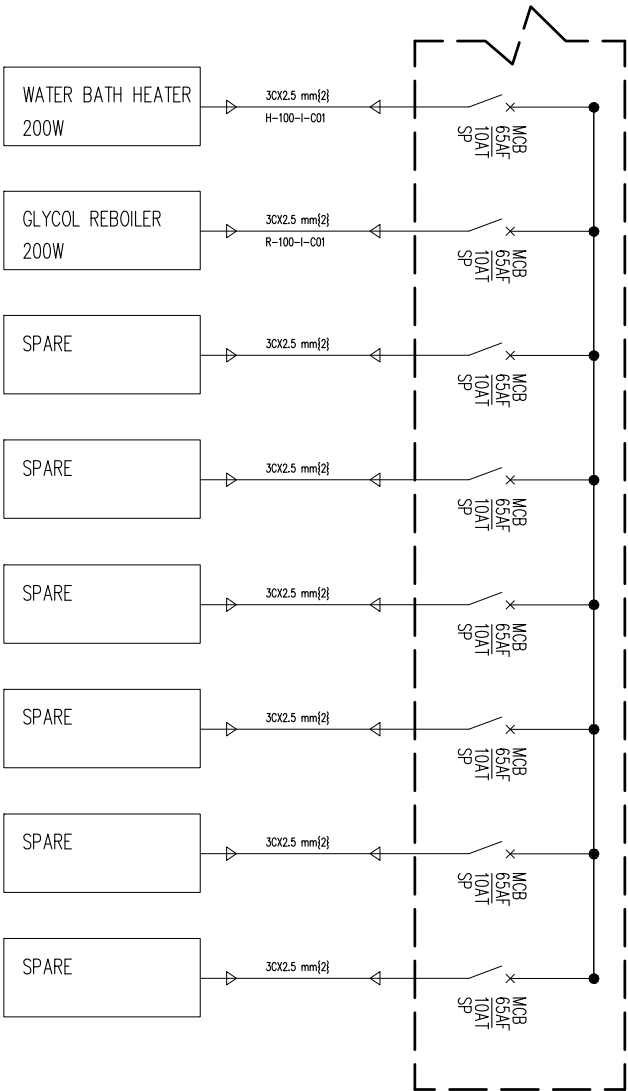



UPS (UNINTERRUPTIBLE POWER SUPPLY)




UPS (UNINTERRUPTIBLE POWER SUPPLY)
WITH EXTERNAL BATTERY BANK


REV	DATE	APP'D
CLIENT APPROVAL		
A	ISSUED FOR APPROVAL	AS MH VC 2015.10.28
REV	DESCRIPTION	PREP'D CHK'D APP'D DATE
REVISIONS		



BANGLADESH GAS FIELDS COMPANY LIMITED



CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND
SINOPEC PETROLEUM ENGINEERING CORPORATION



2 X 75 MWSGD TEG DEHUMIDIFICATION TREATMENT GAS PROCESS PLANT



TITLE
UPS SYSTEM DIAGRAM FOR MCC FOR LOCATION I

FORMAT	DRAWING NO.	REVISION
A3	282-0212-EML-DM01-0002	A
SCALE	NTS	SHEET 2 OF 4

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be reproduced, disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation.

UPS System

230 VAC, 50HZ, 1PH, PE, 3W

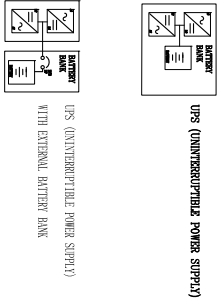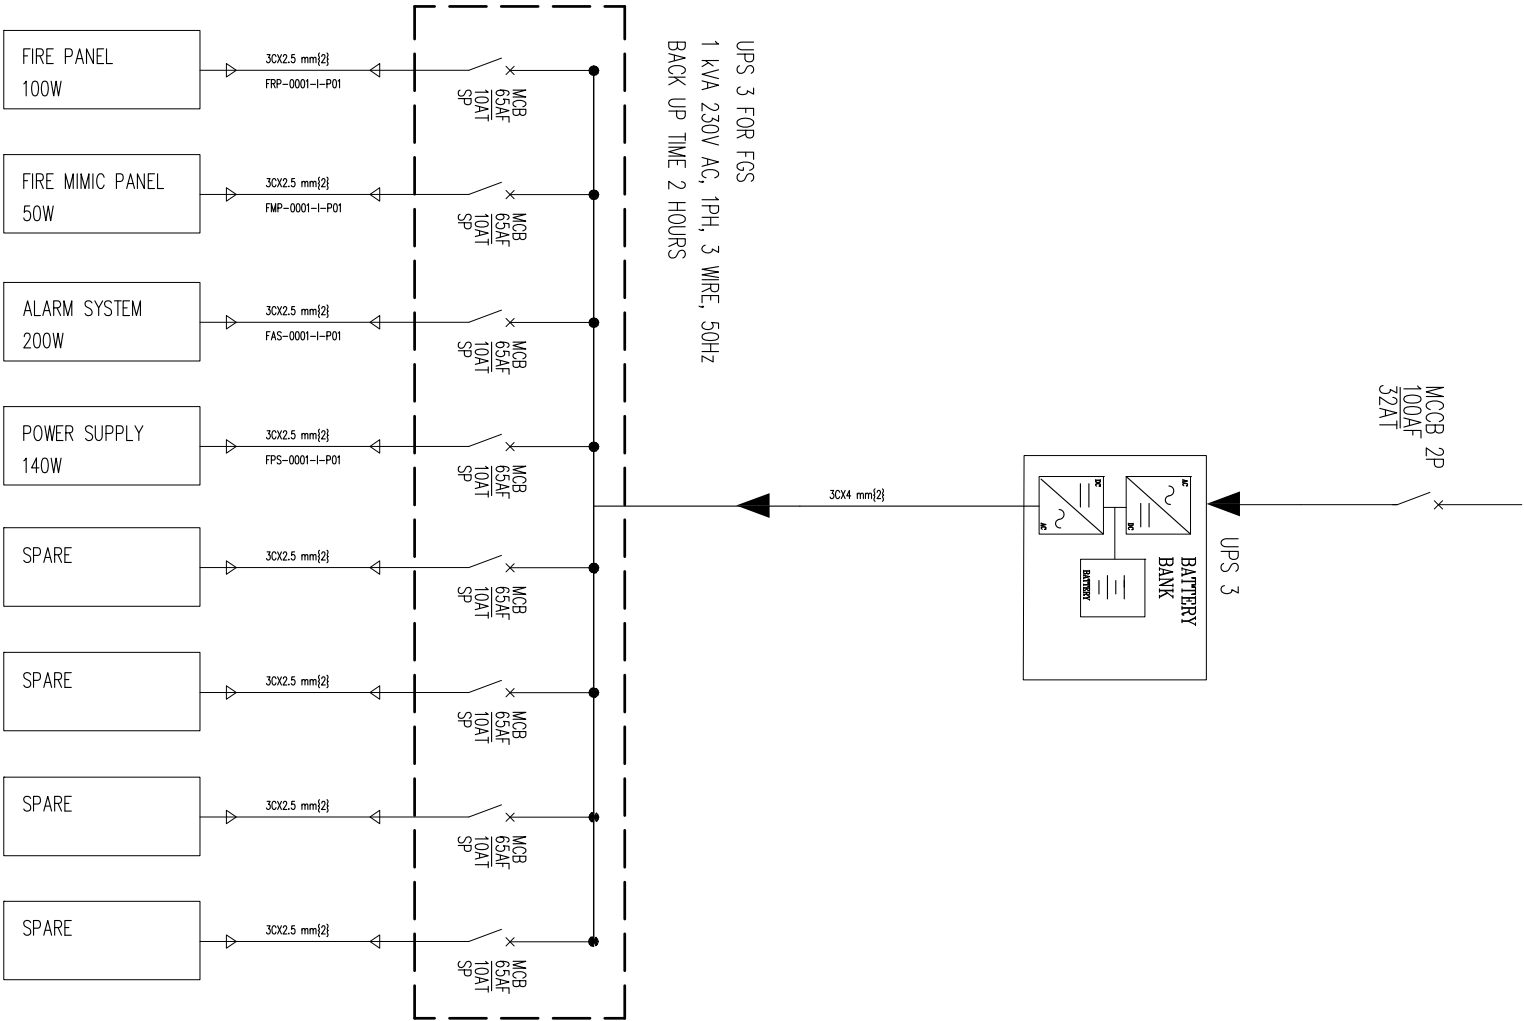

REV	DATE	APPR'D
		CLIENT APPROVAL
A	ISSUED FOR APPROVAL	AS MH VC 2015.10.28
REV	DESCRIPTION	PREP'D CHK'D APP'D DATE
REVISIONS		



BANGLADESH GAS FIELDS COMPANY LIMITED

CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND
SINOPEC PETROLEUM ENGINEERING CORPORATION

2 X 75 MWSGD TEG DEHUMIDIFICATION TREATMENT GAS PROCESS PLANT



TITLE
UPS SYSTEM DIAGRAM FOR MCC FOR LOCATION I

FORMAT	DRAWING NO.	REVISION
A3	282-0212-EML-0W0-0002	A
SCALE	NTS	SHEET 3 OF 4

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be reproduced, disclosed to others without explicit written permission from ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation.

UPS System

230 VAC, 50HZ, 1PH, PE, 3W

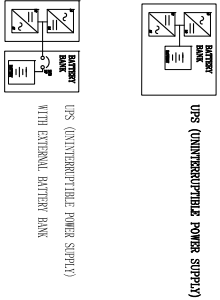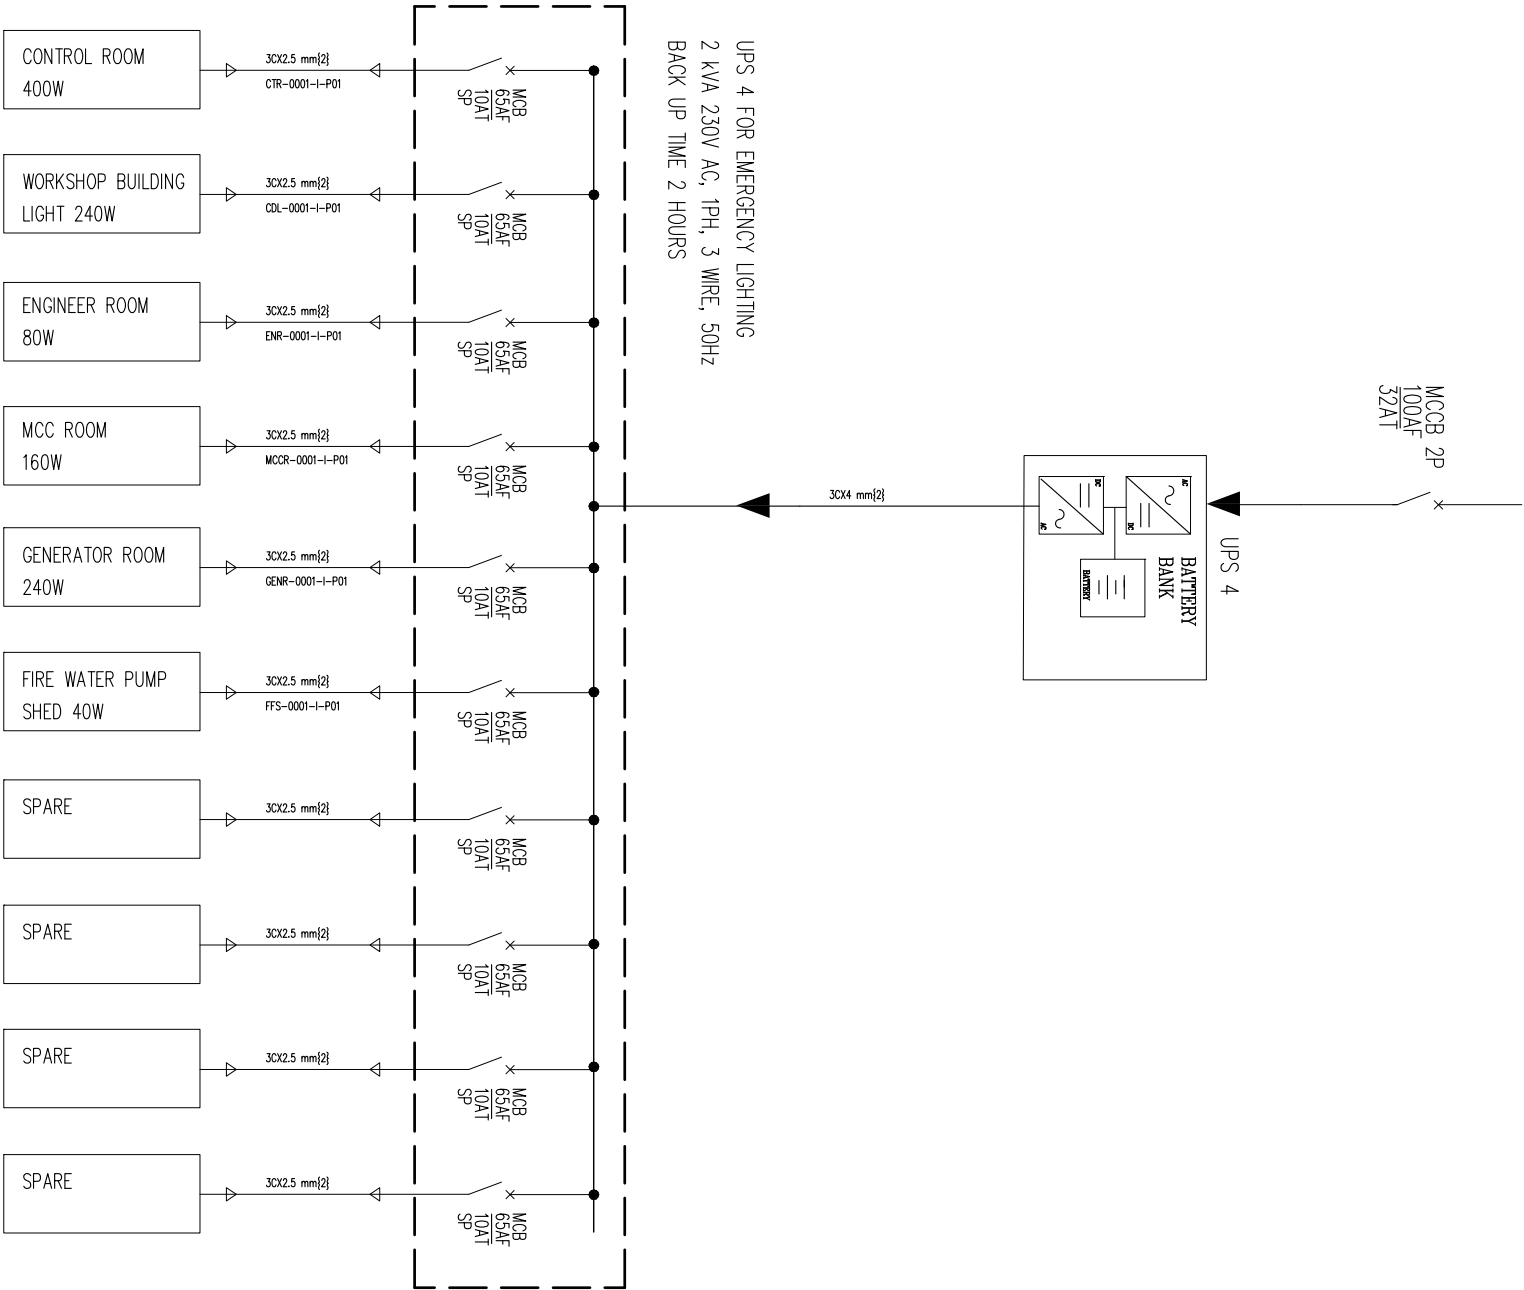

REV	DATE	APPR'D
		CLIENT APPROVAL
A	ISSUED FOR APPROVAL	AS MH VC 2015.10.28
REV	DESCRIPTION	PREP'D CHK'D APP'D DATE
REVISIONS		



BANGLADESH GAS FIELDS COMPANY LIMITED

CONSORTIUM OF
ZICOM EQUIPMENT PTE. LTD.
AND
SINOPEC PETROLEUM ENGINEERING CORPORATION
SINOPEC

2 X 75 MMSCFD TEG DEHUMIDIFICATION TREATMENT GAS PROCESS PLANT

TITLE
UPS SYSTEM DIAGRAM FOR MCC FOR LOCATION I

FORMAT	DRAWING NO.	REVISION
A3	282-0212-EML-DM00-0002	A
SCALE	NTS	SHEET 4 OF 4

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be reproduced, disclosed to others without explicit written permission from ZICOM Equipment Pte Ltd. & Sinopec Petroleum Engineering Corporation.