



### VENTILATING SYSTEM ARRANGEMENT FOR GENERATOR ROOM, L-1 1:100

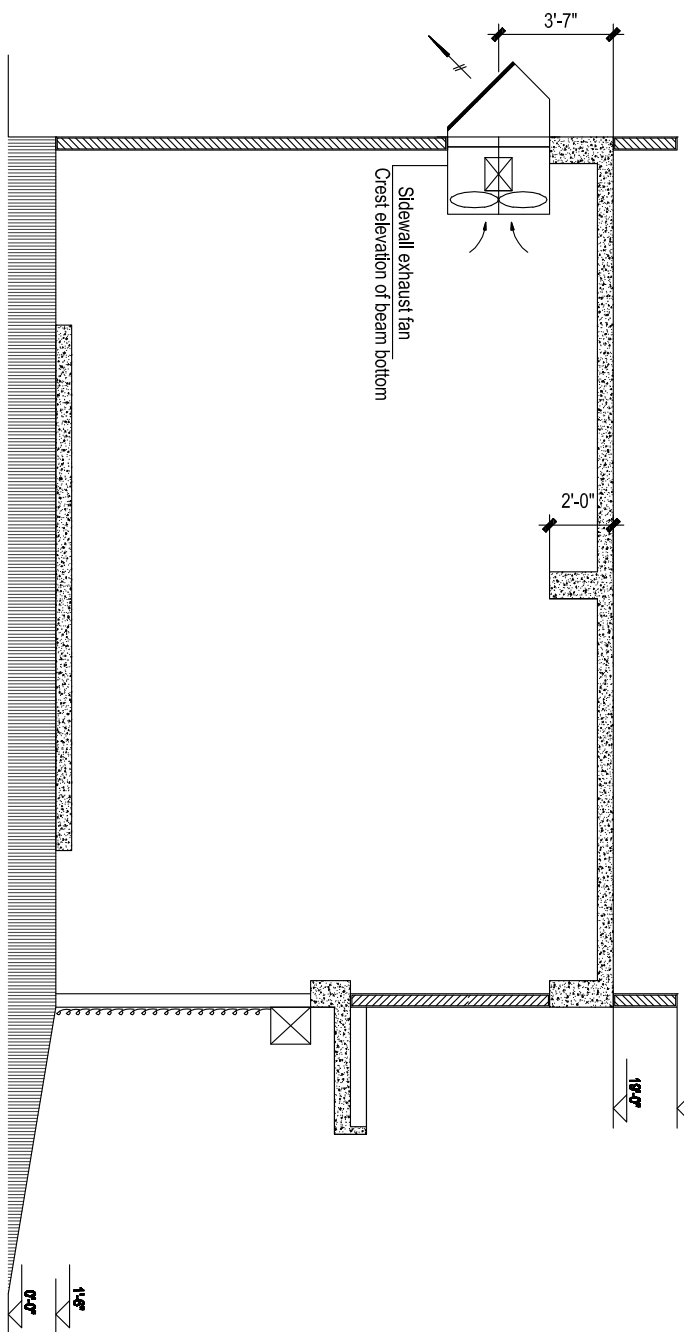

SECTION A-A 1:50

NO.	EQUIPMENT NO.	DESCRIPTION	UNIT	QUANTITY	REMARK
1	0212-PF-01~04	Sidewall exhaust fan	set	3	400V, 2.2kW
		Crest elevation of beam bottom			
		Wall opening size is 1000x1000mm			
		Volume:18300m <sup>3</sup> /h; Static Pressure: 230Pa			
		Speed: VTA			
		Accessories: 45° weather cover,			
		Gravity back-draft damper,			
		Stainless steel insectscreen,			
		Safety protective screening			

REV	DATE	CLIENT APPROVAL	APPR'D
A	ISSUED FOR APPROVAL	AS	MH WG 2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D APP'D DATE
REVISIONS			



**BANGLADESH GAS FIELDS COMPANY LIMITED**

 CONSORTIUM OF  
 ZICOM EQUIPMENT PTE. LTD.  
 AND  
 SINOPEC PETROLEUM ENGINEERING CORPORATION  


2 X 75 MMSD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT

TITLE
VENTILATING SYSTEM ARRANGEMENT FOR GENERATOR ROOM, L-I

FORMAT A3	DRAWING NO. 252-0212-EMHV-DW00-0001		REVISION <div style="border: 1px solid black; padding: 2px; display: inline-block;">A</div>
	SCALE 1:100	SHEET 1 OF 1	

This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information, contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.