









REV	DATE	APPR'D			
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL	AS	MH	VG	2015.10.28
REV	DESCRIPTION	PREP'D	CHK'D	APP'D	DATE
REVISIONS					
FOR					
 BANGLADESH GAS FIELDS COMPANY LIMITED					
 CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION 					
2 X 75 MMSCFD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT					
TITLE					
ELECTRICAL EQUIPMENT LAYOUT FOR UPS ROOM FOR LOCATION J					
FORMAT		DRAWING NO.			REVISION
A2		252-0312-EMEL-DW00-0006			
		SCALE	1:50	SHEET 1 OF 3	
This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.					






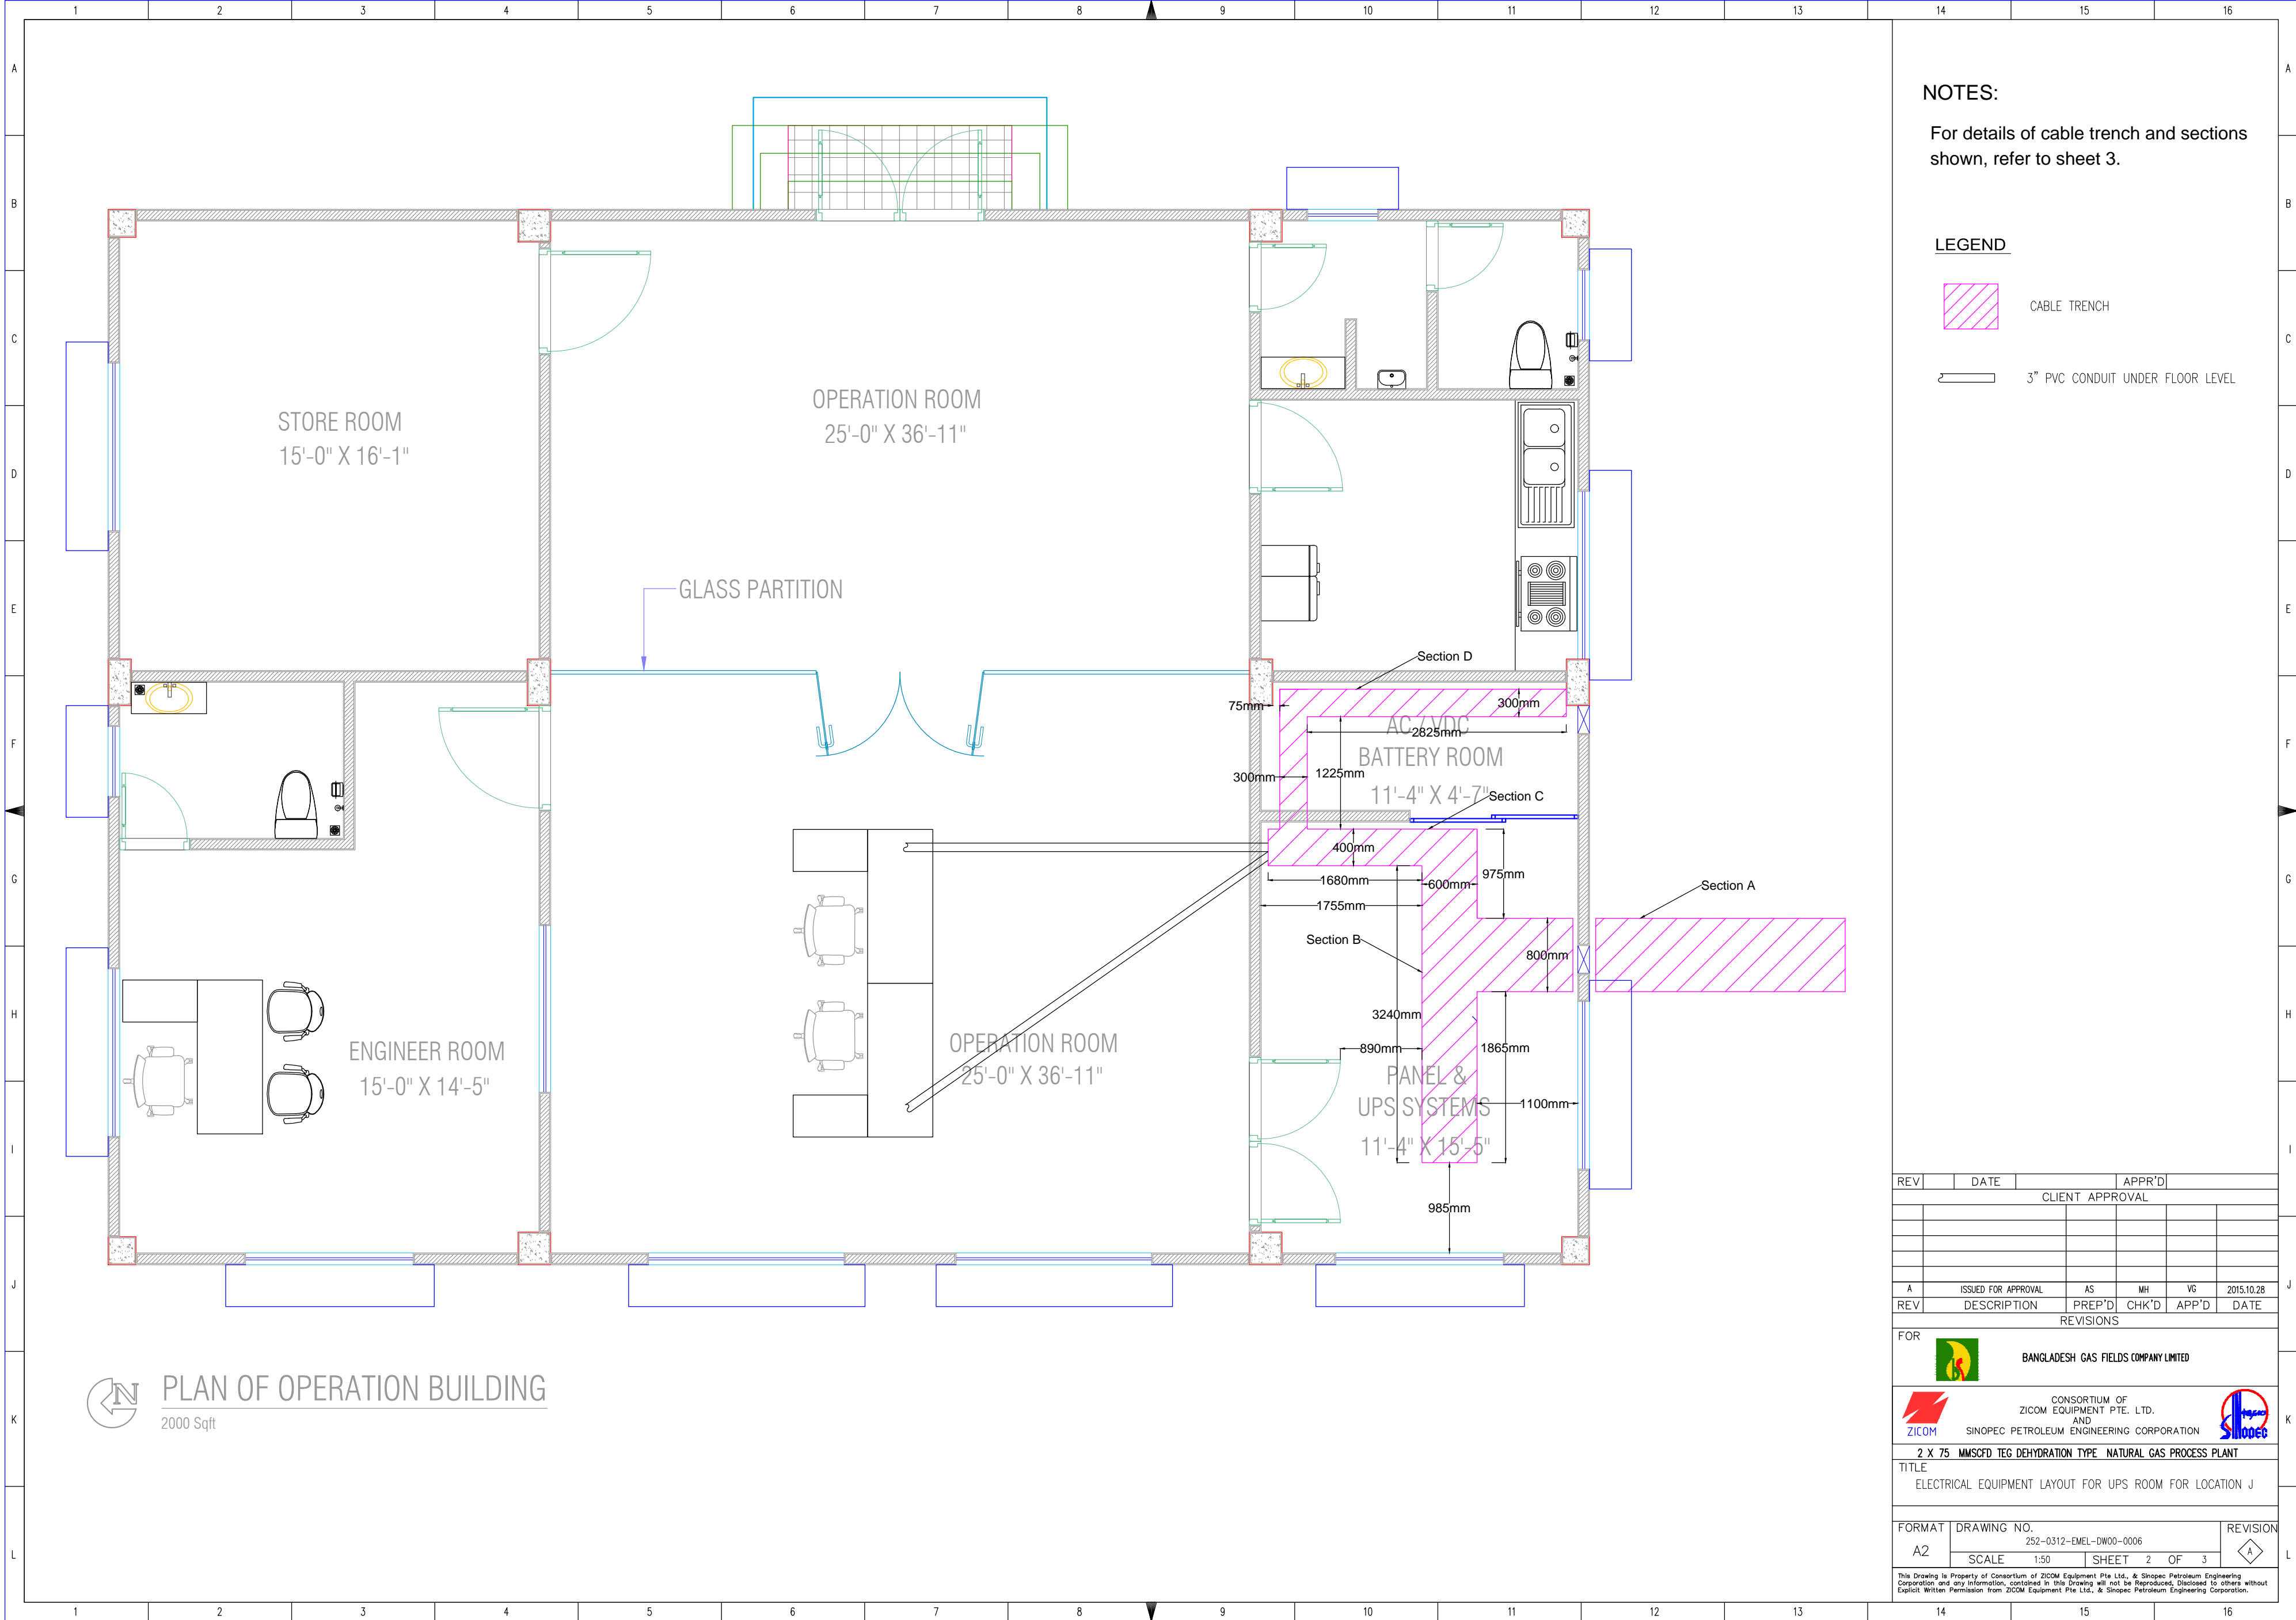

NOTES:

For details of cable trench and sections shown, refer to sheet 3.

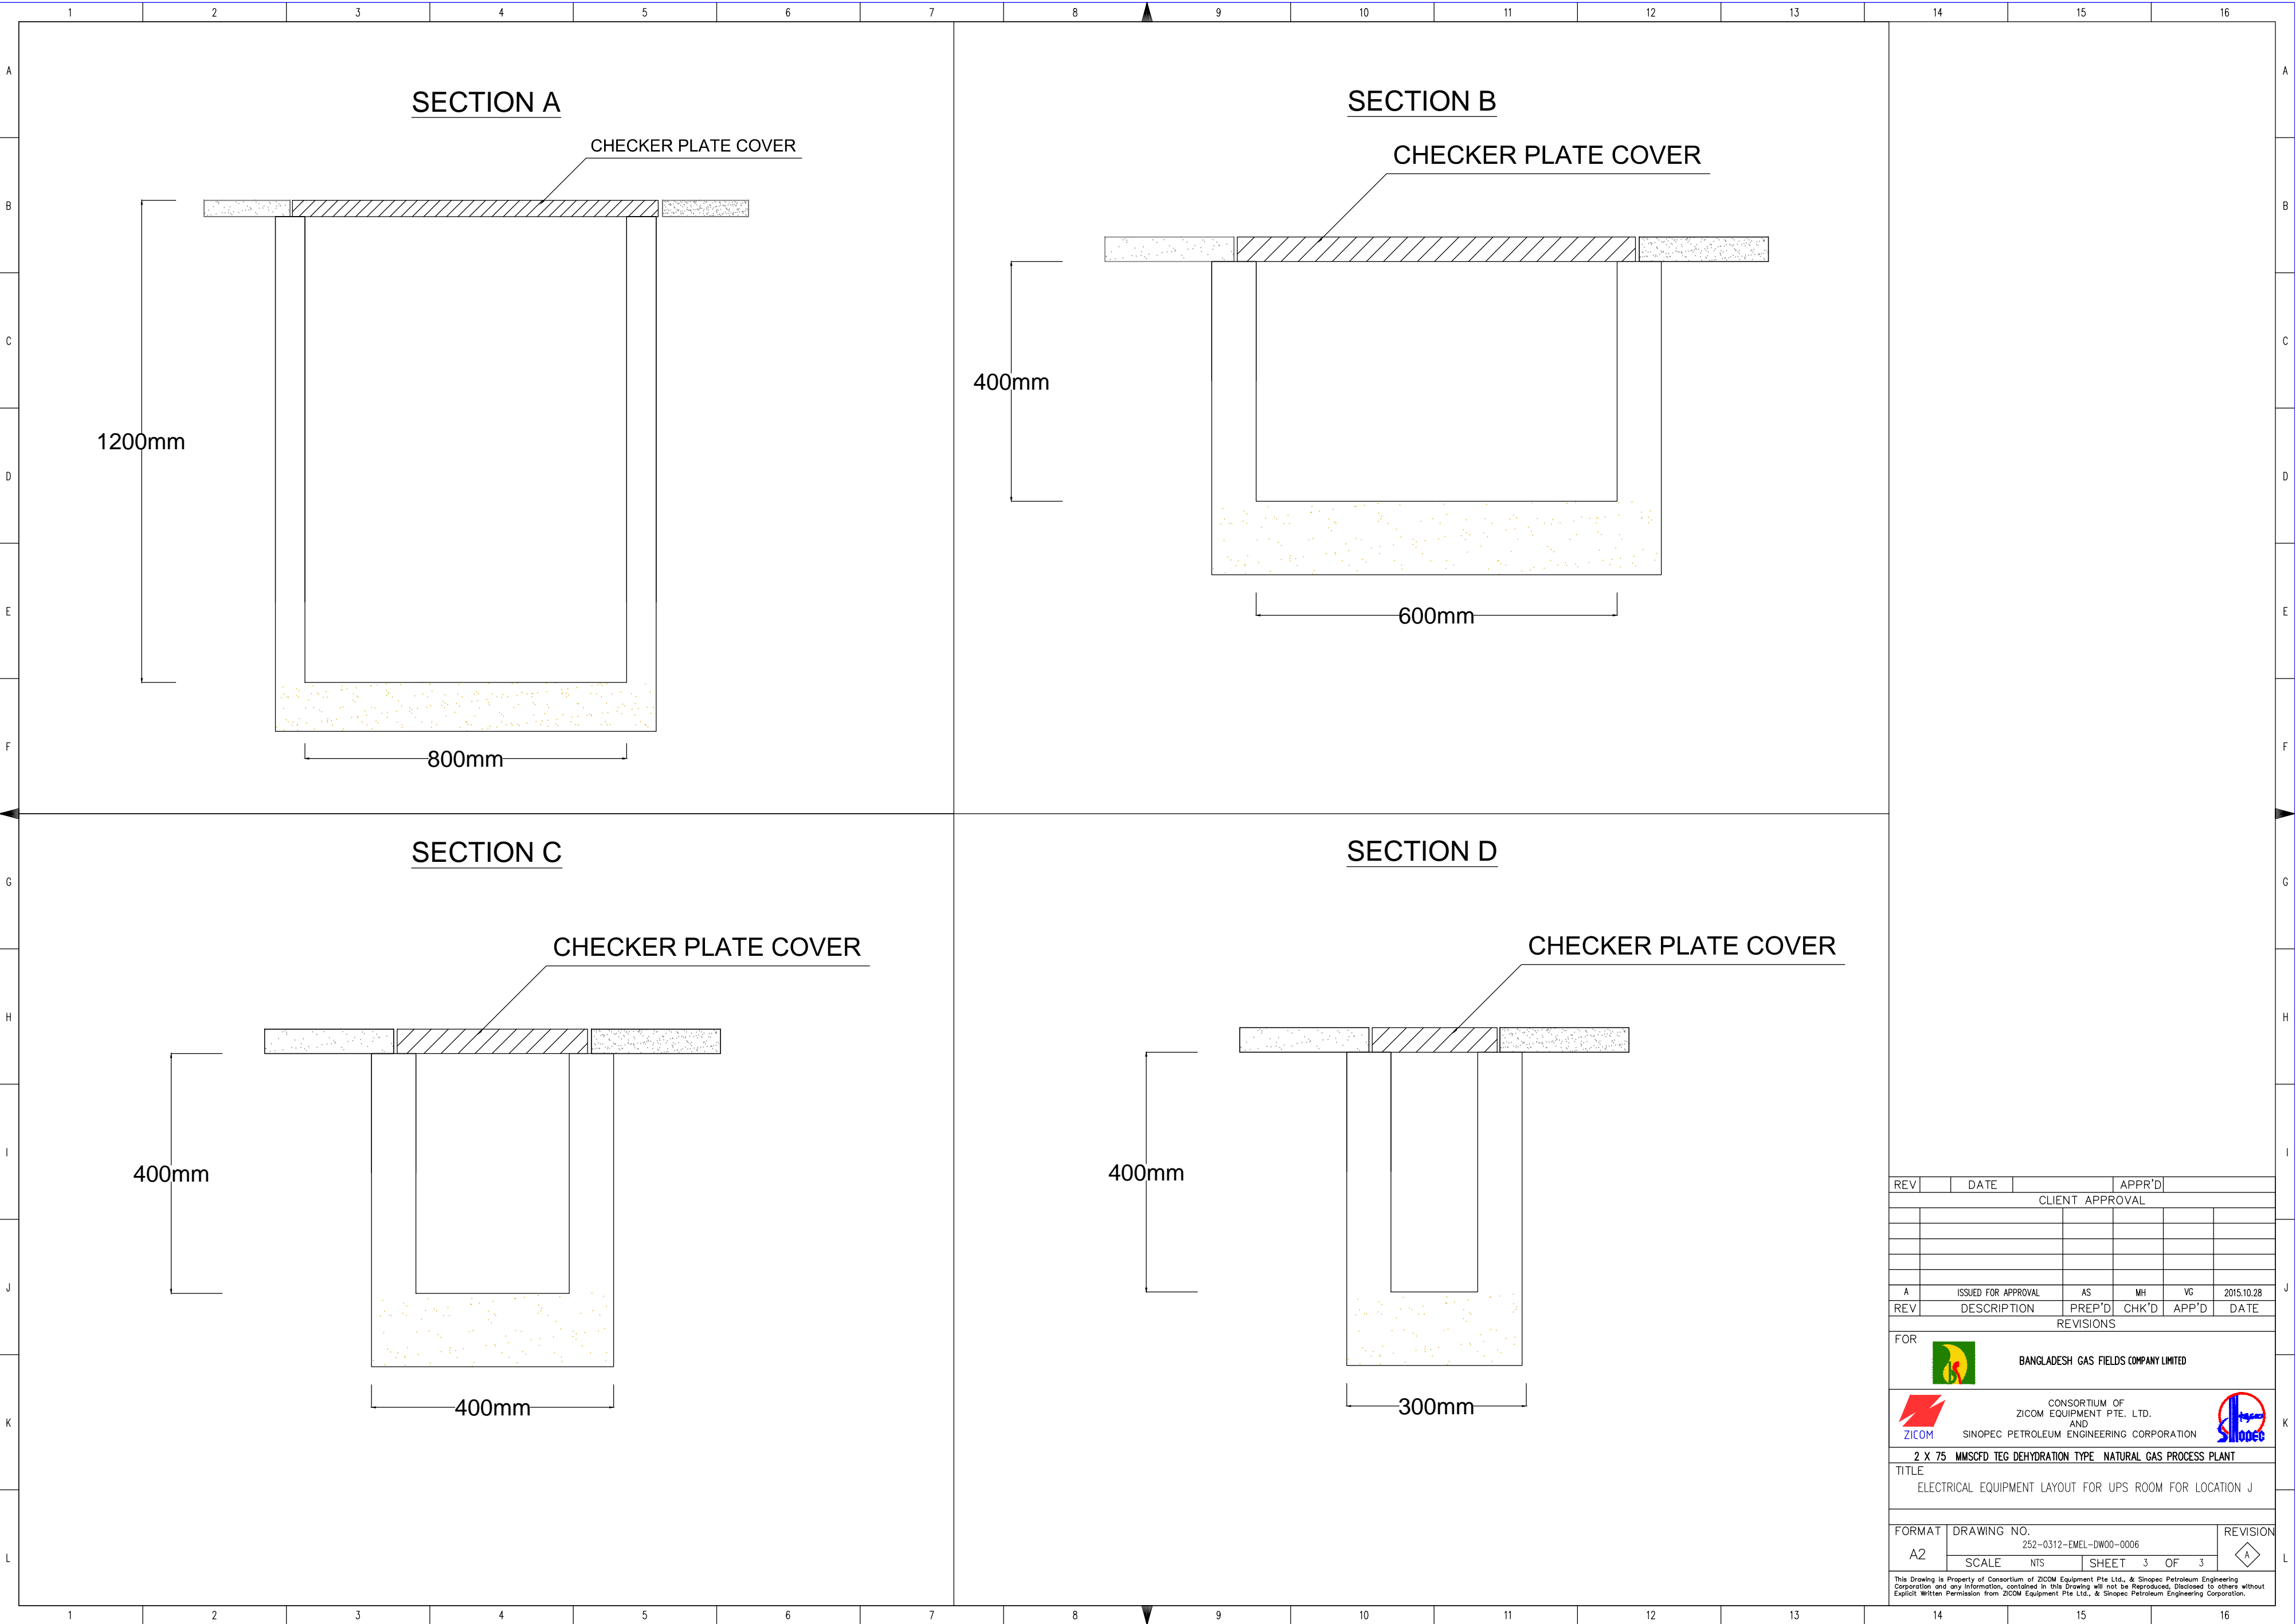- LEGEND**
- CABLE TRENCH
 - 3" PVC CONDUIT UNDER FLOOR LEVEL

REV	DATE		APPR'D		
CLIENT APPROVAL					
A	ISSUED FOR APPROVAL		AS	MH	VG 2015.10.28
REV	DESCRIPTION		PREP'D	CHK'D	APP'D DATE
REVISIONS					
FOR					
<div>BANGLADESH GAS FIELDS COMPANY LIMITED</div>					
<div><div><div>ZICOM</div></div><div>CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION</div><div><div>SINOPEC</div></div></div>					
2 X 75 MMSCFD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT					
TITLE					
ELECTRICAL EQUIPMENT LAYOUT FOR UPS ROOM FOR LOCATION J					
FORMAT		DRAWING NO.			REVISION
A2		252-0312-EMEL-DW00-0006			<div><div></div>A</div>
		SCALE	1:50	SHEET 2 OF 3	
<div>This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.</div>					



REV	DATE		APPR'D			
CLIENT APPROVAL						
A	ISSUED FOR APPROVAL		AS	MH	VG	2015.10.28
REV	DESCRIPTION		PREP'D	CHK'D	APP'D	DATE
REVISIONS						
FOR						
		BANGLADESH GAS FIELDS COMPANY LIMITED				
		CONSORTIUM OF ZICOM EQUIPMENT PTE. LTD. AND SINOPEC PETROLEUM ENGINEERING CORPORATION				
2 X 75 MMSCFD TEG DEHYDRATION TYPE NATURAL GAS PROCESS PLANT						
TITLE ELECTRICAL EQUIPMENT LAYOUT FOR UPS ROOM FOR LOCATION J						
FORMAT		DRAWING NO.				REVISION
A2		252-0312-EMEL-DW00-0006				
		SCALE	NTS	SHEET	3 OF 3	
<small>This Drawing is Property of Consortium of ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation and any information contained in this Drawing will not be Reproduced, Disclosed to others without Explicit Written Permission from ZICOM Equipment Pte Ltd., & Sinopec Petroleum Engineering Corporation.</small>						