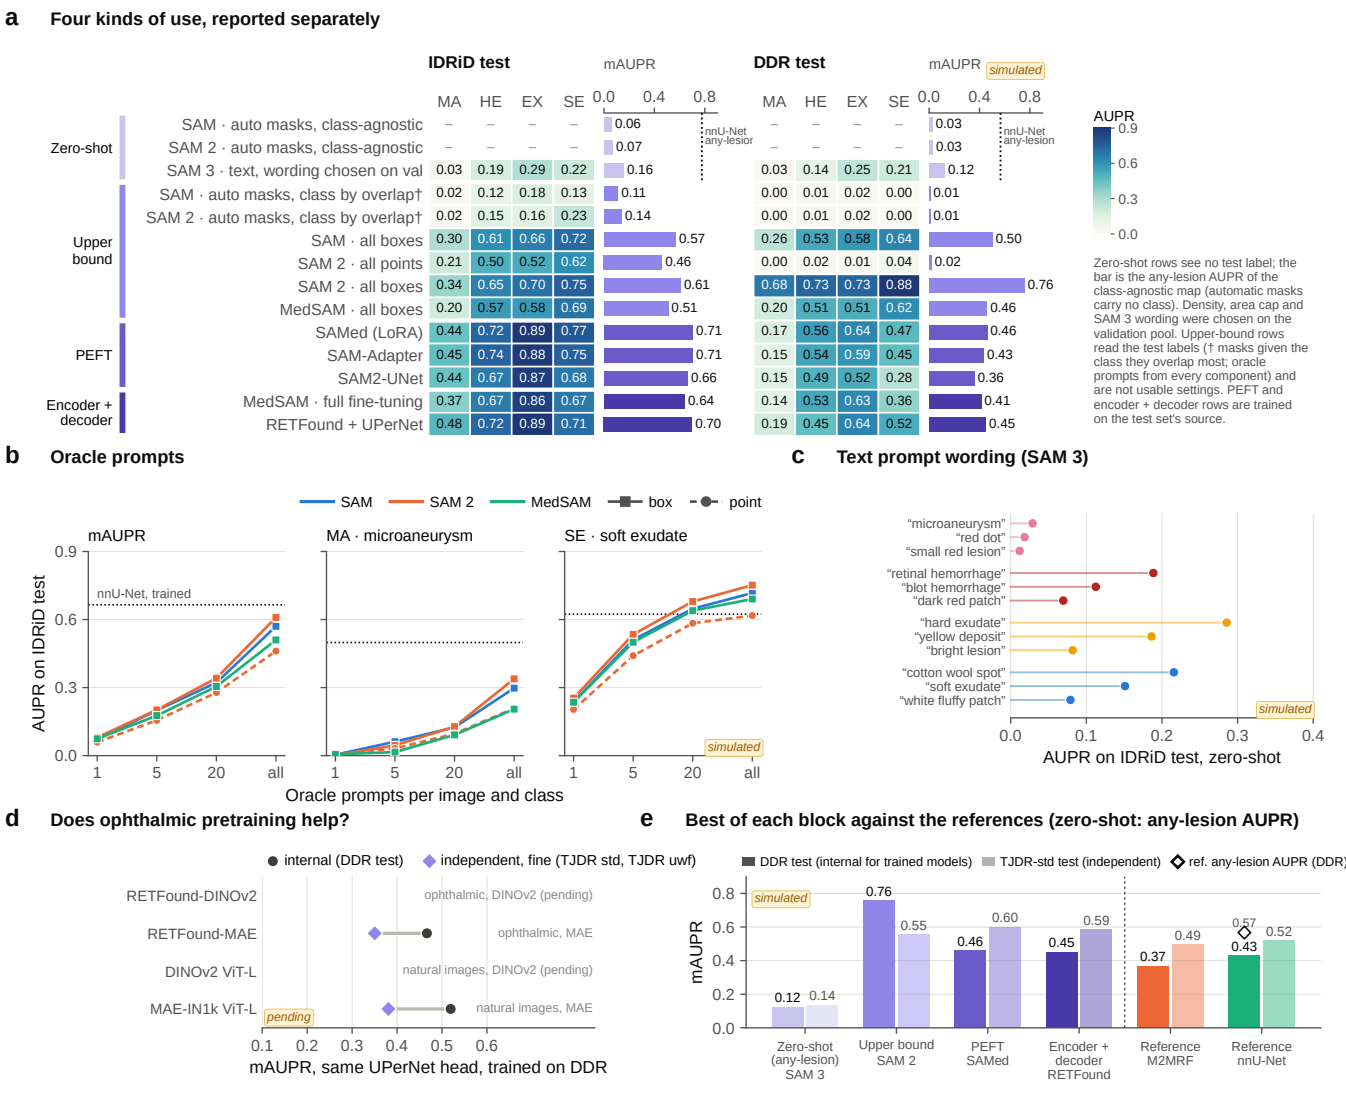

a
Four kinds of use, reported separately
IDRiD test
DDR test
mAUPR
simulated
MA HE EX SE
0.0 0.4 0.8
Zero-shot
Upper bound
PEFT
Encoder + decoder
SAM · auto masks, class-agnostic
SAM 2 · auto masks, class-agnostic
SAM 3 · text, wording chosen on val
SAM · auto masks, class by overlap†
SAM 2 · auto masks, class by overlap†
SAM · all boxes
SAM 2 · all points
SAM 2 · all boxes
MedSAM · all boxes
SAMed (LoRA)
SAM-Adapter
SAM2-UNet
MedSAM · full fine-tuning
RETFound + UPerNet
nnU-Net any-lesion
AUPR
0.9
0.6
0.3
0.0
Zero-shot rows see no test label; the bar is the any-lesion AUPR of the class-agnostic map (automatic masks carry no class). Density, area cap and SAM 3 wording were chosen on the validation pool. Upper-bound rows read the test labels († masks given the class they overlap most; oracle prompts from every component) and are not usable settings. PEFT and encoder + decoder rows are trained on the test set's source.
b
Oracle prompts
SAM
SAM 2
MedSAM
box
point
mAUPR
MA · microaneurysm
SE · soft exudate
AUPR on IDRiD test
nnU-Net, trained
simulated
1 5 20 all
Oracle prompts per image and class
c
Text prompt wording (SAM 3)
“microaneurysm”
“red dot”
“small red lesion”
“retinal hemorrhage”
“blot hemorrhage”
“dark red patch”
“hard exudate”
“yellow deposit”
“bright lesion”
“cotton wool spot”
“soft exudate”
“white fluffy patch”
simulated
0.0 0.1 0.2 0.3 0.4
AUPR on IDRiD test, zero-shot
d
Does ophthalmic pretraining help?
internal (DDR test)
independent, fine (TJDR std, TJDR uwf)
RETFound-DINOv2
ophthalmic, DINOv2 (pending)
RETFound-MAE
ophthalmic, MAE
DINOv2 ViT-L
natural images, DINOv2 (pending)
MAE-IN1k ViT-L
natural images, MAE
pending
0.1 0.2 0.3 0.4 0.5 0.6
mAUPR, same UPerNet head, trained on DDR
e
Best of each block against the references (zero-shot: any-lesion AUPR)
DDR test (internal for trained models)
TJDR-std test (independent)
ref. any-lesion AUPR (DDR)
mAUPR
simulated
0.12 0.14
0.76 0.55
0.46 0.60
0.45 0.59
0.37 0.49
0.57
0.43 0.52
Zero-shot (any-lesion) SAM 3
Upper bound SAM 2
PEFT SAMed
Encoder + decoder RETFound
Reference M2MRF
Reference nnU-Net