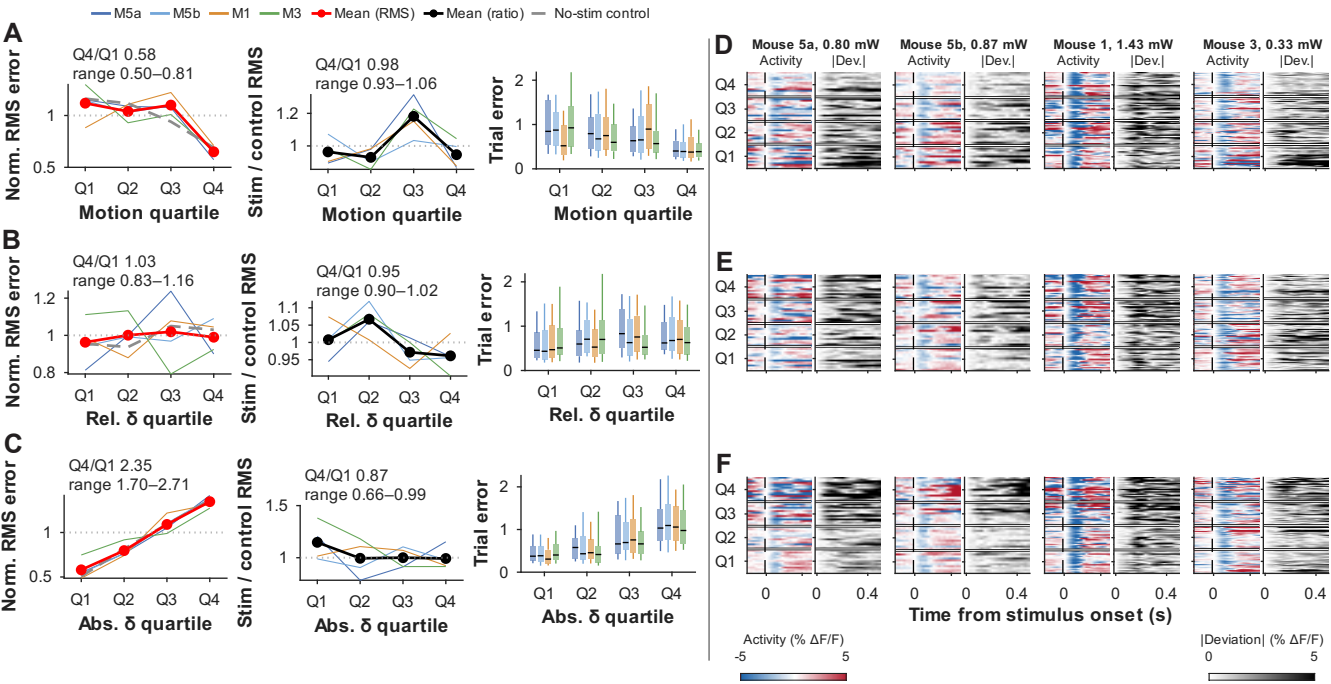

M5a
M5b
M1
M3
Mean (RMS)
Mean (ratio)
No-stim control
A
Q4/Q1 0.58
range 0.50–0.81
Norm. RMS error
Motion quartile
Q4/Q1 0.98
range 0.93–1.06
Stim / control RMS
Motion quartile
Trial error
Motion quartile
B
Q4/Q1 1.03
range 0.83–1.16
Norm. RMS error
Rel. δ quartile
Q4/Q1 0.95
range 0.90–1.02
Stim / control RMS
Rel. δ quartile
Trial error
Rel. δ quartile
C
Q4/Q1 2.35
range 1.70–2.71
Norm. RMS error
Abs. δ quartile
Q4/Q1 0.87
range 0.66–0.99
Stim / control RMS
Abs. δ quartile
Trial error
Abs. δ quartile
D
Mouse 5a, 0.80 mW
Mouse 5b, 0.87 mW
Mouse 1, 1.43 mW
Mouse 3, 0.33 mW
Activity
|Dev.|
E
F
Time from stimulus onset (s)
Activity (% ΔF/F)
|Deviation| (% ΔF/F)