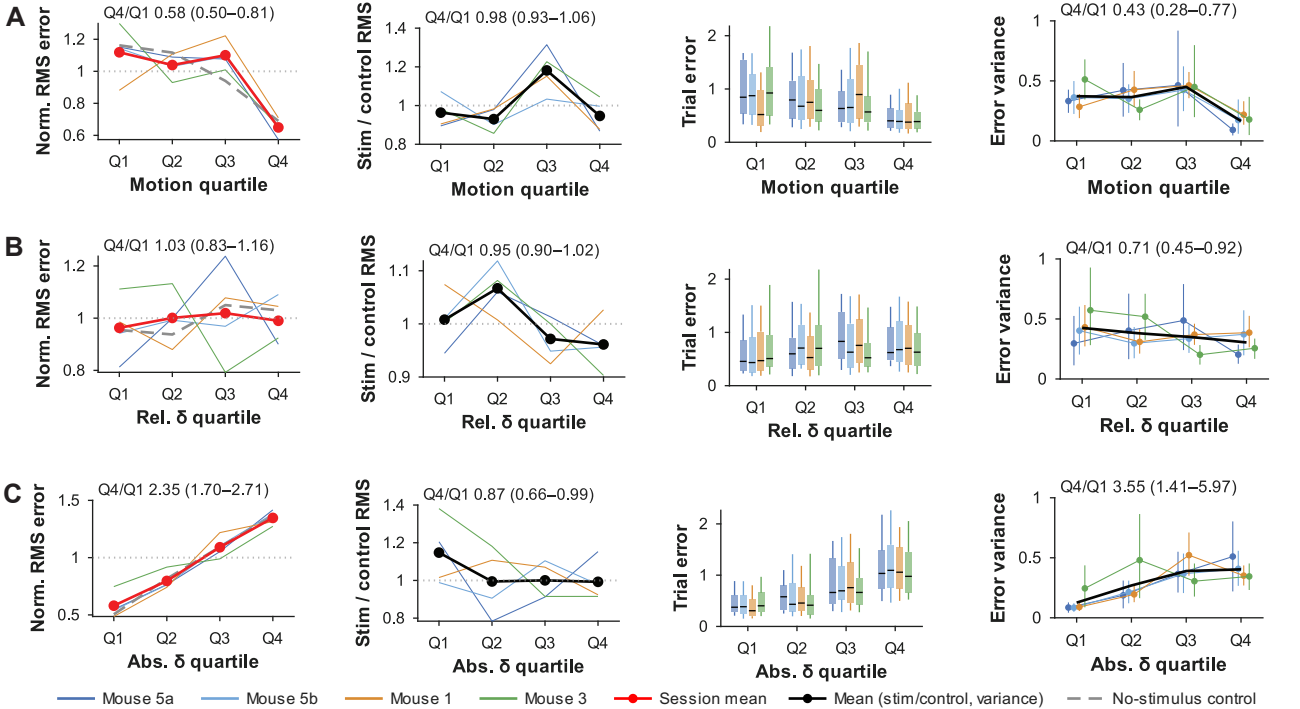

A
Norm. RMS error
Q4/Q1 0.58 (0.50–0.81)
Motion quartile
Stim / control RMS
Q4/Q1 0.98 (0.93–1.06)
Motion quartile
Trial error
Motion quartile
Error variance
Q4/Q1 0.43 (0.28–0.77)
Motion quartile
B
Norm. RMS error
Q4/Q1 1.03 (0.83–1.16)
Rel. δ quartile
Stim / control RMS
Q4/Q1 0.95 (0.90–1.02)
Rel. δ quartile
Trial error
Rel. δ quartile
Error variance
Q4/Q1 0.71 (0.45–0.92)
Rel. δ quartile
C
Norm. RMS error
Q4/Q1 2.35 (1.70–2.71)
Abs. δ quartile
Stim / control RMS
Q4/Q1 0.87 (0.66–0.99)
Abs. δ quartile
Trial error
Abs. δ quartile
Error variance
Q4/Q1 3.55 (1.41–5.97)
Abs. δ quartile
Q1
Q2
Q3
Q4
Mouse 5a
Mouse 5b
Mouse 1
Mouse 3
Session mean
Mean (stim/control, variance)
No-stimulus control