



2019 Data for Ground Water


pH of States

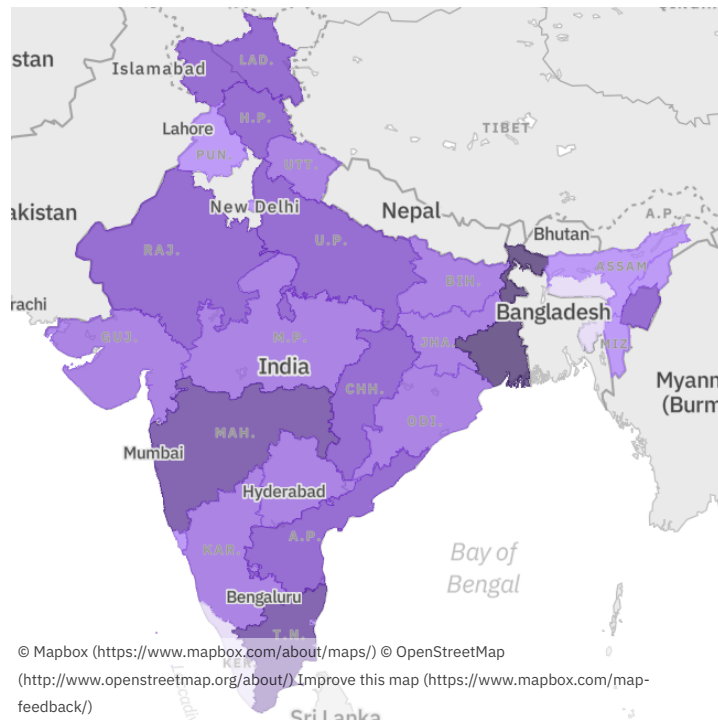

Maximum Temperature by State Name

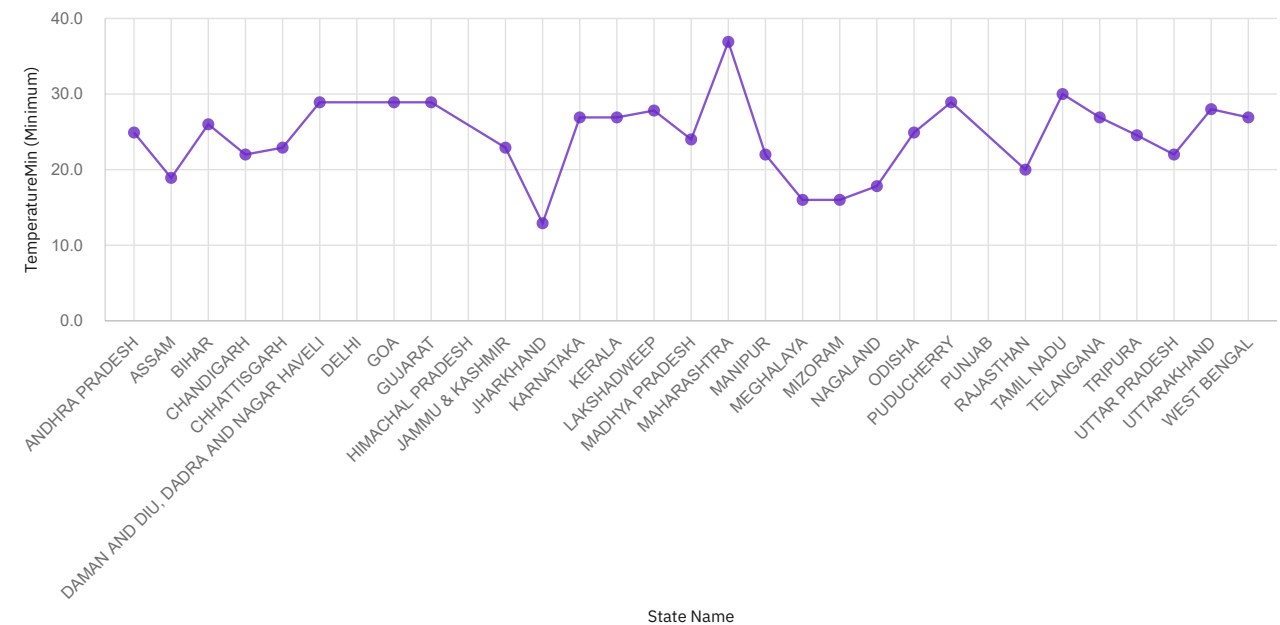

BOD vs pH

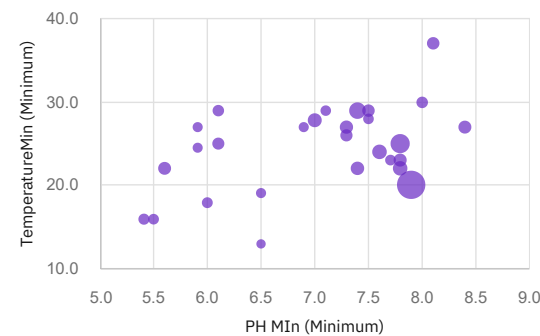

Clean Water
pH range: 6.5 - 8.5

