



West Bengal State Electricity Distribution Company Limited

(A Government of West Bengal Enterprise)

Vidyut Bhavan (4th floor) DJ Block, Sec-II Salt Lake, Kolkata- 700 091

CIN: U40109WB2007SGC113473, Web: www.wbsedcl.in,

e-mail: cereg@wbsedcl.in Telephones : 2359-8391, Extn-364

Regulation Cell

Memo. No. : REG/SERC/

Date: 17.11.2025

To

The C.E. (Distribution-North)/ C.E. (Distribution-South)/ C.E. (IT)/ C.E. (Comml.)/ C.E. (SPGD)/ C.E. (PTP)/ C.E. (DTD)/ C.E. (Proj.-I)/ C.E. (Proj.-II)/ C.E. (Proj.-III)/ C.E. (Proj.-IV)/ C.E. CRM)/ C.E. (P&E)/ C.E. (R&EM)/ C.E. (S&LP)/ C.E. (Safety)/ G.M. (HR&A-Planning)/ G.M. (HR&A-Operation)/ G.M. (HR&A-HRDD)/ G.M. (F&A-Planning)/ G.M. (F&A-Operation), WBSEDCL.

Sub: Detailed procedures of Grid Interactive Rooftop Solar Photovoltaic System under Net-Metering/ Net-Billing/ Gross-Metering arrangement under WBSEDCL Procedure-C (2025) in terms of WBERC (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025.

Sir,

Hon'ble Commission has issued an order on 11.11.2025 in Case No. OA-534/25-26 regarding detailed procedures of Grid Interactive Rooftop Solar Photovoltaic System under Net-Metering/ Net-Billing/ Gross-Metering arrangement under WBSEDCL Procedure-C (2025) in terms of WBERC (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025. The copy for the said order along with detailed procedure and subsequent note of approval of the competent authority are send through e-mail dated 17.11.2025 for your kind perusal and further necessary action please. Copy of the e-mail is attached.

Enclo: As above.

Yours faithfully

Sd./-

(S. Sarkar)


Chief Engineer (Regulation)

Memo. No. : REG/SERC/ 184 (1-3),

Date: 17.11.2025

Copy to:

1. Sr. PS to Dir (R&T)/ (Dist.)/ (Project)/ (Gen.)/ (Finance)/ (HR) WBSEDCL.
2. Sr. P.S. to ED (Dist)/ (Comml.)/ (Project), WBSEDCL.
3. P.S. to CMD, WBSEDCL.


17/11/25
Chief Engineer (Regulation)


WBSEDCL

WEST BENGAL STATE ELECTRICITY DISTRIBUTION COMPANY LTD.

(A GOVERNMENT OF WEST BENGAL ENTERPRISE)

Note Sheet

Sub: Order passed by the Hon'ble WBERC regarding procedure (WBSEDCL Procedure-C (2025)) of Grid Interactive Rooftop Solar Photovoltaic System under Net-Metering/ Net-Billing/ Gross-Metering arrangement as per WBERC (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025 (GRISPV Regulations) notified by the Hon'ble WBERC on 31.07.2025.

Hon'ble WBERC has notified WBERC (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025 on 31.07.2025 vide Notification No. 81/WBERC.

In this regard a procedure (WBSEDCL Procedure-C (2025)) was submitted by the WBSEDCL before the Hon'ble WBERC for approval of the same. Now, Hon'ble WBERC passed an order in this regard on 11.11.2025 in Case No. OA-534/25-26 with following observation:

- For implementation of government scheme if network augmentation/ strengthening is required that will be recovered from the said project/ scheme where the provision of the scheme requires installation of solar capacity higher than the 'contracted demand'.
- Other proposal regarding switchover from one category to another or switchover of existing prosumers and periodicity of testing, etc. which are found align with the provisions and spirit of the GRISPV Regulations. It may also be noted that during switchover from one category to another, the initial agreement shall be modified to the extent, as applicable.
- The procedure shall be implemented within one month from the date of issuance of this order.

In view of the above, the commission considering the provisions of regulation 21 (1) of the GRISPV Regulations 2025, approves the exemption as mentioned under paragraph 4.0 for implementation of Government projects/ Schemes under WBSEDCL Procedure-C (2025). Commission also directed to carry out necessary software modifications and implement the same with online facilities of Net-metering/ Net-billing/ Gross-metering within one month from the date of issuance of this order.

A copy of the order and WBSEDCL Procedure-C (2025) are attached for perusal.

Placed to ACE, Reg Cell. for his kind perusal and further necessary action, please

Enclo: As stated above

M. Das
12/11/2025
(M. Das)

S.E. (E) – II, Reg. Cell

Dir(R&T)/NR/ 115
Date: 13/11/25
14/11/25

CMD/NS/ 524
13 NOV 2025

Memo No.
Reg/WBERC/NS/223
Dt. 13.11.2025

REG/SEC/
Dt.
ACE, Reg Cell.

P.T.O.

Notes pre-pages

Pursuant to the observation of WBERC at paragraph 5.0 of the said order dated 11/11/2025, and following further discussions with WBERC, it has been agreed that the various provisions incorporated in the WBSEDCL PROCEDURE-C(2025), being in conformity with the provisions and spirit of the regulations, shall not require separate approval.

In the absence of the Chief Engineer (Regulation), the matter is being placed directly before the Director (R&T) for kind perusal and necessary advice, considering the urgency.

~~Director (R&T)~~

22/11/25

13/11/25

~~CE~~

CHD

~~Dir (R&T)~~

18/11/25

14/11/25

17/11/25

CO/Reg

ACE



**ORDER
OF THE
WEST BENGAL ELECTRICITY REGULATORY
COMMISSION**

IN CASE NO. OA-534/25-26

**APPROVAL OF THE EXEMPTION SOUGHT FOR THE
IMPLEMENTATION OF PROCEDURE OF GRID INTERACTIVE
ROOFTOP SOLAR PHOTOVOLTAIC SYSTEM UNDER NET-
METERING / NET-BILLING/ GROSS-METERING ARRANGEMENT
(WBSEDCL PROCEDURE-C (2025)).**

DATE: 11.11.2025



Approval of the exemption sought for the implementation of Procedure of
Grid Interactive Rooftop Solar Photovoltaic System Under Net-metering /
Net-billing/ Gross-metering Arrangement (WBSEDCL PROCEDURE-C
(2025))

Facts in brief

- 1.0 The West Bengal State Electricity Distribution Company (in short WBSEDCL) has submitted an application on 24.09.2025 for approval of detailed procedure of Grid Interactive Rooftop Solar Photovoltaic System under Net-metering / Net-billing / Gross-metering arrangement named as WBSEDCL PROCEDURE – C (2025), in terms of regulation 6.1 of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations 2025 (hereinafter referred as 'GIRSPV Regulations'). The petition was admitted on 15.10.2025 and registered as Case No. OA – 534/25-26. Subsequently, WBSEDCL submitted a supplementary petition on 03.11.2025 with a modified PROCEDURE – C (2025) in replacement of the procedure submitted under Annexure-I of the original petition dated 24.09.2025. The supplementary petition was admitted on 04.11.2025.
- 2.0 WBSEDCL in its application and through subsequent supplementary petition has prayed for approval of the detailed procedure along with relaxation / exemption / modification on the following major matters in order to remove difficulty:
 - 2.1. It is proposed that, the installed capacity of Solar PV system may be relaxed in respect of Government Funded projects / schemes, where the provision of the scheme requires installation of solar capacity higher than the 'contract demand'. WBSEDCL in its procedure through supplementary petition has proposed that, such installations may be allowed subject to technical feasibility and payment of any required distribution system upgradation cost. WBSEDCL also proposed for exemption of application fees for Government funded schemes / projects.
 - 2.2. It is proposed that in case of any change of supply voltage of the prosumer under net-billing or gross-metering arrangement due to any reason, the feed in tariff of the said voltage level in that financial year when the initial agreement was executed, will be applicable.
 - 2.3. Regarding the provision of switchover from one category to another permitted under regulation 5(10) of the GIRSPV Regulations, WBSEDCL proposed the followings:
 - (i) Feed-in tariff once agreed by the prosumers in any previous agreement will be valid for the entire useful life of the solar PV system irrespective of number of switching over from one category to another.



Approval of the exemption sought for the implementation of Procedure of
Grid Interactive Rooftop Solar Photovoltaic System Under Net-metering /
Net-billing/ Gross-metering Arrangement (WBSEDCL PROCEDURE-C
(2025))

- (ii) In line with the second proviso of regulation 5(10), at the time of switching over from Net-billing / Gross-metering arrangement to Net-metering / Gross-metering arrangement, as the case may be, any unsettled amount shall be refunded through energy bill(s) after switchover.
- 2.4. WBSEDCL proposed that for alteration of sanctioned load / contract demand, if required at the time of switchover from one category to another, prosumer shall apply separately for such change in sanctioned load /contract demand as per the provisions of relevant Regulations/ Procedure and switchover shall be allowed after effecting alteration of sanctioned load / contract demand.
- 2.5. Regarding switchover of existing prosumers, WBSEDCL proposed that, eligibility will be determined as per the GIRSPV Regulations. However, the feed-in tariff as mentioned in the initial agreement will continue. It is also submitted that the generic tariff of existing prosumers under net-billing shall be considered as feed-in tariff under GIRSPV Regulations.
- 2.6. Regarding periodicity of testing and fitness certificate as under third proviso of the regulation 8(5) of the GIRSPV Regulations, WBSEDCL proposed the followings:
- (i) Prosumers shall have to furnish certificate of fitness from authorised agencies of WBSEDCL, whose details will be available on the website of WBSEDCL with following periodicity:
 - Every two years for PV output above 170 kW (200 kVA)
 - Every three years for PV output upto 170 kW (200 KVA)
 - (ii) If installation remains out of operation for more than six months consumers have to furnish fitness certificate afresh from the authorised agencies of WBSEDCL along with clearance from office of the Chief Electrical Inspector of West Bengal or self-certification as per format (below notified voltage) in accordance with CEA Safety regulations.
- 2.7. It is proposed that, if a prosumer fails to generate Solar generation within one year from the date of agreement or discontinue the solar generation for more than one year for any reason whatsoever, then the agreement shall be automatically cancelled.
- 2.8. It is proposed that, in case of defective/ defunct meter or in case of inaccessibility to meters, assessment of drawal energy including energy export (for net-metering) shall



Approval of the exemption sought for the implementation of Procedure of
Grid Interactive Rooftop Solar Photovoltaic System Under Net-metering /
Net-billing/ Gross-metering Arrangement (WBSEDCL PROCEDURE-C
(2025))

be computed based on the provisions of the Electricity Supply Code. Assessment of solar generation shall be on the basis of average generation and other parameters of the preceding month or during any previous period.

- 2.9. WBSEDCL also prayed for two months' time to modify software and to implement the PROCEDURE – C (2025).

Observations of the Commission:

- 3.0 In terms of regulation 6(1) of the GIRSPV Regulations, each distribution licensee has to prepare a 'detailed procedure' or update their existing 'detailed procedure' in connection with net-metering / net-billing / gross-metering to align with the GIRSPV Regulations and upload the same in its website / online portal. There is no regulatory requirement of approval of the detailed procedure by the Commission.
- 4.0 WBSEDCL in its petition has expressed certain difficulties and express proposals for implementation of the provisions of the GIRSPV Regulations as well as certain exemptions for implementation of Government projects/ Schemes as mentioned under paragraph 2.1. The Commission observes that, for implementation of government schemes if any network augmentation / strengthening is required that will be recovered from the said project / scheme.
- 5.0 WBSEDCL in its petition has included other proposals regarding switchover from one category to another or switchover of existing prosumers and periodicity of testing, etc. which are found align with the provisions and spirit of the GIRSPV Regulations. It may also be noted that during switchover from one category to another, the initial agreement shall be modified to that extent, as applicable.
- 6.0 WBSEDCL has sought two months' time for software modification and implementation of PROCEDURE – C (2025), from the date of approval of the Commission. The Commission notes that, the petition was submitted on 24th September 2025 and two months from that date is 24th November 2025. However, considering the Puja Holidays during these periods the Commission directs to implement the PROCEDURE – C (2025) within one month from the issuance of this order.



Approval of the exemption sought for the implementation of Procedure of
Grid Interactive Rooftop Solar Photovoltaic System Under Net-metering /
Net-billing/ Gross-metering Arrangement (WBSEDCL PROCEDURE-C
(2025))

Order:

- 7.0 In view of the above, the Commission considering the provisions of regulation 21(1) of the GIRSPV Regulations 2025, approves the exemption as mentioned under paragraph 4.0 for implementation of Government projects/ Schemes under WBSEDCL PROCEDURE – C (2025). WBSEDCL is also directed to carry out necessary software modifications and implement the same with online facilities of net-metering / net-billing / Gross-metering within one month from the date of issuance of this order.
- 8.0 The petition is disposed of.
- 9.0 A copy of the order shall be posted in the website of the Commission.
- 10.0 WBSEDCL shall download the copy of the order from the website of the Commission and act on it. Certified copy of the order, if applied for, be given to the parties on completion of formalities laid down in the West Bengal Electricity Regulatory Commission (Conduct of Business) Regulations, 2013, as amended and on submission of necessary fees.

Sd/-

(DR. MALLELA VENKATESWARA RAO)
CHAIRPERSON

Dated: 11.11.2025

Sd/-

DEPUTY DIRECTOR, WBERC

**DETAILED PROCEDURES OF GRID
INTERACTIVE ROOFTOP SOLAR
PHOTOVOLTAIC SYSTEM FOR NET-
METERING, NET-BILLING AND GROSS-
METERING ARRANGEMENT**

UNDER

WBSEDCL PROCEDURES-C (2025)

IN TERMS OF

**WEST BENGAL ELECTRICITY REGULATORY COMMISSION
(GRID INTERACTIVE ROOFTOP SOLAR PHOTOVOLTAIC
SYSTEM FOR PROSUMERS) REGULATIONS, 2025**



WBSEDCL

West Bengal State Electricity Distribution Company Ltd.


(A Government of West Bengal Enterprise)

1.0 PREAMBLE:

- 1.1 These procedures for effecting connection of Grid Interactive Rooftop Solar Photovoltaic (herein after referred as 'GIRSPV') system under Net-metering/ Net-billing/Gross-metering arrangement by WBSEDCL named as '**WBSEDCL PROCEDURES-C (2025)**' have been prepared in accordance with regulation 6(1) of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025 (hereinafter referred to as 'GIRSPV Regulation') in supersession of previous procedures named as 'WBSEDCL PROCEDURES-C(2021)'. Hon'ble West Bengal Electricity Regulatory Commission approved the **WBSEDCL PROCEDURES-C (2025)** vide order dated
- 1.2 Accordingly the effective date of coming into force of these WBSEDCL PROCEDURES-C (2025) shall be..... Henceforth all connections/alteration/switchover of GIRSPV System for Prosumers under Net-metering/ Net-billing/Gross-metering arrangement shall be effected under these WBSEDCL PROCEDURES-C (2025).
- 1.3 Under these procedures, WBSEDCL shall permit total installation of Net-metering Rooftop solar PV system at least upto the limits as specified by the West Bengal Electricity Regulatory Commission time to time. Application received by WBSEDCL in a financial year after fulfilling the overall limit shall be considered in the next financial year in the same serial.
- 1.4 For further interpretation / clarification, if any, GIRSPV Regulations may be referred to.

2.0 SALIENT STIPULATIONS:

- 2.1 While the prosumer will retain their consumer status and the associated rights as of the general consumer, they shall also have the right to set up GIRSPV System — either independently or through a service provider such as Renewable Energy Service Company ("RESCO") or Utility Led Aggregation ("ULA"), on a first-come-first-serve basis, subject to limitations of GIRSPV regulations. In addition to rooftops, GIRSPV System may also be installed on other parts of prosumer's premises, however, the total installed capacity shall not exceed "Contract demand" or "Sanctioned load" except the exception as laid down in Clause 2.5 of this procedure.
- 2.2 The Prosumers may opt for Net-metering, Net-billing or Gross-metering mechanism to set up a GIRSPV system under the above Regulation.
- 2.3 Sanctioned load or contract demand of the prosumers shall be 1kW and above.
- 2.4 Installed capacity of GIRSPV System shall be 1 kWp and above.

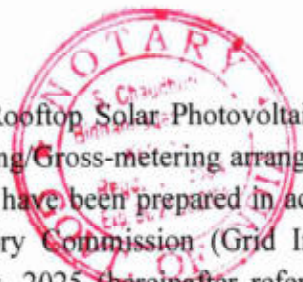
Santanu Sarkar
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

- 2.5 The installed capacity of the GIRSPV System (in kWp) shall not exceed the prosumer's Contract demand or sanctioned Load(in kW), except for Government –funded projects or schemes where higher capacity is permitted under their provisions, subject to technical feasibility and payment of any required distribution system upgradation cost.
- 2.6 All type of prosumers having GIRSPV System with a capacity upto 500kW or the prosumer's Sanctioned Load/Contract demand whichever is lower may avail Net-metering arrangement.
- 2.7 All type of prosumers having GIRSPV System with a capacity of maximum upto Sanctioned Load/Contract demand may avail Net-billing/ Gross-metering arrangement.
- 2.8 The GIRSPV System of prosumer shall be allowed connectivity at the same voltage level at which the Prosumer is supplied by WBSEDCL.

AC Voltage level of Solar Injection for Net-metering/ Net-billing/ Gross-metering arrangement shall be as below:

- i. For Sanctioned Load/Contract demand upto 170 kW (200 kVA): 230/240 V (single-phase) or 400/415 V (three-phase) at which the prosumer has been given supply.
- ii. For Sanctioned Load/Contract demand above 170 kW (200 kVA): 11 kV and above at which the prosumer has been given supply.

Provided HT prosumer may install and connect its GIRSPV System at its LT bus bar but the meter under Net-metering and Net-billing arrangement shall be installed on the HT side of the Prosumer's transformer.

- 2.9 Cumulative capacity of GIRSPV system allowed to be interconnected with the distribution network (feeder/distribution transformer) shall not exceed 100% of the feeder and/or distribution transformer capacity, as applicable.
- 2.10 Net-metering or Net-billing or Gross-metering arrangement as the case may be, shall be permitted in a non-discriminatory basis and distribution transformer-wise or feeder-wise on 'first come first serve' basis.

3.0 RESPONSIBILITY:

- 3.1 In case of Net-metering/ Net-billing the prosumers shall be responsible for safe installation, operation, maintenance and rectification of any defect of the GIRSPV System up to the point of net-meter.

Beyond the net meter responsibility of safe operation, maintenance and rectification of any defect in the system, including the net meter, shall be that of the WBSEDCL as per the provisions specified in the Central Electricity Authority (Measures relating to Safety and Electricity Supply) Regulations, 2023 and subsequent amendments thereof.

- 3.2 In case of Gross-metering the prosumers shall be responsible for safe installation, operation, maintenance and rectification of any defect of the GIRSPV System upto the point of Generation meter and WBSEDCL shall be responsible for safe installation, operation, maintenance and rectification of any defect from Generation meter upto the point of interconnection as per the provisions specified in the Central Electricity Authority (Measures relating to Safety and Electricity Supply) Regulations, 2023 and subsequent amendments thereof.
- 3.3 The prosumers may install the GIRSPV System with or without battery backup, provided that if the prosumer prefer setting up of Rooftop Solar PV System with battery backup (full load backup/partial load backup), the inverter shall have appropriate arrangement to automatically prevent the battery power from flowing into the grid in the absence of grid supply in addition to manual isolation switch that shall also have to be provided.
- 3.4 The prosumers shall ensure that the GIRSPV System is equipped with an automatic synchronization device which may be integral part/in-built with the grid tied inverter but for GIRSPV System using a grid tied inverter shall not be required to have a separate synchronizing device, if it is inherently built to the inverter.
- 3.5 Prosumers under Net-metering/ Net- billing / Gross-metering shall furnish a certificate of fitness conforming to correct operation of islanding, harmonics present and other Power Quality parameters from the Original Equipment Manufacturers (OEM) suppliers i.r.o. Solar module, inverter, battery etc. which may be tested in any National Accreditation Board for Testing and Calibration Laboratories (NABL) accredited testing centres in India. Periodicity and the procedure of such testing have been specified in the procedure 8.
- 3.6 WBSEDCL shall be responsible for the testing, installation and maintenance of the metering equipment, and its adherence to the applicable standards and specifications.
- 3.7 WBSEDCL shall ensure that financial incentives are passed on to the prosumers under applicable Central and State Government schemes.

4.0 CODES AND STANDARDS

- 4.1 WBSEDCL shall ensure the interconnection of the GIRSPV System for eligible prosumers with its network conforming to the specifications, standards and other provisions specified in the Central Electricity Authority (Technical Standards for connectivity of the Distributed Generation Resources) Regulations, 2013 and its subsequent amendments thereof.

- 4.2 The GIRSPV System must be capable of detecting an unintended islanding condition. The system must have anti-islanding protection to prevent any feeding into the grid in case of failure of supply or grid. Applicable IEC/IEEE technical standards shall be followed to test islanding prevention measure for grid connected inverters.
- 4.3 The inverter shall have the features of filtering out harmonics and other distortions before injecting the energy into the system as per Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 as amended.
- 4.4 The prosumers shall ensure that the GIRSPV System complies with Central Electricity Authority (Measures Relating to safety and Electricity Supply) Regulations, 2023 as amended from time to time.
- 4.5 All meters shall comply with the CEA (Installation and Operation of Meters) Regulations, 2006 and subsequent amendments thereof and the meters shall have an Advanced Metering Infrastructure (AMI) facility with communication port.

5.0 CONNECTION DIAGRAM

Connection diagram of Net-metering or Net-billing or Gross-metering arrangement as the case may be in respect of the prosumers of WBSEDCL in whose premises GIRSPV System will be installed as per GIRSPV Regulations:

- i) Connection Diagram for Net-metering/ Net-billing arrangement with Sanctioned Load/Contract demand upto 170 kW (200 kVA) -Diagram-A.
- ii) Connection Diagram for Net-metering/ Net-billing arrangement with Sanctioned Load/Contract demand above 170 kW (200 kVA) -Diagram-B. [connectivity at same voltage level at which the prosumer has been given supply]
- iii) Connection Diagram for Net-metering/ Net-billing arrangement with Sanctioned Load/Contract demand above 170 kW (200 kVA) -Diagram-C. [connectivity at any lower voltage level at which the prosumer has been given supply]
- iv) Connection Diagram for Gross-metering arrangement with Sanctioned Load/Contract demand upto 170 kW (200 kVA) - Diagram- D.
- v) Connection Diagram for Gross-metering arrangement with Sanctioned Load/Contract demand above 170 kW (200 kVA) - Diagram- E [connectivity at same voltage level at which the prosumer has been given supply]

- vi) Connection Diagram for Gross-metering arrangement upto Sanctioned Load/Contract demand above 170 kW (200 kVA) -Diagram-F. [connectivity at any lower voltage level at which the prosumer has been given supply].



6.0 APPLICATION PROCEDURES:

- 6.1 Eligible prosumers shall download the Application form along with the following formats from the website of WBSEDCL free of cost-

- i) Application form '**Form -S1**
- ii) Agreement in '**Form-S2**' (For Net-metering), '**Form-S3**' (For Net-billing), '**Form-S4**' (For Gross-metering) as the case may be,
- iii) Format of Self certified installation certificate in '**Form-S5**',
- iv) Format for Certification in '**Form-S6**'.

- 6.2 The prosumers desiring installation of GIRSPV System shall have to submit the application through online web portal of WBSEDCL or may submit application in '**Form-S1**' (in duplicate) along with other above forms duly filled in at the concerned office of WBSEDCL with the non-refundable application fees as follows:

- i) For LV& MV -Rs 1000/-
- ii) For HV& EHV - Rs 5000/-

Govt. funded projects or schemes are exempted from application fees.

- 6.3 The person(s) authorized on behalf of WBSEDCL to receive the application form duly filled up with other duly filled up documents as stated above shall upload the same in the web portal. A web-based acknowledgement with a unique registration number shall be generated and sent to the applicant's registered mobile number and email ID within 24 hours of receiving the application. System generated receipt shall be provided to the applicant for application submitted through online. Application shall be deemed received on the date of generation of acknowledgement with registration number.
- 6.4 A web based application tracking system linked to the unique registration number will be provided by WBSEDCL to monitor the application status like receipt of application, site inspection, meter installation and commissioning.
- 6.5 Any necessary enhancement of the Sanctioned load of the consumer as requested by the consumer shall be carried out by WBSEDCL with the recovery of expenditure if any as per relevant regulations of Hon'ble Commission (WBERC) before processing the application under these procedures.

Provided that, for installed capacity of GIRSPV system upto 10 kW, recovery of expenditure for enhancement of the Sanctioned load as per relevant regulations of Hon'ble Commission shall be done through quotation as per procedure 6.8.


- 6.6 After complying with above instruction as stated at procedure 6.3, for installed capacity of GIRSPV system upto 10kW shall be deemed accepted without requiring any technical feasibility study and for installed capacity of GIRSPV system above 10 kW, an inspection at the premises to which Net-metering/ Net-billing/Gross-metering arrangement is required and shall have to be carried out within stipulated time frame as mentioned in procedure 7.0.

Notice for inspection of premises shall be intimated to the applicant atleast three (03) days in advance prior to the date of inspection.

- 6.7 During inspection following points are to be checked and recorded in the inspection report:
- Whether there is any constraint in distribution network (feeder/ distribution transformer) capacity,
 - Whether alteration of service is required.
- 6.8 After completion of formalities as per procedure 6.6 above, WBSEDCL shall issue either a single quotation or two separate quotations and intimation for go ahead clearance or issue a letter to the prosumer informing inability of WBSEDCL to provide Net-metering/Net-billing/ Gross-metering arrangement due to non-feasibility as per time schedule specified in procedure 7.0. In case of issuing either a single quotation or two separate quotations, the quotation shall include the matters as specified below:
- Cost of Net Meter and modem (if applicable) as per procedure 9.8
 - Cost of Generation Meter and modem (01 no. for Net-metering/Net-billing and 2 nos. for Gross-metering arrangement) (if applicable) as per procedure 9.8
 - Cost of Alteration of service if applicable as per procedure 11.0
 - Cost of enhancement of Sanctioned Load as per existing procedure of WBSEDCL if applicable.
- 6.9 The quotation shall remain valid for Ninety (90) days from the date of issuance of the quotation after which it will be deemed terminated. On request of applicant, validity of such quotation may be extended once for a maximum period of Thirty (30) days i.e. One Hundred and Twenty (120) days from the date of issuance of quotation. The application shall be cancelled if quotation amount is not submitted within the validity period of the quotation and application fee shall be forfeited with an intimation to the applicant indicating the application/registration number.
- 6.10 On receiving the quotation amount WBSEDCL shall issue a payment receipt to the applicant. On acceptance of the quotation amount, a work order will be issued by WBSEDCL.

6.11 Prosumers shall submit the followings before grid synchronization-

- i) Signed Agreement form as applicable (Form S2/S3/S4),
- ii) Self Certified installation Certificate of GIRSPV System (Form S5),
- iii) Certificate of Fitness
- iv) Clearance from Office of the Chief Electrical Inspector, Govt. of West Bengal or self certification as per format (for supply voltage below notified voltage) in accordance with Central Electricity Authority (Measures relating to Safety and Electric Supply) Regulations, 2023 and its subsequent amendment thereof (Form S6),



6.12 Prosumer have to install the GIRSPV System within a period of 180 days, from the date of clearance or deemed acceptance as per procedure 6.8. On request of the prosumer the installation period may be extended for a maximum period of 90 days. In case the applicant fails to install the GIRSPV System within extended time frame, the application shall be deemed to be cancelled and the quotation amount after adjusting any expenditure already incurred by WBSEDCL shall be refunded without any interest within 30 days.

6.13 After receiving the self certified installation certificate from the prosumer, WBSEDCL shall complete the agreement, meter installation and system commissioning on payment of all necessary costs as per procedure 6.8 within stipulated time frame as mentioned in procedure 7.0.

6.14 During Connectivity inspection if the installation is found not proper for grid synchronization in all respect, a letter for connectivity failure shall be issued to the prosumer within stipulated time frame as mentioned in procedure 7.0.

6.15 In case of any roof-top solar capacity alteration by existing Net-metering/ Net-billing/ Gross-metering prosumers:

- i. Prosumers will be treated as a fresh and eligibility under Net-metering/ Net-billing/ Gross-metering will be determined as per these procedures.
- ii. Feed-in tariff as mentioned in the initial agreement will be continued as per the terms and conditions of the initial agreement.
- iii. If existing Net-metering prosumers freshly eligible for Net-billing/ Gross-metering arrangement the feed-in tariff for that financial year of the switch over will be applicable.

6.16 In case of any change of supply voltage of the prosumers under Net-billing/ Gross-metering arrangement due to any reason, the feed-in tariff for the said voltage level in that financial year when the initial agreement was executed will be applicable.

7.0 TIME SCHEDULE:

<u>Sl. No</u>	<u>Activity</u>	<u>Time Schedule</u>
1	Inspection of technical feasibility/eligibility for installed capacity of GIRSPV system above 10kW	Within 15 days from date of receipt of application
2	Communication of the followings for installed capacity of GIRSPV system above 10kW i. Outcome of the technical feasibility study ii. Quotation as per procedure 6.8, iii. Go ahead clearance.	Within 20 days from date of receipt of application.
3	Payment of quotation amount by applicant	Within 90 days from the date of quotation which can be extended maximum upto 30 days.
4	Installation of GIRSPV system by the applicant and submit a self certified installation certificate	Within 180 days from date of go ahead clearance which can be extended maximum upto 90 days.
5	Connectivity Inspection	Within 10 days from date of receipt of self certified installation certificate from applicant.
6	Intimation for connectivity failure	Within 05 days from date of connectivity Inspection
7	Completion of Agreement, Installation of meter, system commissioning and grid Synchronization	Within 15 days from the date of receipt of self certified installation certificate from applicant.

8.0 TESTING:


8.1 The prosumers who have installed the GIRSPV System under Net-metering / Net-billing/Gross-metering arrangement shall have to furnish certificate of fitness conforming to correct operation of islanding, generation of harmonics and other Power Quality parameters as per limits mentioned in procedure 3 & 4 above.

8.2 Periodicity of Testing of prosumers installations:

Prosumers shall have to furnish certificate of fitness from authorized agencies of WBSEDCL, whose details will be available on the website of WBSEDCL with the following periodicity:

- Every two years for PV output above 170 KW (200 KVA)
- Every three years for PV output upto 170 KW (200 KVA)

If the solar installation remains out of operation for more than six (06) months, consumers shall have to furnish certificate of fitness afresh from the authorized agencies of WBSEDCL along with clearance from Office of the Chief Electrical Inspector, Govt. of West Bengal or self certification as per format (for supply voltage below notified voltage) in accordance with Central Electricity Authority (Measures relating to Safety and Electric Supply) Regulations, 2023 and its subsequent amendment there of (Form S6).

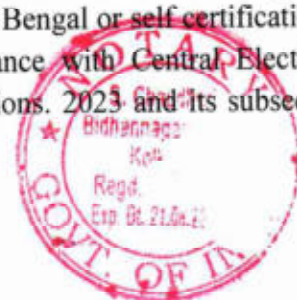

9.0 METERING AND METER COST :


- 9.1 The Net-metering/Net-billing/Gross-metering arrangement shall include a single-phase or a three-phase Net Meter/Prosumer meter as applicable, as per the existing supply arrangement of the eligible prosumer, located at the point of supply as would be ascertained by WBSEDCL. In addition a generation meter shall be installed to measure the output of the Rooftop Solar PV System.
- 9.2 The GIRSPV System generation meter and net meter shall be procured and installed by the distribution licensee against the cost to be borne by the prosumer. However, if any prosumer wishes to procure the meters with standard specifications to be set by the distribution licensee, the prosumer may procure and present the meters to the distribution licensee for testing and installation.
- 9.3 In case of Gross-metering arrangement, a check meter of appropriate class shall be installed by the WBSEDCL for the GIRSPV system generation meter against the cost to be borne by the prosumer.
- 9.4 If the eligible prosumer is within the ambit of the Time-of-Day (ToD) tariff, the net meter installed must be capable of recording both ToD consumption and generation.
- 9.5
 - (a) In case of any defect in the meter supplied by prosumer, the distribution licensee shall rectify or replace the meter, as the case may be, within the time period specified in the Standard of Performance Regulations. Prosumer shall bear the cost of meter rectification or new meter, as the case may be. Till the meter is rectified or replaced, the distribution licensee shall install a temporary meter at its own cost.
 - (b) In case meter supplied by WBSEDCL against the cost borne by the prosumer and becomes defective within 07 years (useful life as per Regulations) from the date of installation where the meter is found not tampered/ damaged on the fault of the prosumers, WBSEDCL will replace the meter and cost of such replaced meter shall not be claimed from the prosumer.

Beyond the above stated stipulated time frame when the meter becomes defective, WBSEDCL shall rectify or replace the meter, as the case may be, within the time period specified in the Standard of Performance Regulations. Prosumer shall bear the cost of meter rectification or new meter, as the case may and meter cost will be claimed through energy bill.

9.6 Till the meter is rectified or replaced, WBSEDCL shall install a temporary meter at its own cost.

9.7 Cost of Net Meter/ Solar Generation meter/ Modem:

The cost of meters and modem will be realized as per cost data of WBSEDCL published time to time.

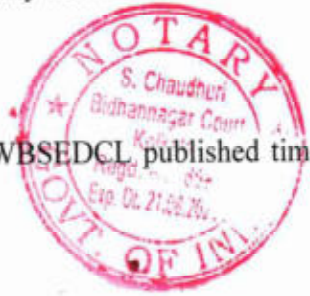

10.0 ENERGY ACCOUNTING AND SETTLEMENT :

- 10.1 For Net-metering arrangement: As per Schedule-1 of these procedures. For this purpose, accounting of Solar Generation is also mandatory.
- 10.2 For Net-billing arrangement: As per Schedule-2 of these procedures. For this purpose, accounting of Solar Generation is also mandatory.
- 10.3 For Gross-metering arrangement: As per Schedule-3 of these procedures.
- 10.4 For Net-metering/Net-billing arrangement at the end of the financial year, any outstanding Billing Credit, if any, shall be reset to zero. For Gross-metering arrangement billing credit, if any, at the end of a settlement period shall be paid by WBSEDCL to the prosumer.
- 10.5 If the prosumer's net meter is installed at HV/EHV side of the prosumer's transformer irrespective of its Sanctioned Load/Contract Demand, energy accounting and settlement for Net-billing/ Gross-metering arrangement will be done based on feed-in tariff for HV/EHV.
- 10.6 In case of inaccessibility of meter Reading of Prosumer meter/ Solar Generation meter:
- i) Assessment and subsequent adjustment of drawal energy in prosumer mode including energy export (Net-meter) shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
 - ii) Assessment of Solar generation energy shall be computed on the basis of average generation and other parameters for the preceding months or during any previous period that may be reasonably comparable.

Provided where the actual Solar generation of previous months/period is not available, adjustment of Solar generation will be done on availability of actual generation during meter reading.

- iii) Inaccessibility of meter reading normally shall not be allowed for more than one (01) consecutive billing cycle beyond which Net-metering / Net-billing /Gross-metering arrangement shall be withdrawn.

10.7 In case of defective /defunct / defect in metering circuit of Prosumer meter/ Solar Generation meter:

- 
- i) Assessment of drawal energy in prosumer mode including energy export (Net-meter) shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
 - ii) For Net-metering/ Net-billing arrangement if Generation meter / metering circuit are found defective, assessment of generation energy shall be computed on the basis of average generation and other parameters for the preceding three months or during any previous period that may be reasonably comparable before the meter has been found to be defective or defunct.
 - iii) For Gross-metering arrangement if Generation meter / metering circuit are found defective, assessment of Solar generation energy shall be computed based on Check meter. If both main and check meter / metering circuit are found defective, assessment of generation energy shall be computed on the basis of average generation and other parameters for the preceding three months or during any previous period that may be reasonably comparable before the meter has been found to be defective or defunct.
 - iv) If the Solar generation of previous months/period is not available, adjustment of Solar generation will be done on availability of actual generation during meter reading by taking average of actual electricity generated during the succeeding period (s) / month (s) after installation of a correct meter.

11.0 ALTERATION OF SERVICE

If any prosumer requires any alteration of service under Net-metering or Net-billing or Gross-metering arrangement the charges for alteration of services will be as follows:

- i) For Sanctioned Load/Contract demand upto 170 KW (200 KVA): Charges will be as per procedure 8.0 of WBSEDCL PROCEDURES-A(2010).
- ii) For Sanctioned Load/Contract demand above 170 KW (200 KVA): On actual basis based on inspection.

12.0 DISCONNECTION OF GIRSPV SYSTEM / DISCONTINUATION OF NET-METERING / NET-BILLING/GROSS-METERING AGREEMENT:

- 12.1 WBSEDCL shall have the right to disconnect the GIRSPV system at any time in 'the event of threat/damage' from such renewable energy system to its distribution system to prevent any accident or damage, without any notice. WBSEDCL shall call upon the prosumer to rectify the defect within a reasonable time.

- 12.2 If the presence of harmonics is beyond the limits specified in procedure 4.3 above, it may be treated as "the event of threat/damage", and WBSEDCL shall have the right to disconnect the GIRSPV system without any notice. WBSEDCL shall call upon the prosumer to rectify the defect within 30 days.
- 12.3 On disconnection of prosumer mode of supply due to any reason whatsoever the Net-billing/Net-metering/Gross-metering arrangement will also be discontinued till reconnection of prosumer mode of supply.
- 12.4 WBSEDCL shall accept power generated by the GIRSPV system throughout its useful life unless the prosumer ceases to be a consumer or abandons GIRSPV System prematurely with proper communication to WBSEDCL.
- 12.5 If, in an emergent or outage situation, WBSEDCL cannot access the disconnecting devices of the GIRSPV System, WBSEDCL may disconnect the power supply to the premises.

13.0 TERMINATION OF AGREEMENT

- 13.1 In case prosumers under Gross-metering system resorts to unlawful drawal of solar power directly from solar panel before capturing of entire solar generation, then Gross-metering facility will be withdrawn immediately for violation of agreement and agreement under Gross-metering facility will be terminated.
- 13.2 On termination of Prosumer mode of supply, agreement under Net-metering/ Net-billing/Gross-metering will also be terminated from date of termination of Prosumer mode of supply agreement. WBSEDCL may terminate this agreement by giving 30 days' notice if the prosumer fails to pay dues in a timely manner or indulges in any malpractices.
- 13.3 If prosumer fails to generate Solar Generation within one year from the date agreement under these procedures or discontinue the solar generation for more than one year for any reason(s) whatsoever then such agreement shall be automatically cancelled.
- 13.4 In case of violation of grid discipline, agreement under Gross-metering facility will be terminated as per order of Hon'ble Commission.
- 13.5 The agreement may be terminated prematurely by Prosumer giving 90 (ninety) days' notice.
- 13.6 The agreement stands terminated as and when the consumer status ceases to exist.

14.0 SWITCHOVER FROM ONE CATEGORY TO ANOTHER

- 14.1 Prosumer shall be permitted to apply for switchover from one category to another only once in financial year subject to recovery of all necessary charges related to that switch-over. For alteration of Sanction Load/ Contract Demand, if required at the time of opting switchover from one category to another, prosumer shall apply separately as per the provision of the existing Regulations/ Procedures and switch over shall be allowed after effecting alteration of Sanction Load/ Contract Demand.
- 14.2 Switchover shall be effected from the next billing cycle from the date of receipt of application for switchover. If the gap between the date of application and next billing cycle is less than 30 days, the switchover shall be affected from second next billing cycle.
- 14.3 At the time of switching from Net-metering arrangement to Net-billing/Gross-metering arrangement as intended by the prosumer, the unsettled unit will be considered as billing credit (Btr), based on applicable feed-in tariff, of the prosumer for the next billing period.
- 14.4 At the time of switching from Net-billing/ Gross-metering arrangement to Net-metering/ Net-billing/ Gross-metering arrangement as applicable as intended by the prosumer, the unsettled amount shall be refunded through energy bill(s) after switchover.
- 14.5 Feed-in tariff once agreed by the prosumers in any previous agreement will be valid for the entire useful life of the GIRSPV system irrespective of number of switching over from one category to another.

15.0 TREATMENT OF EXISTING PROSUMER UNDER NET-METERING /NET-BILLING ARRANGEMENT CONNECTED UNDER PREVIOUS REGULATIONS

- 15.1 Existing Solar-PV generating systems, which are already connected with the distribution network under Net-metering arrangement or under process as per previously approved procedure-C(2021) of WBSEDCL, will be considered as under Net-metering arrangement as per provisions of these procedures.
- 15.2 Existing Solar-PV generating systems, which are already connected with the distribution network under Net-billing arrangement or under process with WBSEDCL as per previously approved procedure-C(2021) of WBSEDCL, will be considered as under Gross-metering arrangement as per provisions of these procedures. In such cases, WBSEDCL shall intimate the prosumers of such changes and seek options for switchover as per the provisions of these procedures. For switchover to Net-metering/Net-billing arrangement as applicable will be allowed only upon receiving application from the prosumers and necessary modification of metering arrangement if required. If no application is received from the prosumer for switchover, Gross-metering arrangement as per these procedures will continue without any further intimation.

WBSEDCL shall effect such switchover as per the procedure 14.

- 15.3 At the time of switching from Net-metering arrangement to Net-billing/Gross-metering arrangement as intended by the prosumer, the unsettled unit will be considered as billing credit (Bcf), based on applicable feed-in tariff, of the prosumer for the next billing period.
- 15.4 At the time of switching from Net-billing arrangement to Net-metering arrangement as intended by the prosumer, the unsettled amount shall be refunded through energy bill(s) after switchover.
- 15.5 Generic tariff of existing prosumers under Net-billing arrangement will be considered as feed-in tariff under the GIRSPV Regulations, 2025.



Chief Engineer (Regulation)
Regulation Department
WBSEDCL

Schedule-1

Net Metering Energy Accounting and Settlement

1. WBSEDCL will conduct meter readings for all GIRSPV Systems of prosumers as per the regular metering cycle of consumers.
2. The readings of both the generation meter and the bi-directional energy meter shall be recorded by WBSEDCL.
3. WBSEDCL's bill issued to the prosumer for each billing period shall include the following details:
 - (a) Units of energy generated by the GIRSPV System, as recorded by the generation meter;
 - (b) Units of energy exported to the grid by the GIRSPV System, including the present and previous meter readings;
 - (c) Units of energy supplied by WBSEDCL, including the present and previous meter readings;
 - (d) Net energy import/export;
 - (e) Excess energy brought forward from the previous billing period;
 - (f) Net energy import (if any) liable for payment by the prosumer;
 - (g) Net energy export, if any, to be carried over to the next billing period.

Illustration of Net Metering:

Amount to be billed to a Net Metering prosumer shall be

$$N_{met} = \{(E_{imp} - E_{exp}) - E_{bf}\} \times T$$

Where,

N_{met} = Amount to be billed to a Net Metering prosumer,

E_{imp} = Energy imported (in kWh) from the grid during the billing period,

E_{exp} = Energy exported (in kWh) to the grid during the billing period,


E_{bf} = Excess of energy exported (in kWh) over energy imported (in kWh) from the grid in the previous billing cycle,

T = Applicable tariff of the consumer (in Rs. / kWh) including MVCA, if any

In case $E_{imp} < (E_{exp} + E_{bf})$, then $N_{met} = 0$ and the energy (in kWh) $(E_{exp} + E_{bf} - E_{imp})$ shall be carried forward to the next billing cycle.


4. Notwithstanding anything contained contrary to any other regulation of the Commission for prosumers availing time-of-day tariff previous to availing Net-metering will continue to be billed under time-of-day tariff. However, for such prosumers: (a) Electricity consumption in each time block will be offset against generation in the same time block. (b) Excess generation in any time block will be accounted for in the immediately lower tariff time block. (c) This process continues until all consumption in lower tariff blocks is offset against GIRSPV System generation. (d) Any excess generation after offsetting consumption will be carried forward to the next billing cycle. (e) The same process applies in subsequent billing cycles.
5. At the beginning of each financial year, any accumulated surplus exported energy shall be reset to zero.

6. Prosumers shall continue to pay all other charges, such as fixed/demand charges, rebates and surcharges, government levies & duties, arrears due to tariff revision during any billing period, etc.
7. WBSEDCL shall continue to accept energy generated from the GIRSPV System for its entire useful life, unless the prosumer ceases to be a consumer of WBSEDCL or voluntarily discontinues the GIRSPV System.



Santam Saha
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

Schedule-2
Net Billing Energy Accounting and Settlement



1. WBSEDCL will conduct meter readings for all GIRSPV Systems of prosumers as per the regular billing cycle of consumers.
2. The readings of both the generation meter and the bi-directional energy meter shall be recorded by WBSEDCL.
3. WBSEDCL on its bill to the consumer for each billing period shall include the following details:
 - (a) Recorded generation from the generation meter of the GIRSPV System;
 - (b) Energy injected into the grid by the GIRSPV System during the billing period, with present and previous reading;
 - (c) Energy supplied by WBSEDCL during the billing period, with present and previous reading;
 - (d) Monetary value of energy imported at retail tariff of the consumer;
 - (e) Monetary value of energy exported at feed-in tariff determined by the Commission;
 - (f) Billing credit brought forward from the previous billing period;
 - (g) Amount billed to the net billing prosumer;
 - (h) Billing credit carried forward to the next billing period.

Illustration of Net Billing:

Amount to be billed to a Net Billing prosumer shall be

$$N_{bill} = \{(B_{imp} - B_{exp}) - B_{bf}\}$$

Where,

N_{bill} = Amount to be billed to a Net Billing prosumer

B_{imp} = Energy imported (in kWh) from the grid during the billing period * applicable retail tariff (in Rs./ kWh) including MVCA, if any

B_{exp} = Energy exported (in kWh) to the grid during the billing period * feed-in tariff (in Rs. / kWh)


B_{bf} = Billing credit (in Rs.) brought forward from the previous billing period.

In case $B_{imp} < (B_{exp} + B_{bf})$, then $N_{bill} = 0$ and the billing credit (in Rs.) of $(B_{exp} + B_{bf} - B_{imp})$ shall be carried forward to the next billing cycle

4. At the end of the financial year, any outstanding Billing Credit, if any, shall be reset to zero.
5. Prosumers shall continue to pay all other charges, such as fixed/demand charges, rebates and surcharges, government levies & duties, arrears due to tariff revision during any billing period, etc.
6. WBSEDCL shall accept power generated by the GIRSPV System throughout its useful life unless the prosumer ceases to be a consumer or abandons the Rooftop Solar PV System prematurely.

Santam Sanyal
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

Schedule-3
Gross Metering Energy Accounting and Settlement



1. WBSEDCL shall conduct meter readings for all GIRSPV System of prosumers as per the regular metering cycle of the consumer.
2. Both the generation meter and consumer energy meter readings shall be recorded by WBSEDCL.
3. WBSEDCL on its bill to the consumer for each billing period shall include the following details:
 - (a) Recorded generation with present and previous readings from the generation meter of the GIRSPV System;
 - (b) Energy consumed by the prosumer during the billing period, with present and previous reading;
 - (c) Monetary value of energy consumed at retail tariff of the consumer;
 - (d) Monetary value of energy generated at feed-in tariff determined by the Commission;
 - (e) Billing credit brought forward from the previous billing period;
 - (f) Amount billed to the prosumer under gross metering;
 - (g) Billing credit carried forward to the next billing

Illustration of Gross Metering:

Amount to be billed to a Gross Metering prosumer shall be

$$N_{gross} = \{(B_{con} - B_{gen}) - B_{bf}\}$$

Where,

N_{gross} = Amount to be billed to a Gross Metering prosumer

B_{con} = Energy consumed (in kWh) by a consumer during the billing period * applicable retail tariff (in Rs. / kWh) including MVCA, if any;

B_{gen} = Energy generated (in kWh) by the GIRSPV System of prosumer during the billing period * feed-in tariff (in Rs. / kWh);

B_{bf} = Billing credit (in Rs.) brought forward from the previous billing period.

In case $B_{con} < (B_{gen} + B_{bf})$, then $N_{gross} = 0$ and the billing credit (in Rs) of $(B_{gen} + B_{bf} - B_{con})$ shall be carried forward to the next billing cycle.

4. Billing credit, if any, at the end of a settlement period shall be paid by WBSEDCL to the prosumer.
5. Prosumers shall continue to pay all other charges, such as fixed/demand charges, rebates and surcharges, government levies & duties, arrears due to tariff revision during any billing period, etc.
6. WBSEDCL shall accept power generated by GIRSPV System throughout its useful life unless the prosumer ceases to be a consumer or abandons the GIRSPV System prematurely.

Chief Engineer (Regulation)
Regulation Department
WBSEDCL

Application Form i.r.o GIRSPV Connection for new Connection/Alteration of Capacity of GIRSPV System/ Switchover under Net Metering/Net Billing /Gross Metering Arrangement)

To
The Station Manager /Regional Manager/Chief Engineer Commercial



.....
.....
Application Number (Auto generated):

1. Applicant's Full Name (in capital letters):
2. Gender:
3. Address of the Premises at Which the GIRSPV System is to be installed (in capital letters):
4. Mobile Number:
5. E-mail ID (if any):
6. Alternate Address for Communication (if any):
7. Consumer Category of Existing Electricity Connection:
8. Consumer ID:
9. Sanctioned Load / Contract Demand (in kW /kVA):
10. Whether he/she is owner or tenant of the property: Owner / Tenant
(For tenant a 'No objection certificate' from owner to be attached)

A. For New connection:

1. Capacity of Grid Interactive Rooftop Solar Photovoltaic System to be Installed:..... (in kWp)
2. Category of Prosumer: Net Metering/ Net Billing /Gross Metering

B. For alteration of existing GIRSPV System Capacity:

1. Existing Capacity of GIRSPV System sanctioned..... (in kWp)
2. Existing Category of Prosumer: Net Metering/ Net Billing /Gross Metering
3. Extended Capacity requested [including sanctioned Capacity]:.....(in kWp)
4. Proposed Category of Prosumer: Net Metering/ Net Billing /Gross Metering

C. For Switchover:

1. Installed Capacity of GIRSPV: (in kWp)
2. Existing arrangement of GIRSPV: Net-metering / Net-billing / Gross-Metering
3. Proposed arrangement of GIRSPV: Net-metering / Net-billing / Gross-Metering
4. I/We hereby declare that I have not availed any switchover of my existing GIRSPV System in this financial year.

*Strikeout which is not applicable.

Declaration:

I/ We do hereby declare that I/we fulfill the eligibility criteria for net metering/ net billing/ gross metering specified in the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025. I/ We also agree to bear the cost of switchover, alteration of service and infrastructure up gradation (for capacity exceeding 10 kW), if any, required under the regulation.

Signature of Applicant:

Name:

Date:

Place:

Santam Sanjay
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

Agreement of Net Metering Arrangement

This Agreement is made and entered into on this [date] day of [month], [year], at [location], between the Prosumer identified below, hereinafter referred to as the "Prosumer," and the Distribution Licensee identified below, hereinafter referred to as the "Licensee."

1. Parties

(1) The Prosumer:

Name:

Address:

Consumer ID.:

(2) The Licensee:

Name:

Address:

2. Background

Whereas the Prosumer having contract demand or sanctioned load of [in kW] has applied to the Licensee for approval of a Net Metering Arrangement under the provisions of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar PV System for Prosumers) Regulations, 2025 ("Grid-Interactive Rooftop Solar PV Regulations") and sought permission to inject surplus solar power from its Grid-Interactive Rooftop Solar PV system of [capacity in kilowatt] to the Licensee's distribution Network;

Whereas the Licensee has agreed to allow the injection of energy generated from the Grid-interactive Rooftop Solar PV System of [capacity in kilowatt] of the prosumer;

3. Agreement

The Parties hereby agree as follows:

- (1) The Prosumer shall fulfil the eligibility criteria specified in the WBERC (Grid-Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025.
- (2) The Distribution Licensee shall provide Interconnection of Grid-Interactive Rooftop Solar Photovoltaic Systems of prosumers as per Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 as amended from time to time.
- (3) The prosumer shall maintain Standards for Grid-Interactive Rooftop Solar Photovoltaic System as per Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 as amended from time to time.
- (4) The Licensee shall provide Metering of the Grid Interactive Rooftop Solar Photovoltaic System of the prosumer / the prosumer agrees to provide meters as per Central Electricity Authority (Installation and Operation of Meters), Regulations 2006 as amended from time to time.
- (5) The prosumer shall ensure that the Grid Interactive Rooftop Solar Photovoltaic System complies with Central Electricity Authority (Measures Relating to Safety and Electricity Supply) Regulations, 2023 as amended from time to time.

Santam Sarkar
 Chief Engineer (Regulation)
 Regulation Department
 WBSEDCL

- (6) The prosumer shall obtain statutory approvals and clearances that may be required under any statute or regulation framed there under, before connecting the Grid Interactive Rooftop Solar Photovoltaic System to the distribution Network.
- (7) This Agreement shall be valid for 25 years or upto the useful life of GRI-SPV system, whichever is earlier from the date of signing but may be terminated prematurely by Prosumer giving 90 (ninety) days' notice.
- (8) Licensee may terminate this agreement by giving 30 days' notice, if the Prosumer breaches any terms of this Agreement or the provisions of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025 and does not remedy such breach within 30days, or such other reasonable period as may be provided, of receiving notice of such breach, or for any other valid reason communicated by the Licensee in writing.
- (9) Licensee may terminate this agreement by giving 30 days' notice if the prosumer fails to pay his dues in a timely manner or indulges in any malpractices.
- (10) The agreement stands terminated as and when the consumer status ceases to exist.
- (11) The Prosumer shall provide access to the Licensee to the metering equipment and disconnecting devices of Rooftop Solar Photovoltaic system.
- (12) The Interconnection point with the WBSEDCL's system will be immediate after the generation meter.
- (13) In case of inaccessibility of meter:
- Assessment of drawal energy in prosumer mode including energy export (Net-meter) shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
 - Assessment of Solar generation energy shall be computed on the basis of average generation and other parameters for the preceding months or during any previous period that may be reasonably comparable.
Provided where the actual Solar generation of previous months/period is not available, adjustment of Solar generation will be done on availability of actual generation during meter reading.
 - Inaccessibility of meter for Reading normally shall not be allowed for more than one (01) consecutive billing cycle beyond which net metering arrangement shall be withdrawn.
- (14) In case of defective /defunct / defect in metering circuit of Prosumer meter, assessment of drawal energy in prosumer mode including energy export (Net-meter) shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
- (15) In case of defective /defunct / defect in metering circuit of Generation meter assessment of generation energy shall be computed on the basis of average generation and other parameters for the preceding three months or during any previous period that may be reasonably comparable before the meter has been found to be defective or defunct.

Santam Sarkar
 Chief Engineer (Regulation)
 Regulation Department
 WBSEDCL

- (16) If prosumer fails to generate Solar Generation within one year from the date agreement under these procedures or discontinue the solar generation for more than one year for any reason(s) whatsoever then such agreement shall be automatically cancelled.
- (17) If, in an emergent or outage situation, the Licensee cannot access the disconnecting devices of the Grid Interactive Rooftop Solar Photovoltaic System it may disconnect the power supply to the premises.
- (18) The commercial settlements under this Agreement shall be in accordance with the West Bengal Electricity Regulatory Commission (Grid Interactive Solar Photovoltaic System for Prosumers) Regulations, 2025.

Illustration of Net Metering:

Amount to be billed to a Net Metering prosumer shall be

$$N_{met} = \{(E_{imp} - E_{exp}) - E_{bf}\} \times T$$

Where

N_{met} = Amount to be billed to a Net Metering prosumer

E_{imp} = Energy imported (in kWh) from the grid during the billing period

E_{exp} = Energy exported (in kWh) to the grid during the billing period

E_{bf} = Excess of energy exported (in kWh) over energy imported (in kWh) from the grid in the previous billing cycle

T = Applicable tariff of the consumer (in Rs. / kWh) including MVCA, if any

In case $E_{imp} < E_{exp} + E_{bf}$, then $N_{met} = 0$ and the energy (in kWh) $(E_{exp} + E_{bf} - E_{imp})$ shall be carried forward to the next billing cycle.

At the beginning of each financial year, any accumulated surplus exported energy, shall be reset to zero.

- (19) The Prosumer shall bear all costs related to the setting up of the Rooftop Solar Photovoltaic System, including the cost of necessary Meters.
- (20) The Prosumer shall be solely responsible for any loss, damage of its GIRSPV System and WBSEDCL shall not be liable for any damage of GIRSPV System

In Witness Whereof,

Signature of the Prosumer: _____

Signature of Licensee: _____

Witness No. 1: Signature: _____

Name and Address:

Witness No. 2: Signature: _____

Name and Address:

Santam Sarkar
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

Model Agreement of Net Billing or Net Feed-in Arrangement

This Agreement is made and entered into on this [date] day of [month], [year], at [location], between the Prosumer identified below, hereinafter referred to as the "Prosumer," and the Distribution Licensee identified below, hereinafter referred to as the "Licensee."

**1. Parties****(1) The Prosumer:**

Name:

Address:

Consumer No.:

(2) The Licensee:

Name:

Address:

2. Background

Whereas the Prosumer having contract demand or sanctioned load of [in kW] has applied to the Licensee for approval of a Net Billing Arrangement under the provisions of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar PV System for Prosumers) Regulations, 2025 ("Grid-Interactive Rooftop Solar PV Regulations") and sought permission to inject surplus solar power from its Grid-Interactive Rooftop Solar PV system of [capacity in kilowatt] to the Licensee's distribution Network;

Whereas the Licensee has agreed to allow the injection of energy generated from the Grid-Interactive Rooftop Solar PV System of [capacity in kilowatt] of the prosumer;

3. Agreement

The Parties hereby agree as follows:

- (1) The Prosumer shall fulfil the eligibility criteria specified in the WBERC (Grid-Interactive Rooftop Solar Photovoltaic System for Prosumer) Regulations, 2025.
- (2) The Distribution Licensee shall provide Interconnection of solar Photovoltaic systems of prosumers as per Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 as amended from time to time.
- (3) The prosumer shall maintain standards for Grid Interactive Rooftop Solar Photovoltaic System as per Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 as amended from time to time.
- (4) The Licensee shall provide Metering of the Grid Interactive Rooftop Solar Photovoltaic System of the prosumer / the prosumer agrees to provide meters as per Central Electricity Authority (Installation and Operation of Meters), Regulations 2006 as amended from time to time.
- (5) The prosumer shall ensure that the Grid Interactive Rooftop Solar Photovoltaic System complies with Central Electricity Authority (Measures Relating to Safety and Electricity Supply) Regulations, 2023 as amended from time to time.
- (6) The prosumer shall obtain any statutory approvals and clearances that may be required under any statute or regulation framed thereunder, before connecting the Grid Interactive Rooftop Solar Photovoltaic System to the distribution Network.

- (7) This Agreement shall be valid for 25 years or upto the useful life of GIRSPV system whichever is earlier from the date of signing but may be terminated prematurely by Prosumer giving 90(ninety) days 'notice.
- (8) Licensee may terminate this agreement by giving 30 days' notice, if the prosumer breaches any terms of this Agreement or the provisions of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025 and does not remedy such breach within 30 days, or such other reasonable period as may be provided, of receiving notice of such breach, or for any other valid reason communicated by the licensee in writing.
- (9) Licensee may terminate this agreement by giving 30 days' notice if the prosumer fails to pay dues in a timely manner or indulges in any malpractices.
- (10) The agreement stands terminated as and when the consumer status ceases to exist.
- (11) The Prosumer shall provide access to the Licensee to the metering equipment and disconnecting devices of Rooftop Solar Photovoltaic System.
- (12) The Interconnection point with the WBSEDCL's system will be immediate after the generation meter.
- (13) In case of inaccessibility of meter:
- Assessment of drawal energy in prosumer mode including energy export (Net-meter) shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
 - Assessment of Solar generation energy shall be computed on the basis of average generation and other parameters for the preceding months or during any previous period that may be reasonably comparable.
Provided where the actual Solar generation of previous months/period is not available, adjustment of Solar generation will be done on availability of actual generation during meter reading.
 - Inaccessibility of meter for Reading normally shall not be allowed for more than one (01) consecutive billing cycle beyond which net metering arrangement shall be withdrawn.
- (14) In case of defective /defunct / defect in metering circuit of Prosumer meter, assessment of drawal energy in prosumer mode including energy export (Net-meter) shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
- (15) In case of defective /defunct / defect in metering circuit of Generation meter assessment of generation energy shall be computed on the basis of average generation and other parameters for the preceding three months or during any previous period that may be reasonably comparable before the meter has been found to be defective or defunct.
- (16) If prosumer fails to generate Solar Generation within one year from the date agreement under these procedures or discontinue the solar generation for more than one year for any reason(s) whatsoever then such agreement shall be automatically cancelled.
- (17) If, in an emergent or outage situation, the Licensee cannot access the disconnecting devices of the Rooftop Solar Photovoltaic System it may disconnect the power supply to the premises.

(18) The commercial settlements under this Agreement shall be in accordance with the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025.

Illustration of Net Billing:

Amount to be billed to a Net Billing prosumer shall be

$$N_{bill} = \{(B_{imp} - B_{exp}) - B_{bf}\}$$

Where

N_{bill} = Amount to be billed to a Net Billing prosumer

B_{imp} = Energy imported (in kWh) from the grid during the billing period * applicable retail tariff (in Rs./ kWh) including MVCA, if any

B_{exp} = Energy exported (in kWh) to the grid during the billing period * feed-in tariff (in Rs. / kWh)

B_{bf} = Billing credit (in Rs.) brought forward from the previous billing period.

In case $B_{imp} < (B_{exp} + B_{bf})$, then $N_{bill} = 0$ and the billing credit (in Rs) of $(B_{exp} + B_{bf} - B_{imp})$ shall be carried forward to the next billing cycle

- At the end of the financial year, any outstanding Billing Credit, if any, shall be reset to zero.

(19) The Prosumer shall bear all costs related to the setting up of the Rooftop Solar Photovoltaic System, including the cost of necessary Meters.

(20) The Prosumer shall be solely responsible for any loss, damage of its GIRSPV System and WBSEDCL shall not be liable for any damage of GIRSPV System.

(21) Both the parties have agreed that the tariffs for supply of electricity to WBSEDCL from the GIRSPV system under this agreement shall be at Rs..... (Feed-In Tariff) and shall be fixed for the entire useful life of the project.

Inwitnesswhereof,

Signature of the Licensee: _____

Signature of Prosumer: _____

Witness No. 1: Signature: _____

Name and Address:

Witness No. 2: Signature: _____

Name and Address:



Santam Sarkar
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

Model Agreement of Gross Metering Arrangement

This Agreement is made and entered into on this [date] day of [month], [year], at [location], between the Prosumer identified below, hereinafter referred to as the "Prosumer" and the Distribution Licensee identified below, hereinafter referred to as the "Licensee."

1. Parties

(1) The Prosumer:

Name:

Address:

Consumer No.:

(2) The Licensee:

Name:

Address:

2. Background

Whereas the Prosumer having contract demand or sanctioned load of [in kW] has applied to the Licensee for approval of a Gross Metering Arrangement under the provisions of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar PV System for Prosumers) Regulations, 2024 ("Grid-interactive Rooftop Solar PV Regulations") and sought permission to inject entire solar power from its Grid-Interactive Rooftop Solar PV system of [capacity in kilowatt] to the Licensee's distribution Network;

Whereas the Licensee has agreed to allow the injection of energy generated from the Grid-Interactive Rooftop Solar PV System of [capacity in kilowatt] of the prosumer;

3. Agreement

The Parties hereby agree as follows:

- (1) The Prosumer shall fulfil the eligibility criteria specified in the WBERC (Grid-interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025.
- (2) The Distribution Licensee shall provide Interconnection of solar Photovoltaic systems of prosumers as per Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 as amended from time to time.
- (3) The prosumer shall maintain standards for Grid Interactive Rooftop Solar Photovoltaic Systems as per Central Electricity Authority (Technical Standards for Connectivity of the Distributed Generation Resources) Regulations, 2013 as amended from time to time.
- (4) The Licensee shall provide Metering of the Grid Interactive Rooftop Solar Photovoltaic System of the prosumer / the prosumer may provide meters as per Central Electricity Authority (Installation and Operation of Meters), Regulations 2006 as amended from time to time.
- (5) The prosumer shall ensure that the Grid Interactive Rooftop Solar Photovoltaic System complies with Central Electricity Authority (Measures Relating to Safety and Electricity Supply) Regulations, 2023 as amended from time to time.
- (6) The prosumer shall obtain any statutory approvals and clearances that may be required under any statute or regulation framed thereunder, before connecting the Rooftop Solar Photovoltaic System to the distribution Network.

Santam Sarkar
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

- (7) This Agreement shall be valid for 25 years or upto the useful life of GIRSPV system whichever is earlier from the date of signing but may be terminated prematurely by Prosumer giving 90(ninety) days' notice.
- (8) The Licensee may terminate this agreement by giving 30 days' notice, if the prosumer breaches any terms of this Agreement or the provisions of the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025 and does not remedy such breach within 30 days, or such other reasonable period as may be provided, of receiving notice of such breach, or for any other valid reason communicated by the Licensee in writing.
- (9) Licensee may terminate this agreement by giving 30 days' notice if the prosumer fails to pay dues in a timely manner or indulges in any malpractices.
- (10) The agreement stands terminated as and when the consumer status ceases to exist.
- (11) The prosumer shall provide access to the Licensee to the metering equipment and disconnecting devices of Grid Interactive Rooftop Solar Photovoltaic System.
- (12) The Interconnection point with the WBSEDCL's system will be immediate after the generation meter.
- (13) In case of inaccessibility of meter:
- Assessment of drawal energy in prosumer mode including energy export (Net-meter) shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
 - Assessment of Solar generation energy shall be computed on the basis of average generation and other parameters for the preceding months or during any previous period that may be reasonably comparable.
Provided where the actual Solar generation of previous months/period is not available, adjustment of Solar generation will be done on availability of actual generation during meter reading.
 - Inaccessibility of meter for Reading normally shall not be allowed for more than one (01) consecutive billing cycle beyond which net metering arrangement shall be withdrawn.
- (14) In case of defective /defunct meter:
- Assessment of drawal energy in prosumer mode shall be computed based on the provision as laid down in the West Bengal Electricity Regulatory Commission (Electricity Supply Code) Regulations, 2013 as amended.
 - Assessment of Solar generation energy shall be computed based on Check meter. If both main and check meter / metering circuit are found defective, assessment of generation energy shall be computed on the basis of average generation and other parameters for the preceding three months or during any previous period that may be reasonably comparable before the meter has been found to be defective or defunct.
 - If the Solar generation of previous months/period is not available, adjustment of Solar generation will be done on availability of actual generation during meter reading by taking average of actual electricity generated during the succeeding period (s) / month (s) after installation of a correct meter.
- (15) If prosumer fails to generate Solar Generation within one year from the date agreement under these procedures or discontinue the solar generation for more than one year for any reason(s) whatsoever then such agreement shall be automatically cancelled.

- (16) If, in an emergent or outage situation, the Licensee cannot access the disconnecting devices of the Rooftop Solar Photovoltaic System it may disconnect the power supply to the premises.
- (17) The commercial settlements under this Agreement shall be in accordance with the West Bengal Electricity Regulatory Commission (Grid Interactive Rooftop Solar Photovoltaic System for Prosumers) Regulations, 2025.

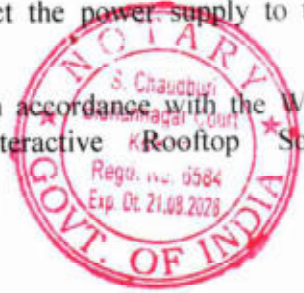


Illustration of Gross metering

Amount to be billed to a Gross metering prosumer shall be

$$N_{\text{gross}} = \{(B_{\text{con}} - B_{\text{gen}}) - B_{\text{bf}}\}$$

Where

N_{gross} = Amount to be billed to a Gross Metering prosumer

B_{con} = Energy consumed (in kWh) by a consumer during the billing period * applicable retail tariff (in Rs. / kWh) including MVCA, if any;

B_{gen} = Energy generated (in kWh) by Grid Interactive Rooftop Solar Photovoltaic of prosumer during the billing period * feed-in tariff (in Rs. / kWh);

B_{bf} = Billing credit (in Rs.) brought forward from the previous billing period.

In case $B_{\text{con}} < (B_{\text{gen}} + B_{\text{bf}})$, then $N_{\text{gross}} = 0$ and the billing credit (in Rs) of $(B_{\text{gen}} + B_{\text{bf}} - B_{\text{con}})$ shall be carried forward to the next billing cycle

- **Billing Credit if any at the end of the settlement period shall be paid by the WBSEDCL to the prosumer**

- (18) The Prosumer shall bear all costs related to the setting up of the Rooftop Solar Photovoltaic System, including the cost of necessary Meters.
- (19) The Prosumer shall be solely responsible for any loss, damage of its GIRSPV System and WBSEDCL shall not be liable for any damage of GIRSPV System.
- (20) Both the parties have agreed that the tariffs for supply of electricity to WBSEDCL from the GIRSPV system under this agreement shall be at Rs..... (Feed-In Tariff) as determined by the Commission and shall be fixed for the entire useful life of the project.

In Witness Whereof,

Signature of the Licensee: _____ Signature

of Prosumer: _____

Witness No. 1: Signature: _____

Name and Address:

Witness No. 2: Signature: _____


Name and Address

Santam Saha
 Chief Engineer (Regulation)
 Regulation Department
 WBSEDCL

Self Certified Installation Certificate

To

The Station Manager/ Regional Manager/ Chief Engineer Commercial,



.....

Sub: Submission of Self Certified Installation Certificate.

Ref: Application No.: dated.....

Dear Sir / Madam,

This is in reference to my above application for installation of GIRSPV system I /We hereby confirm you that I /We have completed the work of installation of the GIRSPV system of capacity.....and submit the following basic information for your perusal and request you to inspect and commission the system.

Sl. No.	Particulars	Information
A.	Details of the Solar PV Module	
1.	Type of Module	Polycrystalline/ Mono-crystalline/TOPCon/HJT/ Any other Crystalline Technology
2.	Name and address of manufacturer	
3.	Capacity of each Module (Wp)	
4.	No. of Modules (attach Serial Nos.)	
5.	Total Capacity (kWp)	
6.	Date of Installation	
7.	Applicable Standard (BIS/IEC)	IEC 61215 / IS 14286, IEC 61730(Part I & II), IEC 62804
B.	Details of the Inverter	
8.	Name and address of the Inverter manufacturer	
9.	Brand Name of the Inverter	
10.	Serial Nos. of inverters installed	
11.	AC Capacity of individual Inverter (kW)	
12.	Cumulative AC capacity of Inverters (kW)	
13.	Current THD at full load & Voltage THD-less than 3%	YES/NO

14.	Ingress Protection Limit	
15.	Date of Installation	
16.	Applicable Standard (BIS/IEC)	IEC-62109(Part I & II), IEC-60068, IEC-61683, IEC 61000, IEC62116, IEC 61727
C.	Details of the DC Cables	
17.	Make / Name of manufacturer	
18.	Size & Type	
19.	Applicable Standard (IEC)	IS 17293
D.	Details of the AC Cables	
20.	Make / Name of manufacturer	
21.	Size & Type	
22.	Applicable Standard (IS/IEC)	IS 7098 (Part-I & II)/IS 1554/IS 694
E.	Details of the Array Junction Box(AJB)	
23.	Make / Name of manufacturer	
24.	Serial No.	
25.	DC Surge Protection Device	
26.	MCB / Isolator quantity & capacity	
27.	Size & Type	
28.	Applicable Standard (IEC)	IEC 61643 –Surge Protection Device, IEC 60529- Ingress Protection
F.	Details of the AC Distribution Box/Inverter Interfacing Panel	
29.	Make / Name of manufacturer	
30.	Serial No.	
31.	AC Surge Protection Device	
32.	MCB / MCCB quantity & capacity	
33.	Size & Type	
34.	Applicable Standard (IEC)	IEC 61643 - Surge Protection Device, IEC 60898 - MCB
G.	Details of the Earthing *	
35.	Earth resistance (shall be less than 2 ohms)	
36.	Size of the Earth wire / flat*	

37.	Two separate Earthing points: Module Mounting Structure & DC Surge Protection Device	Yes / No
	Inverter, AC Surge Protection Device & Lightning Arrester	Yes / No
38.	Size & Type	
39.	Applicable Standard (BIS / IEC)	IS 3043
Note: * Earthing shall be done in accordance IS 3043-1986, provided that Earthing conductors shall have a minimum size of 6 mm ² copper wire or 10 mm ² aluminum wire or 3 mm ² X 70 mm ² hot dip galvanized steel flat.		
H.	Details of the Caution signage	
40.	Caution Signage	IS 2551
I.	Provision of manual and automatic switches: Yes / No	
41.	Manual / Automatic Switches	
J.	G.P.S. Co-ordinates of the RTSPV System Installation	
42.	Latitude / Longitude	
K.	Operation and Maintenance	
43.	Whether Operation and Maintenance Manual provided to the consumer: Yes / No	

Standards Certificate / Standard Number BIS / IEC / etc. to be mentioned, wherever applicable.

Certification:

I / We certify that the above said GIRSPV system is installed and the equipment used in the system comply the Technical and Safety Standards as specified in the regulations notified by the Respective Authorities.

Signature of the Applicant

Name and Address

Name:.....

.....

.....


Date:.....

Enclosures:

1. Copy of test report of PV modules, Inverter, Cable etc as per procedure 3.5.
2. Data sheets / Drawing for the array mounting System.
3. Actual Single line wiring diagram (SLD) of the GIRSPV System.

DIAGRAM-A

CONNECTION DIAGRAM FOR NET METERING AND NET BILLING ARRANGEMENT HAVING SANCTIONED LOAD/CONTRACTUAL DEMAND UPTO 200KVA/170 KW

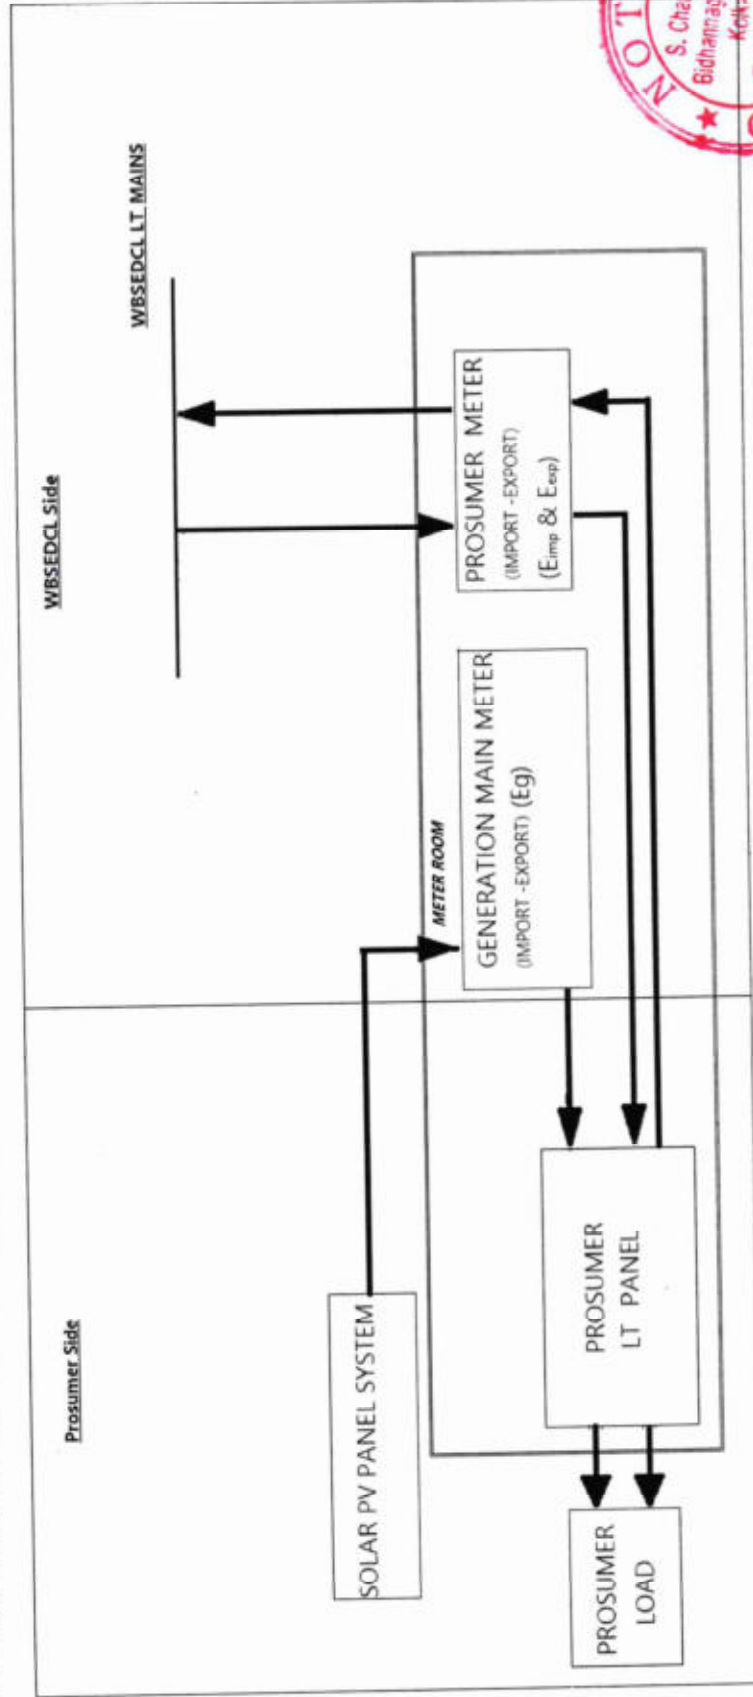

*For net metering arrangement billing will be done as per Schedule-1 of WBSEDCL PROCEDURES-C(2025).


*For net billing arrangement net billing will be done as per Schedule-2 of WBSEDCL PROCEDURES-C(2025).



Santam Saha
 Chief Engineer (Regulation)
 Regulation Department
 WBSEDCL

DIAGRAM-B
CONNECTION DIAGRAM FOR NET METERING AND NET BILLING ARRANGEMENT HAVING SANCTIONED
LOAD/CONTRACTUAL DEMAND ABOVE 200KVA/170KW

(Solar Injection at same voltage level at which prosumer has been given supply)

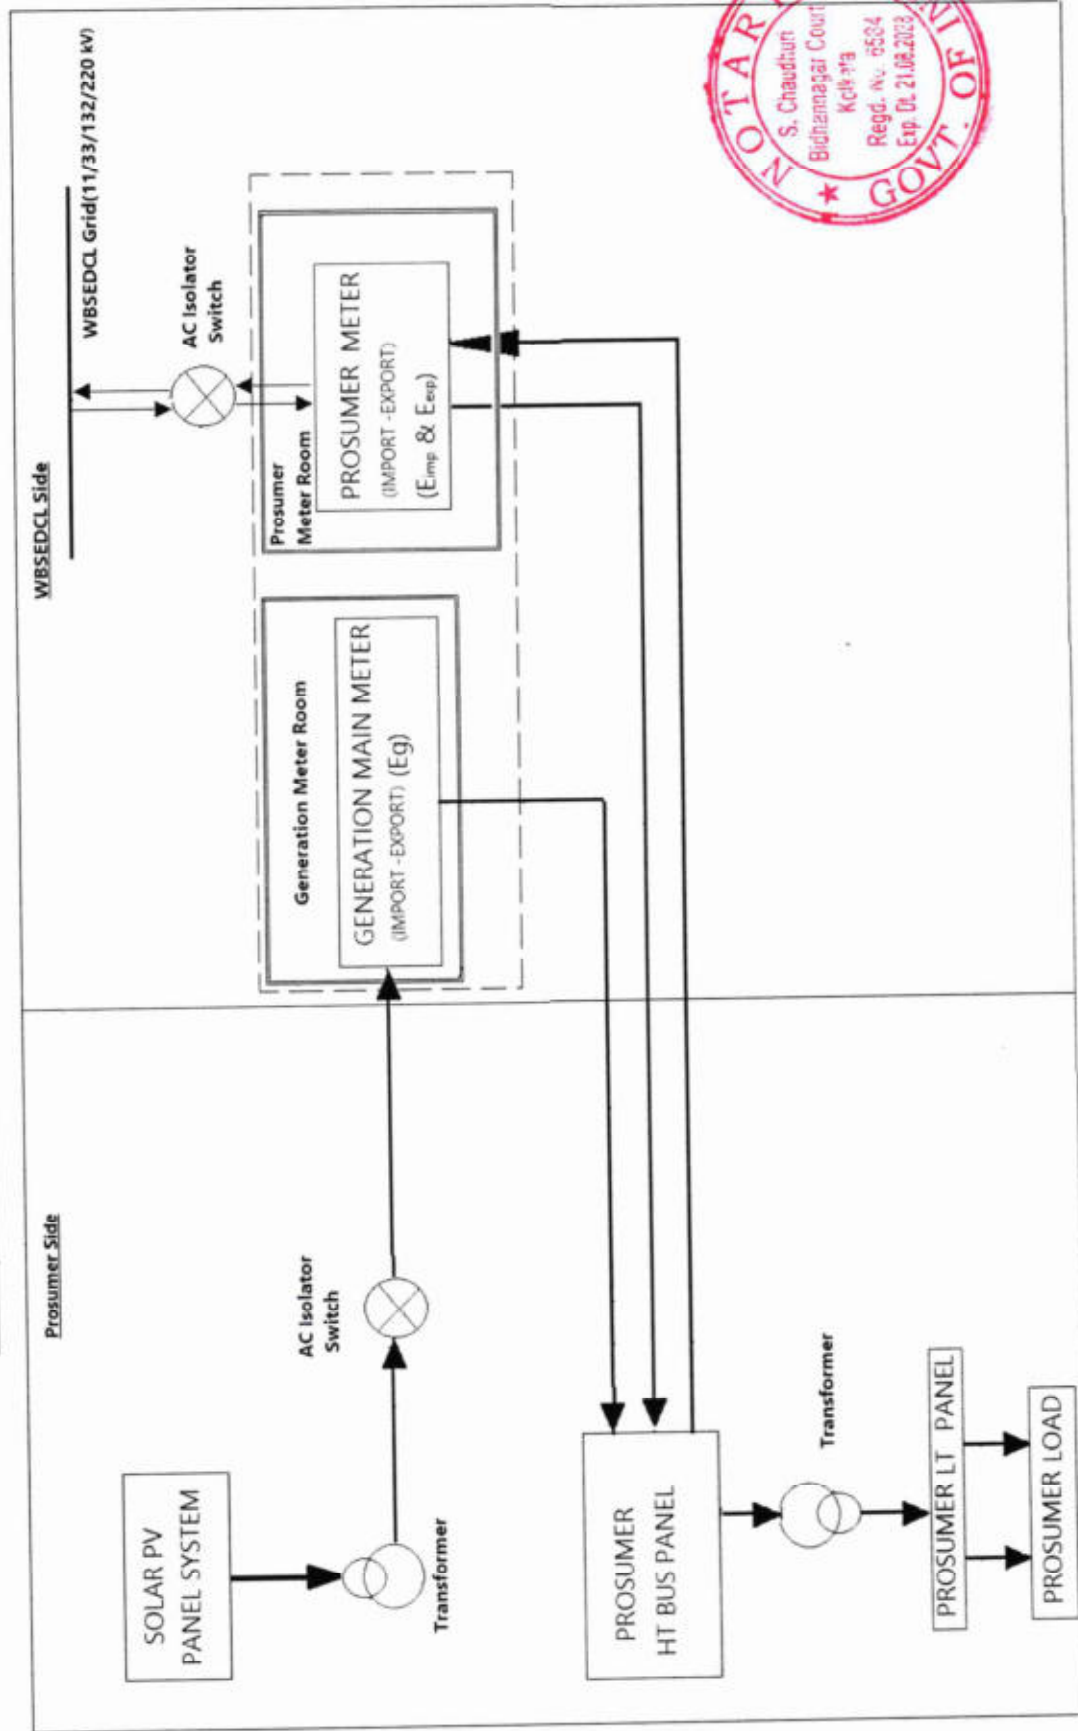


*For net metering arrangement billing will be done as per Schedule-1 of WBSEDCL PROCEDURES-C(2025).
 *For net billing arrangementnet billing will be done as per Schedule-2 of WBSEDCL PROCEDURES-C(2025).

DIAGRAM-C

CONNECTION DIAGRAM FOR NET METERING AND NET BILLING ARRANGEMENT HAVING SANCTIONED LOAD/CONTRACTUAL DEMAND ABOVE 200KVA/170KW


(Solar Injection at any other lower voltage at which the prosumer has been given supply)

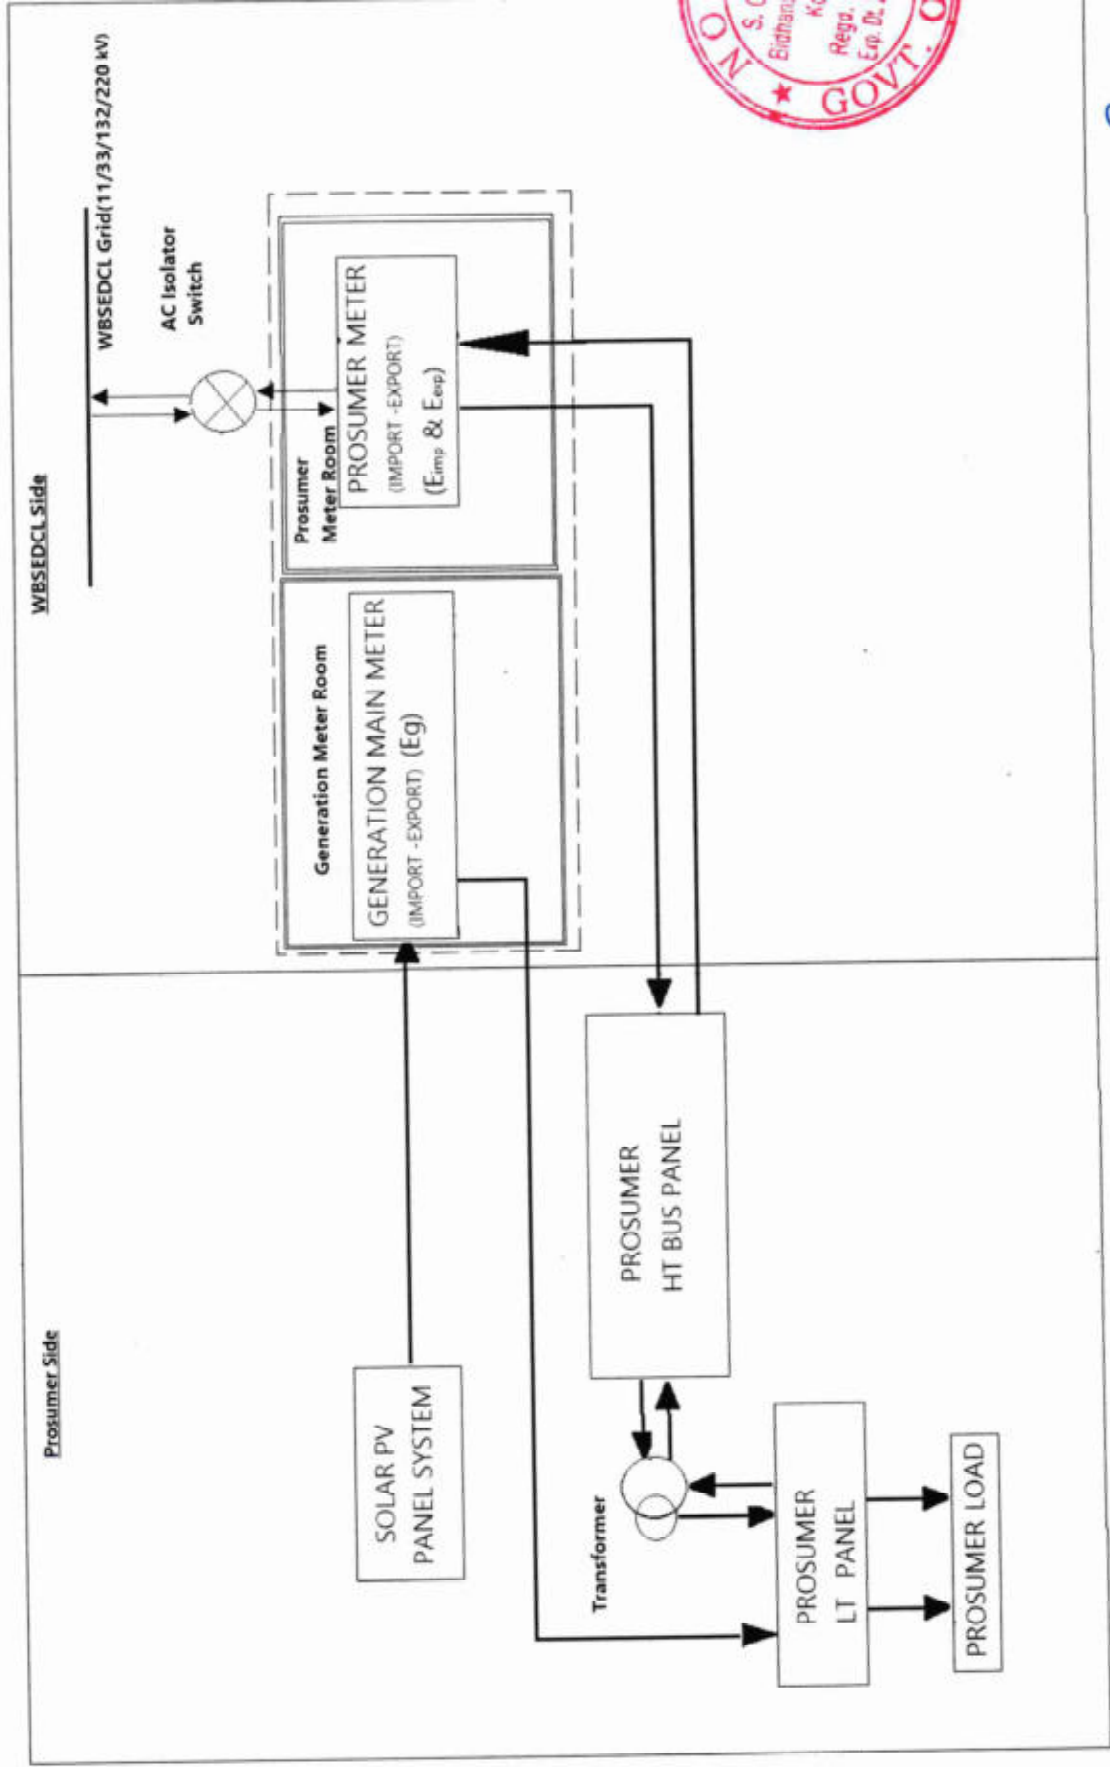

Santam Sarkar
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

*For net metering arrangement billing will be done as per Schedule-1 of WBSEDCL PROCEDURES-C(2025).
*For net billing arrangement billing will be done as per Schedule-2 of WBSEDCL PROCEDURES-C(2025).

DIAGRAM-D
CONNECTION DIAGRAM FOR GROSS METRING ARRANGEMENT HAVING SANCTIONED
LOAD/CONTRACT DEMAND UPTO 200KVA/170KW

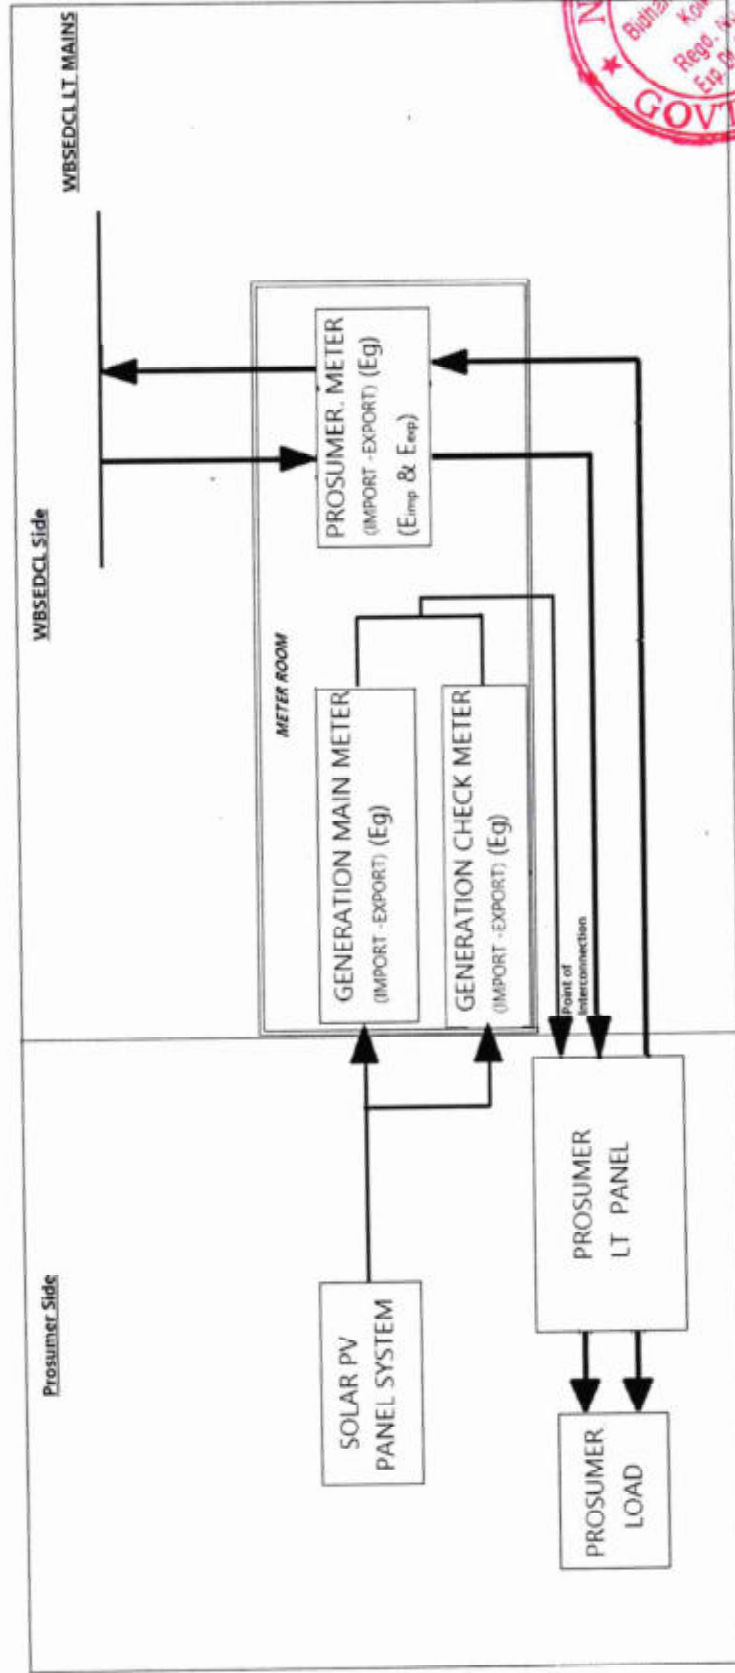

* For Gross metering arrangement the billing will be done as per Schedule-3 of WBSEDCL PROCEDURES-C(2025) where


Energy generated by a Prosumer by SPV during billing period = E_g
 Energy consumed by a Prosumer during billing period = $E_g + E_{imp} - E_{exp}$

Santam Sanyal
 Chief Engineer (Regulation)
 Regulation Department
 WBSEDCL

DIAGRAM-E

CONNECTION DIAGRAM FOR GROSS METERING ARRANGEMENT HAVING SANCTIONED LOAD/CONTRACT DEMAND ABOVE 200KVA/170KW

(Solar Injection at same voltage level at which prosumer has been given supply)

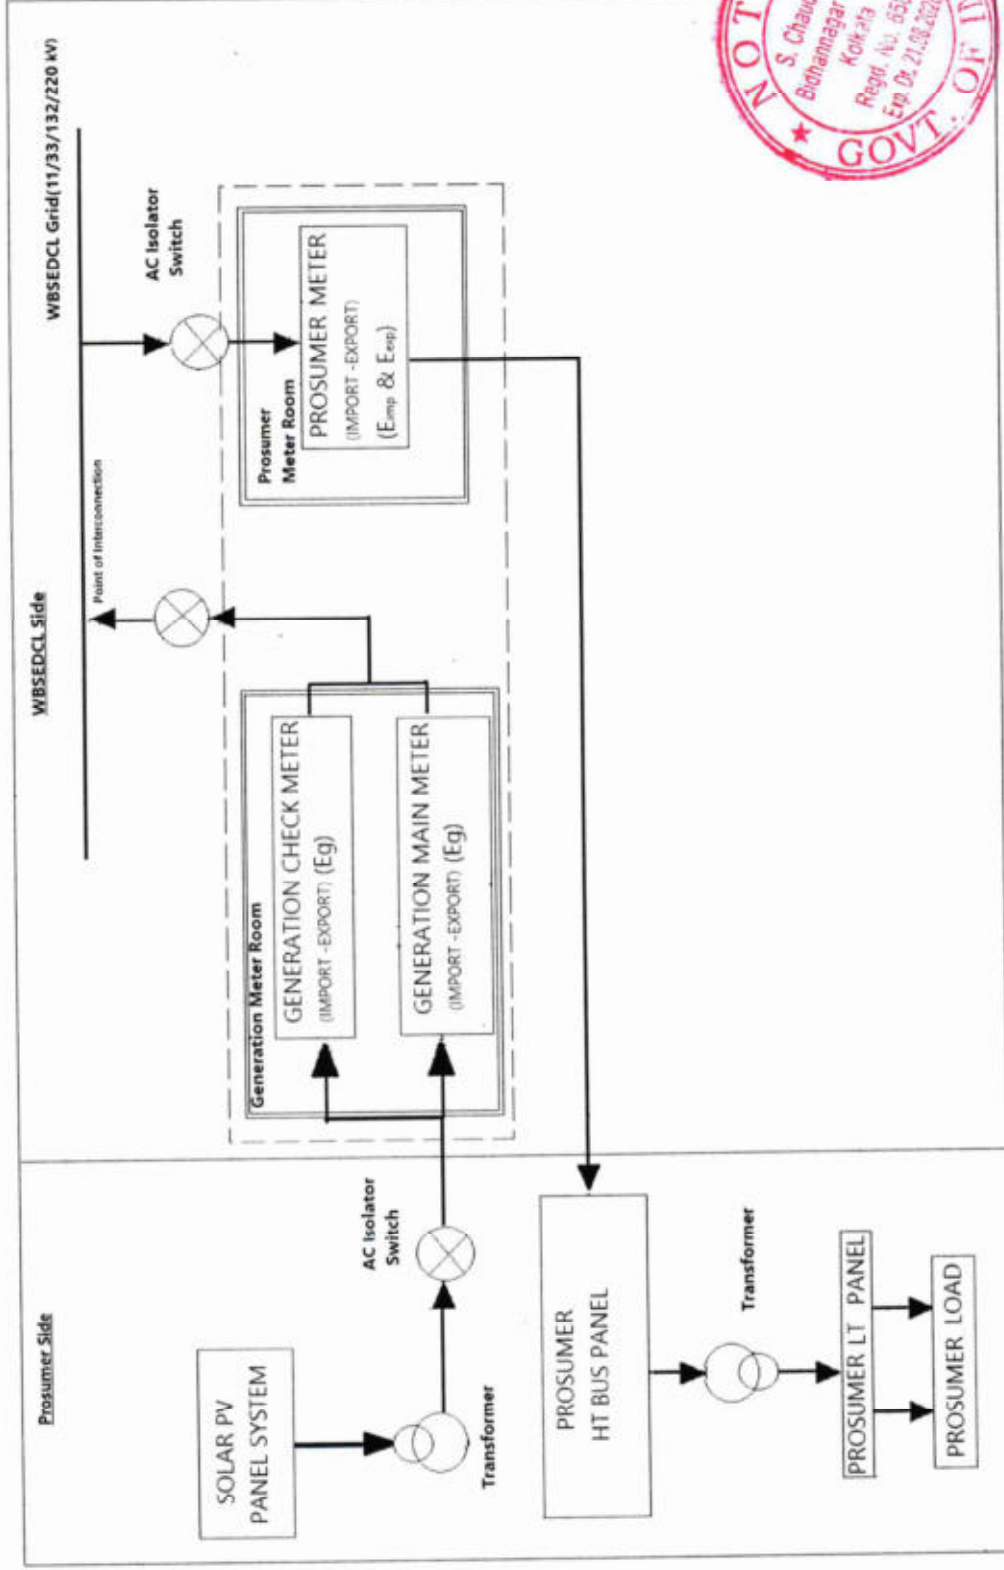

*For Gross metering arrangement the billing will be done as per Schedule-3 of WBSEDCL PROCEDURES-C(2025)
where


Energy generated by a Prosumer by SPV during billing period = E_g
Energy consumed by a Prosumer during billing period = E_{imp}

Santanu Sarker
Chief Engineer (Regulation)
Regulation Department
WBSEDCL

DIAGRAM-F

CONNECTION DIAGRAM FOR GROSS METERING ARRANGEMENT HAVING SANCTIONED LOAD/CONTRACT DEMAND ABOVE 200KVA/170KW

(Solar injection at any other lower voltage at which the prosumer has been given supply)

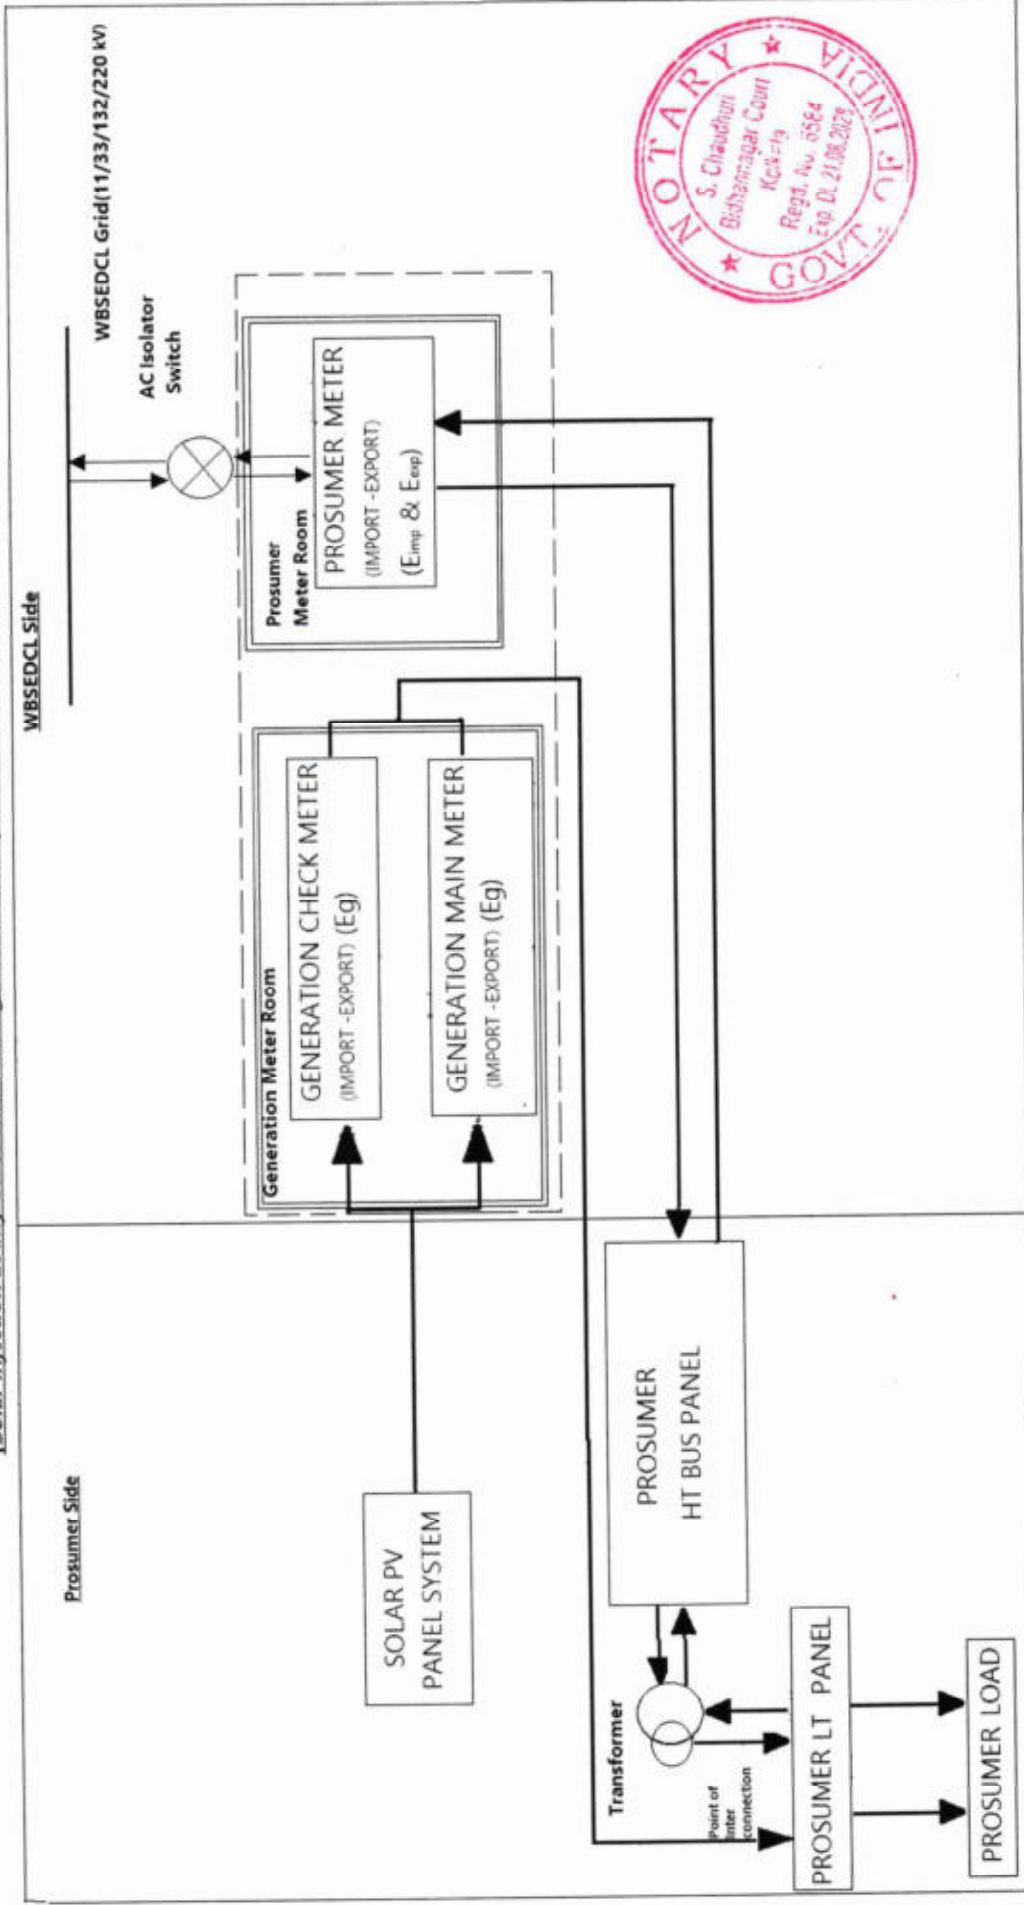

* For Gross metering arrangement the billing will be done as per Schedule-3 of WBSEDCL PROCEDURES-C(2025)

where

Energy generated by a Prosumer by SPV during billing period = $E_g / (1.03)^n$

Energy consumed by a Prosumer during billing period = $(E_g / (1.03)^n) + E_{imp} - E_{exp}$

and n = Number of Voltage Transformation in between Prosumer supply point of WBSEDCL and solar generation injection point.

Santam Sarkar
 Chief Engineer (Regulation)
 Regulation Department
 WBSEDCL