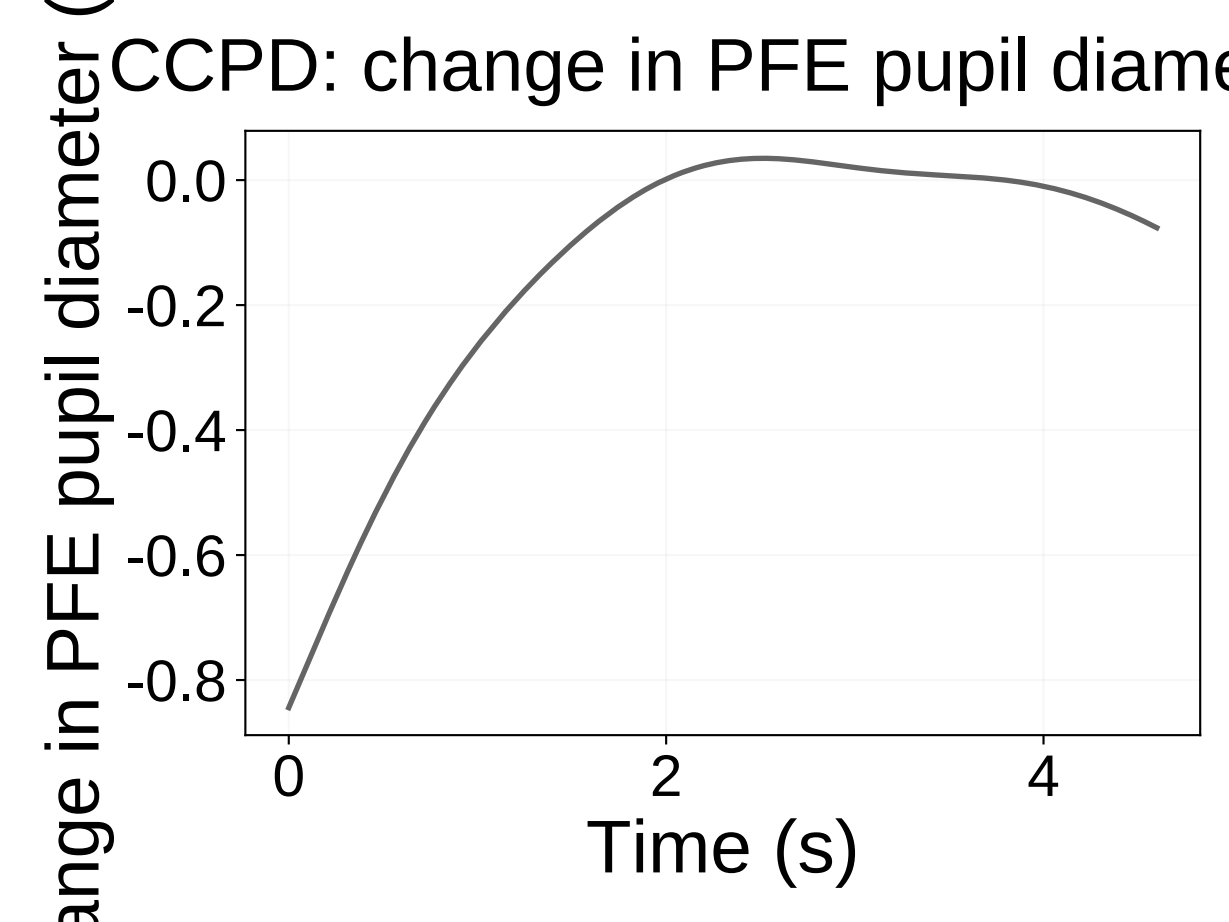
CCPD: change in PFE pupil diame
0.0
-0.2
-0.4
-0.6
-0.8
0
2
4
Time (s)
ange in PFE pupil diameter (