


NOTES:

1. ALL BIORETENTION FACILITIES SHALL HAVE A MINIMUM 20 FOOT ACCESS EASEMENT CONNECTING TO A DEDICATED PUBLIC RIGHT OF WAY. ACCESS ROAD SHALL HAVE MIN. 12' STABILIZED WIDTH, MAX. LONG. GRADE OF 15%, MAX. CROSS-SLOPE 5%. IN ADDITION, A 10-FOOT WIDE PERMANENT MAINTENANCE ACCESS EASEMENT MUST BE PROVIDED AROUND THE PERIMETER OF ALL BMPs TO ALLOW FOR ADEQUATE MAINTENANCE AND REPAIR.
2. ALL DRAINAGE AREAS TO A BIORETENTION FACILITY ARE TO BE STABILIZED PRIOR TO INSTALLATION OF AMENDED SOILS, MULCH OR PLANTINGS.
3. AMENDED SOIL WILL ONLY BE PERMITTED WITH A VALID SOIL ANALYSIS REPORT. NO AMENDED SOIL SHALL BE ALLOWED ON THE SIDE SLOPES.
4. INSTALL WIRE SCREENING AROUND ALL OUTLET OPENINGS TO PREVENT LOSS OF MULCH.
5. UNDERDRAIN PIPE SHOULD BE MIN. 6" PERFORATED SCHEDULE 40 PVC (PER AASHTO M278) OR DOUBLE WALL HDPE (PER AASHTO M252). PERFORATIONS SHOULD BE 3/8" SPACED 3" ON CENTER ALONG 4 LONGITUDINAL ROWS SPACED 90° APART.
6. UNDERDRAIN CLEANOUTS SHOULD EXTEND A MIN. OF 6" ABOVE MAXIMUM PONDING ELEVATION. ONE CLEANOUT MAY BE FLUSH WITH TOP OF SURFACE TO ALLOW DRAWDOWN.
7. ONLY SMALL MATURING TREES ARE ALLOWED TO BE PLANTED IN THE AMENDED SOILS.

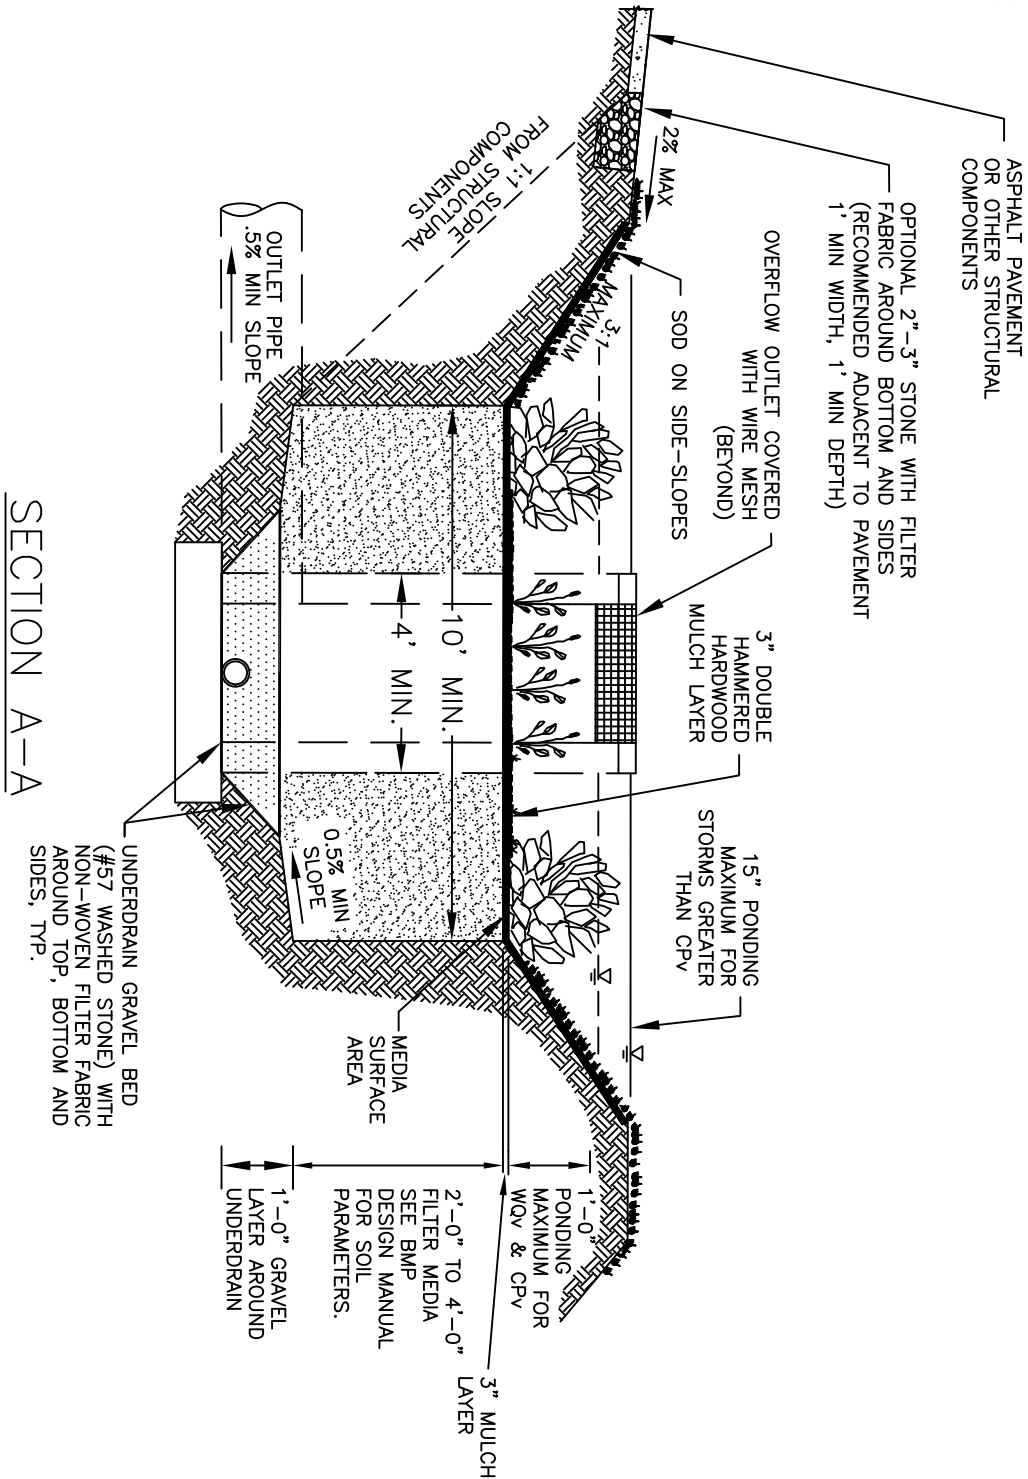

SECTION A-A

NOT TO SCALE

