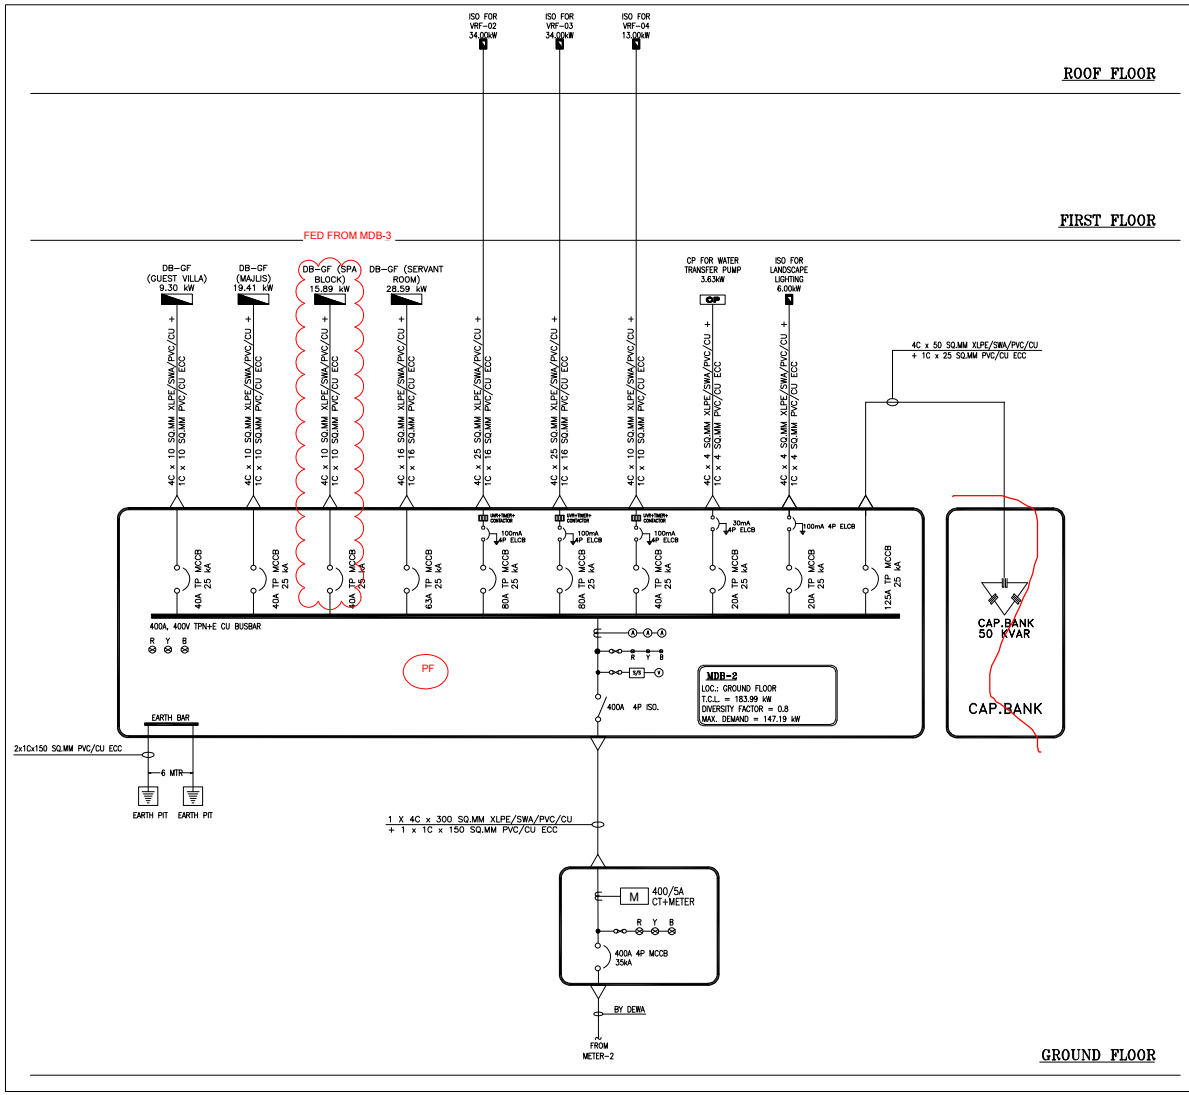

METER CABINET D



TYPICAL ARRANGEMENT OF METERI
CABINET ON COMPOUND WALL

1—MINIMUM DIMENSIONS

kwh Metering Type Reference	Rating of incomer breaker in metering cabinet
1	400A

NOTE :—

ALL DIMENSIONS NOTED ARE IN CENTIMETRES AND NOT TO SCALE

II— DESCRIPTION

1:- COMPOUND WALL
2:- WEATHER PROOF (IP 55) METEF
3:- TRANSPARENT VIEWING WINDO
4:- HINGED DOOR WITH PROVISION SEALING & PAD LOCKING.
5:- CABLE (GLAND) BOX.
6:- POSITION OF INCOMER BREAKE
7:- 15 / 10 cm PVC. PIPE SLEEVE FO SERVICE CABLE.
8:- 15 / 10 cm PVC. PIPE SLEEVE FO LOAD CABLE.
9:- CONDUIT/S FOR EARTHING COI
10:- CANOPY FOR METER CABINET