



REFER SCHEDULE FOR THE CORRECTIONS TO INCORPORATE

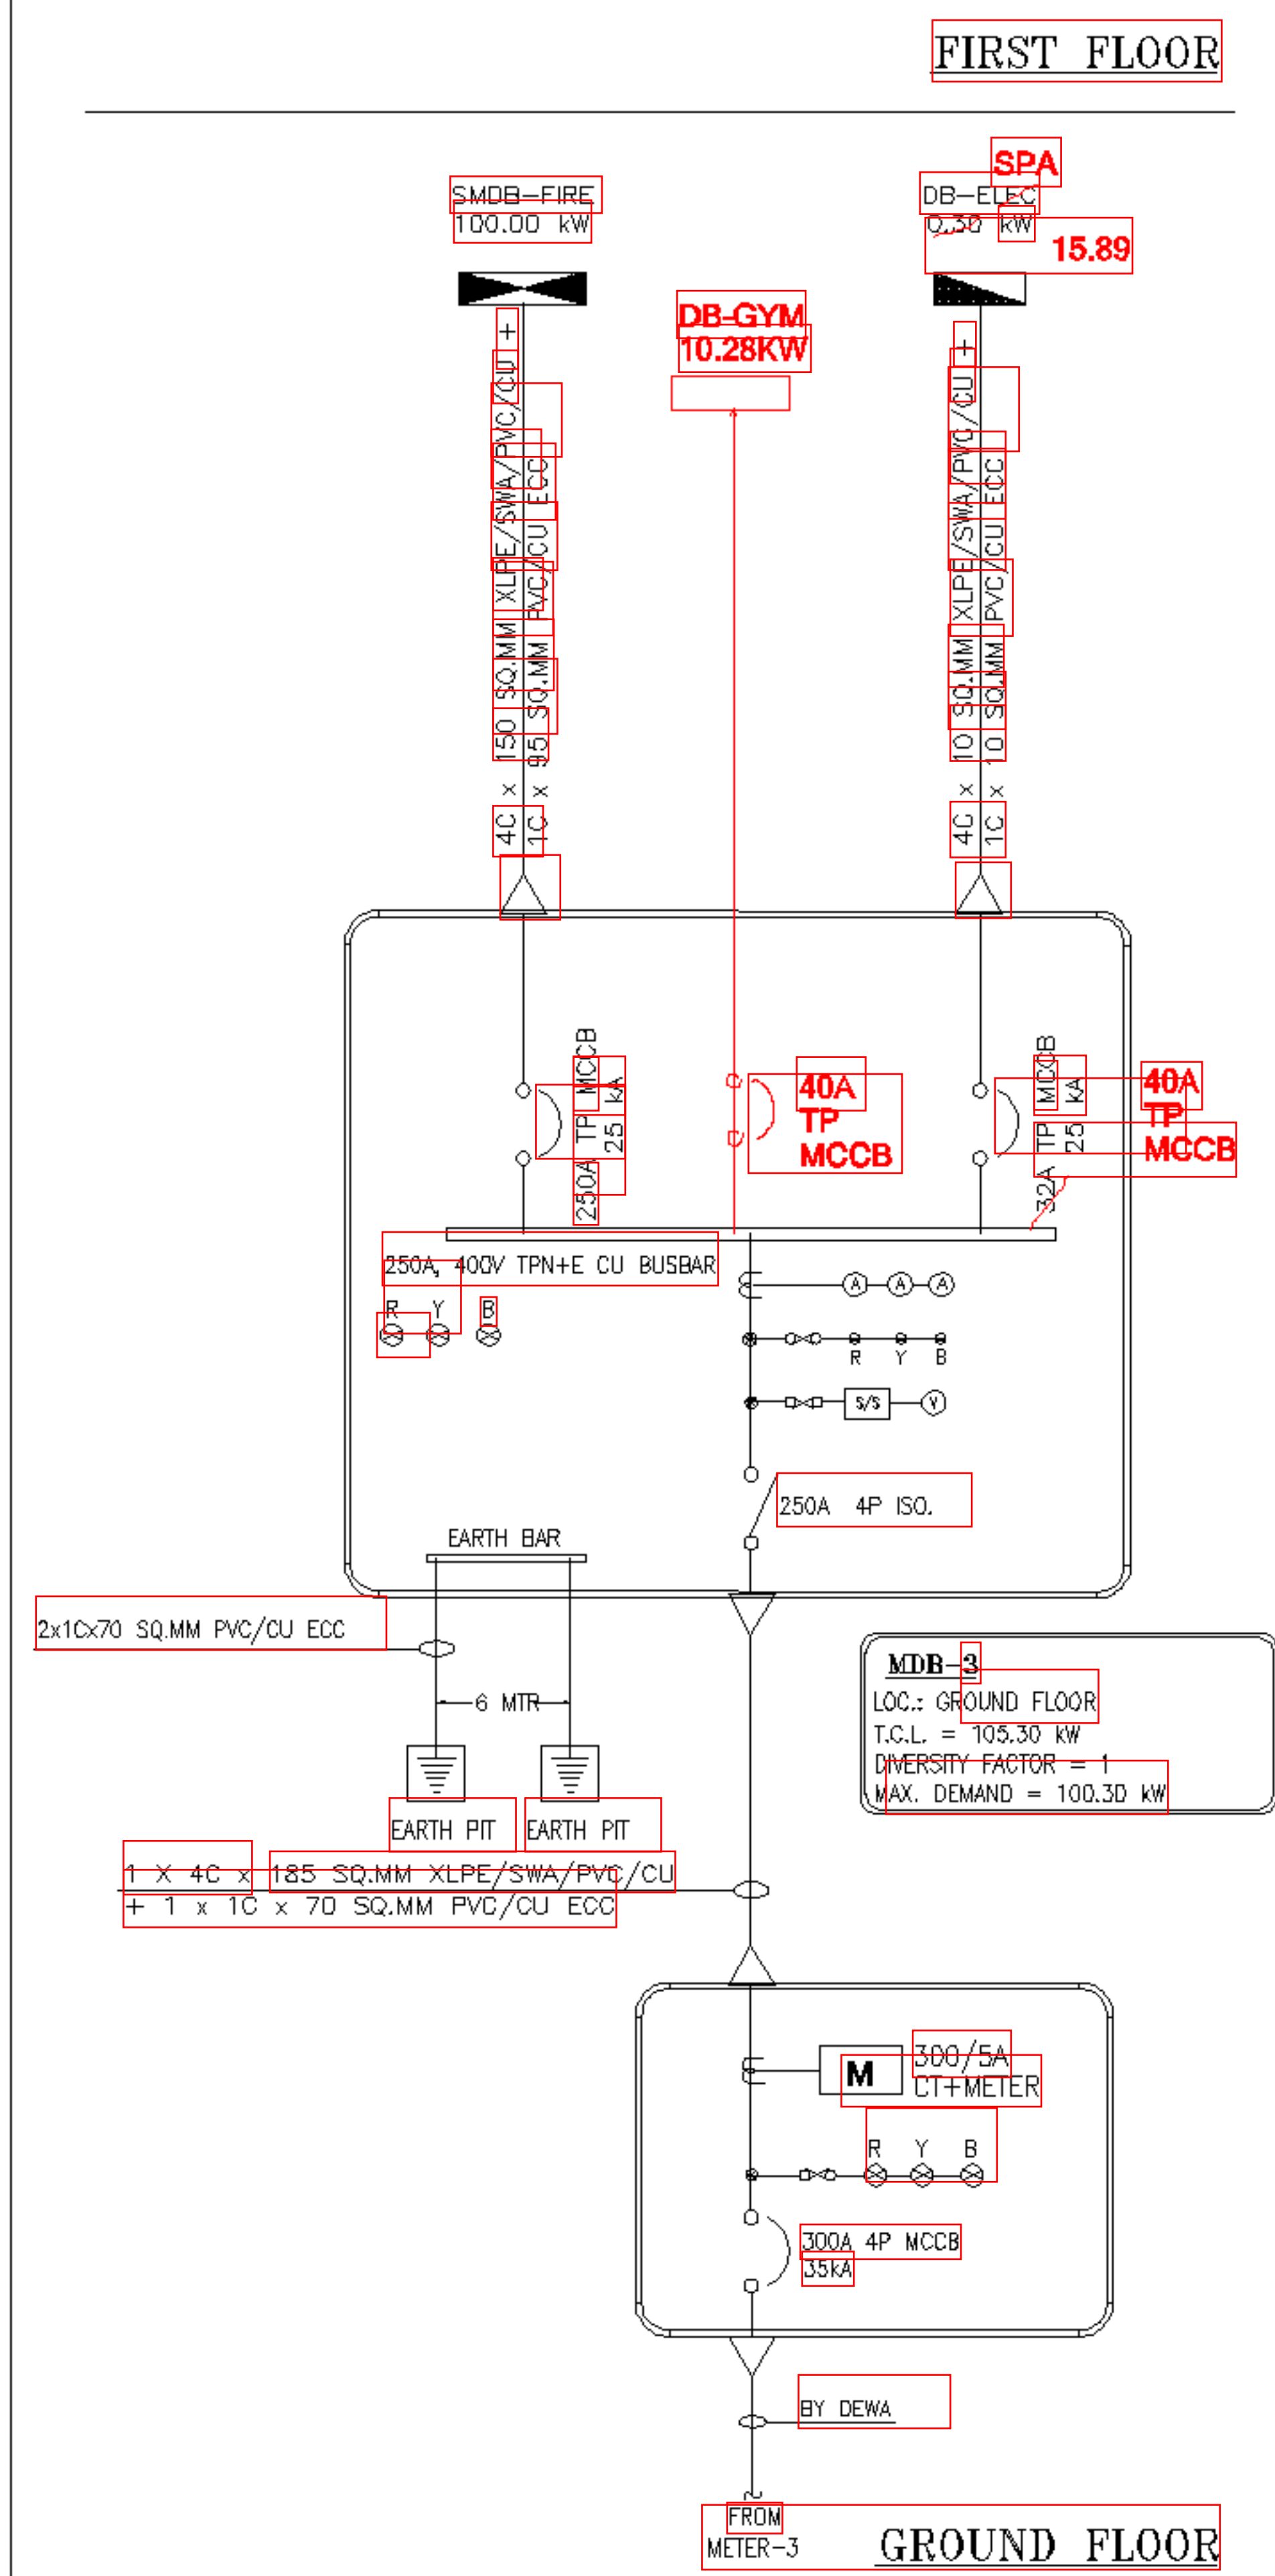

METER CABINET DETAIL

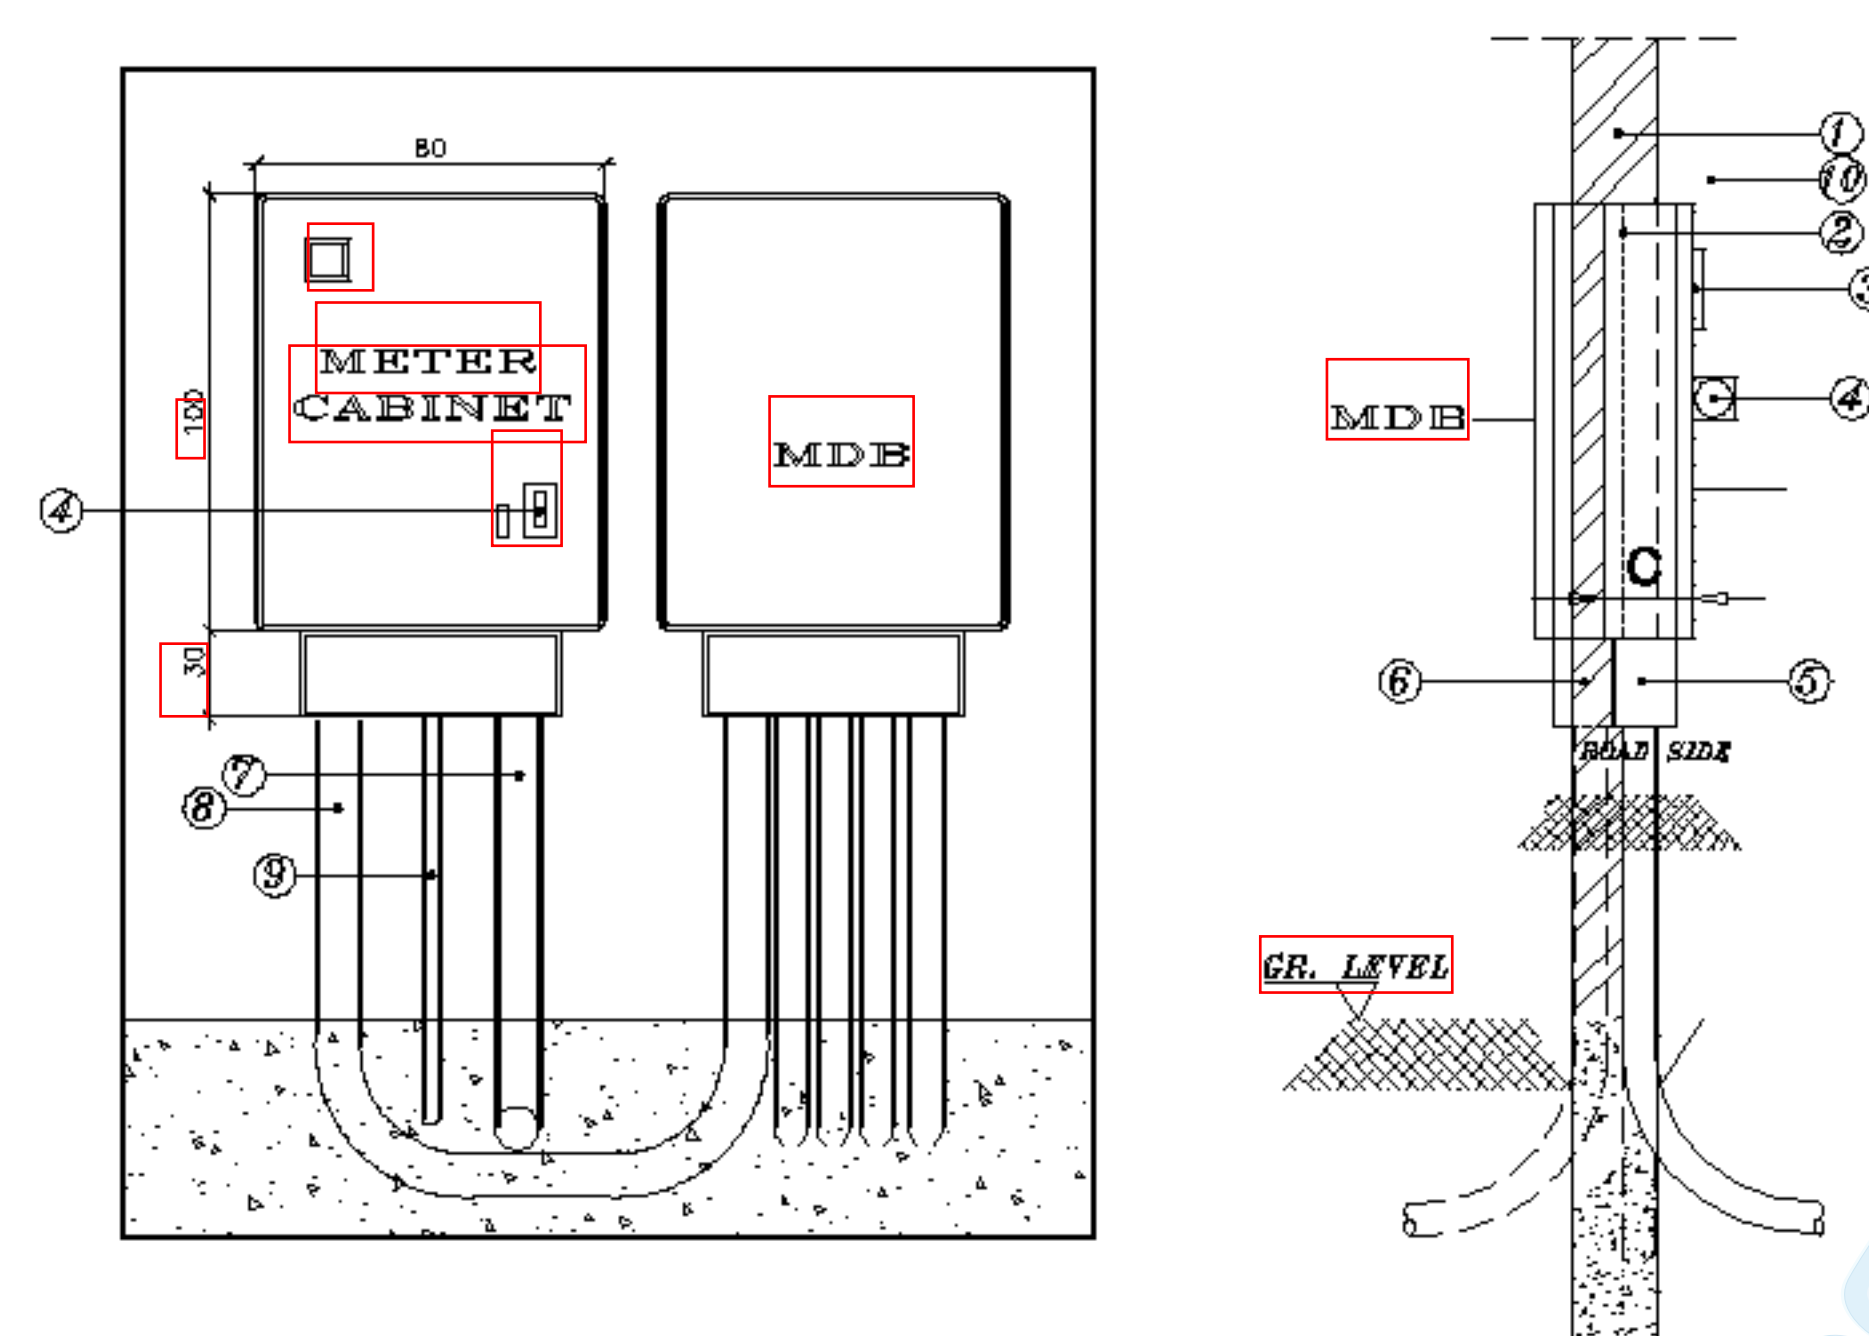

TYPICAL ARRANGEMENT OF METERING CABINET ON COMPOUND WALL

1 - MINIMUM DIMENSIONS

kwh Metering Type Reference	Rating of incomer breaker in metering cabinet	Dimensions in cm			
		A	B	C	D
1	250A	80	100	30	25

NOTE 1 -
ALL DIMENSIONS NOTED ARE IN
CENTIMETRES AND NOT TO SCALE

II - DESCRIPTION

- 1:- COMPOUND WALL
- 2:- WEATHER PROOF (IP 55) METERING CABET.
- 3:- TRANSPARENT VIEWING WINDOW.
- 4:- HINGED DOOR WITH PROVISION FOR WIRE SEALING & PAD LOCKING.
- 5:- CABLE (GLAND) BOX.
- 6:- POSITION OF INCOMER BREAKER.
- 7:- 15 / 10 cm PVC. PIPE SLEEVE FOR SERVICE CABLE.
- 8:- 15 / 10 cm PVC. PIPE SLEEVE FOR LOAD CABLE.
- 9:- CONDUITS FOR EARTHING CONDUCTORS (ECC).
- 10:- CANOPY FOR METER CABINET

