

IRRIGATION LEGEND:		
MAIN LINE DONE BY OTHERS		
	150 mm DIA u PVC	
	150 mm DIA OR ABOVE AC	
	75 mm DIA OR ABOVE uPVC	
LEGENDS:- (JO-122)		
	Description	Qty.
	3" INCH DIA uPVC	50.00 Mtrs
	1" INCH DIA uPVC	12.00 Mtrs
	75/25x75mm Dia uPVC TEE	2 Nos.
	TIE IN CONNECTION WITH 75 mm Dia uPVC END CAP	1 No.
	1" DIA IRRIGATION WATER SUPPLY METER ASSEMBLY	1 No.
	75mm Dia uPVC END CAP	1 No.
		2 Nos.
		2 Nos.
	75/50mm Dia uPVC Reducer	1 No.
	50/38mm Dia uPVC Reducer	1 No.
	38/25mm Dia uPVC Reducer	1 No.
	THRUST BLOCK	7 Nos.
	TRIAL PIT	5 Nos.
	CONCRETE BARRIER	50.00 Mtrs

IRRIGATION DUCT SCHEDULE							
PIPE SIZE	1"		2"	3"	4"	6"	8"
DUCT SIZE	4"	4"	4"	6"	8"	12"	12"

ELECTRICITY NETWORK LEGEND

CABLES


400KV In Service	110KV In Service	110KV Proposed	110KV Cancelled	110KV Proposed	110KV Cancelled
400KV Proposed	110KV Proposed	110KV Cancelled	110KV Proposed	110KV Cancelled	110KV Proposed
400KV Cancelled	110KV Cancelled	110KV Proposed	110KV Cancelled	110KV Proposed	110KV Cancelled
400KV Proposed	110KV Proposed	110KV Cancelled	110KV Proposed	110KV Cancelled	110KV Proposed
400KV Cancelled	110KV Cancelled	110KV Proposed	110KV Cancelled	110KV Proposed	110KV Cancelled
132KV In Service	6.6KV In Service	6.6KV Proposed	6.6KV Cancelled	6.6KV Proposed	6.6KV Cancelled
132KV Proposed	6.6KV Proposed	6.6KV Cancelled	6.6KV Proposed	6.6KV Cancelled	6.6KV Proposed
132KV Cancelled	6.6KV Cancelled	6.6KV Proposed	6.6KV Cancelled	6.6KV Proposed	6.6KV Cancelled
132KV Proposed	6.6KV Proposed	6.6KV Cancelled	6.6KV Proposed	6.6KV Cancelled	6.6KV Proposed
132KV Cancelled	6.6KV Cancelled	6.6KV Proposed	6.6KV Cancelled	6.6KV Proposed	6.6KV Cancelled
33KV In Service	400 V. In Service	400 V. Proposed	400 V. Cancelled	400 V. Proposed	400 V. Cancelled
33KV Proposed	400 V. Proposed	400 V. Cancelled	400 V. Proposed	400 V. Cancelled	400 V. Proposed
33KV Cancelled	400 V. Cancelled	400 V. Proposed	400 V. Cancelled	400 V. Proposed	400 V. Cancelled
33KV Proposed	400 V. Proposed	400 V. Cancelled	400 V. Proposed	400 V. Cancelled	400 V. Proposed
33KV Cancelled	400 V. Cancelled	400 V. Proposed	400 V. Cancelled	400 V. Proposed	400 V. Cancelled

Conduit System

Electric Station

Service Points

THIS AREA
AL KHAWANEEJ 1ST
COMMUNITY 281

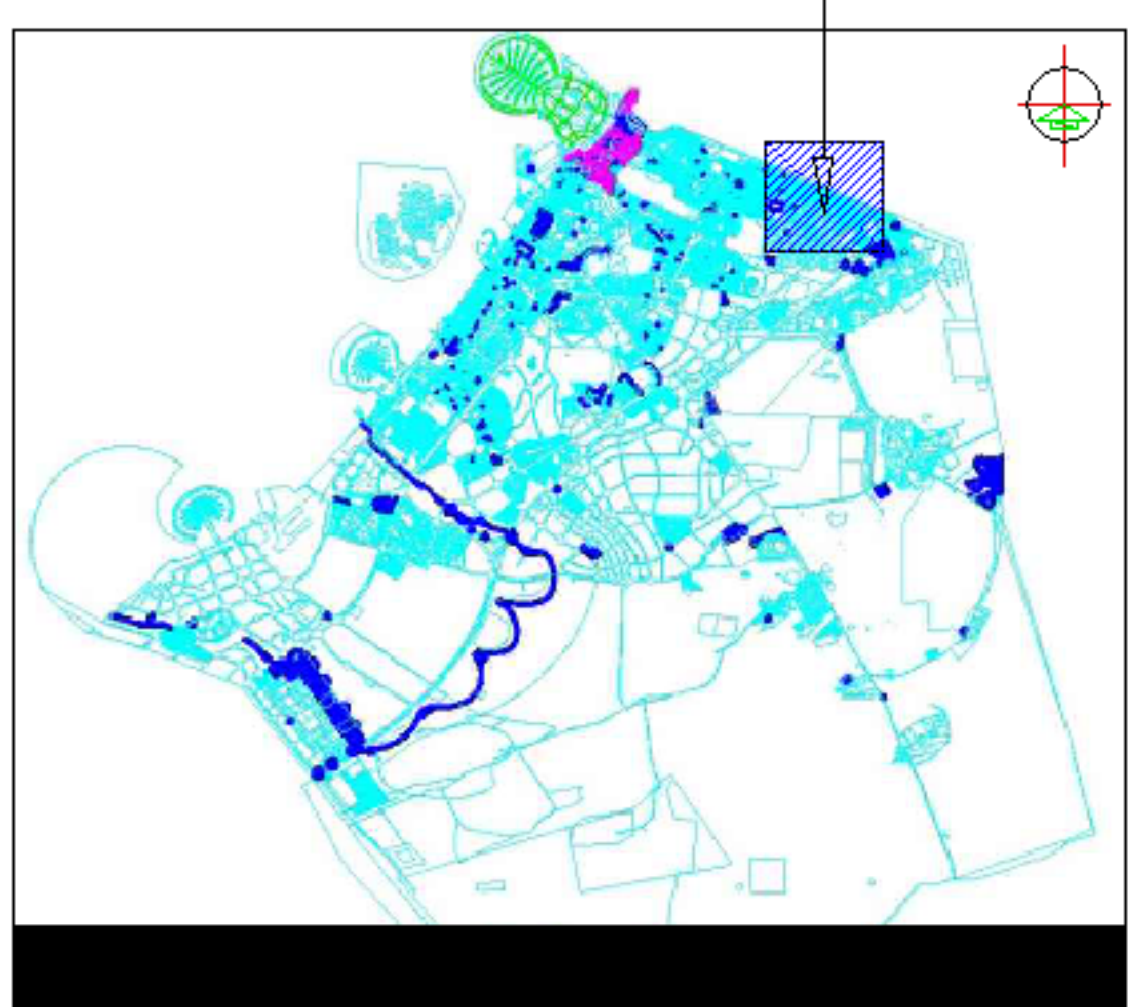

Project Title	IR - 165 SMALL SITES AND IRRIGATION CONNECTIONS- PHASE-11	Drawing No.	GI/R/165/CO-122/22
		Contract	IR 185
Drawing Title	1 st Irrigation Connection for Plot No. 281-1818 with DEWA Electrical Services (CO-122) At Khawaneel 1st	Date	05/04/2018
		Scale	1:750 @ A1
		Reference	