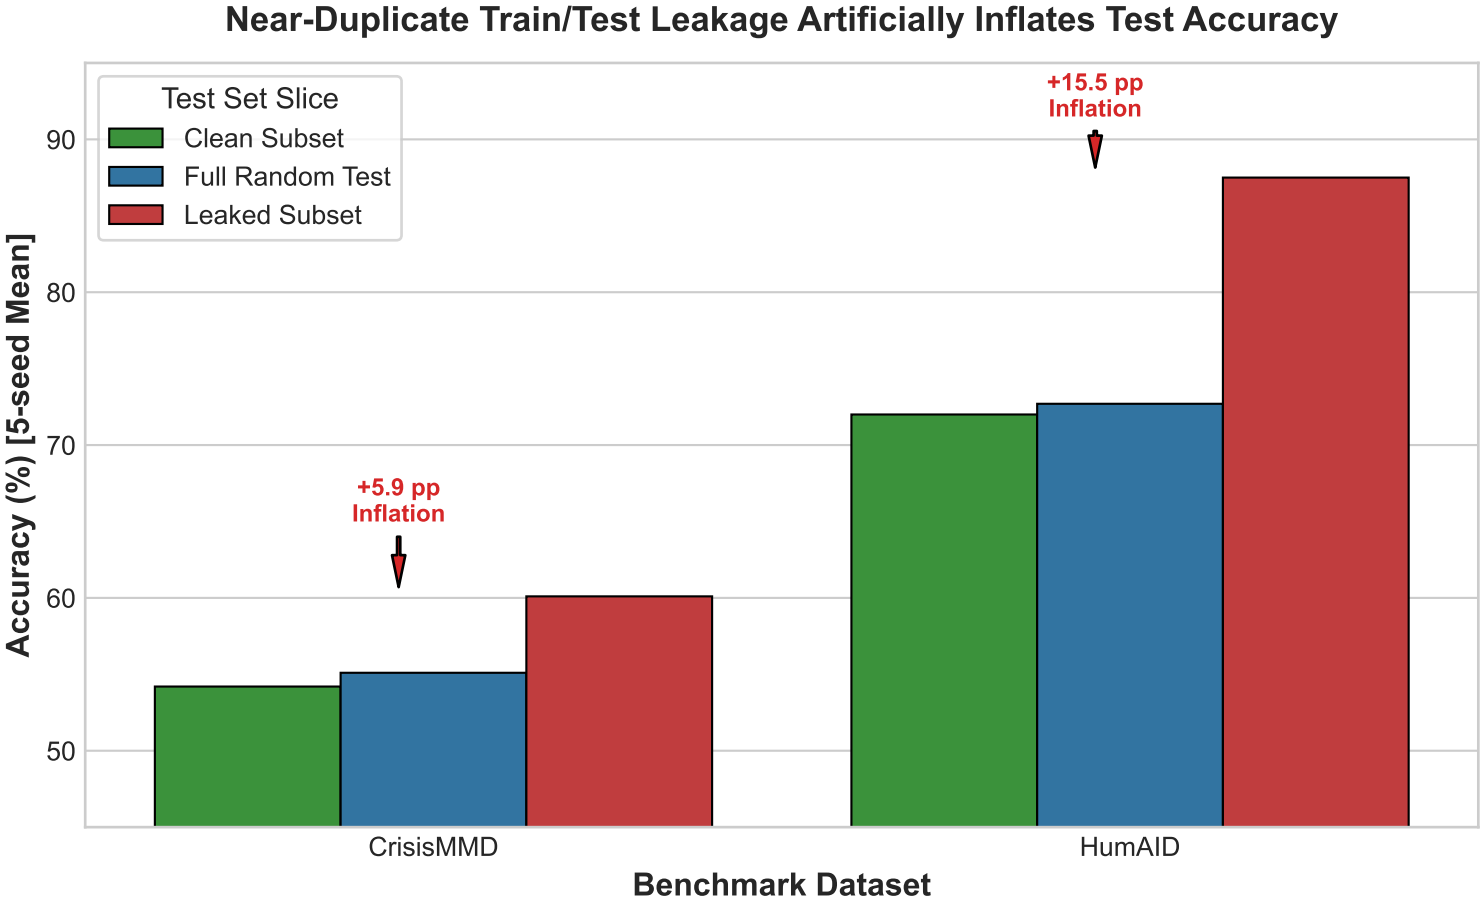
Near-Duplicate Train/Test Leakage Artificially Inflates Test Accuracy
Test Set Slice
Clean Subset
Full Random Test
Leaked Subset
+5.9 pp
Inflation
+15.5 pp
Inflation
Accuracy (%) [5-seed Mean]
90
80
70
60
50
CrisisMMD
HumAID
Benchmark Dataset