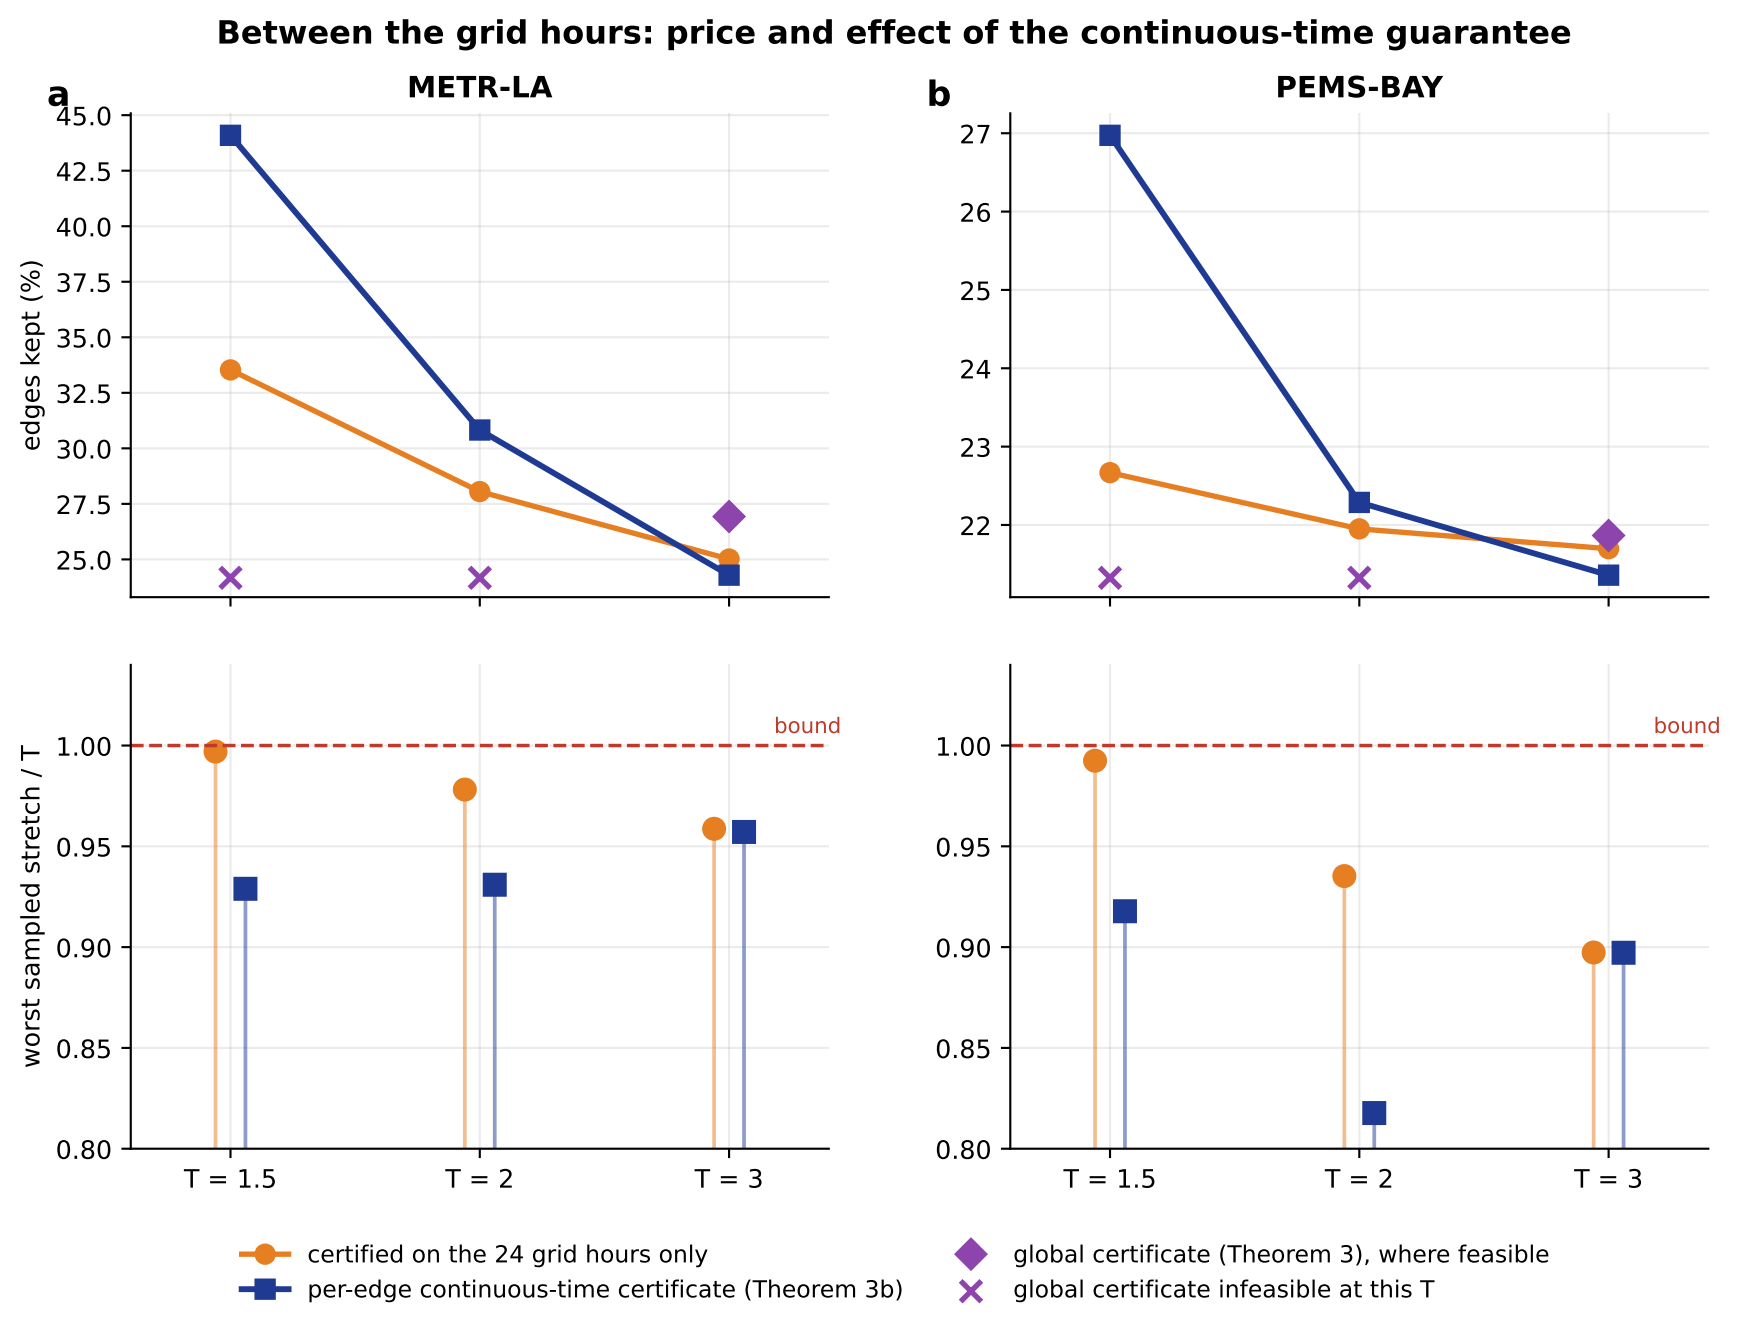
Between the grid hours: price and effect of the continuous-time guarantee
a
METR-LA
b
PEMS-BAY
edges kept (%)
45.0
42.5
40.0
37.5
35.0
32.5
30.0
27.5
25.0
27
26
25
24
23
22
worst sampled stretch / T
1.00
0.95
0.90
0.85
0.80
bound
T = 1.5
T = 2
T = 3
certified on the 24 grid hours only
per-edge continuous-time certificate (Theorem 3b)
global certificate (Theorem 3), where feasible
global certificate infeasible at this T