


No-introgression de novo sweep: simulation status and conditioning diagnostics

Every expected design cell is shown (9 total)

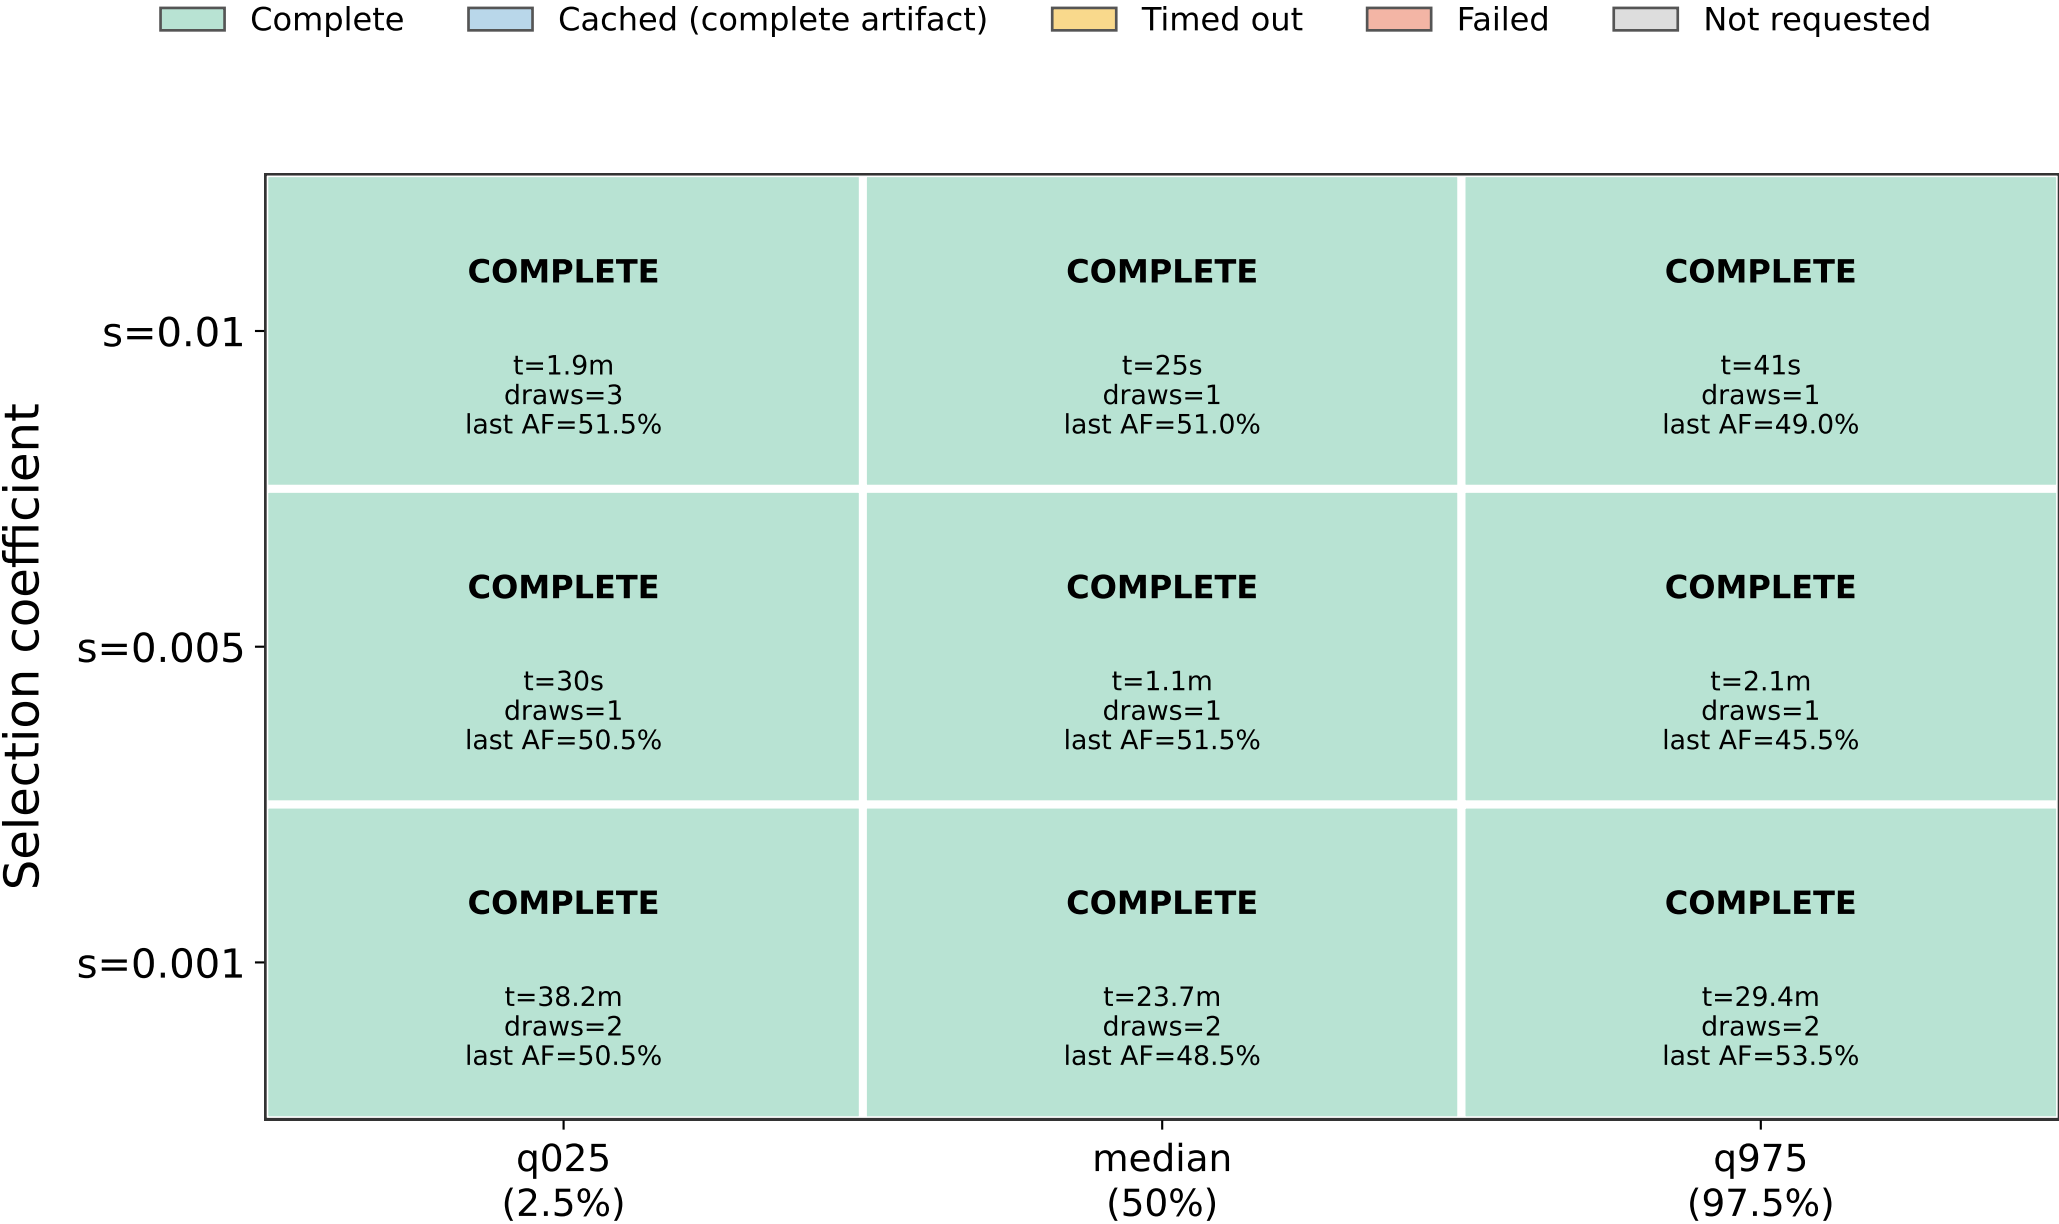

Pointwise EAS Ne sensitivity curve

Cell annotations: recorded final invocation time (not cumulative across retries); completed external draws; sample AF from the last completed draw (when available).