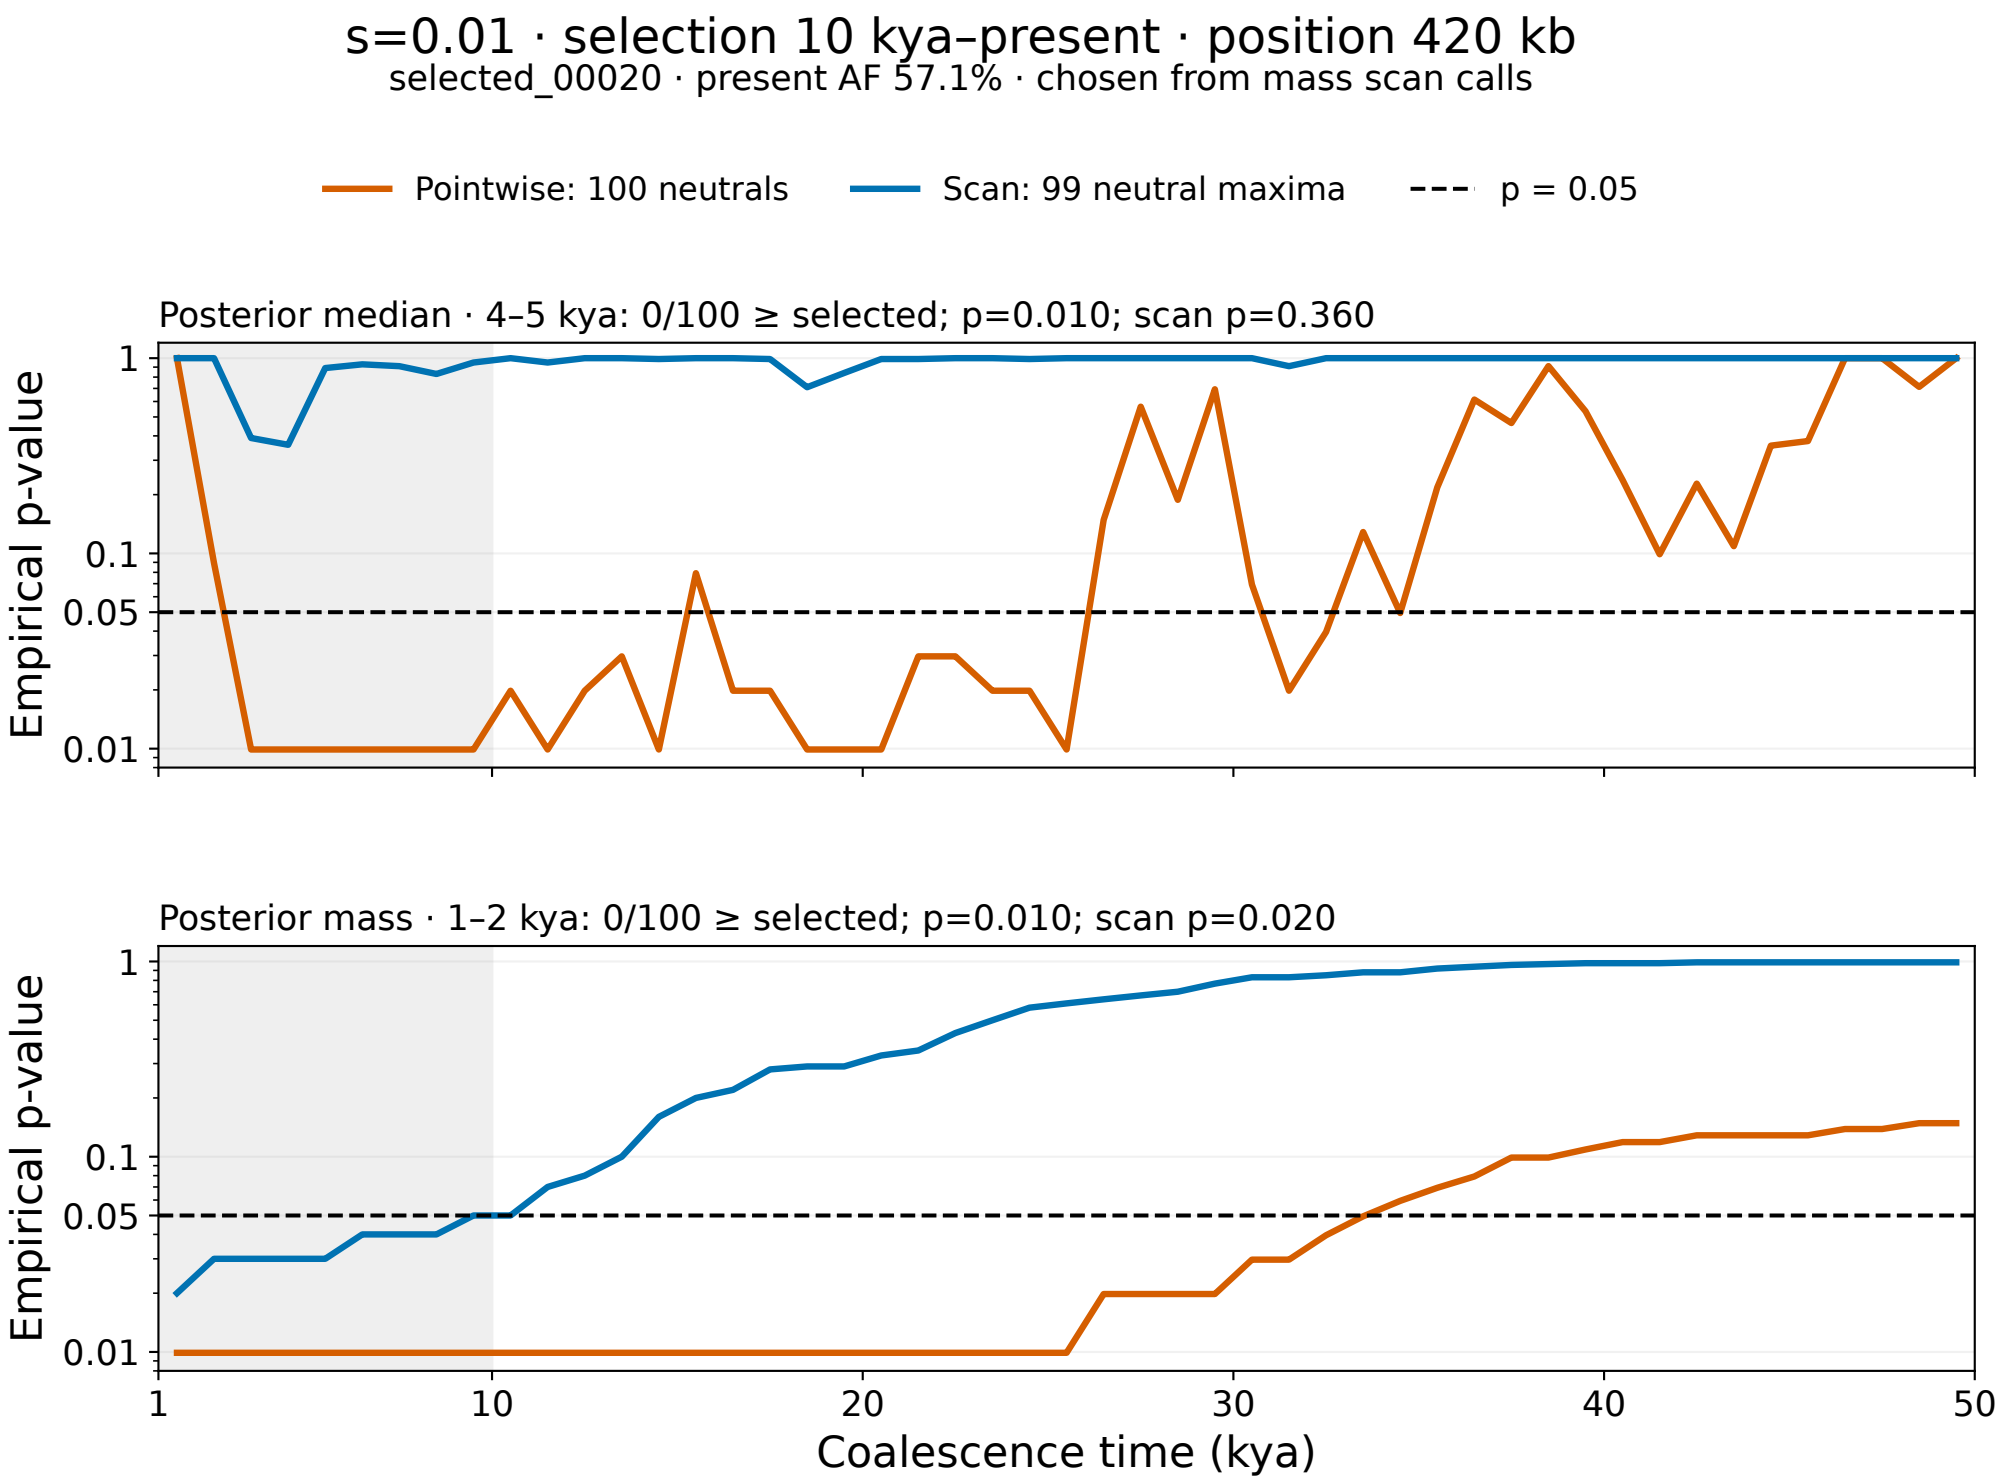

Scan p-values correct over 100 positions × 49 intervals; pointwise p-values do not.

Shading: evaluated part of selection episode. Neutral display: 50 held-out + 50 calibration; illustrative example.