

Cervical Cytology-Histology Correlation QA Report

Automated rule-based quality assurance analysis

Total Cases: 130

Executive Summary

A total of 130 cases were analyzed.

Concordance Summary

Concordance_Class	Count	Percent
minor_discordant	65	50.0
major_discordant	34	26.15
concordant	31	23.85

HSIL-Focused Metrics

Metric	Value
HSIL Pap tests with histologic HSIL (CIN2/CIN3)	42.31
HSIL Pap tests with minor discrepancies	23.08
HSIL Pap tests with major false-positive discrepancies	34.62
Number of major false-negative / cytology undercall discrepancies	14.0
PV+ for HSIL Pap tests (%)	42.31

Discrepancy Bucket Summary

Bucket	Count	Percent
MinVar	7	5.38
MajUnd	14	10.77
MinUnd	43	33.08
Agree	31	23.85
MinOver	15	11.54
MajOver	20	15.38

Key Quality Signals


- Major discordance rate: 26.15%
- Minor discordance rate: 50.0%
- Undercall proportion: 43.85%

- Overall proportion: 26.92%


- HSIL PV+: 42.31%

Figures


Concordance Distribution

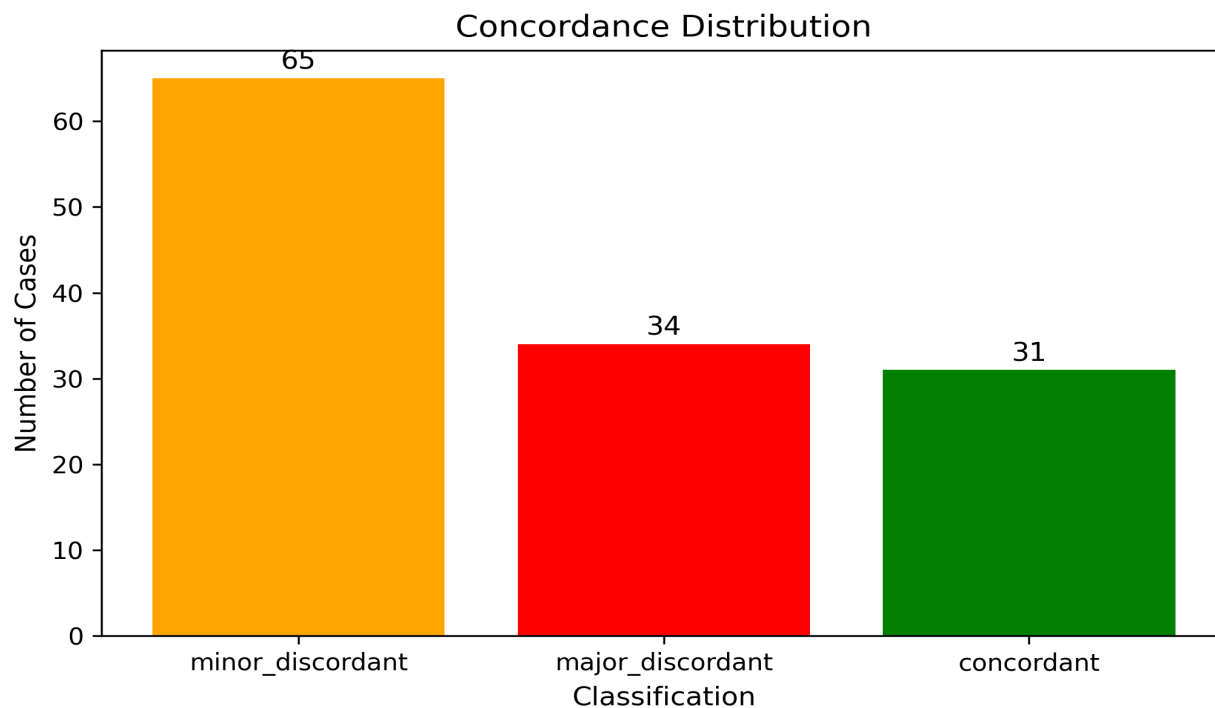


Cytology-Histology Correlation Buckets

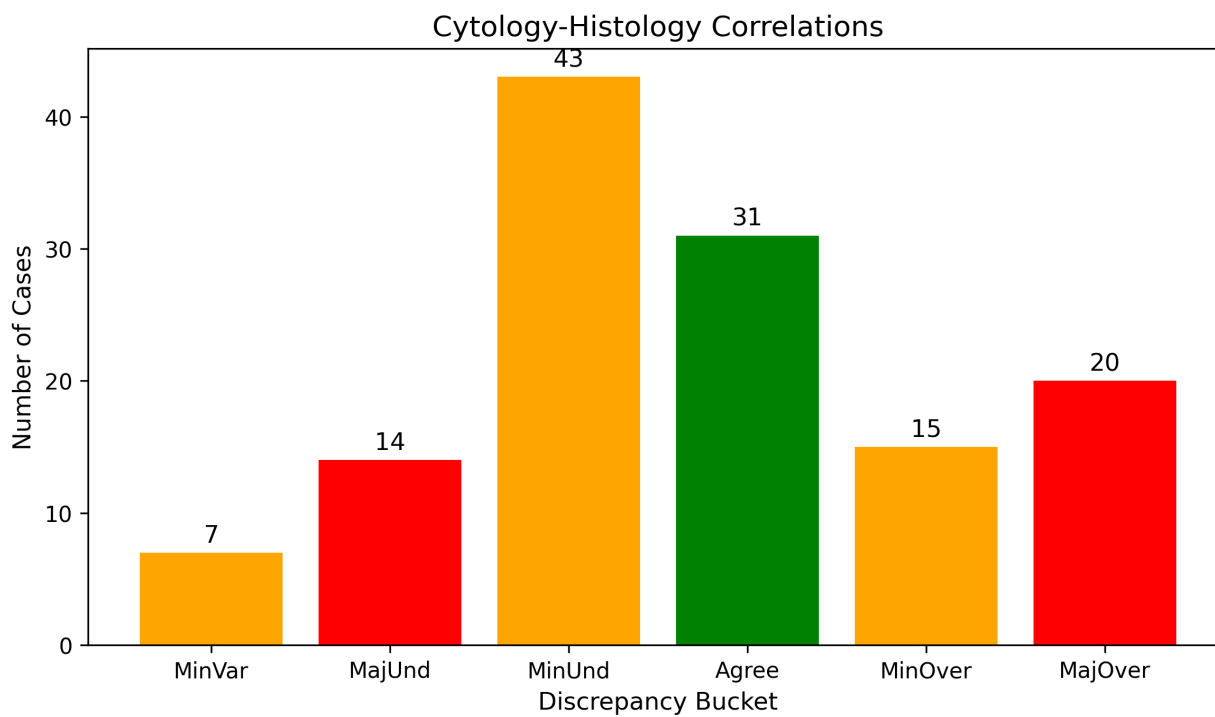

HSIL Correlation Metrics

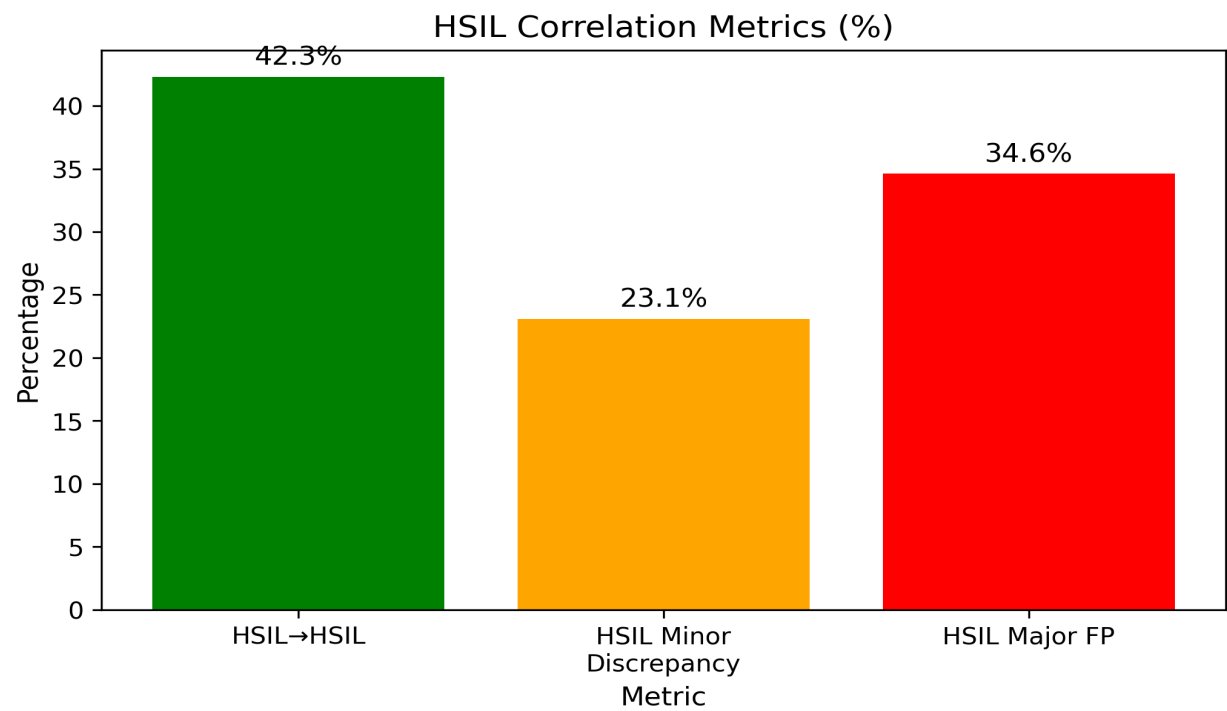

Confusion Matrix

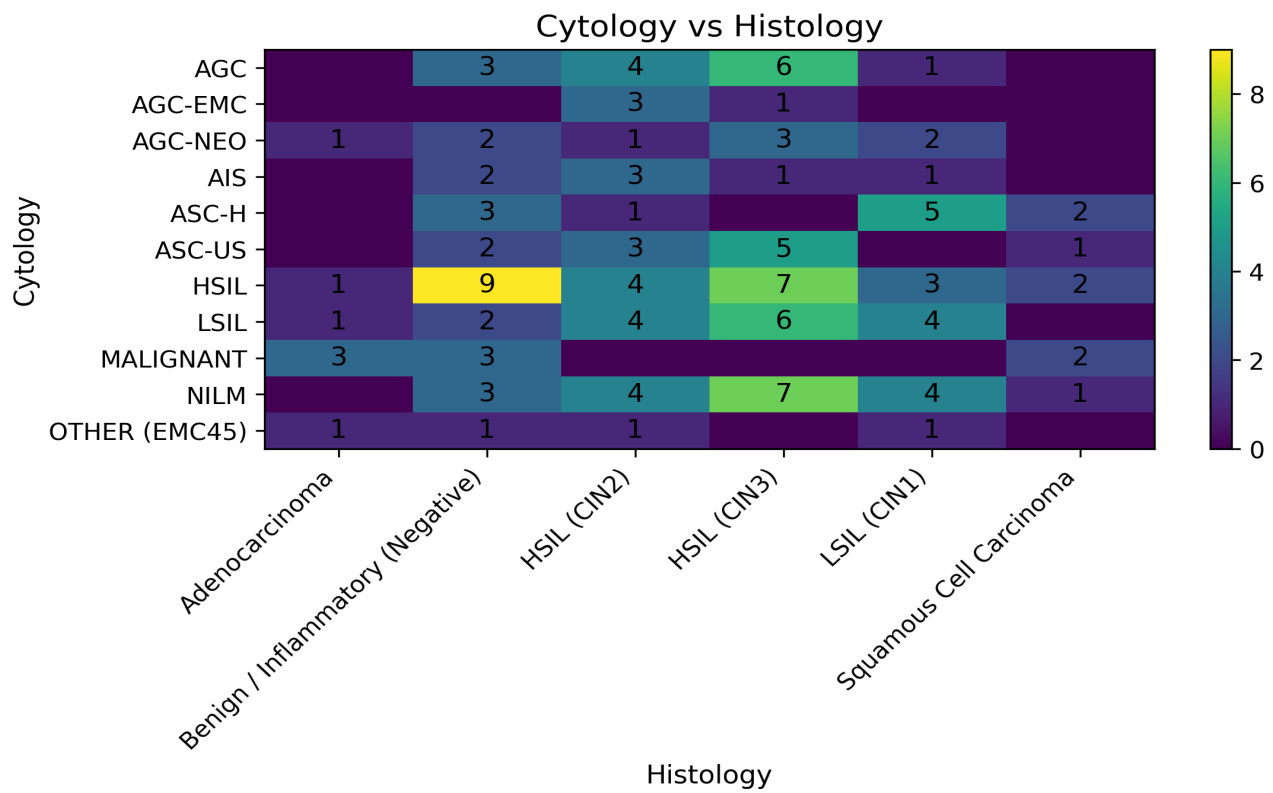

Limitations

This report is based on deterministic cytology-histology correlation using rule-based classification.

Routine CHC datasets are subject to verification bias due to selective histologic follow-up.

Accordingly, these results should not be interpreted as measures of screening sensitivity or specificity.

Observed discrepancies should be interpreted within the context of laboratory QA review rather than as direct indicators of diagnostic error.