

Cervical Cytology-Histology Correlation QA Report

Automated rule-based quality assurance analysis

Total Cases: 1000

Executive Summary

A total of 1000 cases were analyzed using a deterministic cytology-histology correlation QA pipeline.

Concordance Summary

Concordance_Class	Count	Percent
minor_discordant	399	39.9
major_discordant	393	39.3
concordant	208	20.8

HSIL-Focused Metrics

Metric	Value
HSIL Pap tests with histologic HSIL (CIN2/CIN3)	0.0
HSIL Pap tests with minor discrepancies	100.0
HSIL Pap tests with major false-positive discrepancies	0.0
Number of major false-negative / cytology undercall discrepancies	205.0
PV+ for HSIL Pap tests (%)	0.0

Discrepancy Bucket Summary

Bucket	Count	Percent
MinVar	0	0.0
MajUnd	205	20.5
MinUnd	204	20.4
Agree	208	20.8
MinOver	195	19.5
MajOver	188	18.8

Key Quality Signals


- Major discordance rate: 39.3%
- Minor discordance rate: 39.9%
- Undercall proportion: 40.9%

- Overall proportion: 38.3%


- HSIL PV+: 0.0%

Figures


Concordance Distribution

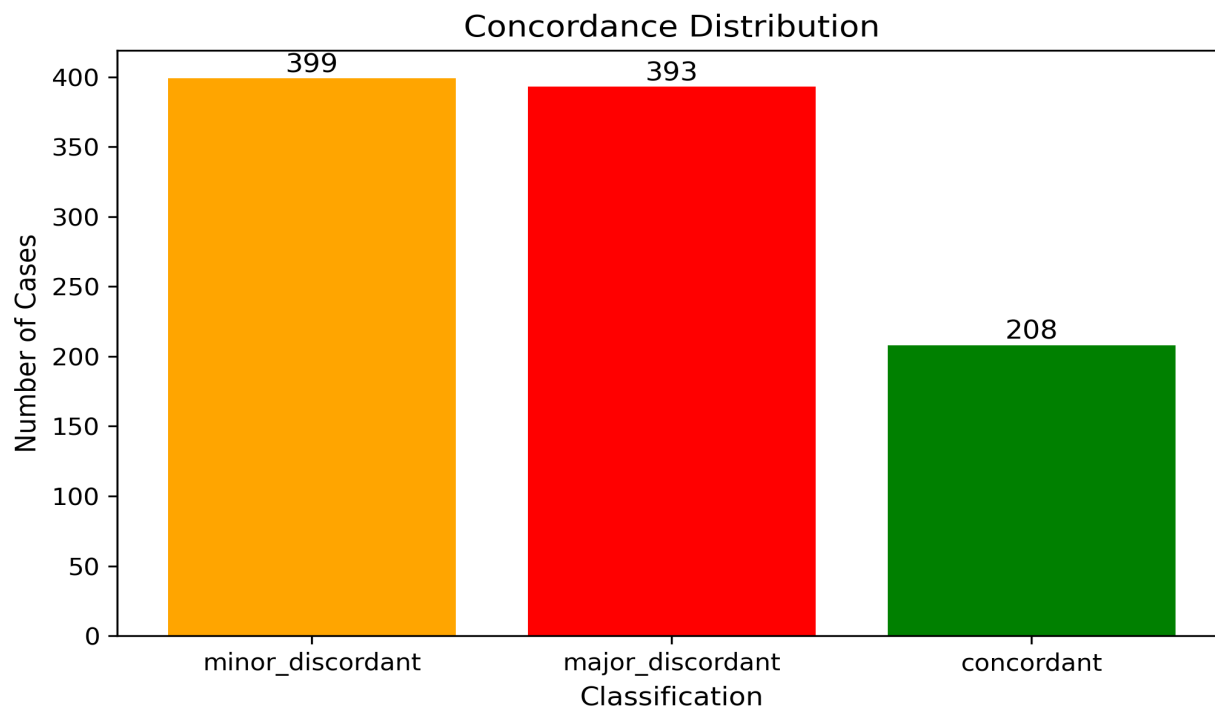


Cytology-Histology Correlation Buckets

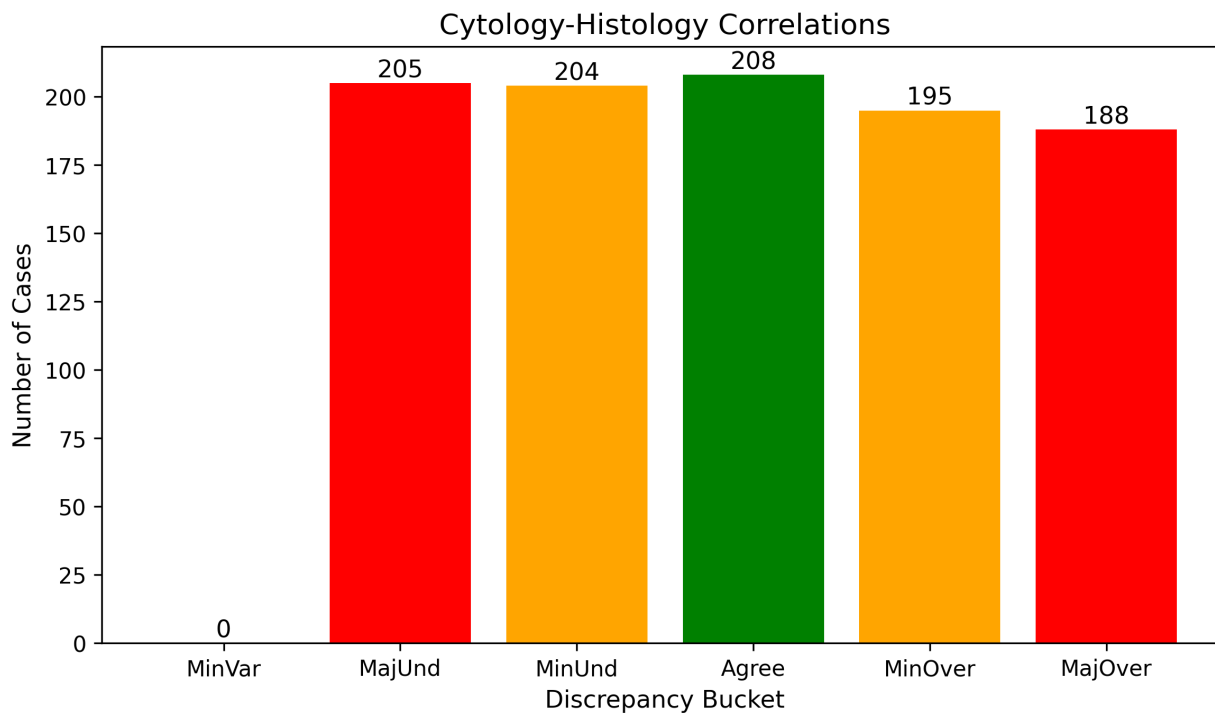

HSIL Correlation Metrics

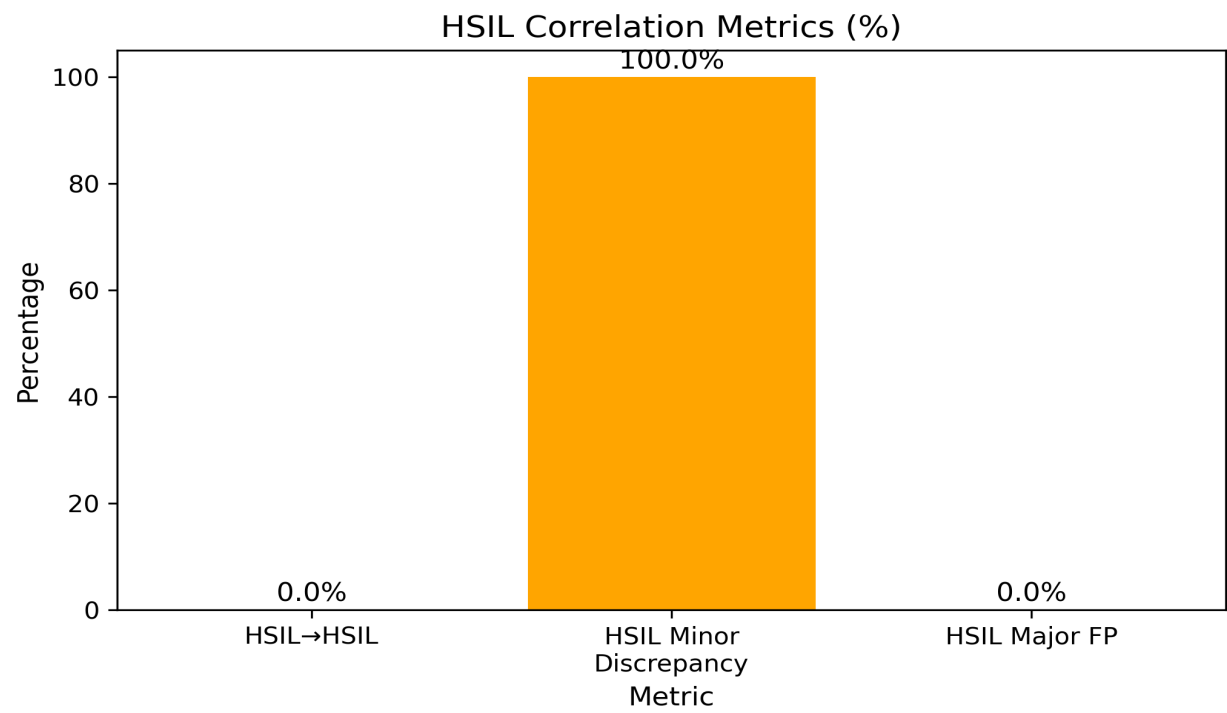

Confusion Matrix

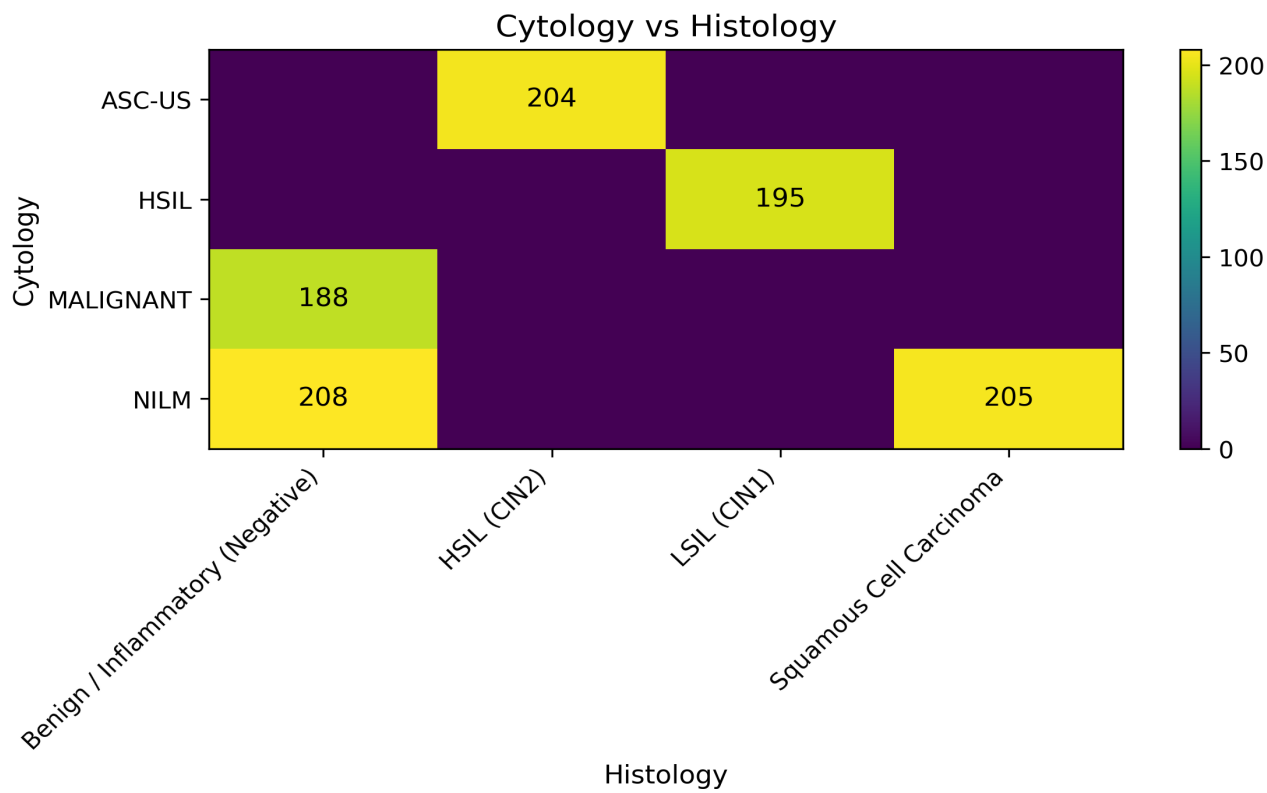

Limitations

This report is based on deterministic cytology-histology correlation using rule-based classification.

Routine CHC datasets are subject to verification bias due to selective histologic follow-up.

Accordingly, these results should not be interpreted as measures of screening sensitivity or specificity.

Observed discrepancies should be interpreted within the context of laboratory QA review rather than as direct indicators of diagnostic error.